






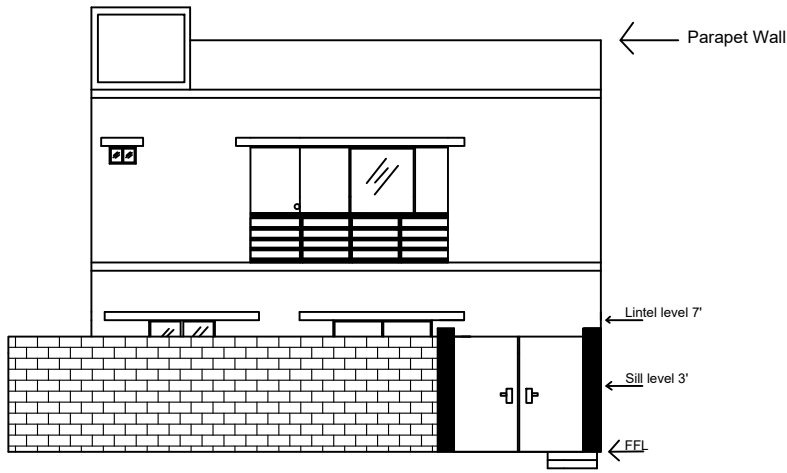


FRONT ELEVATION

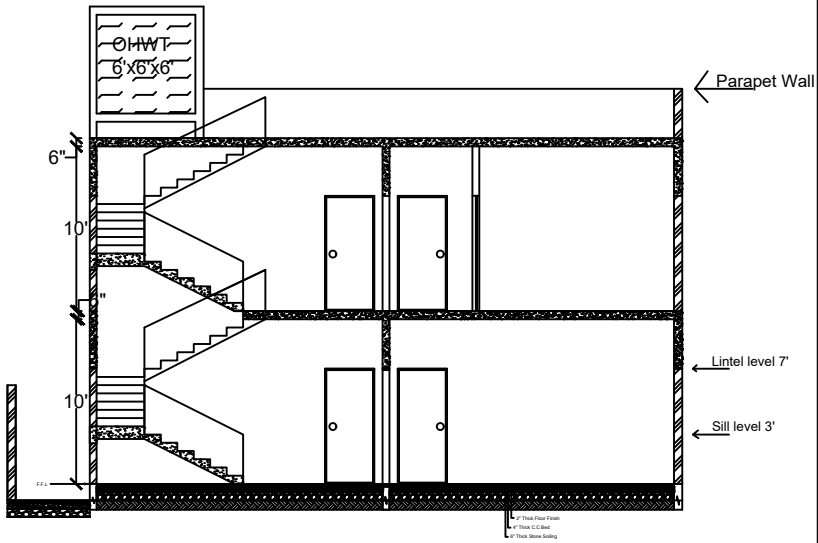


SECTION A-A

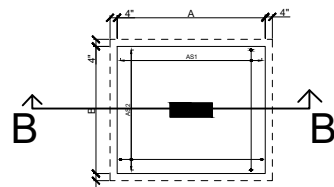

TYP. ISOLATED FOOTING

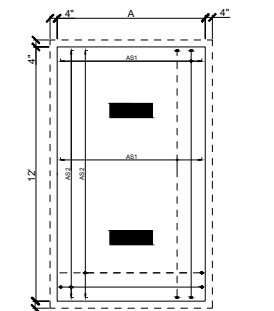

TYP. COMBINED FOOTING

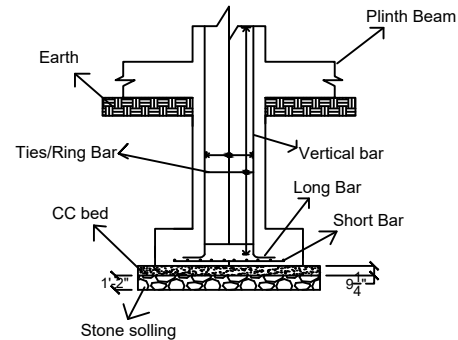

TYPICAL FOOTING DETAILS

SCHEDULE OF AREA

Total Area Of Plot = 200 Sq Yards/1800 Sq ft
Allowable Cover Area = 130 Sq Yards/1170 Sq ft
Proposed Cover Area = 127.8 Sq Yards/1151 Sq ft
Proposed Open Area = 72.1 Sq Yards/649 Sq ft

Covered Area % = 63.9%
Open Area % = 36.1 %

Drawing Notes:

Windows	4' x 4'
Doors	3' x 7'
Main Gate	8' x 8'
Ventilators	1'-6" x 1'
I.B Wall Thickness	5"
O.B Wall Thickness	6"
Boundary Wall Height	7'
Lintel Level	7'
Sill Level	3'
Stairs Steps	20
Tread	1'
Riser	6"
Landing Width	3'
Ceiling Height	10'
U.G.W.T	9'x4'x8'
O.H.W.T	6'x5'x6'

Drawing Status: Approved/Submission

Client: ABC

Contractor:

XYZ

Consultant:

PQR

Project Name:

G+1 House design

Drawing Title:

Submission Drawing

Drawn/Designed By:
Muhammad Zaryab
Ali

Roll Number / Batch / Section:
CE-22016 / 2022 / A

Sheet Size:
A3

Sheet Scale:
3/35"=1'

Issue Date:
A3


Project Number

--


Rev. No.

Drawing Number


00

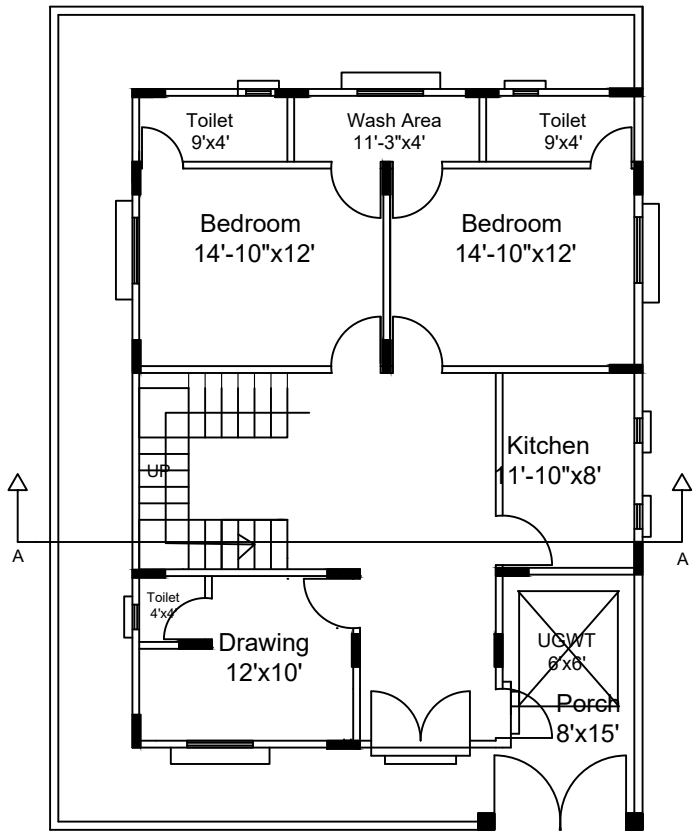


GROUND FLOOR

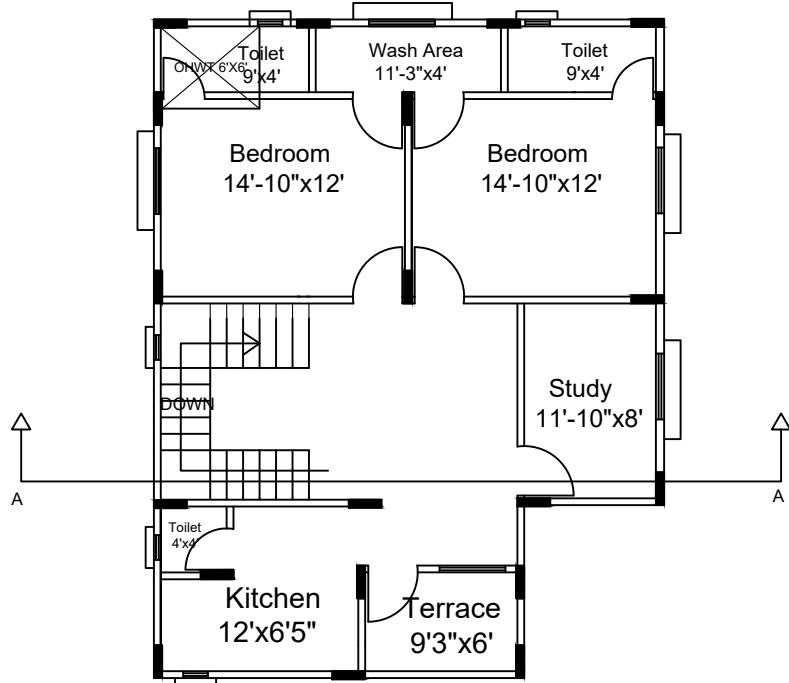


FIRST FLOOR

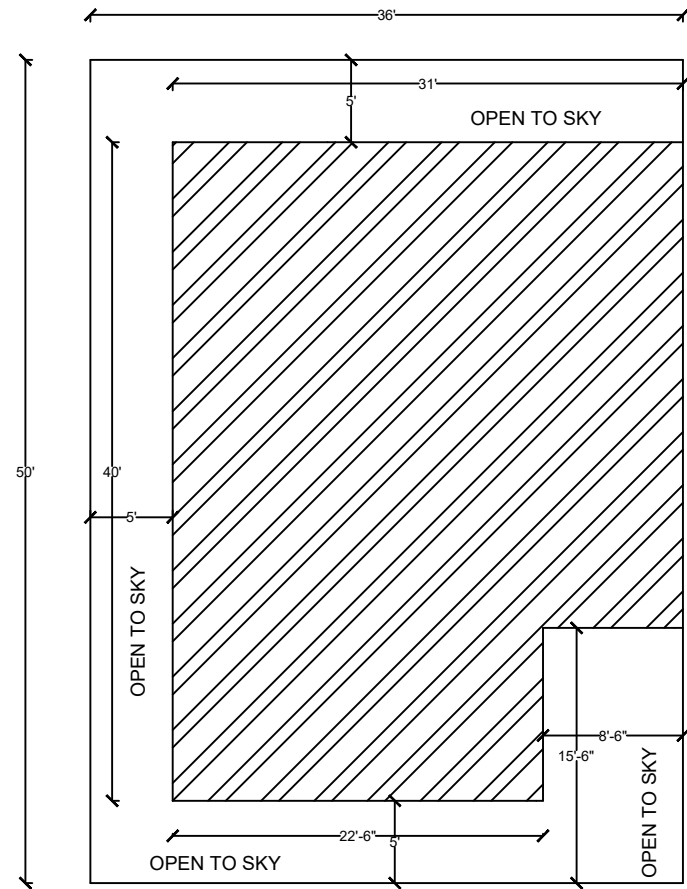

Site Plan

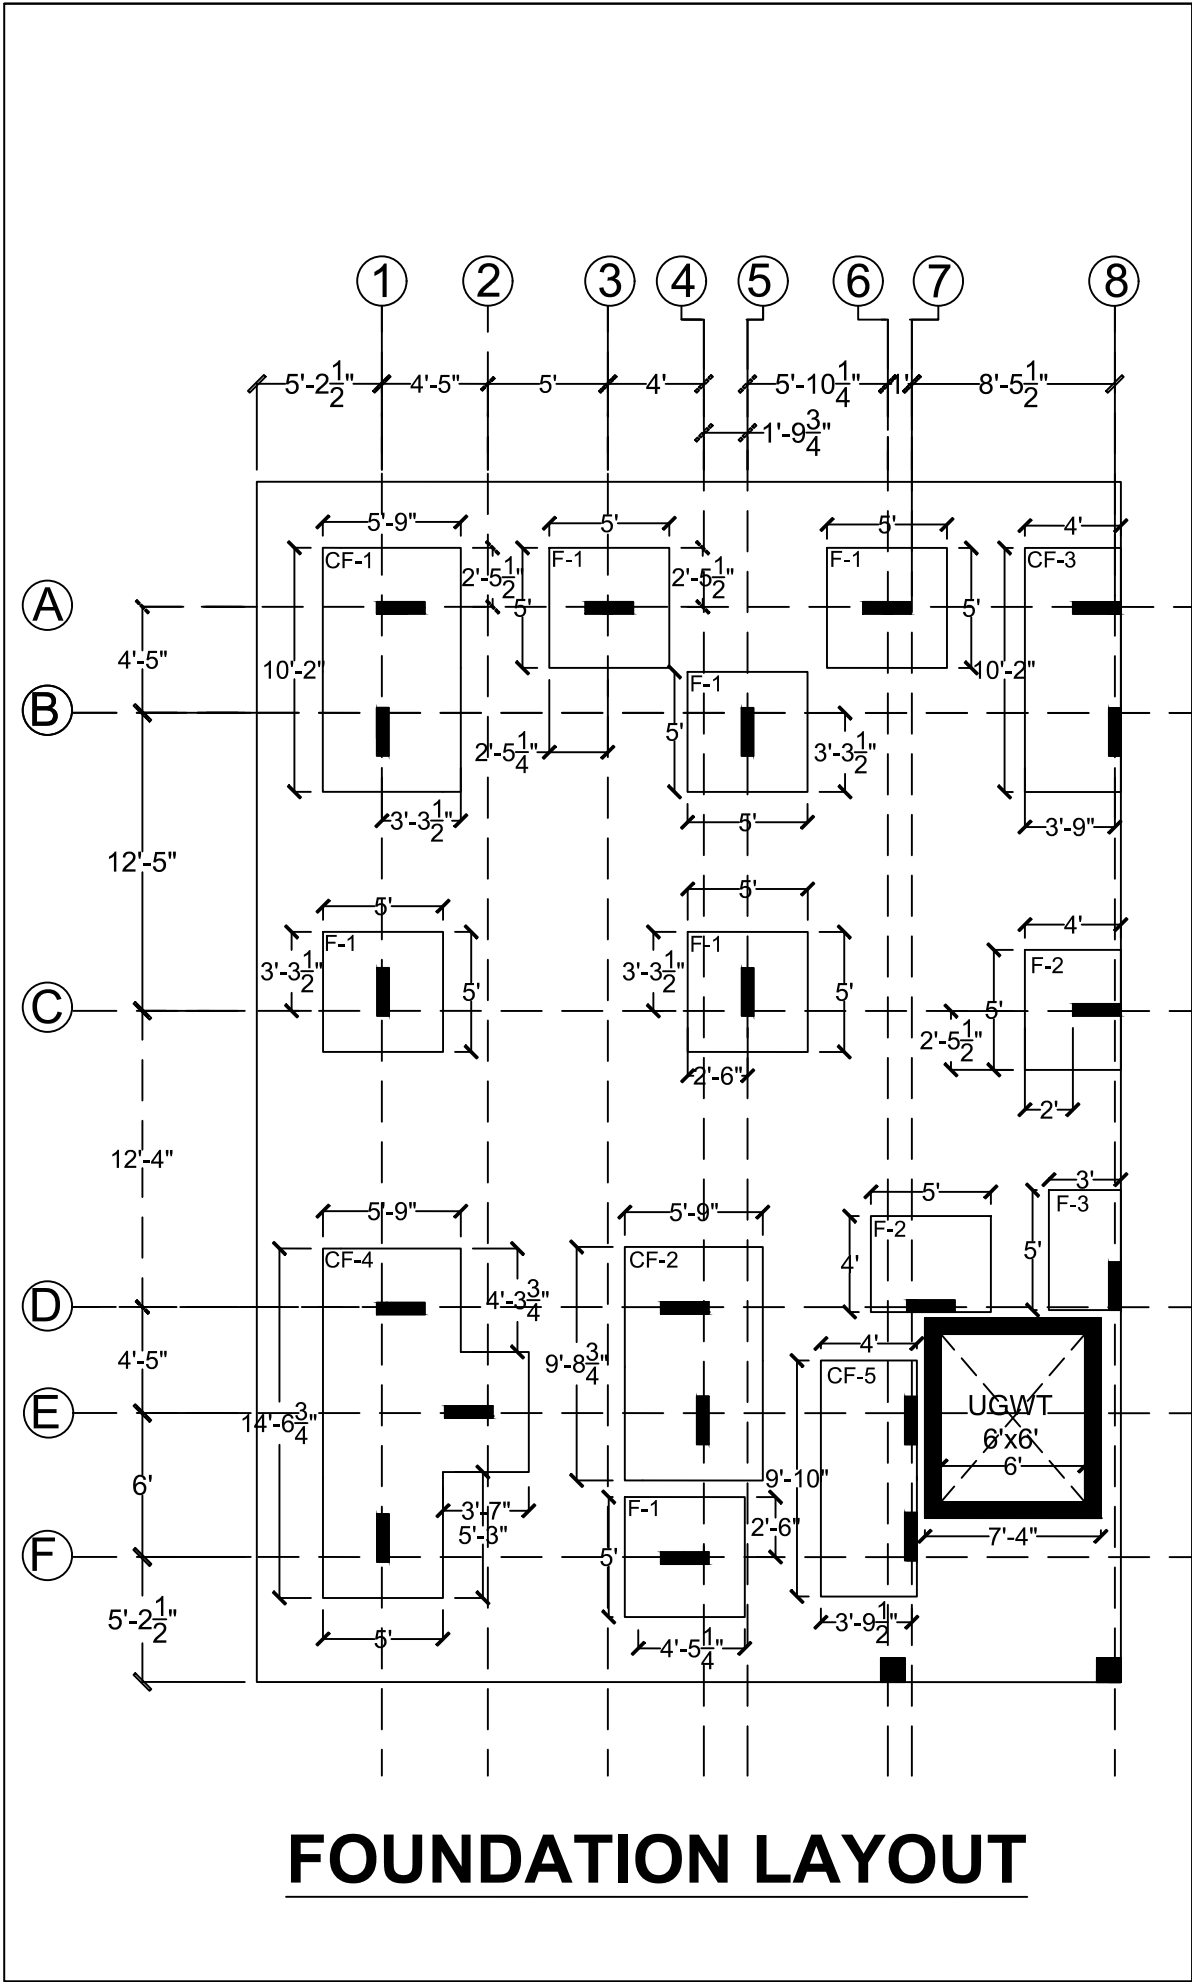


FOUNDATION LAYOUT

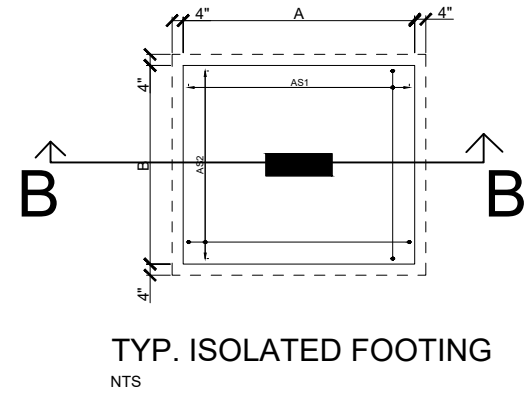


TYP. ISOLATED FOOTING

NTS

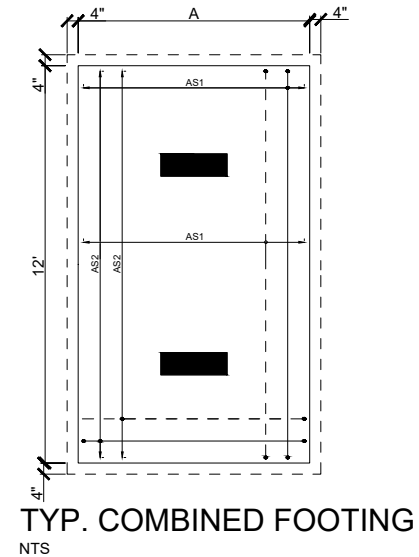

TYP. COMBINED FOOTING


NTS

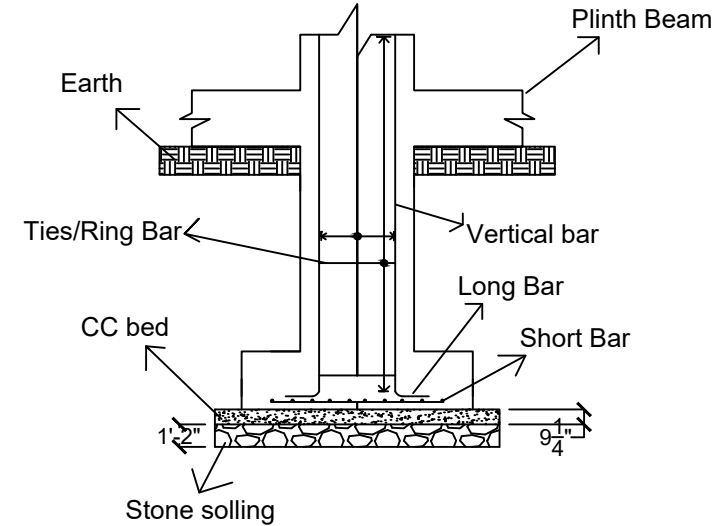





TYPICAL FOOTING DETAILS

FOOTING SCHEDULE								
S. NO.	FOOTING ID.	SIZE (ft-in)			BOTTOM REINFORCEMENT		TOP REINFORCEMENT	
		A	B	C	AS1	AS2	AS1	AS2
1	F-1	5'-0"	5'-0"	1'-6"	#4@5"C/C	#4@5"C/C	-	-
2	F-2	4'-0"	5'-0"	1'-6"	#4@5"C/C	#4@5"C/C	-	-
3	F-3	3'-0"	5'-0"	1'-6"	#4@5"C/C	#4@5"C/C	-	-
4	CF-1	5'-9"	10'-2"	2'-0"	#4@6"C/C	#4@6"C/C	#4@6"C/C	#4@6"C/C
5	CF-2	5'-9"	9'-8"	2'-0"	#4@6"C/C	#4@6"C/C	#4@6"C/C	#4@6"C/C
6	CF-3	4'-0"	10'-2"	1'-9"	#4@6"C/C	#4@6"C/C	#4@6"C/C	#4@6"C/C
7	CF-4	See Plan		2'-0"	#4@6"C/C	#4@6"C/C	#4@6"C/C	#4@6"C/C
7	CF-5	4'-0"	9'-10"	2'-0"	#4@6"C/C	#4@6"C/C	#4@6"C/C	#4@6"C/C

GENERAL NOTES			
COLUMN DETAILS: C1 6"X24" C2 12"x12'			
COLUMN CLEAR COVER 1.5" FOOTING CLEAR COVER 3" CONCRETE STRENGTH: 4000psi(For M15) SOIL BEARING CAPACITY 3tsf			
DRAWING NOTES			
1.These drawing shall be read in conjunction with all relevant architectural,other disciplines and other consultant's drawings and specifications and with such other written instructions as may be issued during the course of the contract.			
2.Dimensions shall not be obtained by scaling from drawings.Unless noted otherwise, all dimensions and levels are in feet-inches.			
3.All materials and workmanship shall be in accordance with the relevant and current specified standards and the by-laws and ordinances of the relevant building authorities except where verified by the project specification and/or drawings.			
4.Setting out dimensions and levels shown on the drawings shall be verified by the contractor.The design consultant shall be notified of any discrepancies prior to construction .			
Req No	Description	DATE	Approved
CLIENT: Mr. XYZ			
CONTRACTOR: ABC Construction			
DRAWN BY: M. Zaryab Ali CE-22016	DESIGN BY: M. Zaryab Ali CE-22016	APPROVED BY:	
SHEET SIZE: A3	SCALE: 1"=8'	ISSUE DATE:	
PROJECT NO:		REQ NO:	
01			
DRAWING NO:			
01			

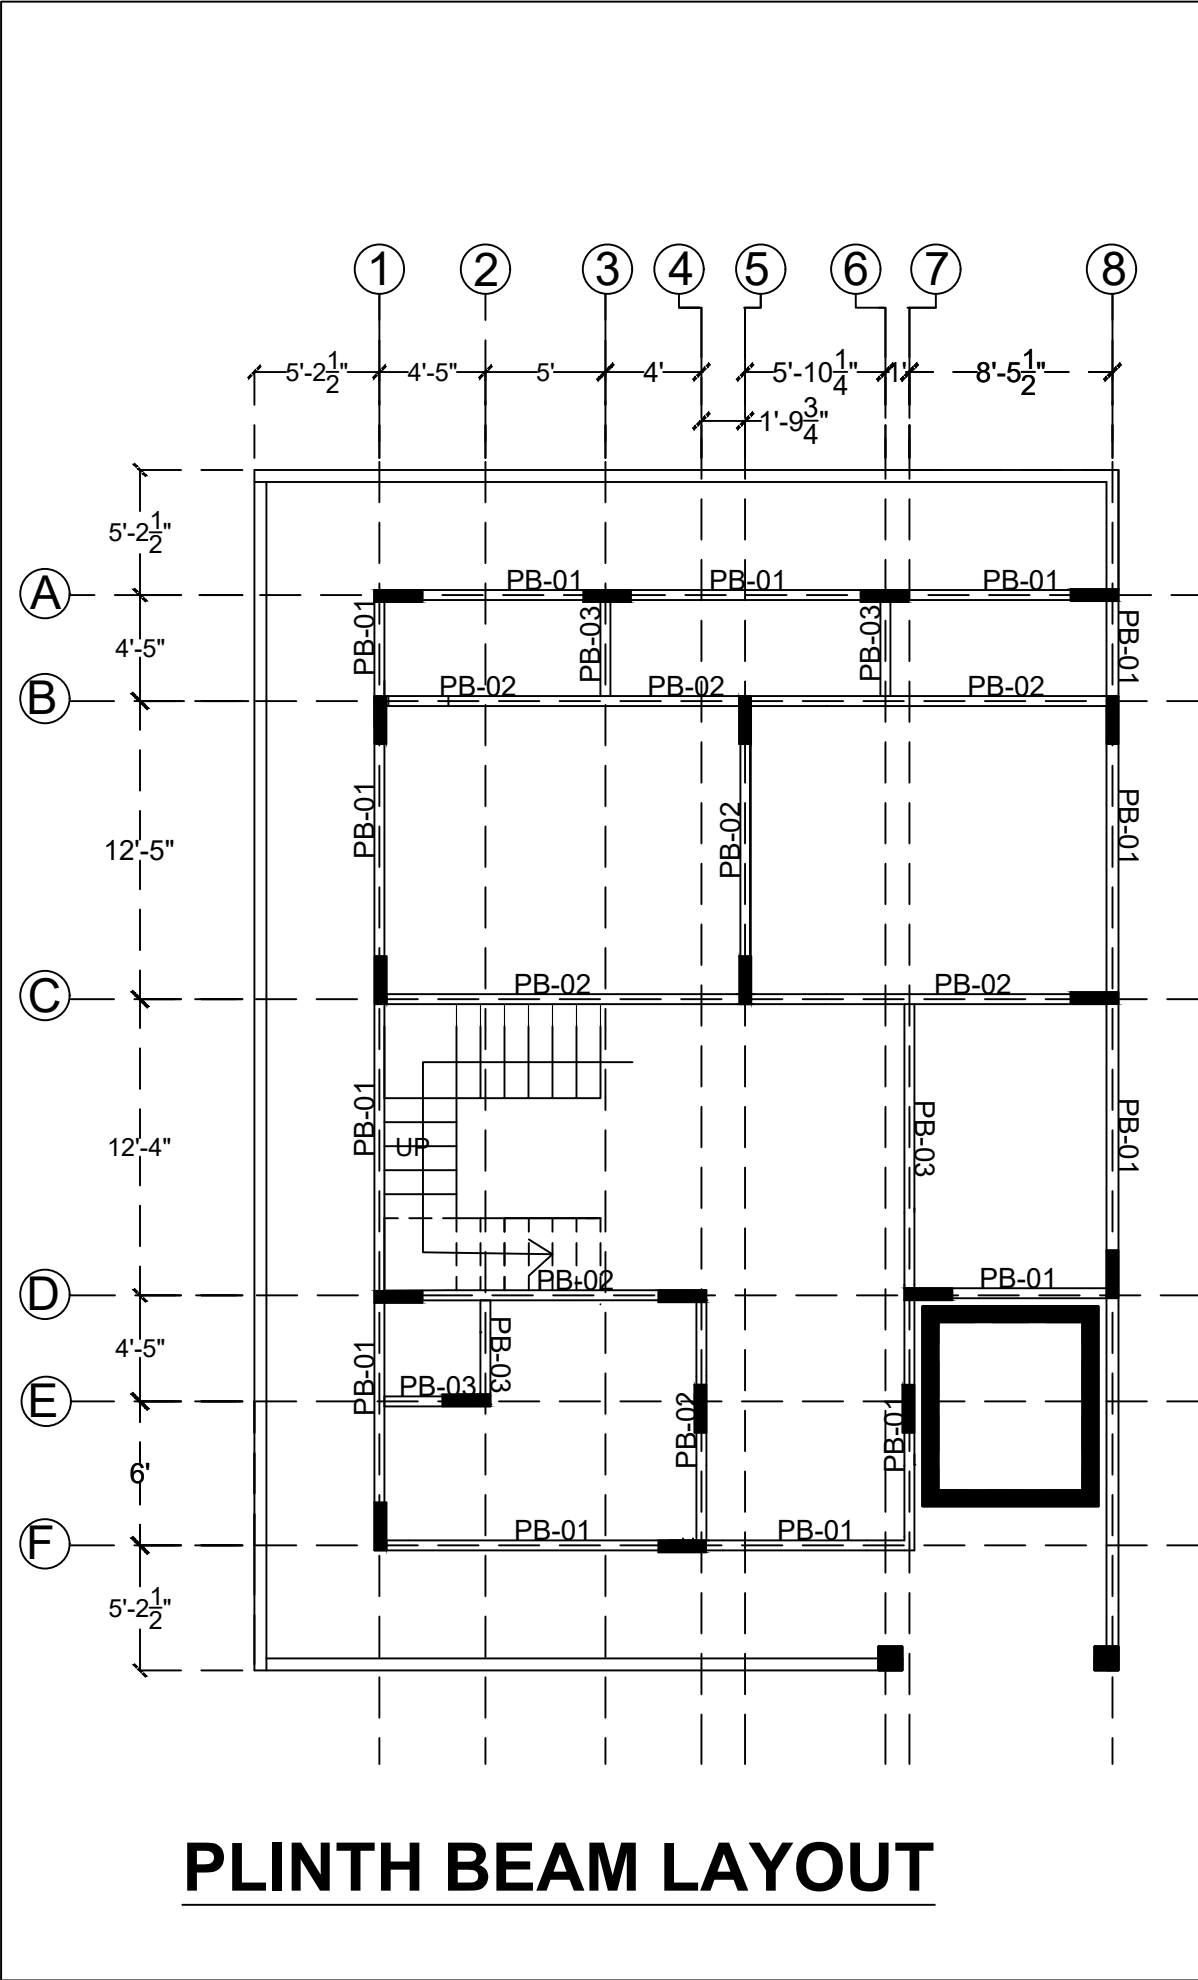

PLINTH BEAM SCHEDULE								
BEAM I.D	CROSS SECTION	BOTTOM REINFORCEMT		TOP REINFORCEMENT			BINDERS	
		BOTTOM THROUGH	BOTTOM EXTRA @ MIDSPAN	TOP THROUGH	TOP EXTRA @ CONTINUE SUPPORT	TOP EXTRA @ DISCONTINUE SUPPORT	NEAR SUPPORT	NEAR MID SPAN
PB-1	6' X 30"	2 #5	-	2 #5	-	-	#3@5"C/C	#3@10"C/C
PB-2	6' X 30"	2 #5	-	2 #5	-	-	#3@5"C/C	#3@10"C/C
PB-3	6' X 30"	2 #4	2 #4	2 #5	2 #4	2 #4	#3@5"C/C	#3@10"C/C

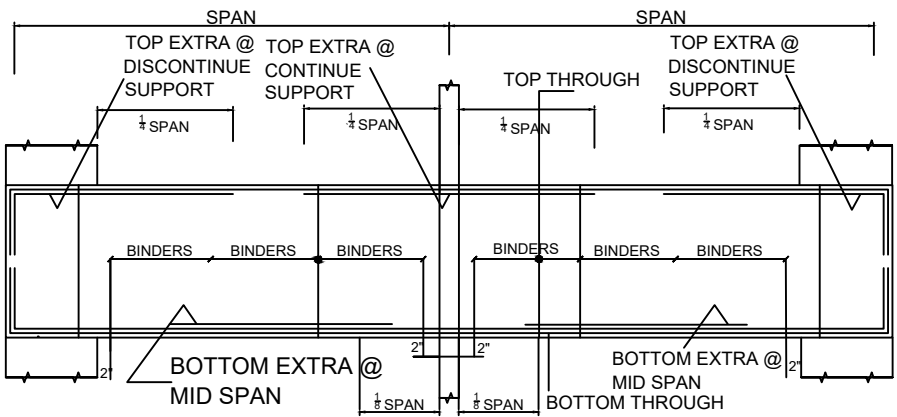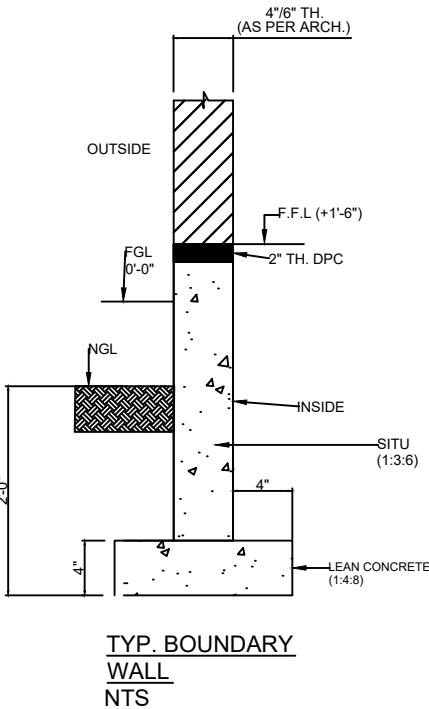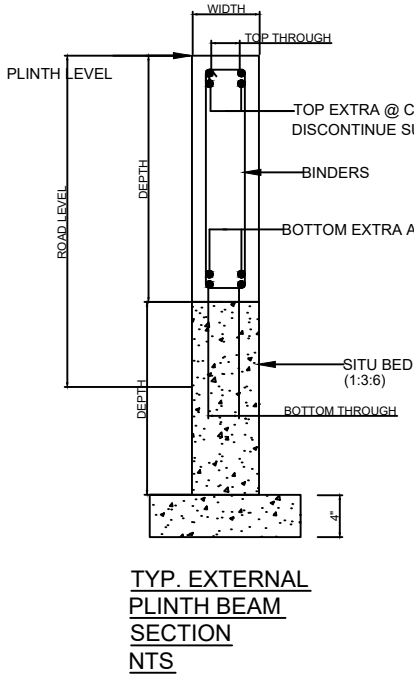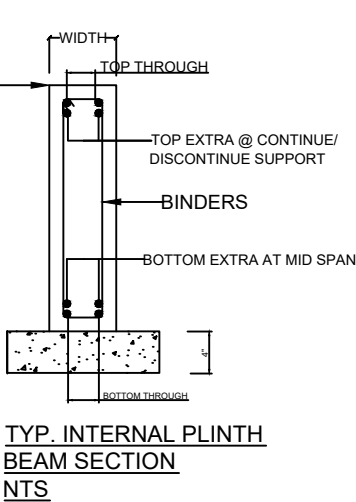

GENERAL NOTES

COLUMN DETAILS:
C1 6"X24"
C2 12"x12'

BEAM CLEAR COVER 1.5" top & bottom
BEAM CLEAR COVER 1" from Sides
CONCRETE STRENGTH:
5000psi(For M20)
SOIL BEARING CAPACITY 30tsf

DRAWING NOTES

1.These drawing shall be read in conjunction with all relevant architectural,other disciplines and other consultant's drawings and specifications and with such other written instructions as may be issued during the course of the contract.

2.Dimensions shall not be obtained by scaling from drawings.Unless noted otherwise, all dimensions and levels are in feet-inches.

3.All materials and workmanship shall be in accordance with the relevant and current specified standards and the by-laws and ordinances of the relevant building authorities except where verified by the project specification and/or drawings.

4.Setting out dimensions and levels shown on the drawings shall be verified by the contractor.The design consultant shall be notified of any discrepancies prior to construction .

Req No	Description	DATE	Approved

CLIENT:
Mr. XYZ

CONTRACTOR:
ABC Construction

DRAWN BY:
M. Zaryab Ali
CE-22016

DESIGN BY:
M. Zaryab Ali
CE-22016

APPROVED

SHEET SIZE:
A3


SCALE:
1"=8'

ISSUE DATE:

PROJECT NO:
01


REQ NO:

DRAWING NO:
02

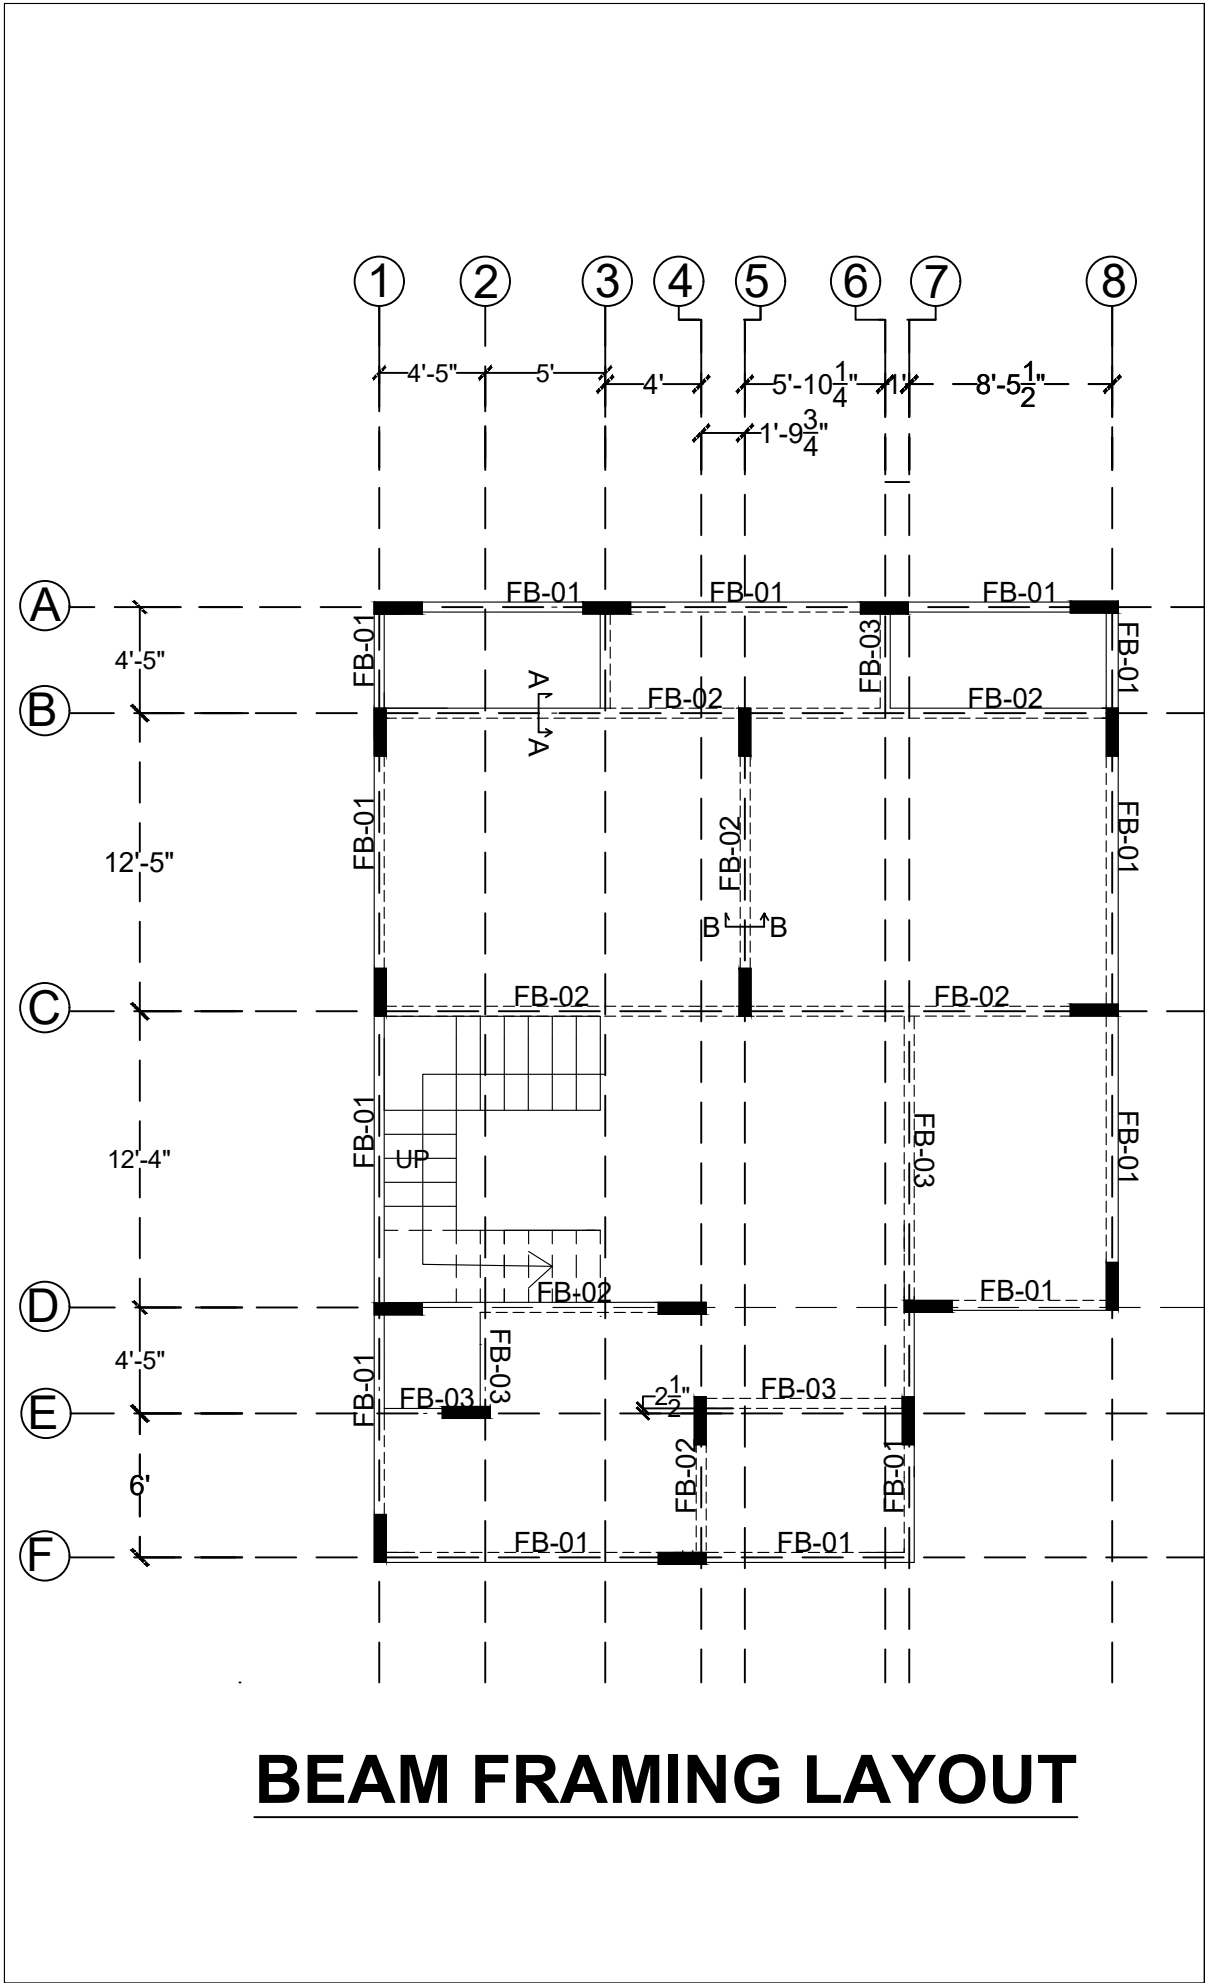


BEAM FRAMING LAYOUT


PLINTH BEAM SCHEDULE								
BEAM I.D	CROSS SECTION	BOTTOM REINFORCEMENT		TOP REINFORCEMENT			BINDERS	
		BOTTOM THROUGH	BOTTOM EXTRA @ MIDSPAN	TOP THROUGH	TOP EXTRA @ CONTINUE SUPPORT	TOP EXTRA @ DISCONTINUE SUPPORT	NEAR SUPPORT	NEAR MID SPAN
FB-1	6' X 30"	2 #5	-	2 #5	-	-	#3@5"C/C	#3@10"C/C
FB-2	6' X 30"	2 #5	-	2 #5	-	-	#3@5"C/C	#3@10"C/C
FB-3	6' X 30"	2 #4	2 #4	2 #5	2 #4	2 #4	#3@5"C/C	#3@10"C/C

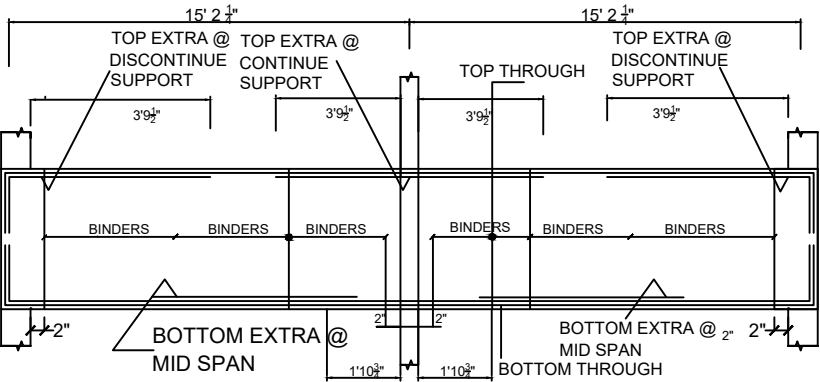


CONTINUOUS BEAM ELEVATION FB-02

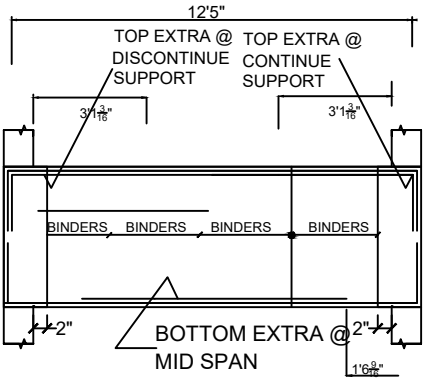

Simply Supported BEAM ELEVATION FB-02

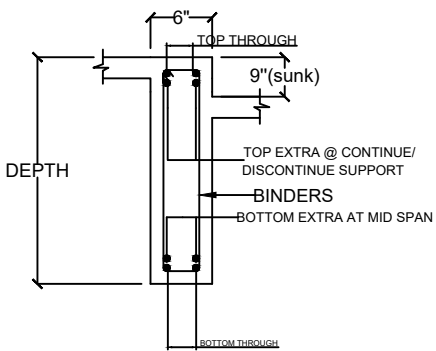

TYP. INTERNAL CONTINUOUS BEAM SECTION FB-02 (6"x30") NTS

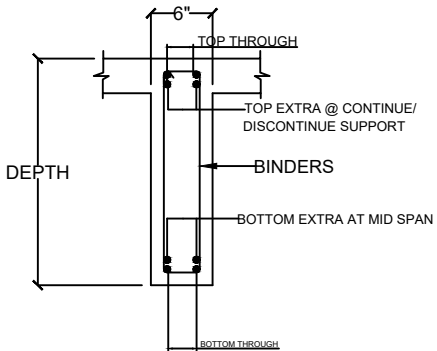

TYP. INTERNAL SIMPLY SUPPORTED BEAM SECTION FB-02 (6"x30") NTS

GENERAL NOTES

COLUMN DETAILS:
C1 6"x24"
C2 12"x12'

BEAM CLEAR COVER 1.5" top & bottom
BEAM CLEAR COVER 1" from Sides
CONCRETE STRENGTH:
5000psi(For M20)
SOIL BEARING CAPACITY 30tsf

DRAWING NOTES

1.These drawing shall be read in conjunction with all relevant architectural,other disciplines and other consultant's drawings and specifications and with such other written instructions as may be issued during the course of the contract.

2.Dimensions shall not be obtained by scaling from drawings.Unless noted otherwise, all dimensions and levels are in feet-inches.

3.All materials and workmanship shall be in accordance with the relevant and current specified standards and the by-laws and ordinances of the relevant building authorities except where verified by the project specification and/or drawings.

4.Setting out dimensions and levels shown on the drawings shall be verified by the contractor.The design consultant shall be notified of any discrepancies prior to construction .

Req No	Description	DATE	Approved

CLIENT:

Mr. XYZ

CONTRACTOR:

ABC Construction

DRAWN BY:	DESIGN BY:	APPROVED BY:
M. Zaryab Ali CE-22016	M. Zaryab Ali CE-22016	

SHEET SIZE:	SCALE:	ISSUE DATE:
A3	1"=8'	

PROJECT NO:	REQ NO:
01	

DRAWING NO:
02


Column Reinforcement Calculation

Step 1: Calculate Longitudinal Reinforcement


- Column size: 6" x 24"
- $\rho = 1\%$
- $A_s = \rho A_g$
 $A_s = (1\%)(6 \times 24)$
 $A_s = 1.44 \text{ in}^2$
Selecting #6 bars:
 $A_b = \pi(6/8)^2 / 4 = 0.441 \text{ in}^2$
Number of bars:
 $N = A_s / A_b = 1.44 / 0.441 = 3.26 \approx 4 \text{ bars (even)}$
Spacing between longitudinal bars (longer side):
 $S = 24 - 2(1.5) - 2(3/8) - 2(6/8)$
 $S = 18.75 \text{ in}$
Spacing between longitudinal bars (short side):
 $S = 6 - 2(1.5) - 2(3/8) - 2(6/8)$
 $S = 0.75 \text{ in}$

Step 2: Lateral Tie Reinforcement

- The provided dia of longitudinal bars is #6, which is less than #10 bars.Thus, the dia of tie will be #3 bars.
- Vertical spacing of ties will be least lateral dimension of column.
- Hook angle is 135°

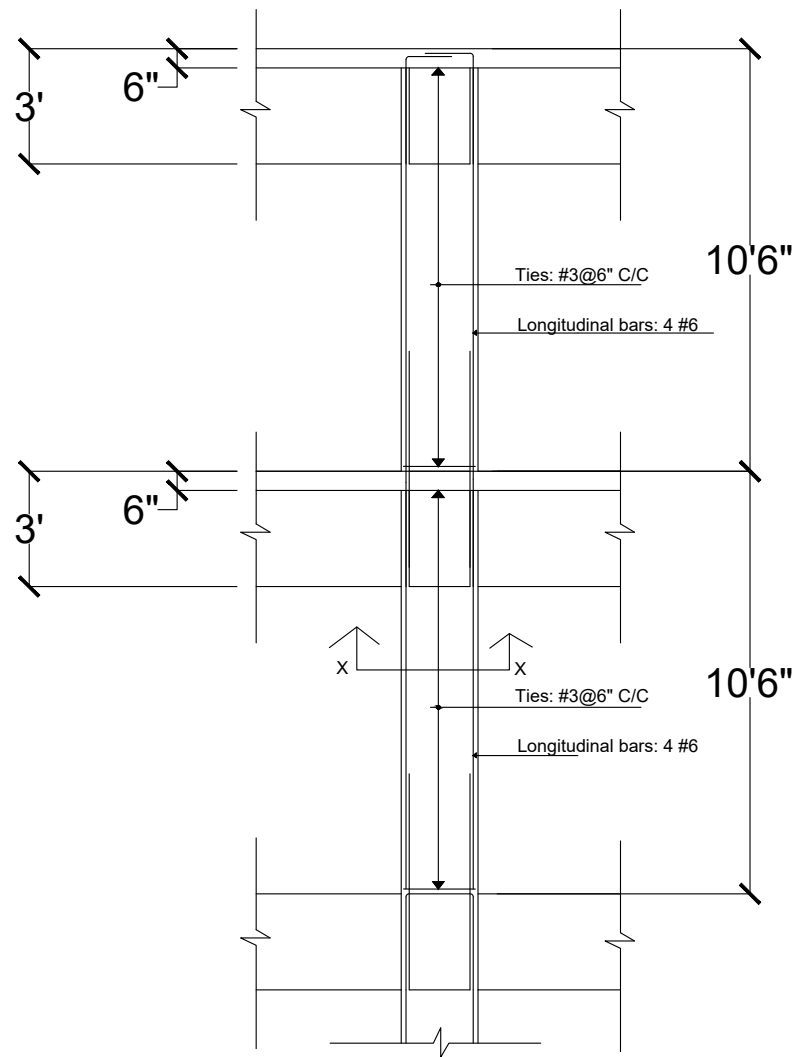

COLUMN ELEVATION
(sc 3"=15')

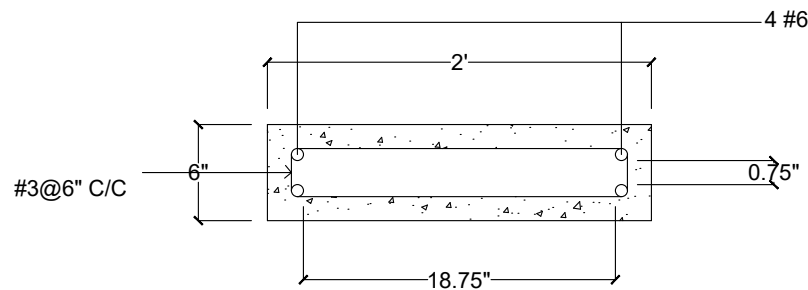

Longitudinal bars: 4 #6
Ties: #3@6" C/C
Section X-X of Column (sc 1'=1")

GENERAL NOTES

COLUMN DETAILS:
C1 6"X24"
C2 12"x12"

COLUMN CLEAR COVER 1.5"
FOOTING CLEAR COVER 2"
CONCRETE STRENGTH:
5000psi(For M20)
SOIL BEARING CAPACITY 3tsf

DRAWING NOTES

1.These drawing shall be read in conjunction with all relevant architectural,other disciplines and other consultant's drawings and specifications and with such other written instructions as may be issued during the course of the contract.

2.Dimensions shall not be obtained by scaling from drawings.Unless noted otherwise, all dimensions and levels are in feet-inches.

3.All materials and workmanship shall be in accordance with the relevant and current specified standards and the by-laws and ordinances of the relevant building authorities except where verified by the project specification and/or drawings.

4.Setting out dimensions and levels shown on the drawings shall be verified by the contractor.The design consultant shall be notified of any discrepancies prior to construction .

Req No	Description	DATE	Approved

CLIENT:
Mr. XYZ


CONTRACTOR:
ABC Construction

DRAWN BY:	DESIGN BY:	APPROVED
M. Zaryab Ali CE-22016	M. Zaryab Ali CE-22016	

SHEET SIZE:	SCALE:	ISSUE DATE:
A3	As Shown	

PROJECT NO:	REQ NO:
01	

DRAWING NO:
04

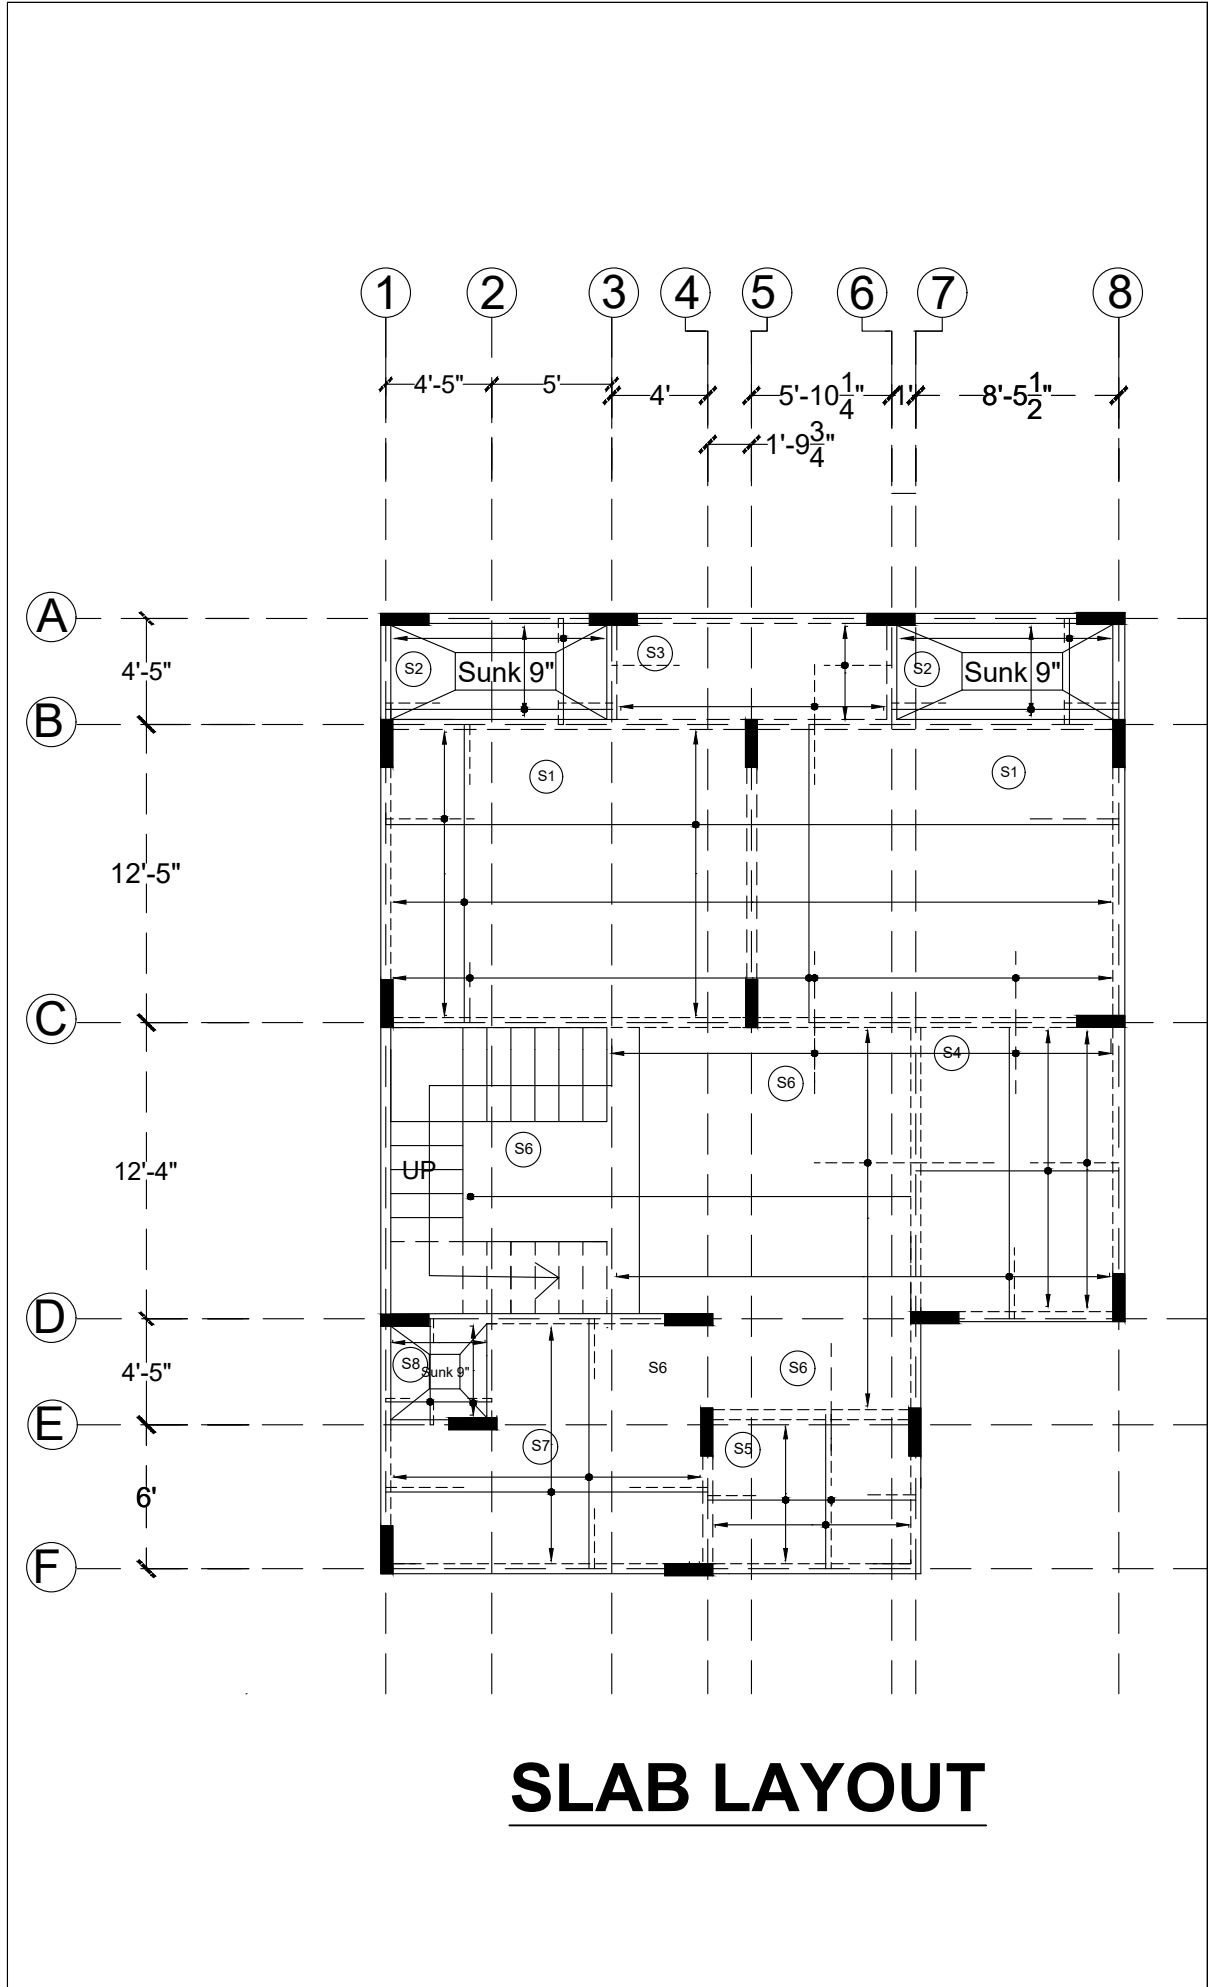

SLAB SCHEDULE									
SLAB id	Longer Span	Shorter Span	Ly/Lx	Type of SLAB	SLAB TH	BOTTOM REINFORCEMENT		TOP REINFORCEMENT	
	Ly	Lx				Short Way	Long Way	Short Way	Long Way
S1	14'9"	12'	1.22	Two-way Slab	6"	#3@6"C/C	#3@8"C/C	#3@8"C/C	#3@8"C/C
S2	9'	4'	2.25	One-way Slab	6"	-	-	#3@8"C/C	#3@10"C/C
S3	11'3"	4'	2.8125	One-way Slab	6"	-	-	#3@8"C/C	#3@10"C/C
S4	11'10"	8'	1.479	Two-way Slab	6"	#3@6"C/C	#3@8"C/C	#3@8"C/C	#3@8"C/C
S5	8'3"	6'	1.375	Two-way Slab	6"	#3@6"C/C	#3@8"C/C	#3@8"C/C	#3@8"C/C
S6	18'8"	11'10"	1.577	Two-way Slab	6"	#3@6"C/C	#3@8"C/C	#3@8"C/C	#3@8"C/C
S7	13'	10'	1.3	Two-way Slab	6"	#3@6"C/C	#3@8"C/C	#3@8"C/C	#3@8"C/C
S8	4'	4'	1	Two-way Slab	6"	#3@6"C/C	#3@8"C/C	#3@8"C/C	#3@8"C/C

GENERAL NOTES

COLUMN DETAILS:
C1 6"X24"
C2 12"x12'

SLAB CLEAR COVER 3/4"

CONCRETE STRENGTH:
5000psi(For M20)
SOIL BEARING CAPACITY 30sf

DRAWING NOTES

1.These drawing shall be read in conjunction with all relevant architectural,other disciplines and other consultant's drawings and specifications and with such other written instructions as may be issued during the course of the contract.

2.Dimensions shall not be obtained by scaling from drawings.Unless noted otherwise, all dimensions and levels are in feet-inches.

3.All materials and workmanship shall be in accordance with the relevant and current specified standards and the by-laws and ordinances of the relevant building authorities except where verified by the project specification and/or drawings.

4.Setting out dimensions and levels shown on the drawings shall be verified by the contractor.The design consultant shall be notified of any discrepancies prior to construction .

Req No	Description	DATE	Approved

CLIENT:

Mr. XYZ

CONTRACTOR:

ABC Construction

DRAWN BY: M. Zaryab Ali CE-22016	DESIGN BY: M. Zaryab Ali CE-22016	APPROVED
SHEET SIZE: A3	SCALE: 1"=8'	ISSUE DATE:

PROJECT NO:

01

REQ NO:

DRAWING NO:

05