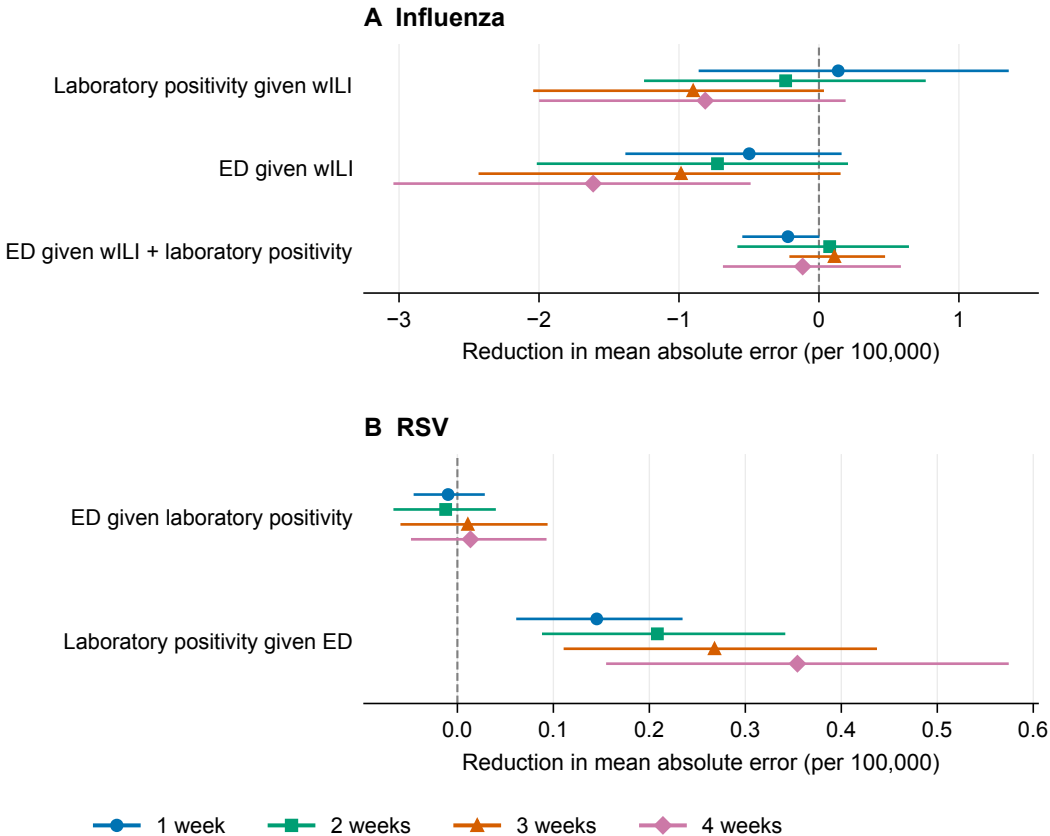
A Influenza
Laboratory positivity given wILI
ED given wILI
ED given wILI + laboratory positivity
−3
−2
−1
0
1
Reduction in mean absolute error (per 100,000)
B RSV
ED given laboratory positivity
Laboratory positivity given ED
0.0
0.1
0.2
0.3
0.4
0.5
0.6
Reduction in mean absolute error (per 100,000)
1 week
2 weeks
3 weeks
4 weeks