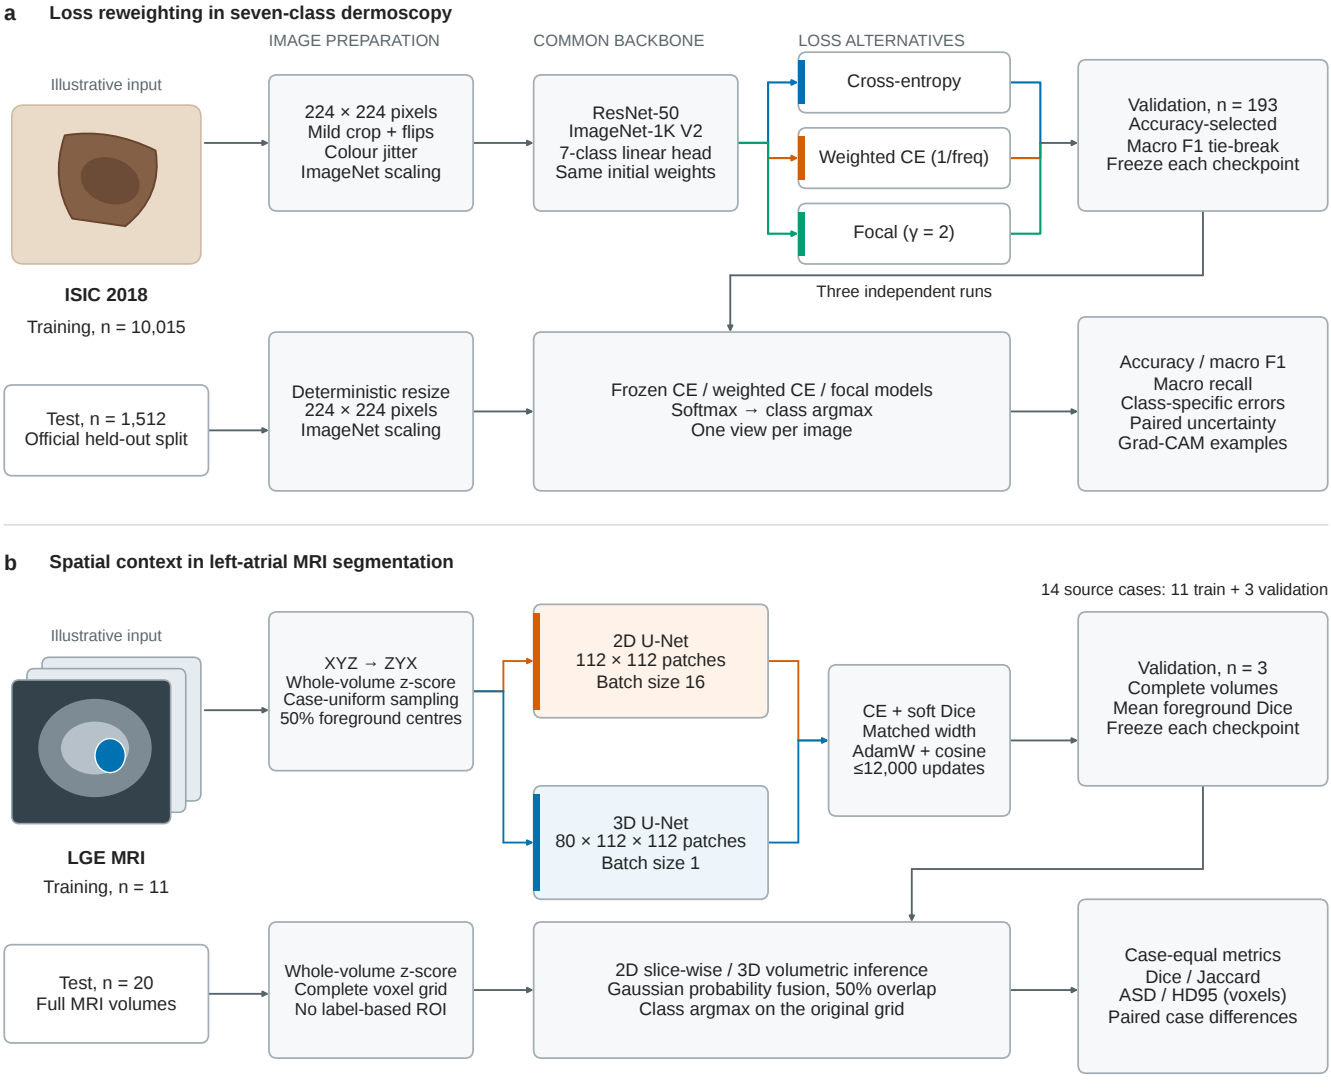

Primary protocol shown; post-test sensitivity analyses are reported separately.