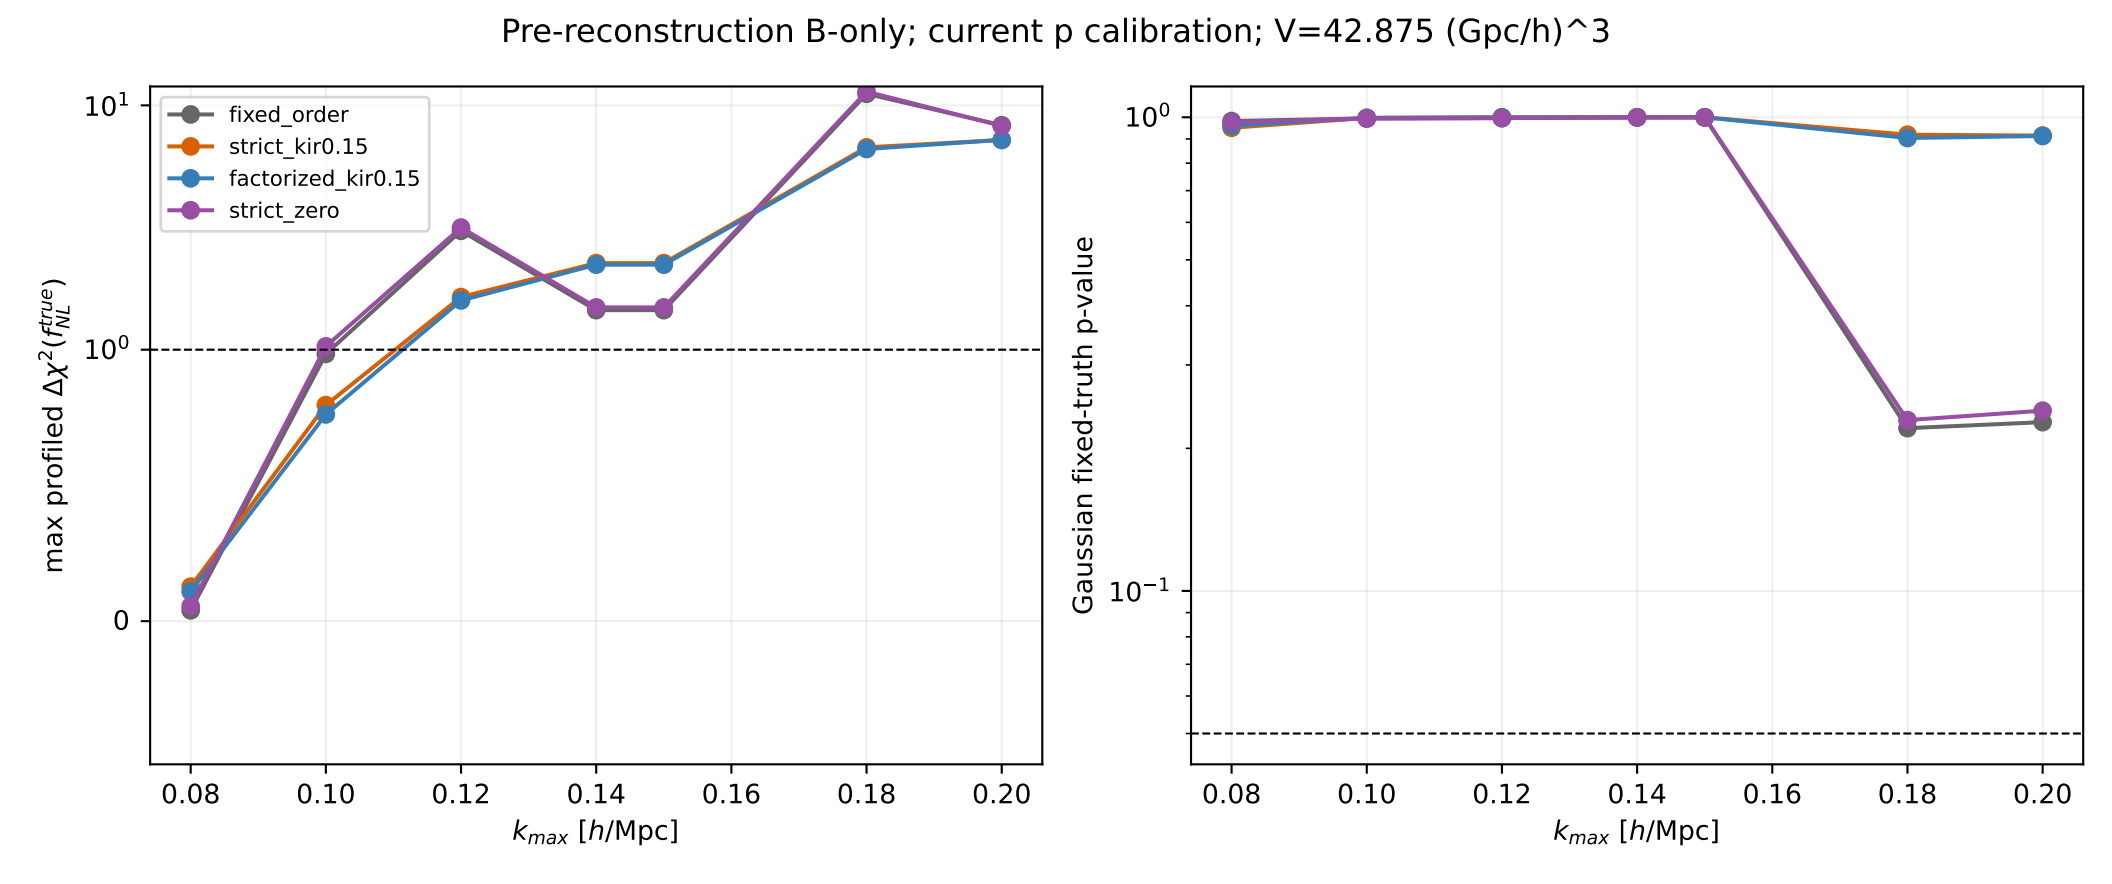
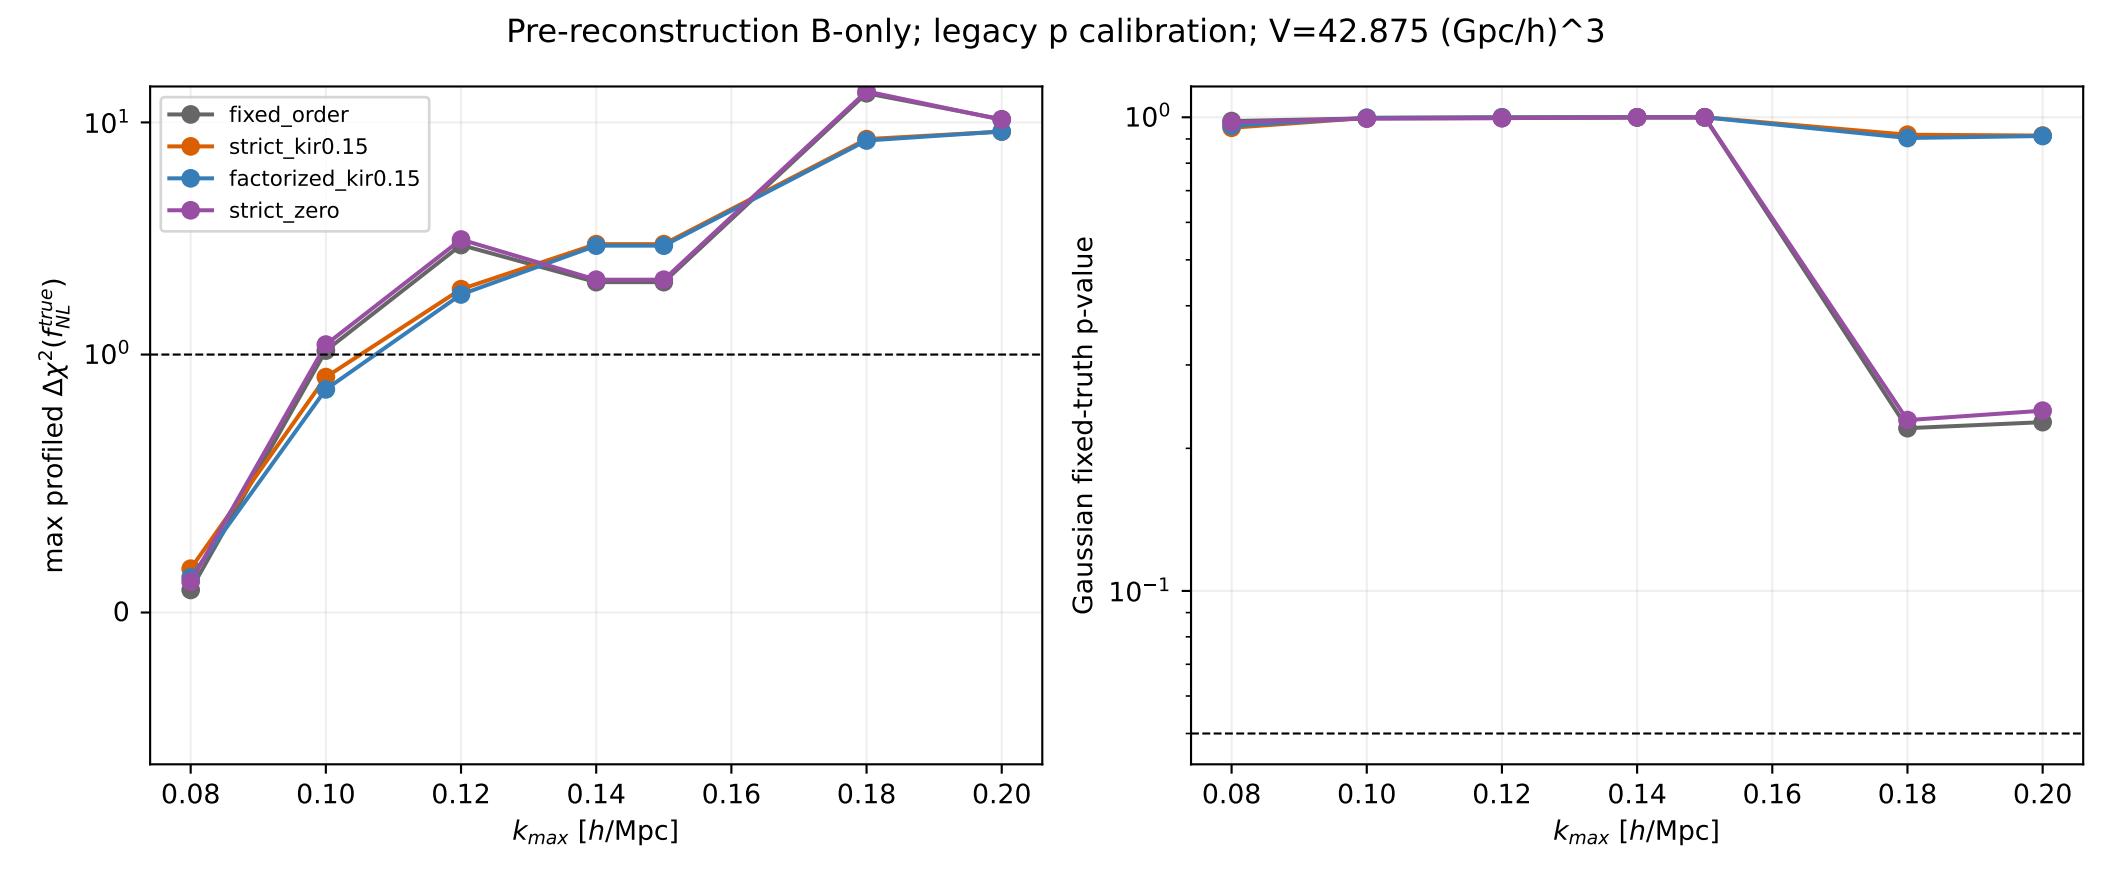
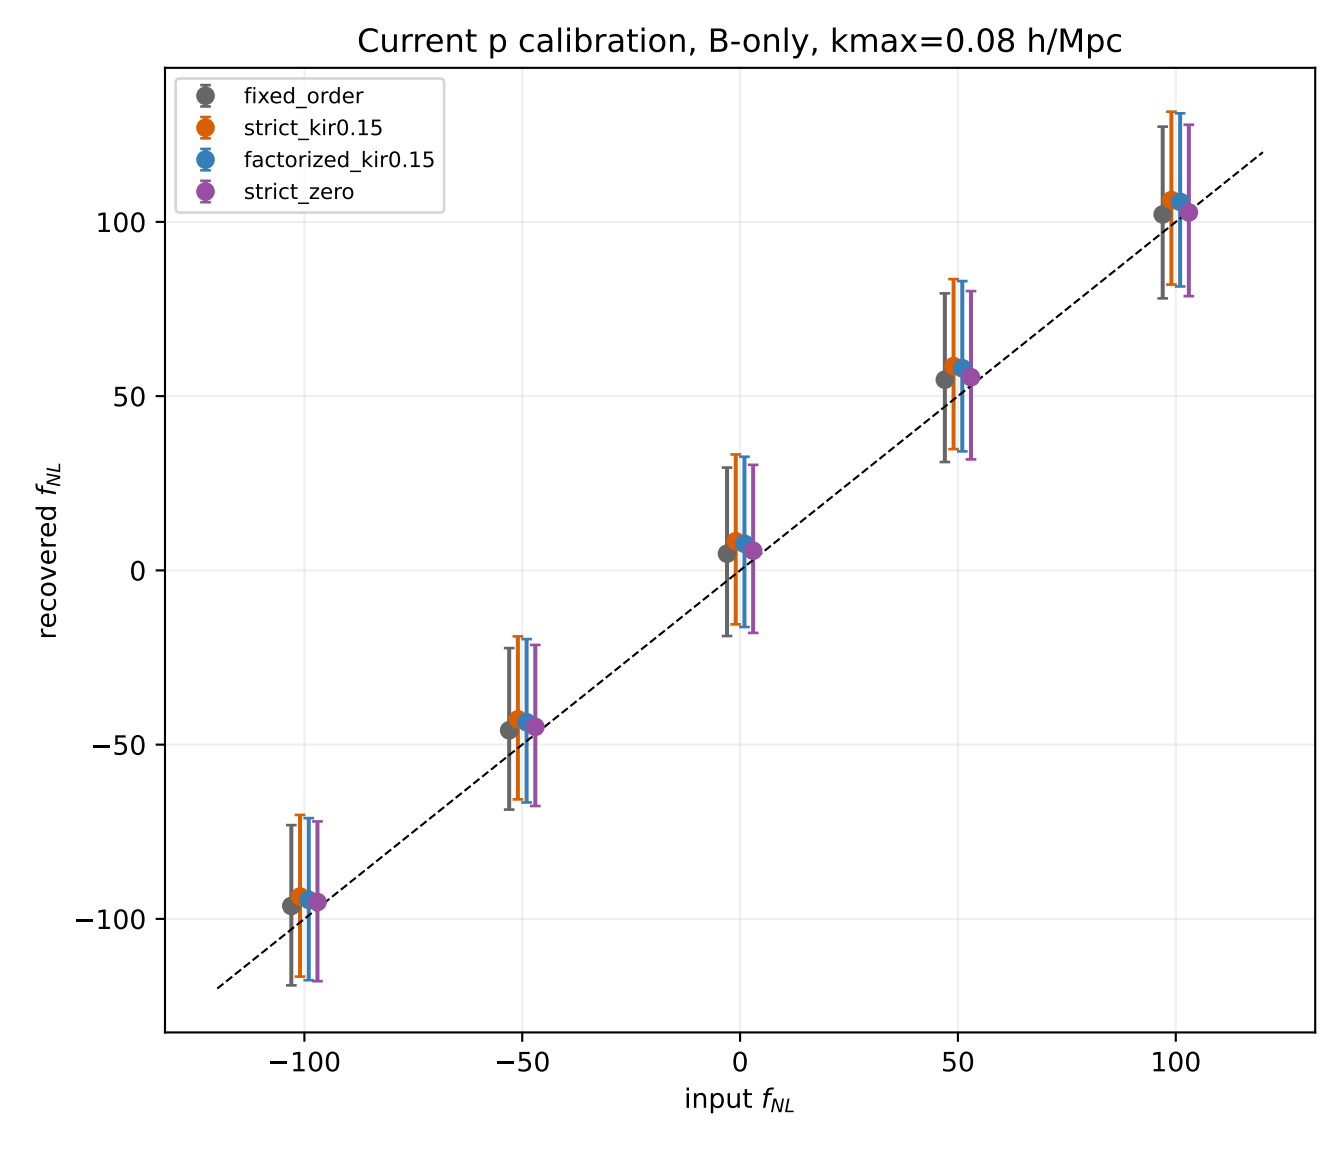
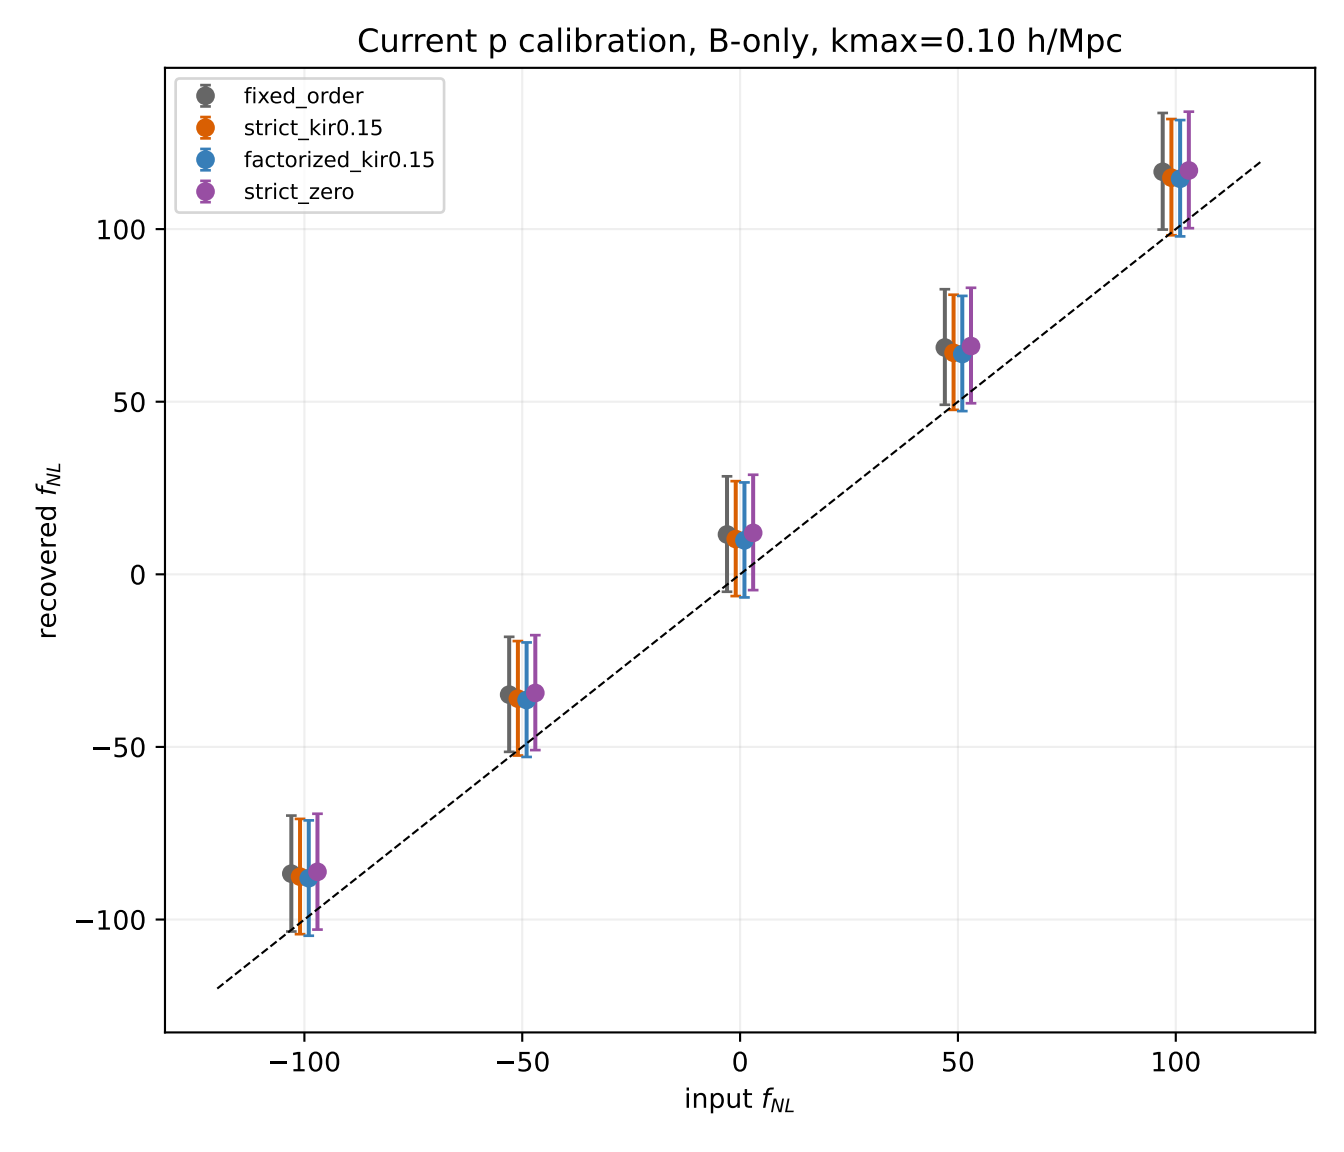
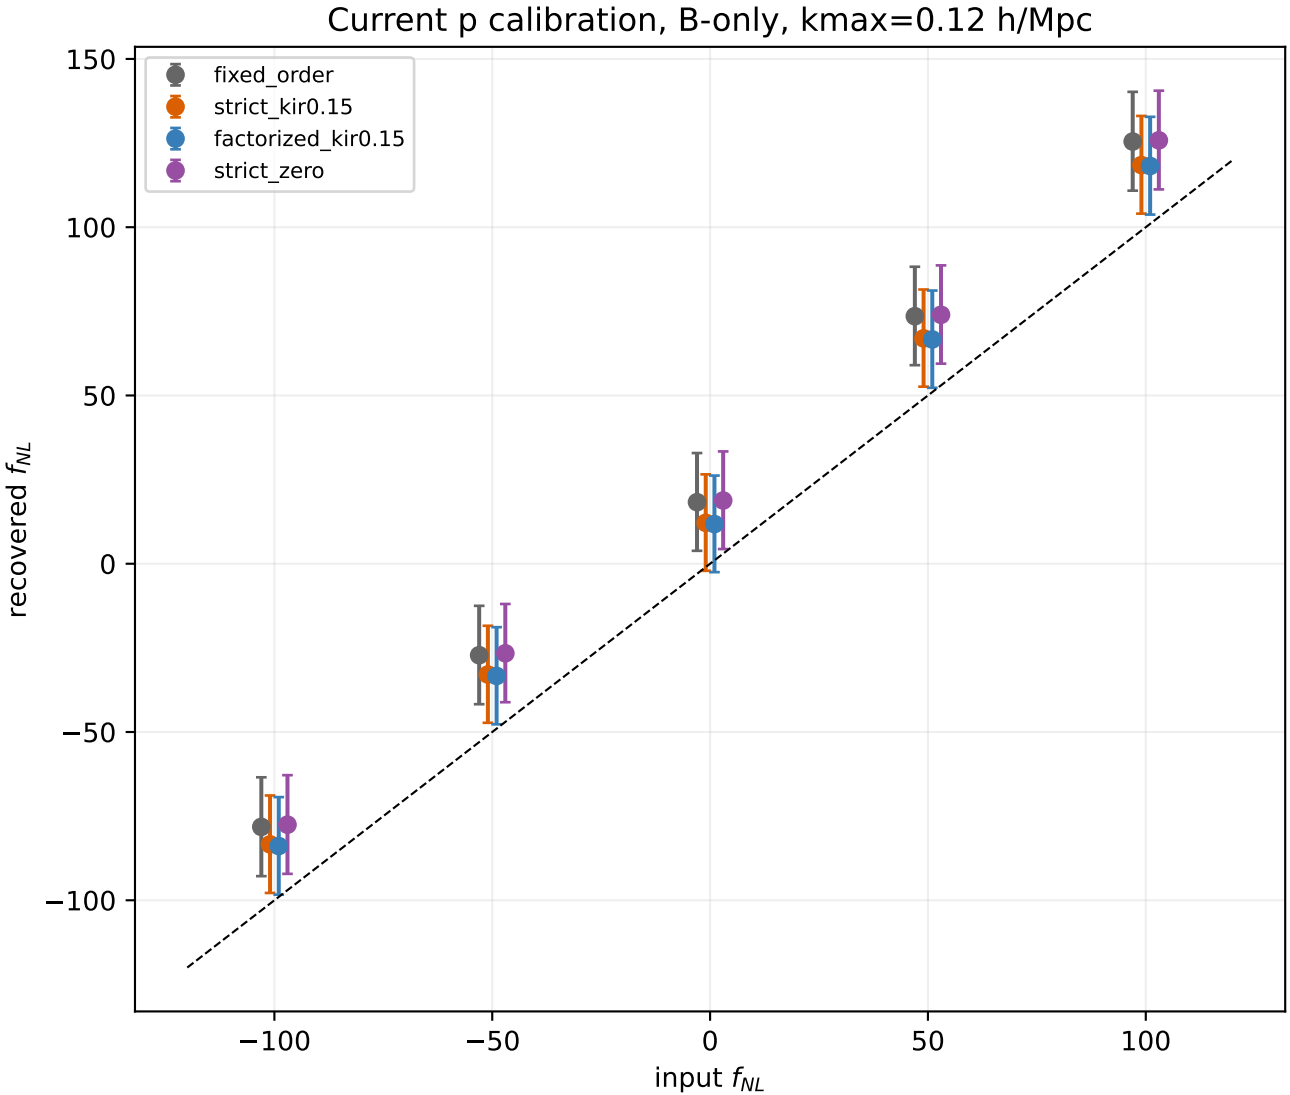
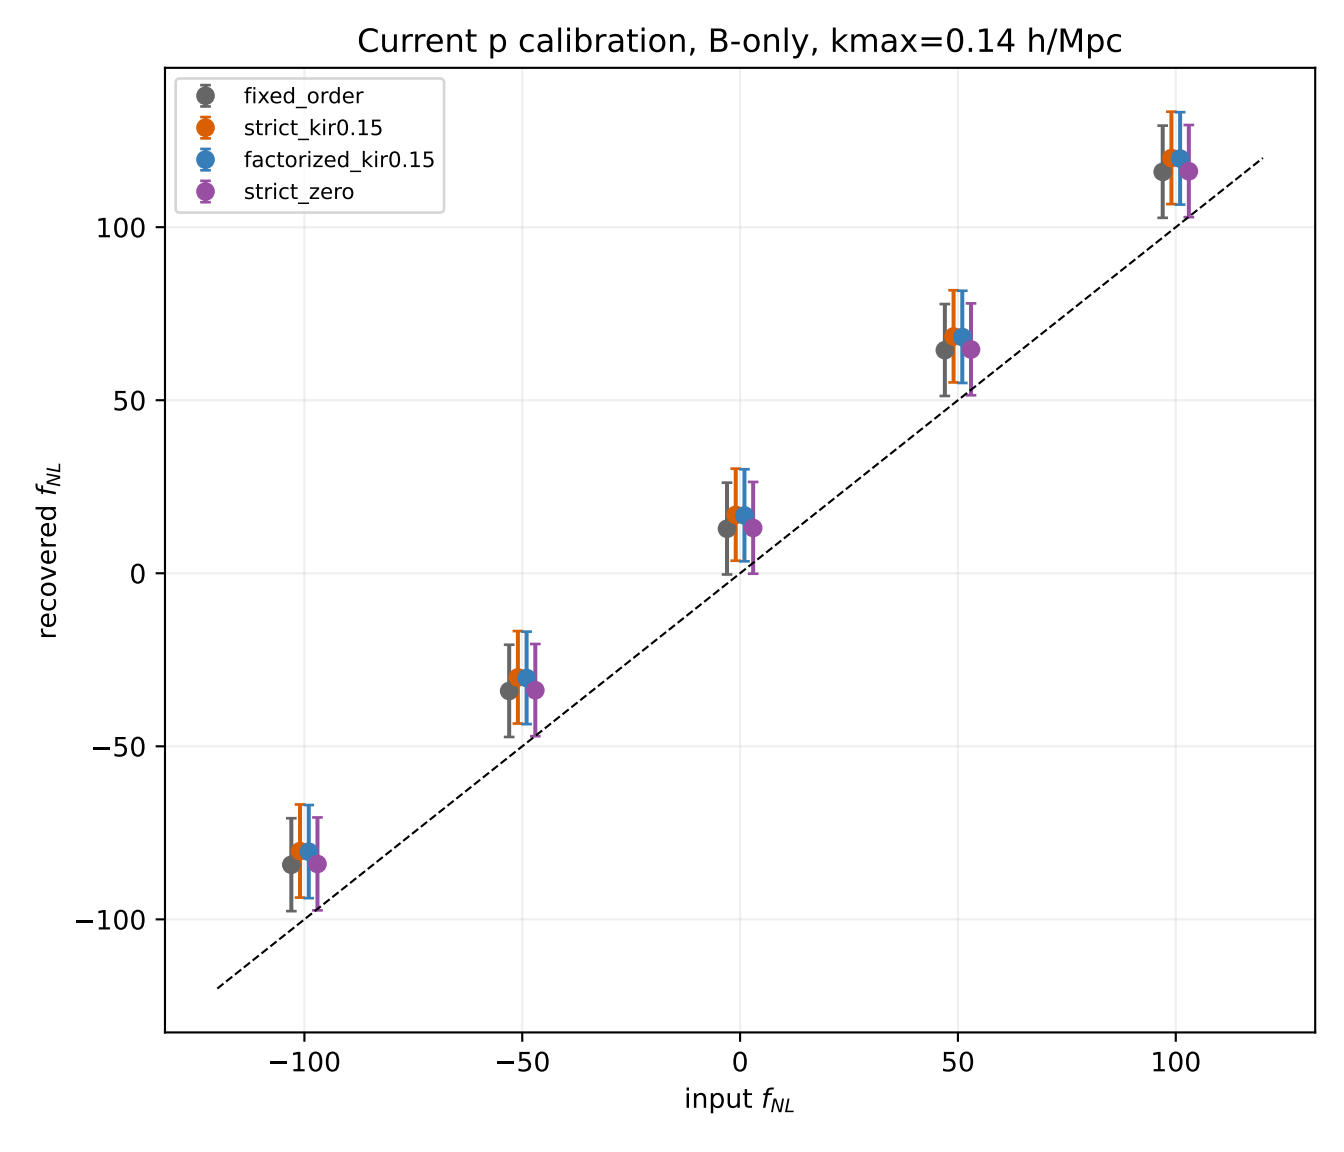

Pre-reconstruction B-only; current p calibration; V=42.875 (Gpc/h)^3
fixed_order
strict_kir0.15
factorized_kir0.15
strict_zero
max profiled $\Delta\chi^2(f_{NL}^{true})$
10^1
10^0
0
0.08
0.10
0.12
0.14
0.16
0.18
0.20
k_{max} [h/Mpc]
Gaussian fixed-truth p-value
10^0
10^{-1}
0.08
0.10
0.12
0.14
0.16
0.18
0.20
k_{max} [h/Mpc]

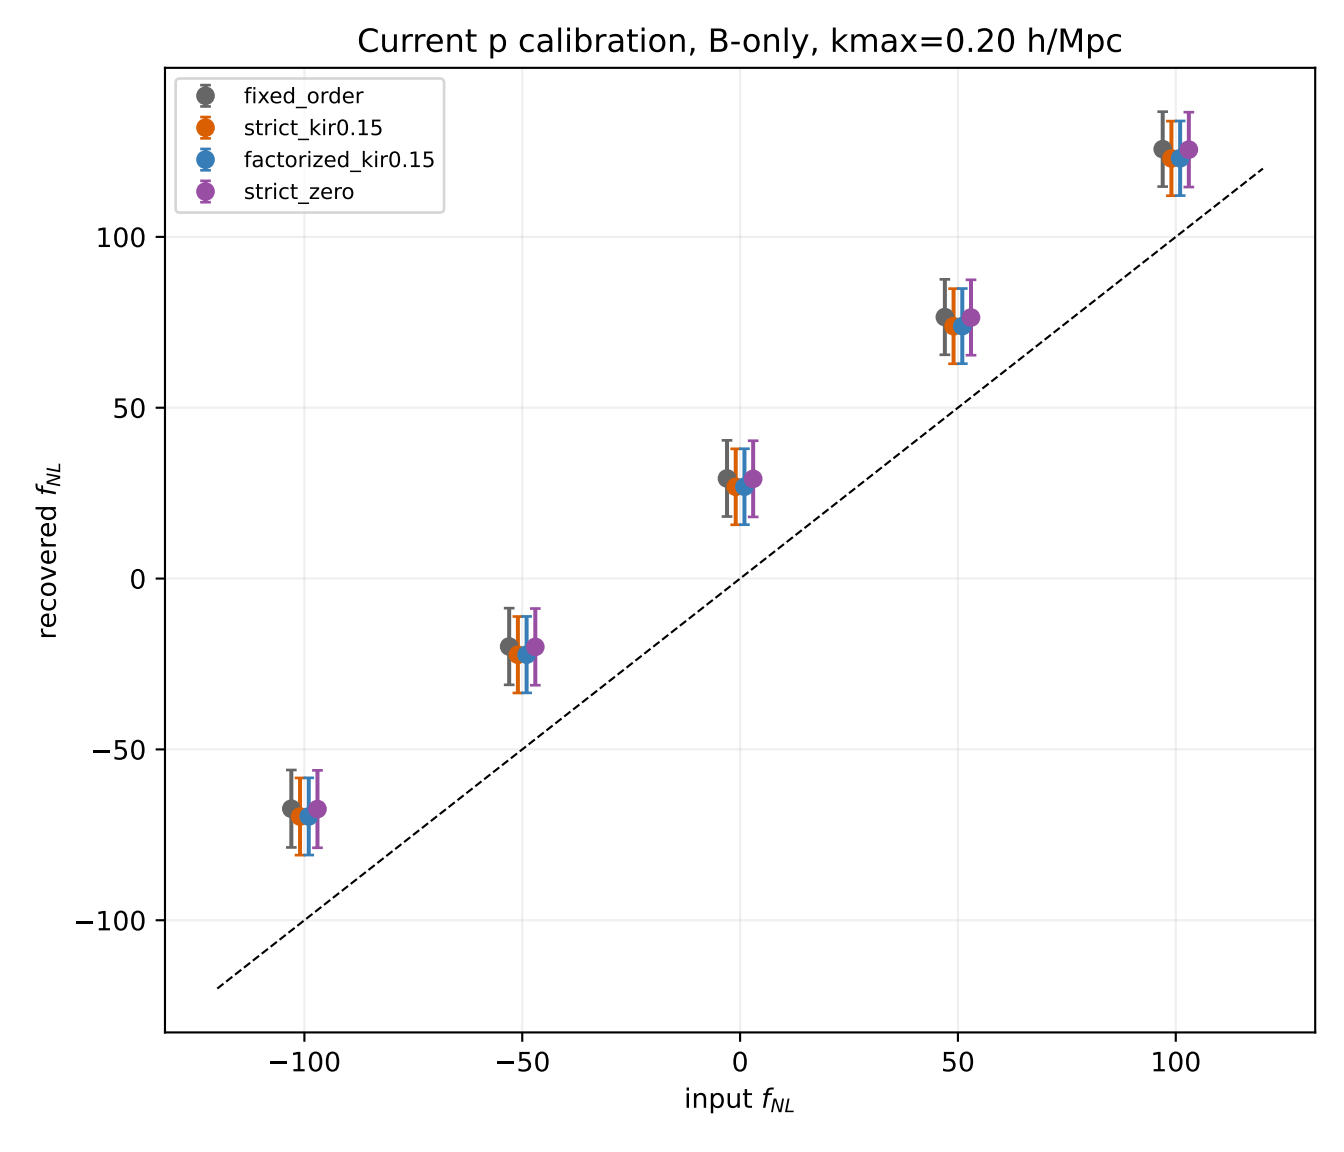

Pre-reconstruction B-only; legacy p calibration; V=42.875 (Gpc/h)^3
fixed_order
strict_kir0.15
factorized_kir0.15
strict_zero
max profiled $\Delta\chi^2(f_{NL}^{true})$
10^1
10^0
0
0.08
0.10
0.12
0.14
0.16
0.18
0.20
k_{max} [h/Mpc]
Gaussian fixed-truth p-value
10^0
10^{-1}
0.08
0.10
0.12
0.14
0.16
0.18
0.20
k_{max} [h/Mpc]


Current p calibration, B-only, kmax=0.08 h/Mpc
fixed_order
strict_kir0.15
factorized_kir0.15
strict_zero
recovered f_{NL}
input f_{NL}
100
50
0
−50
−100
−100
−50
0
50
100


Current p calibration, B-only, kmax=0.10 h/Mpc
fixed_order
strict_kir0.15
factorized_kir0.15
strict_zero
recovered f_{NL}
input f_{NL}
100
50
0
−50
−100
−100
−50
0
50
100


Current p calibration, B-only, kmax=0.12 h/Mpc
fixed_order
strict_kir0.15
factorized_kir0.15
strict_zero
recovered f_{NL}
input f_{NL}
150
100
50
0
−50
−100
−100
−50
0
50
100


Current p calibration, B-only, kmax=0.14 h/Mpc
fixed_order
strict_kir0.15
factorized_kir0.15
strict_zero
recovered f_{NL}
input f_{NL}
100
50
0
−50
−100
−100
−50
0
50
100


Current p calibration, B-only, kmax=0.20 h/Mpc
fixed_order
strict_kir0.15
factorized_kir0.15
strict_zero
recovered f_{NL}
input f_{NL}
100
50
0
−50
−100
−100
−50
0
50
100