



Layerwise transfer from Electricity

(a) PT-ID targets

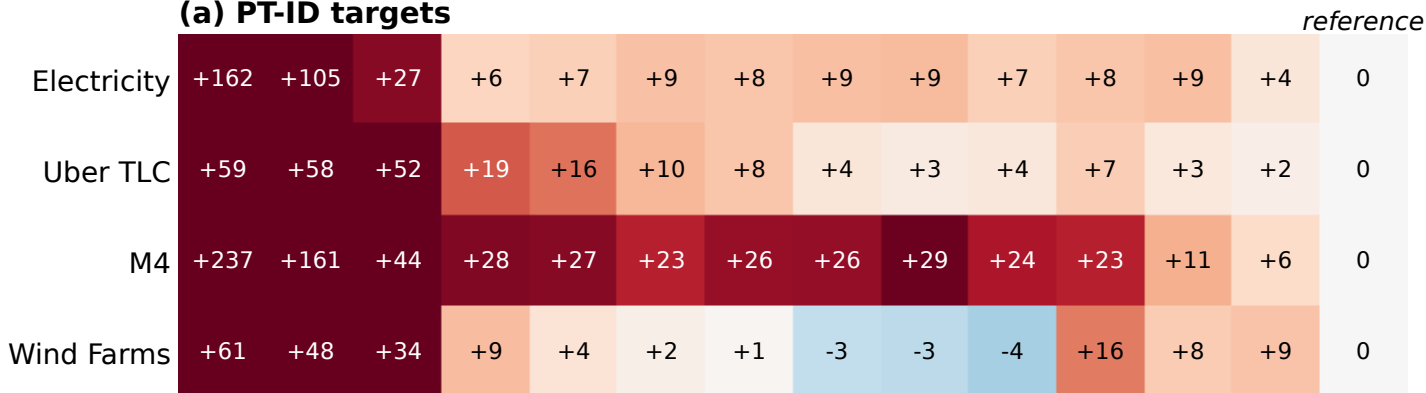

(b) PT-OOD targets

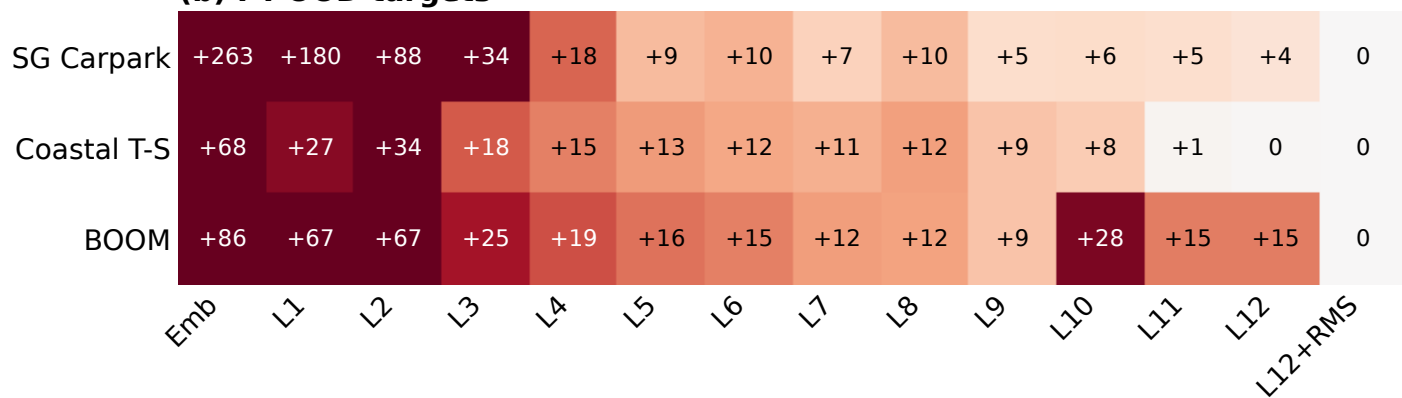

Representation point

Relative test-loss difference
from L12+RMS (%)