



RULER NIAH Retrieval Accuracy by Needle Depth

b = 50%

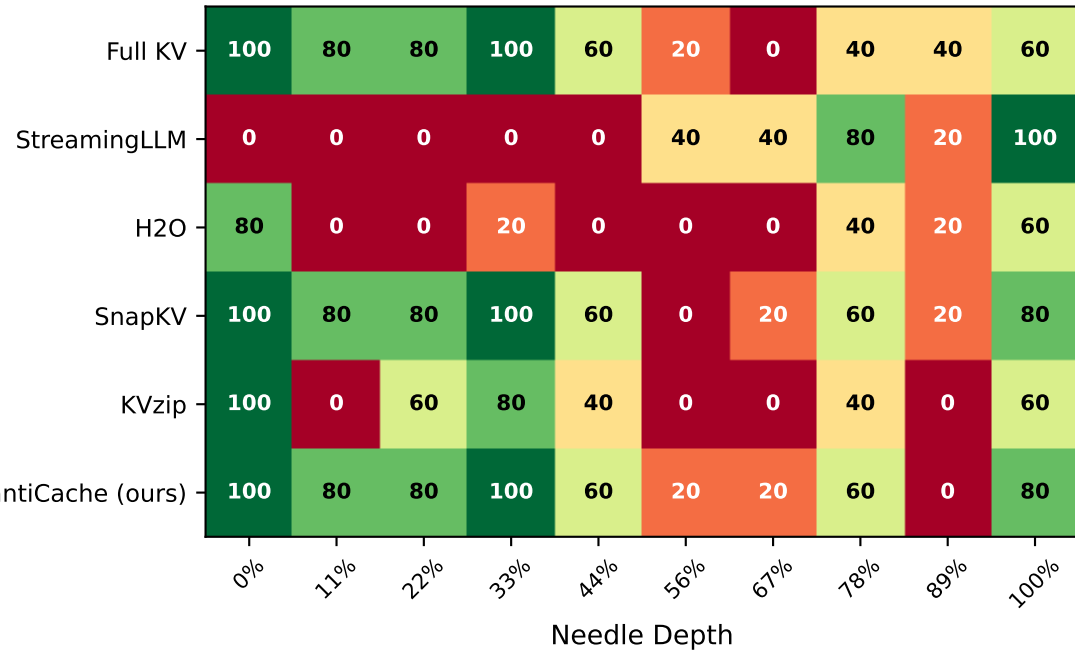

b = 30%

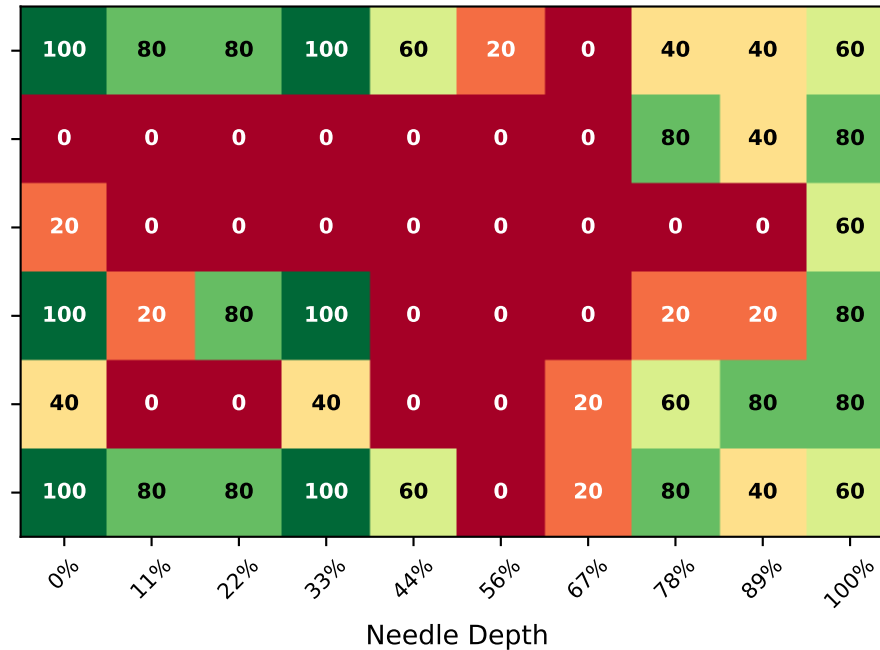

b = 20%

