


CT_{max} (°C)

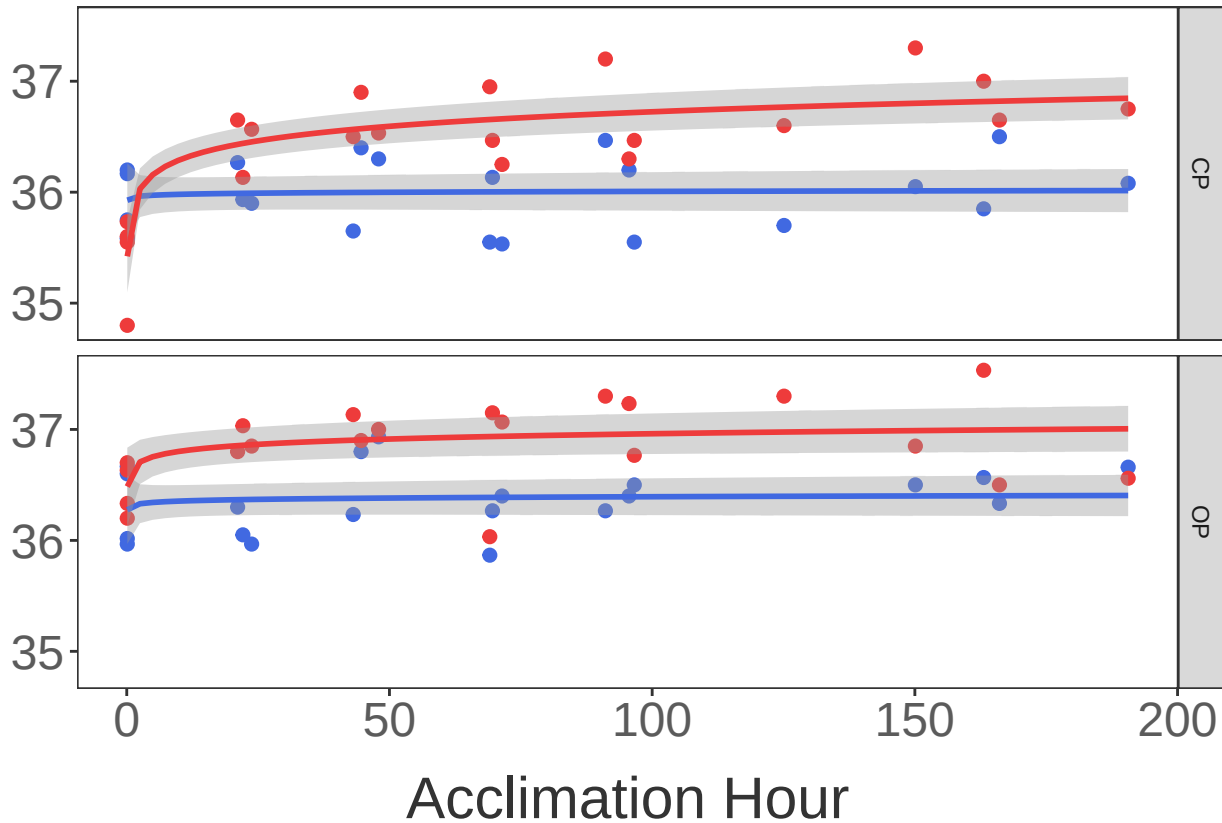

treatment control warming