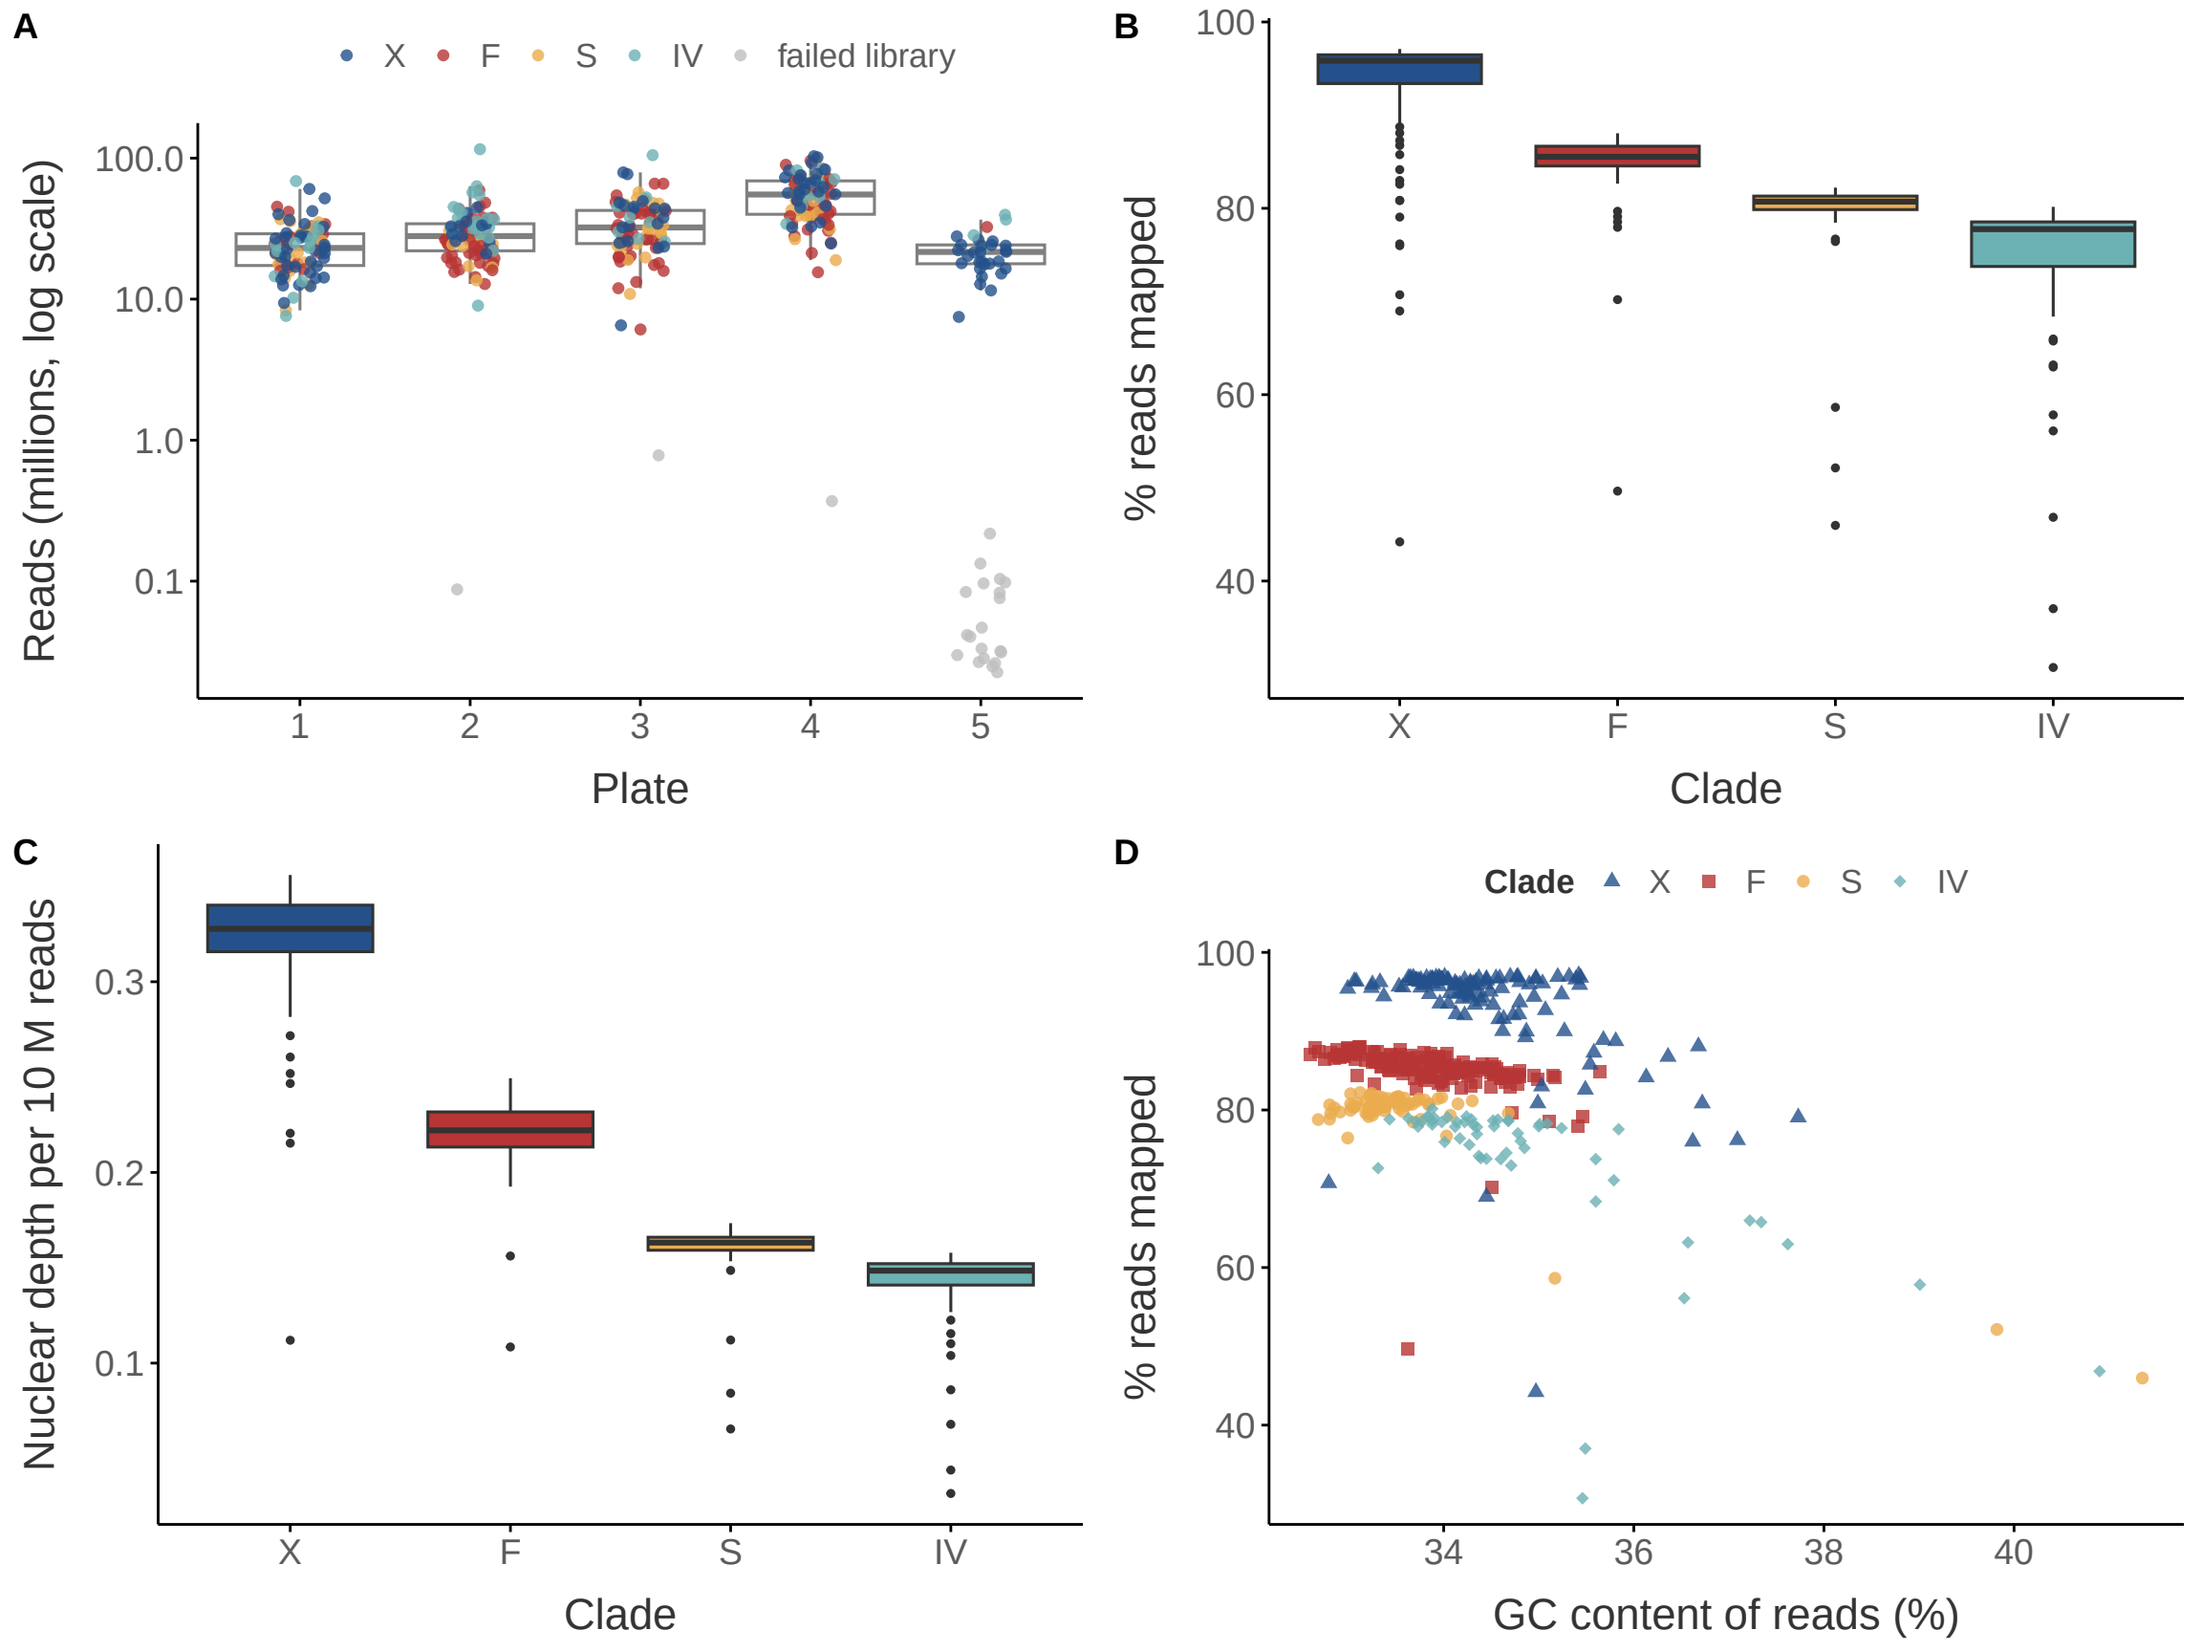
A
X
F
S
IV
failed library
Reads (millions, log scale)
100.0
10.0
1.0
0.1
1
2
3
4
5
Plate
B
% reads mapped
100
80
60
40
X
F
S
IV
Clade
C
Nuclear depth per 10 M reads
0.3
0.2
0.1
X
F
S
IV
Clade
D
Clade
X
F
S
IV
% reads mapped
100
80
60
40
34
36
38
40
GC content of reads (%)