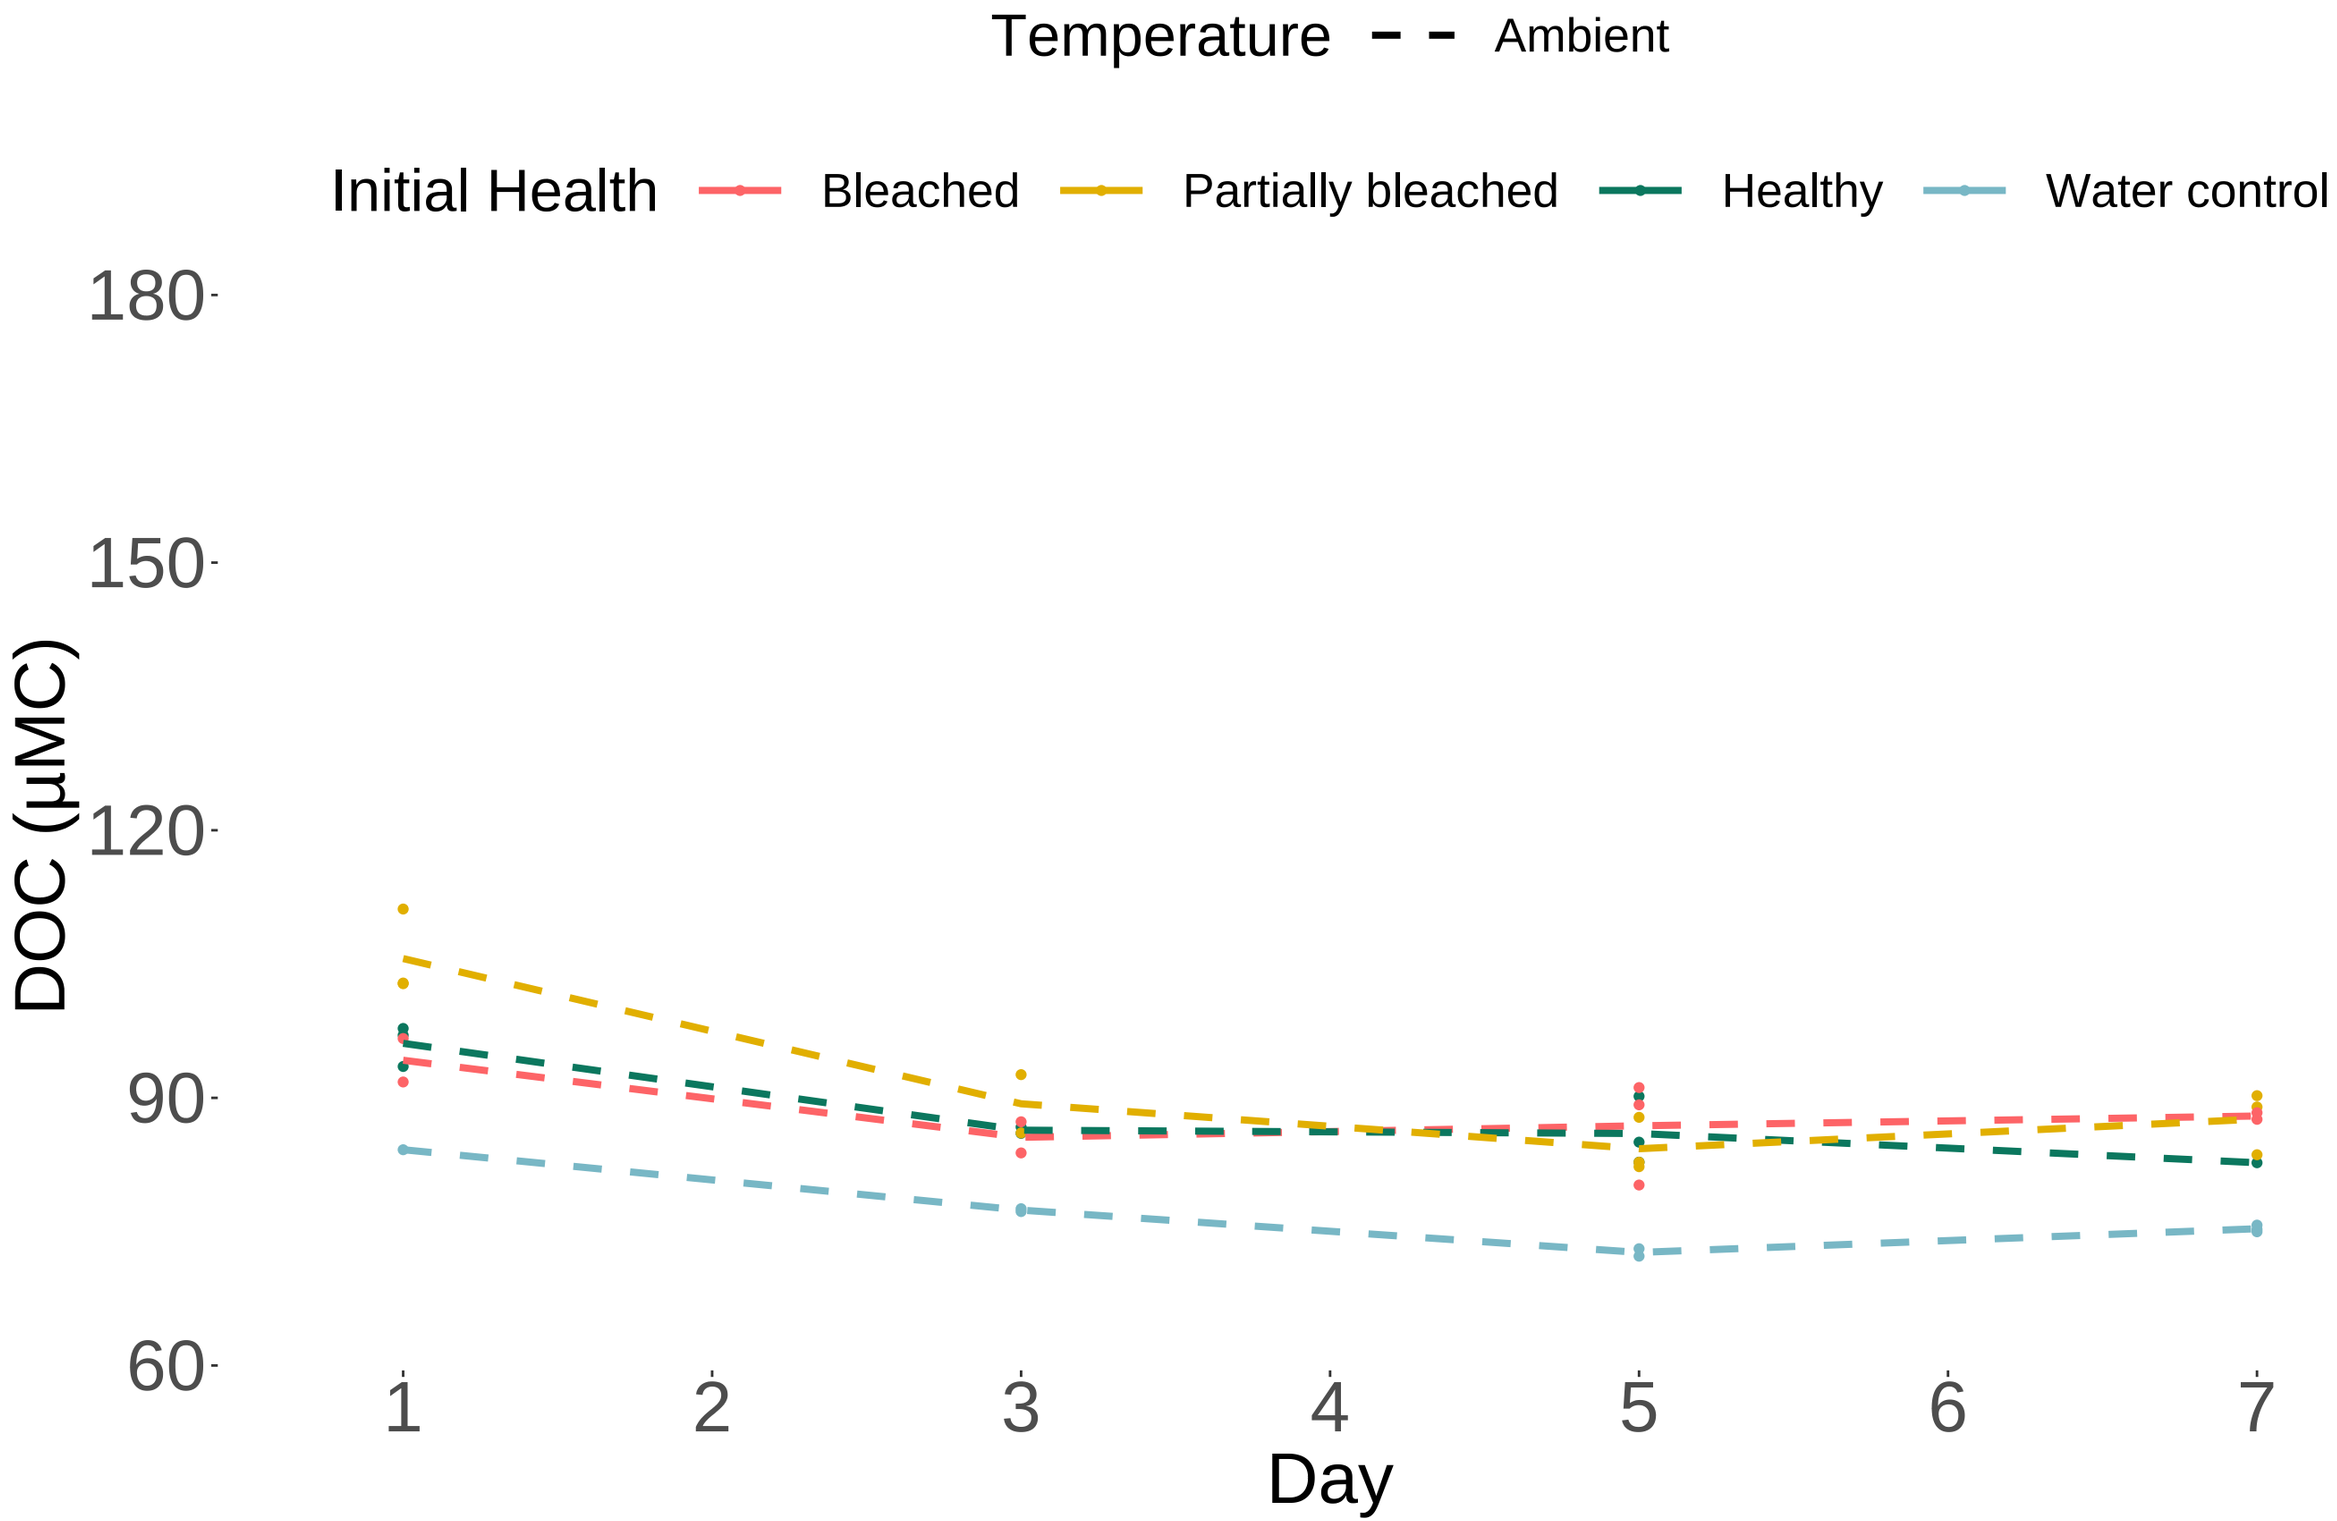
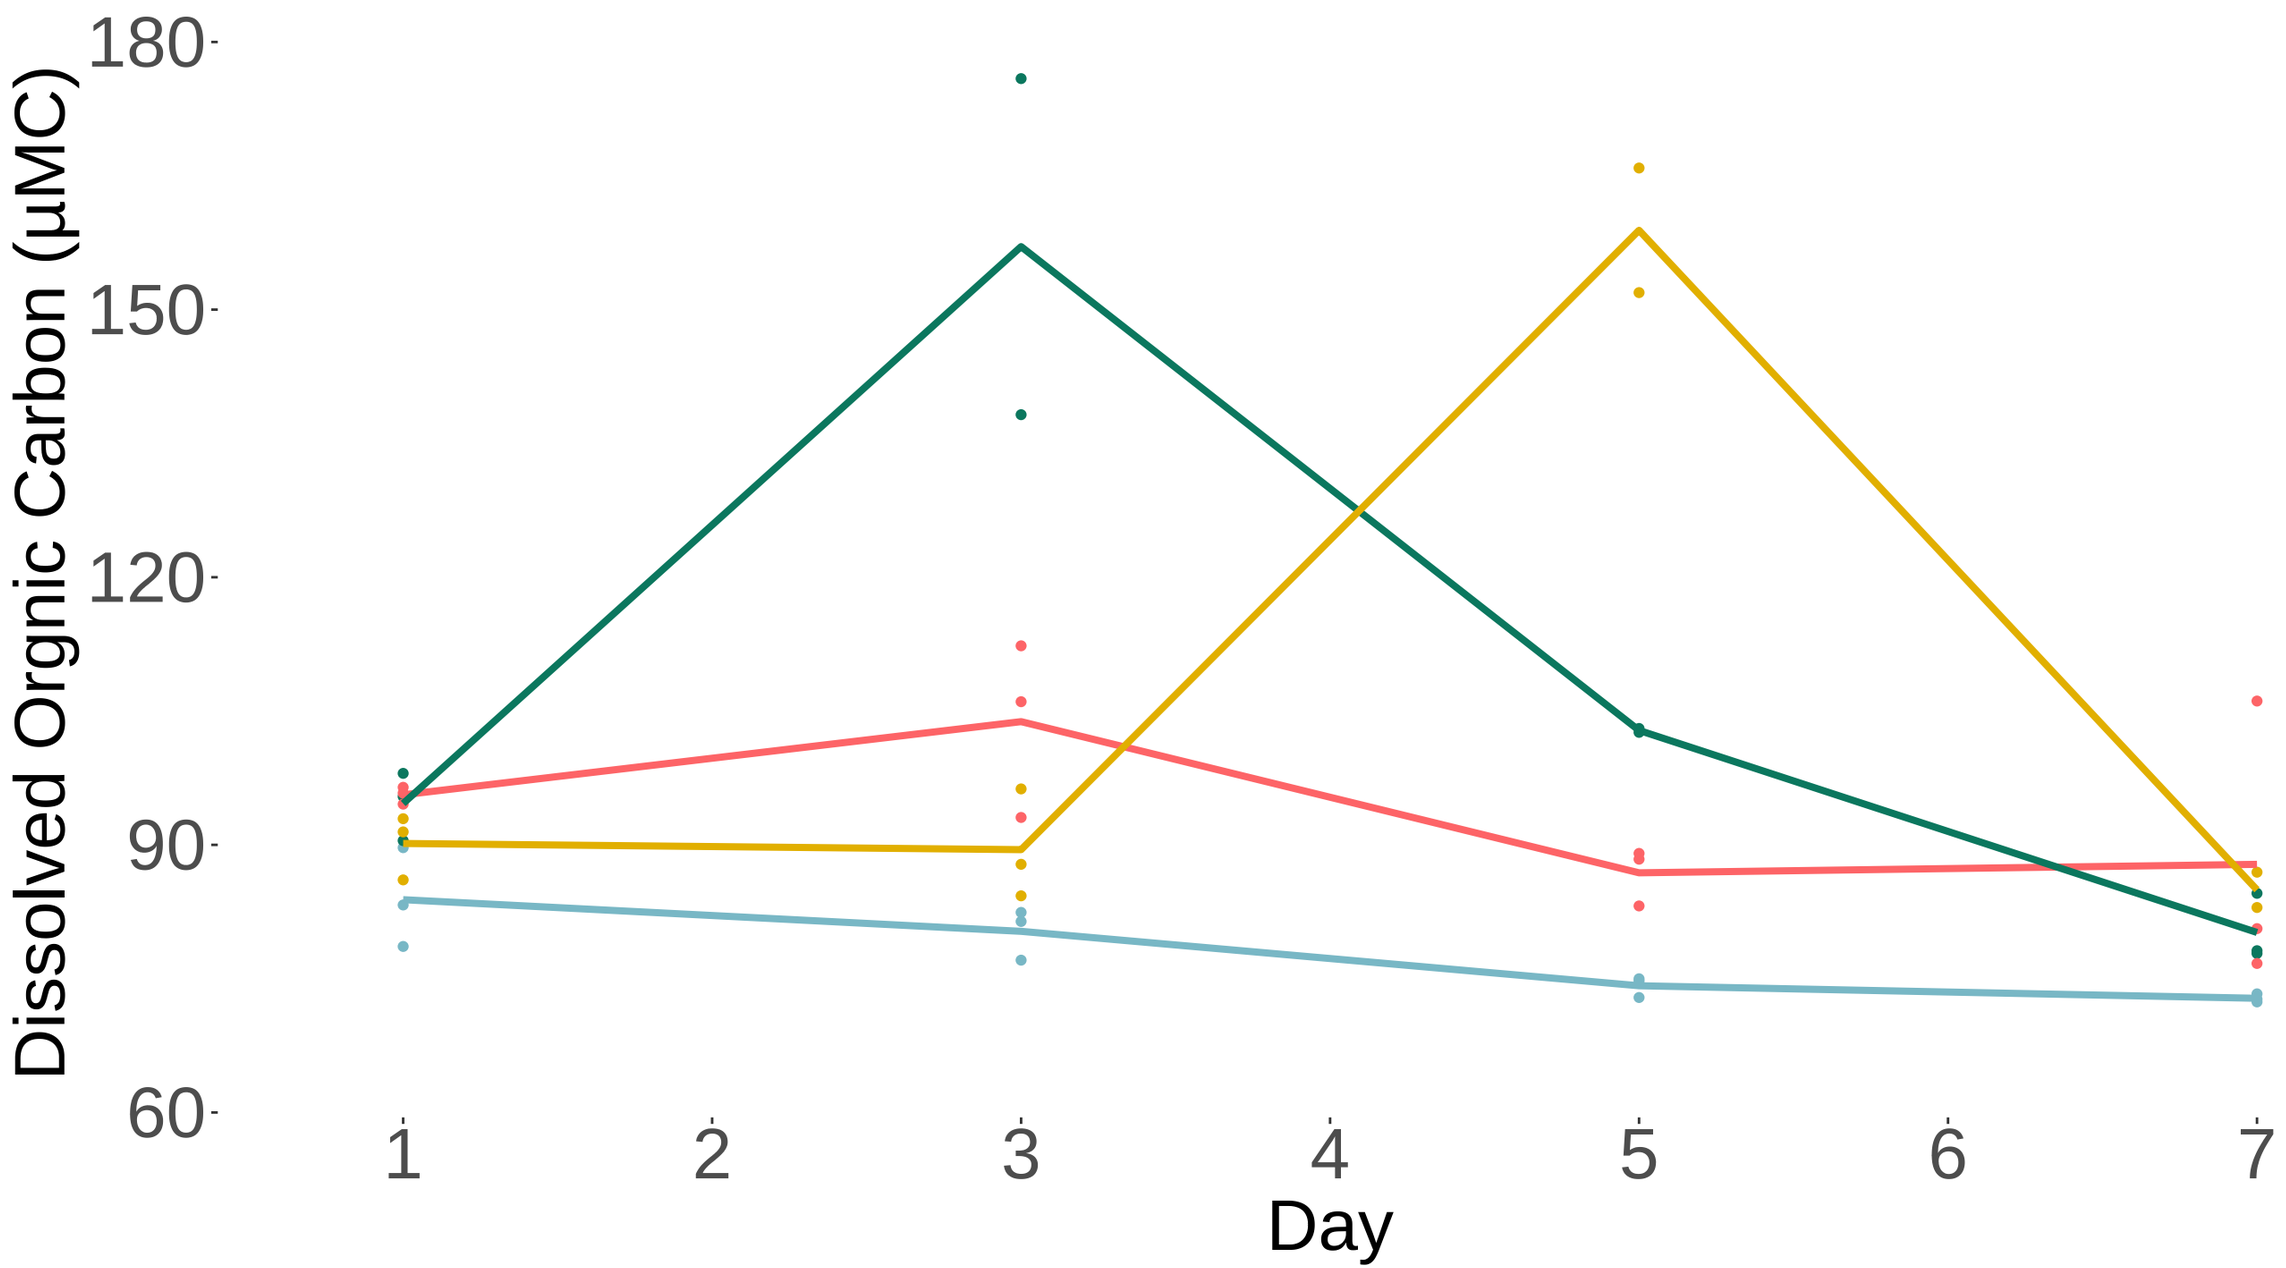
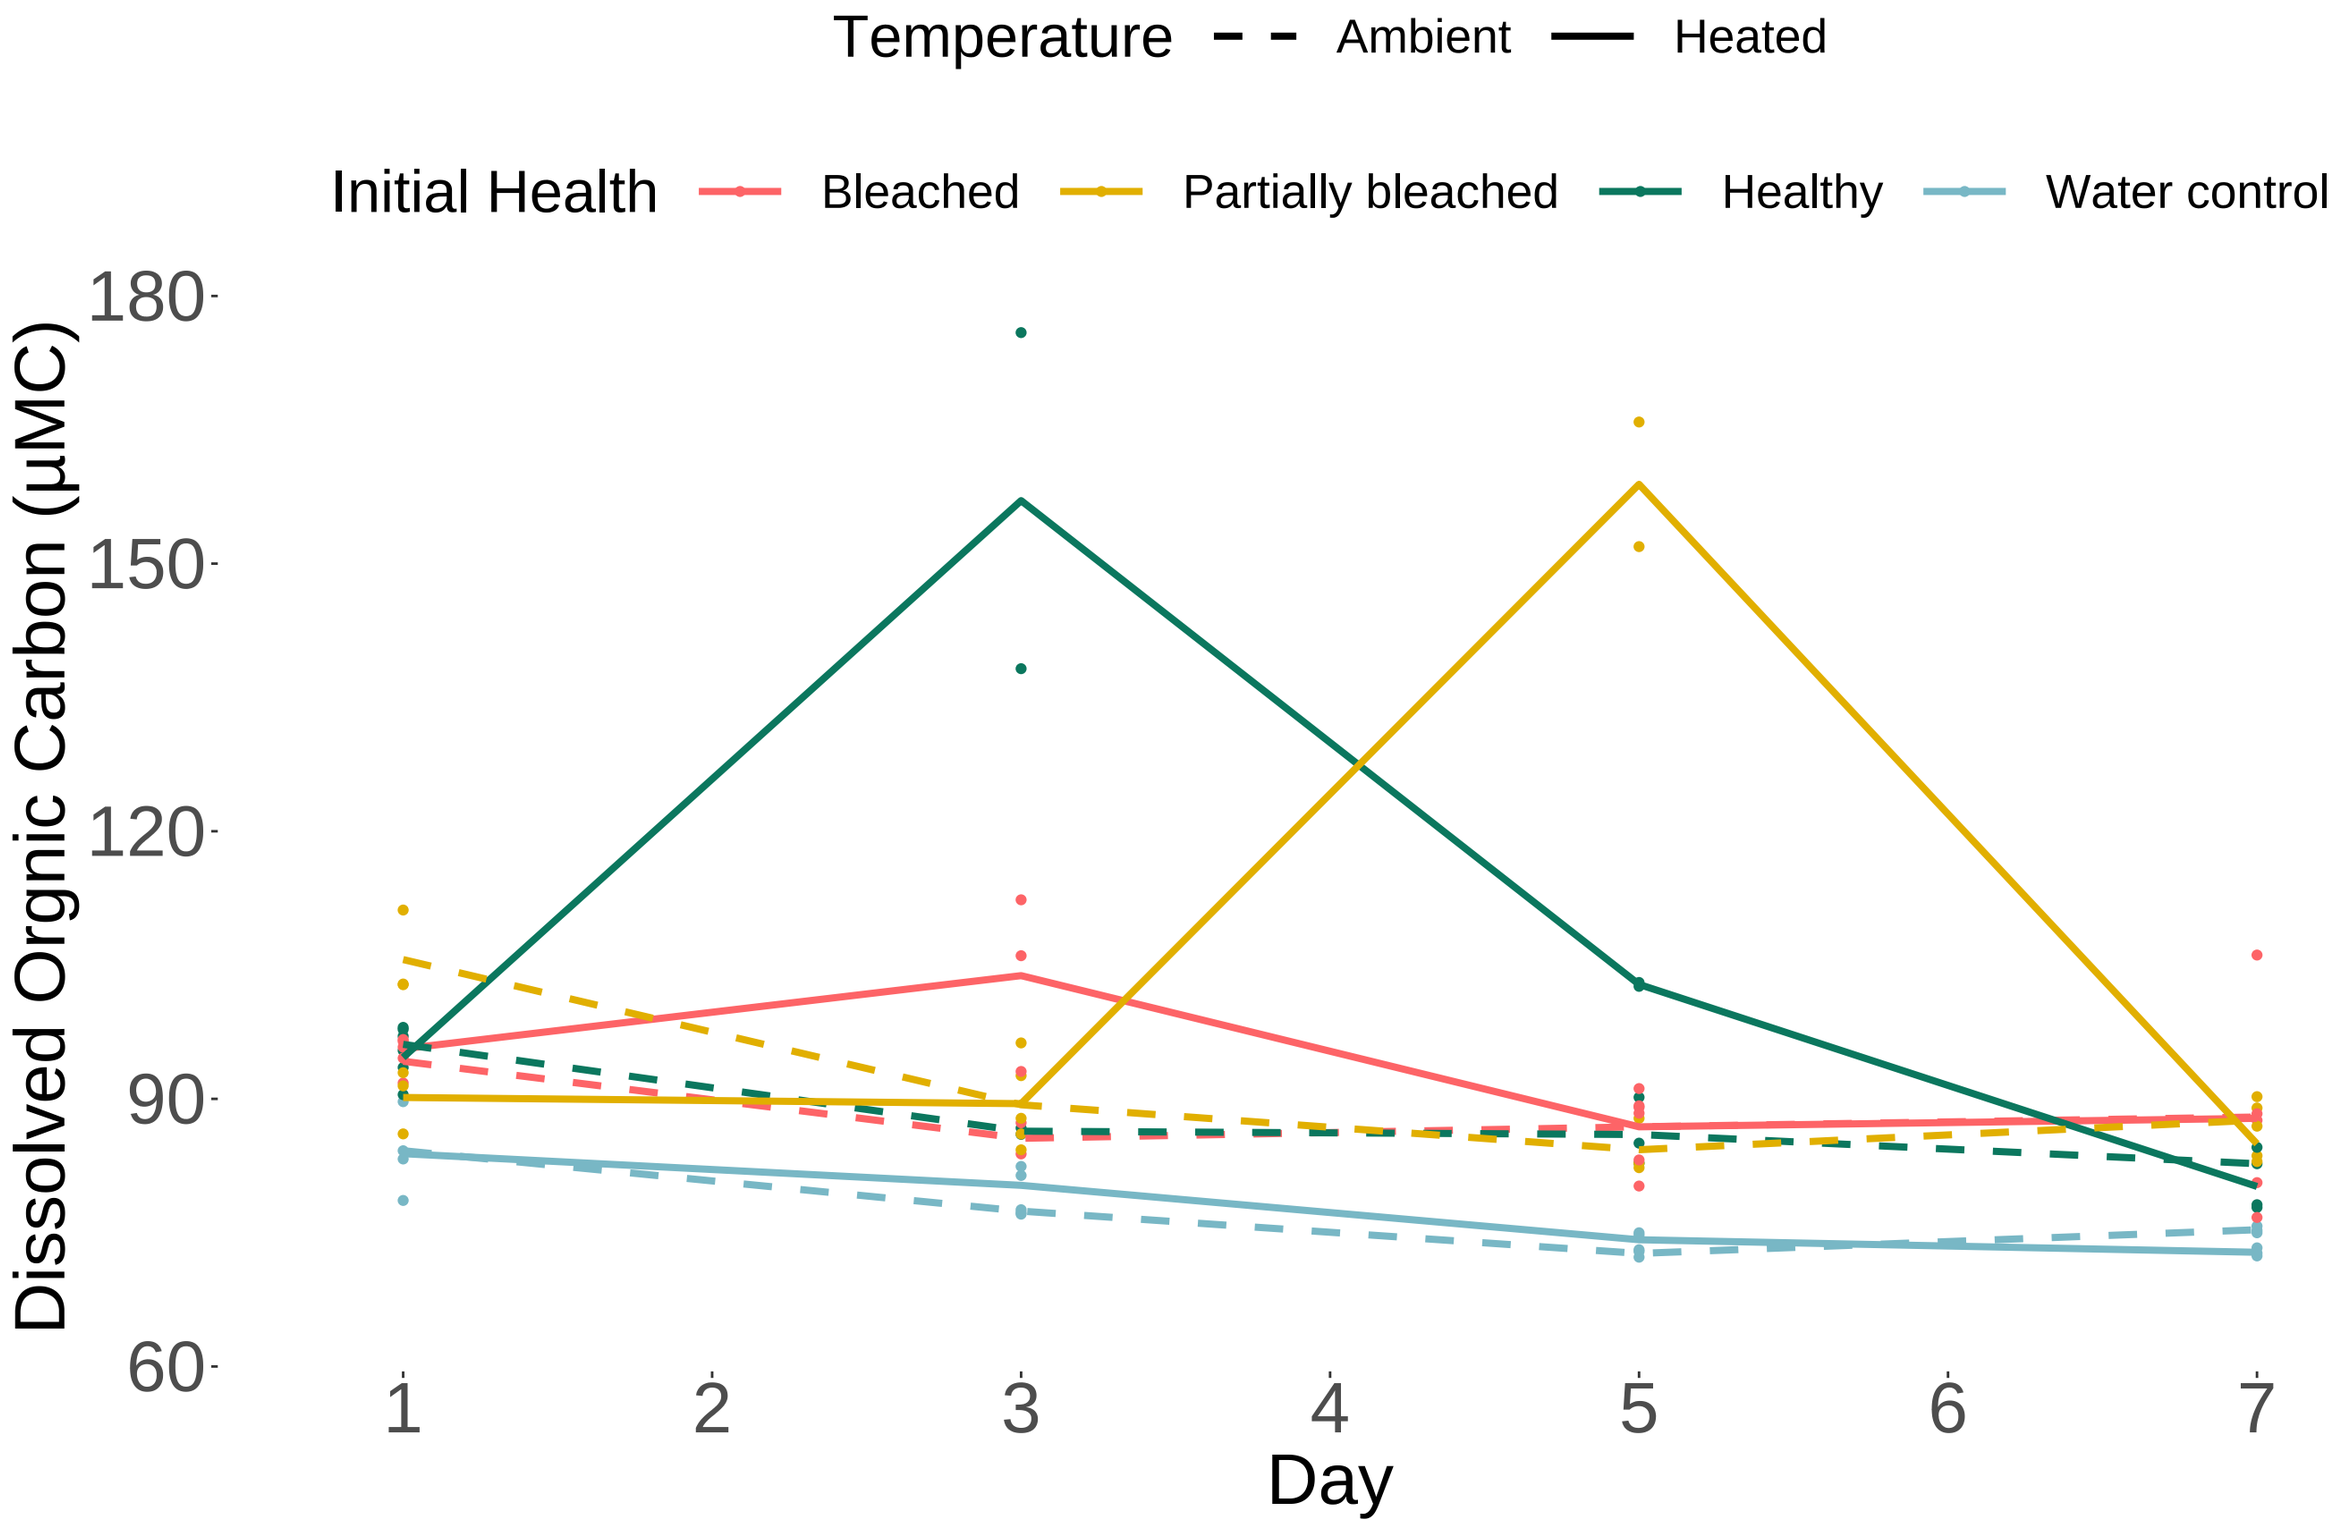

Temperature
Ambient
Initial Health
Bleached
Partially bleached
Healthy
Water control
180
150
120
90
60
DOC (µ
MC)
1
2
3
4
5
6
7
Day

Temperature — Heated

Initial Health — Bleached — Partially bleached — Healthy — Water control




Temperature
Ambient
Heated
Initial Health
Bleached
Partially bleached
Healthy
Water control
Dissolved Orgnic Carbon (µMC)
180
150
120
90
60
1
2
3
4
5
6
7
Day