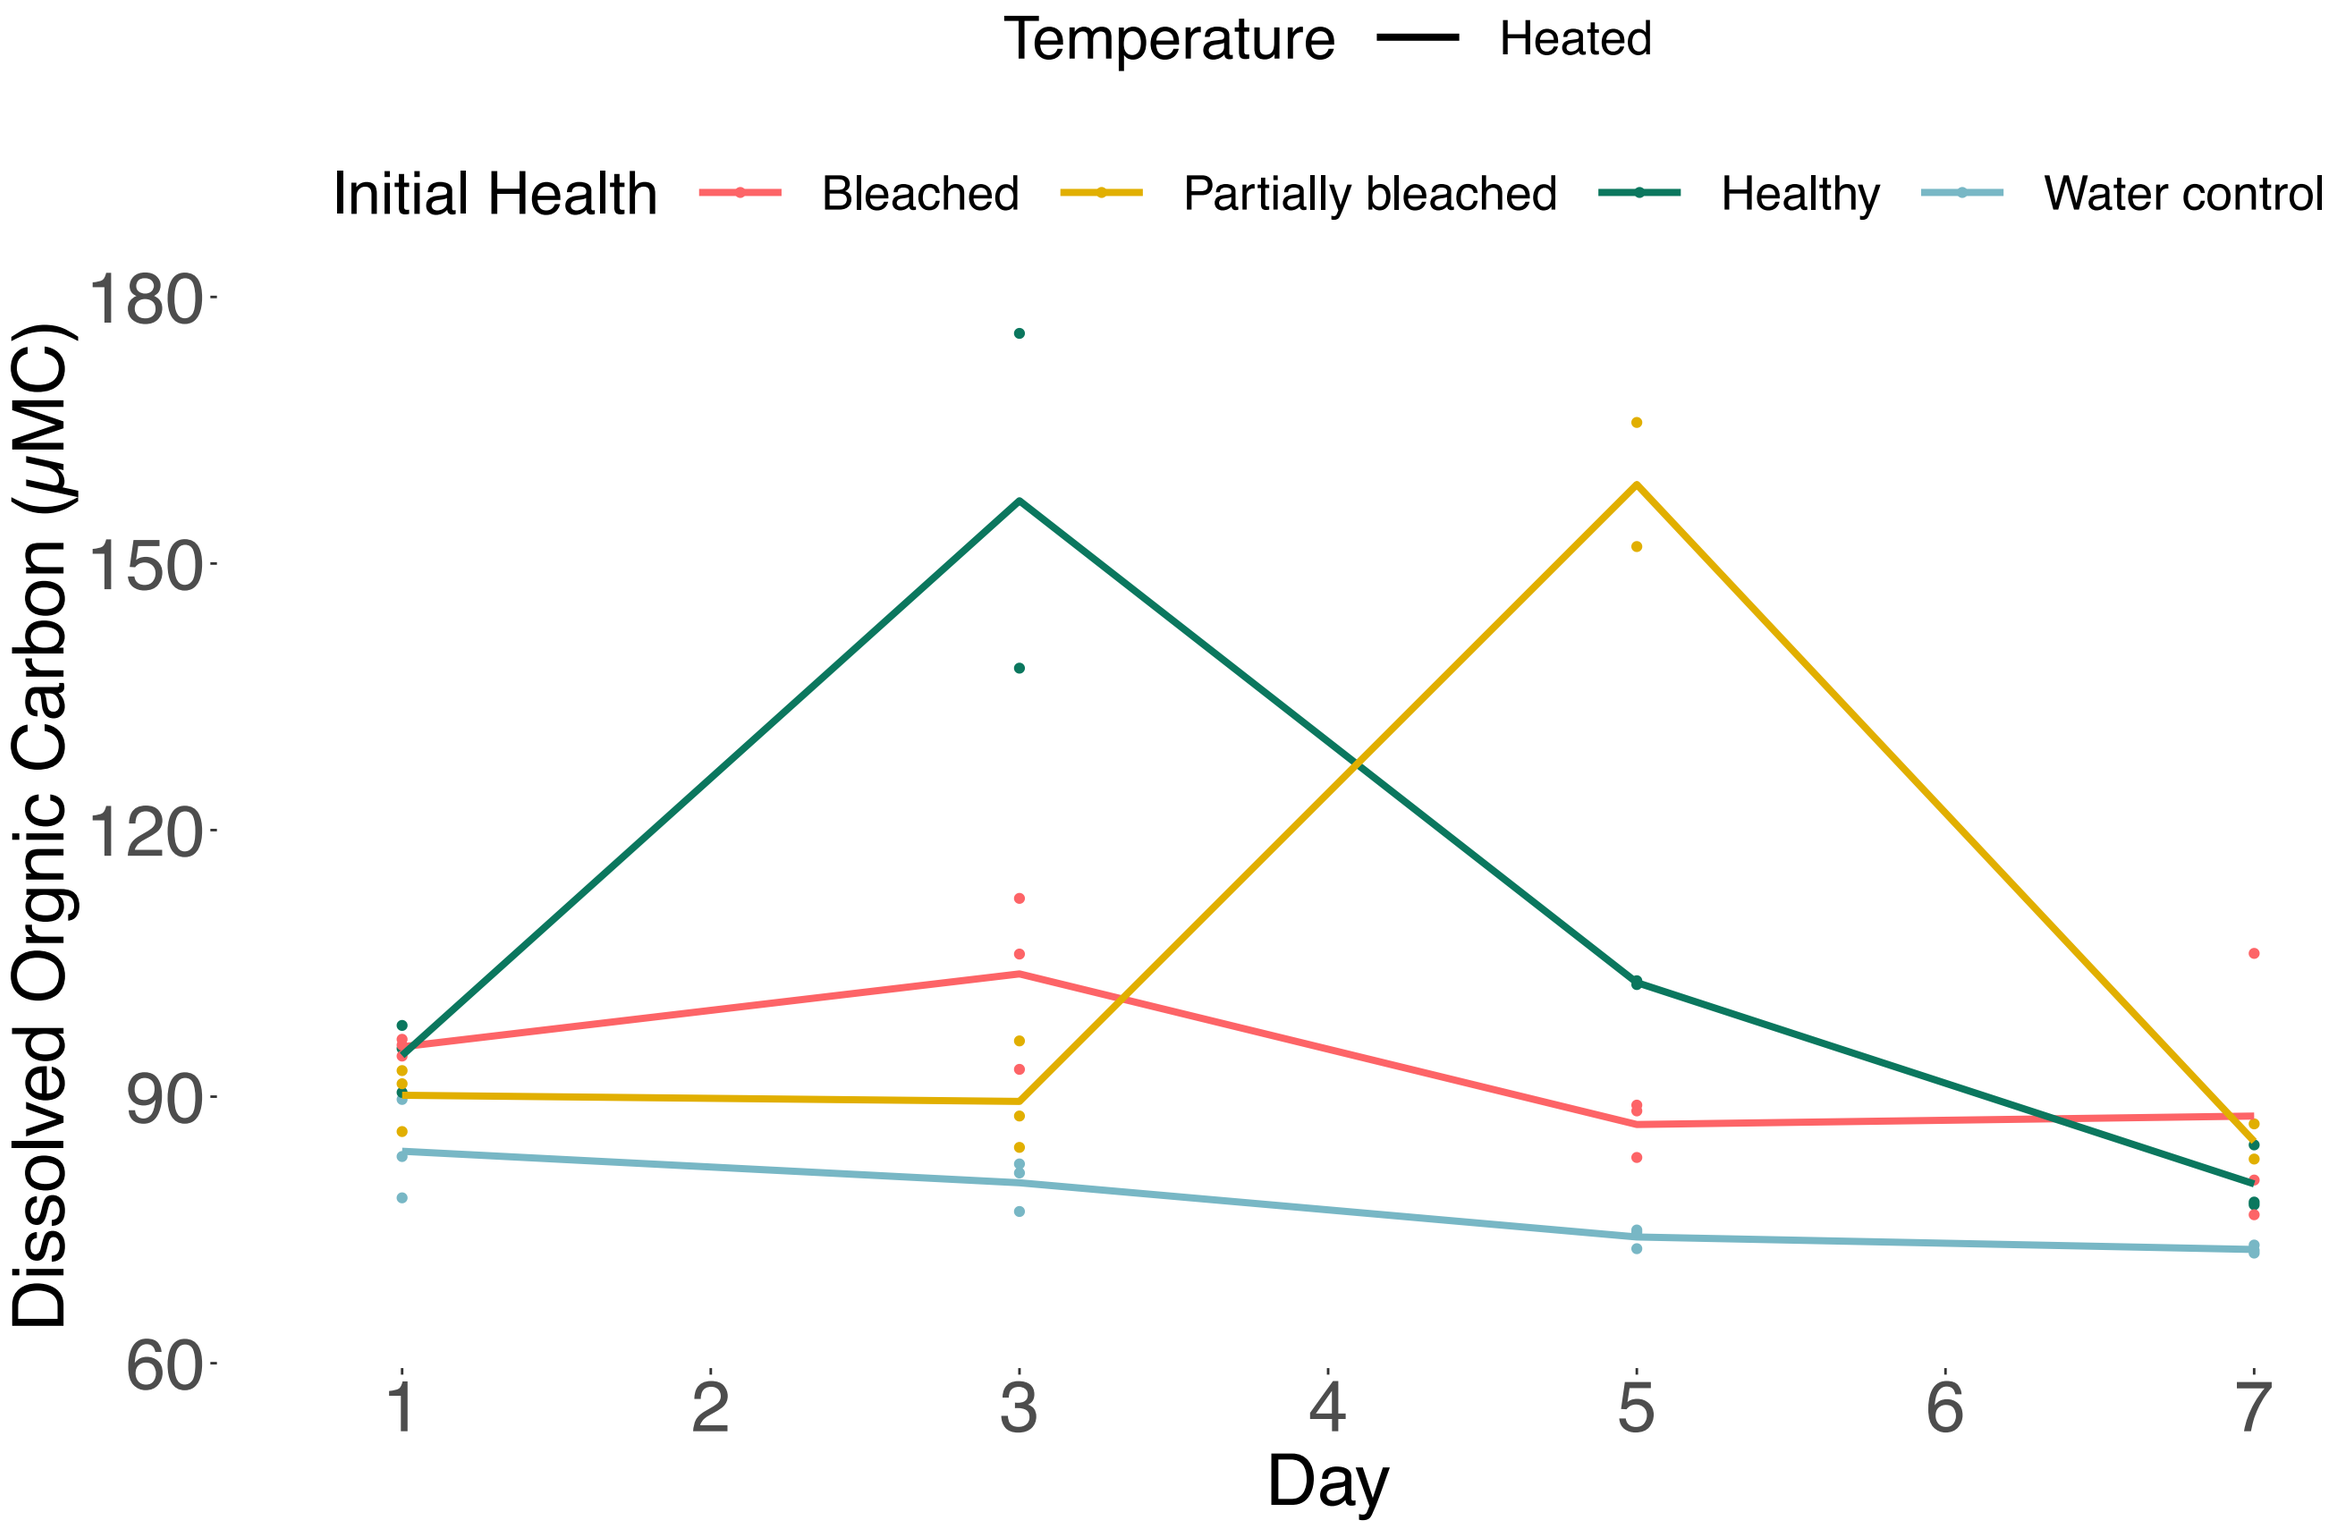
Temperature
Heated
Initial Health
Bleached
Partially bleached
Healthy
Water control
Dissolved Orgnic Carbon (μMC)
180
150
120
90
60
1
2
3
4
5
6
7
Day