




C:\Users\bfahmy\Documents\1524R1-07_M15_Olsson 2nd Fl Reno_Mech_AB_battany.rvt

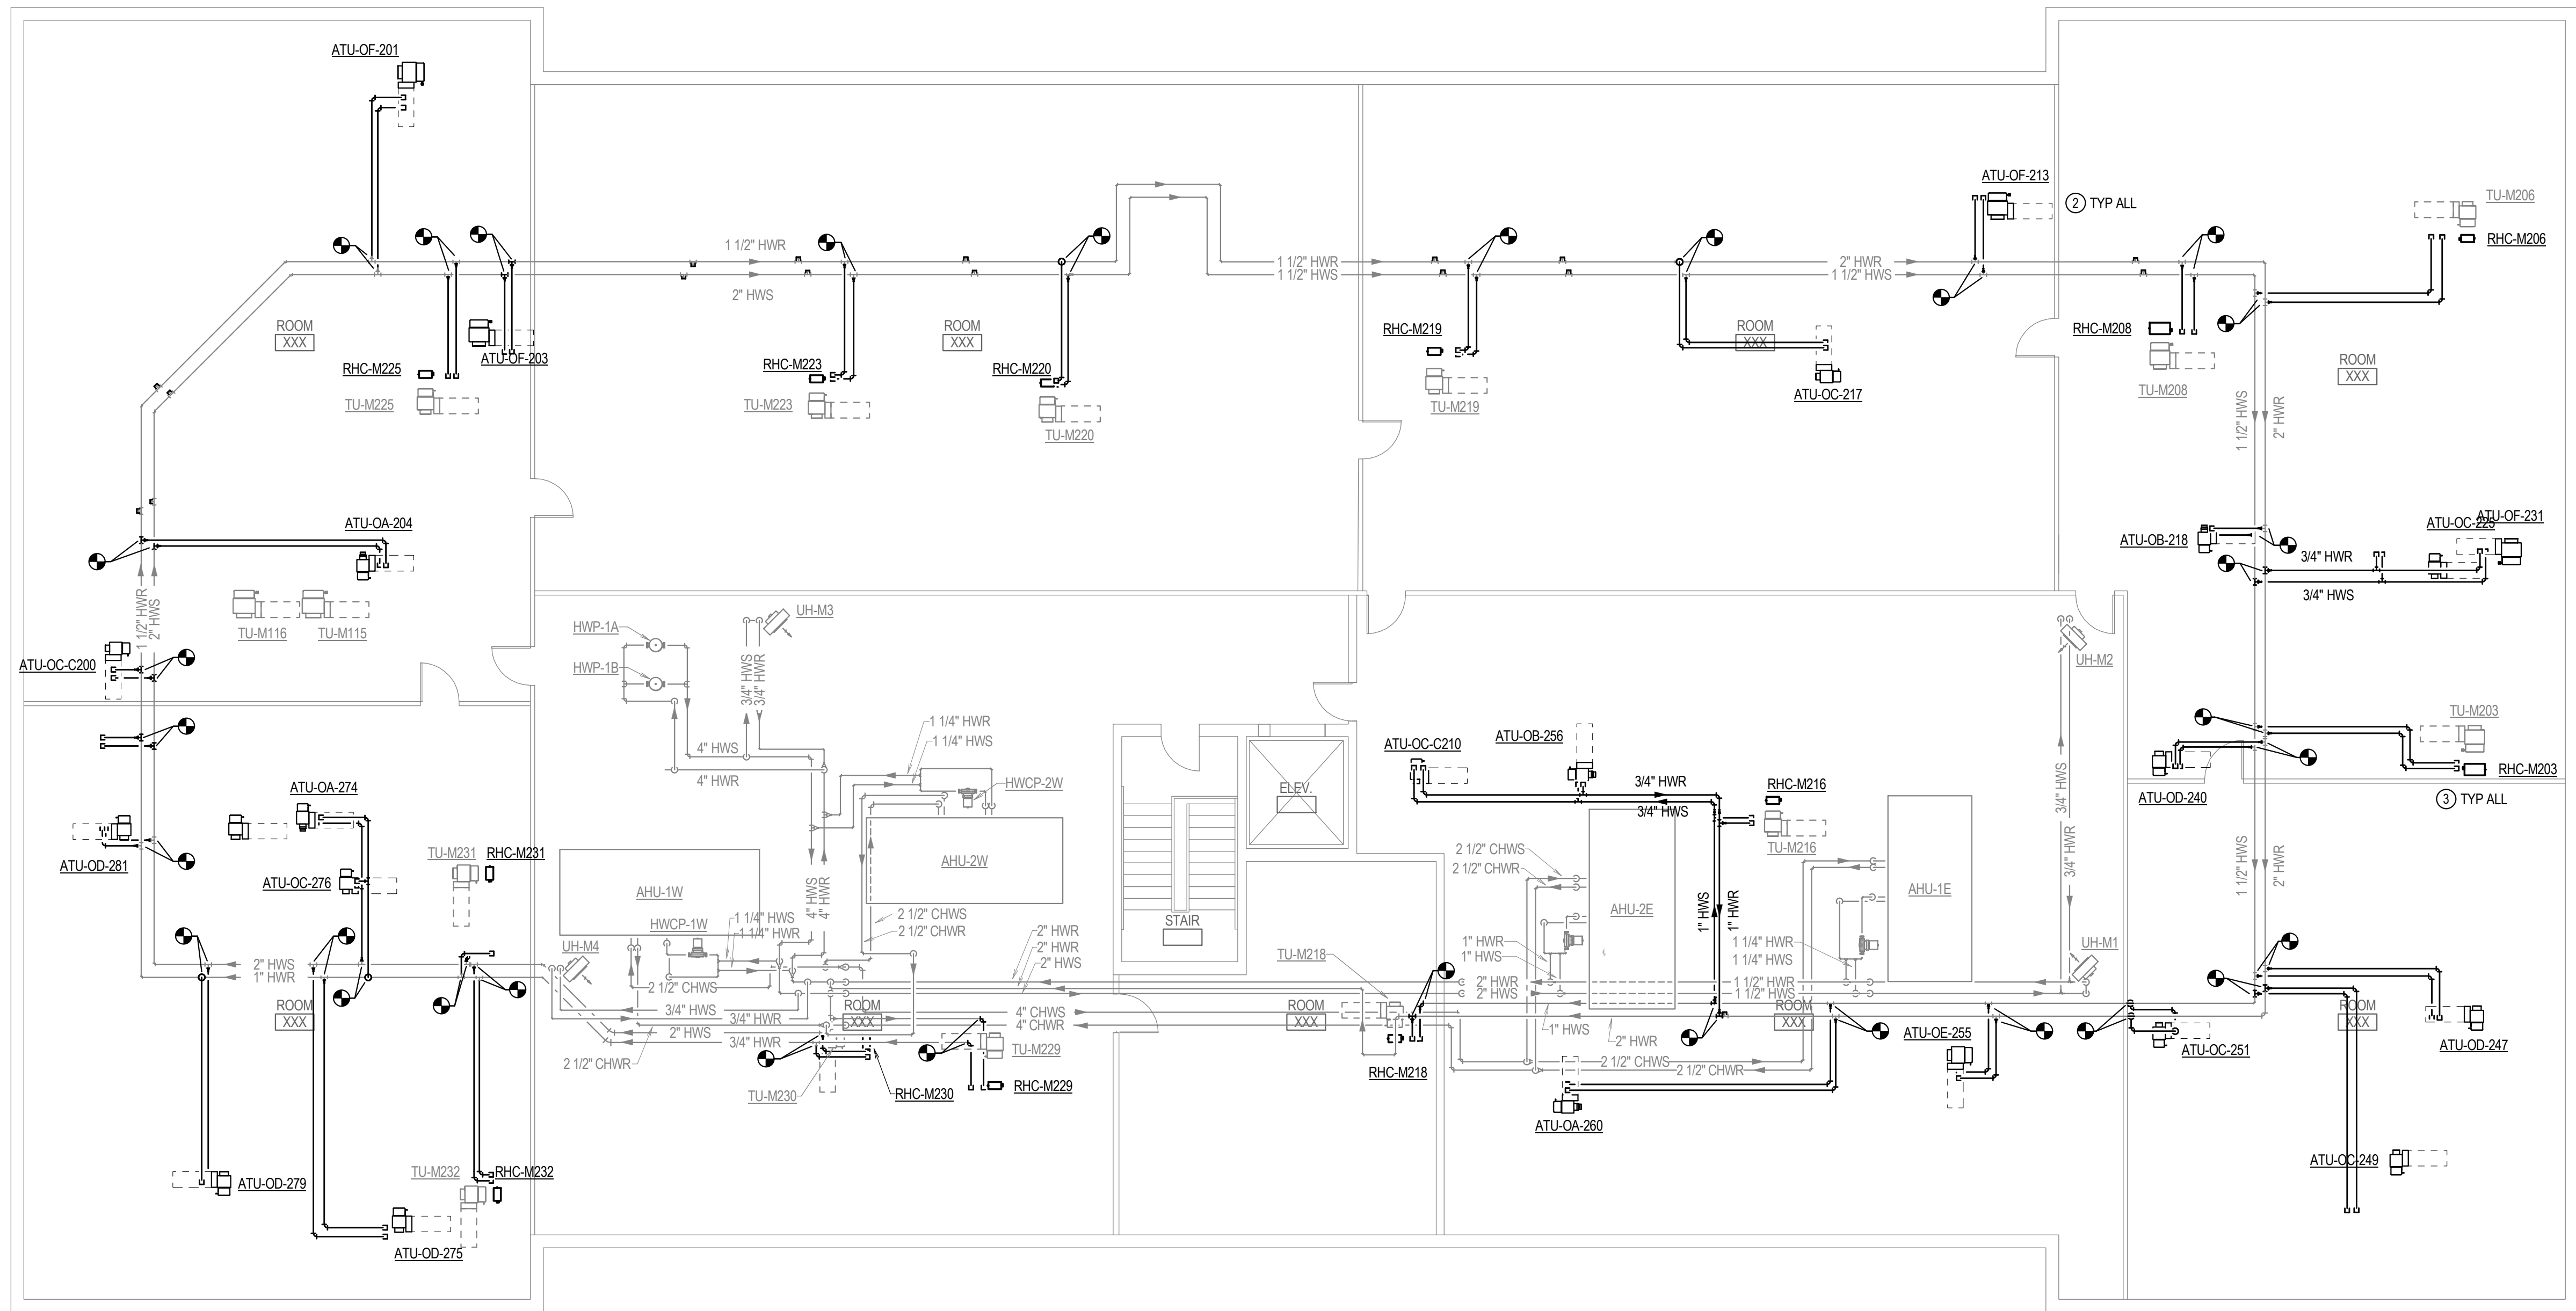

ATTIC MECHANICAL PIPING

SCALE: 1/8" = 1'-0"



⊗ KEY NOTES (NEW WORK)

- EXISTING CHW AND HW MAINS TO REMAIN, UNO.
- PROVIDE BRANCH PIPING TO ALL NEW ATU'S. REFER TO ATU SCHEDULE FOR BRANCH PIPE SIZING. REFER TO HW COIL DETAIL FOR ADDITIONAL INFORMATION.
- PROVIDE BRANCH PIPING TO ALL NEW RHC'S. REFER TO RHC SCHEDULE FOR BRANCH PIPE SIZING. REUSE EXISTING BAS CONTROL VALVE. PROVIDE ALL OTHER NEW COMPONENTS AS INDICATED ON HW COIL DETAIL.

UNIVERSITY of VIRGINIA
design group

Facilities Planning & Construction
575 Alderman Rd / PO Box 400726
Charlottesville, VA 22904 / 434-952-4621

2rw
CONSULTANTS INC.

100 10th Street NE, Ste. 202
Charlottesville, VA 22902
TJ 434.296.2116

SECOND FLOOR RENOVATIONS OLSSON HALL, BUILDING NO. 0202

RECORD
DRAWINGS

ATTIC MECH PIPING

DATE: 04/23/18
DRAWN BY: CJP/BNM
CHECKED BY: PMM
REVISIONS

PROJECT NUMBER
PO4406

M2.1

SHEET