



Training Lab — 18' × 19' (342 sq ft) — seating for 24 participants

Option 1 — Pure U-shape (your starting point)

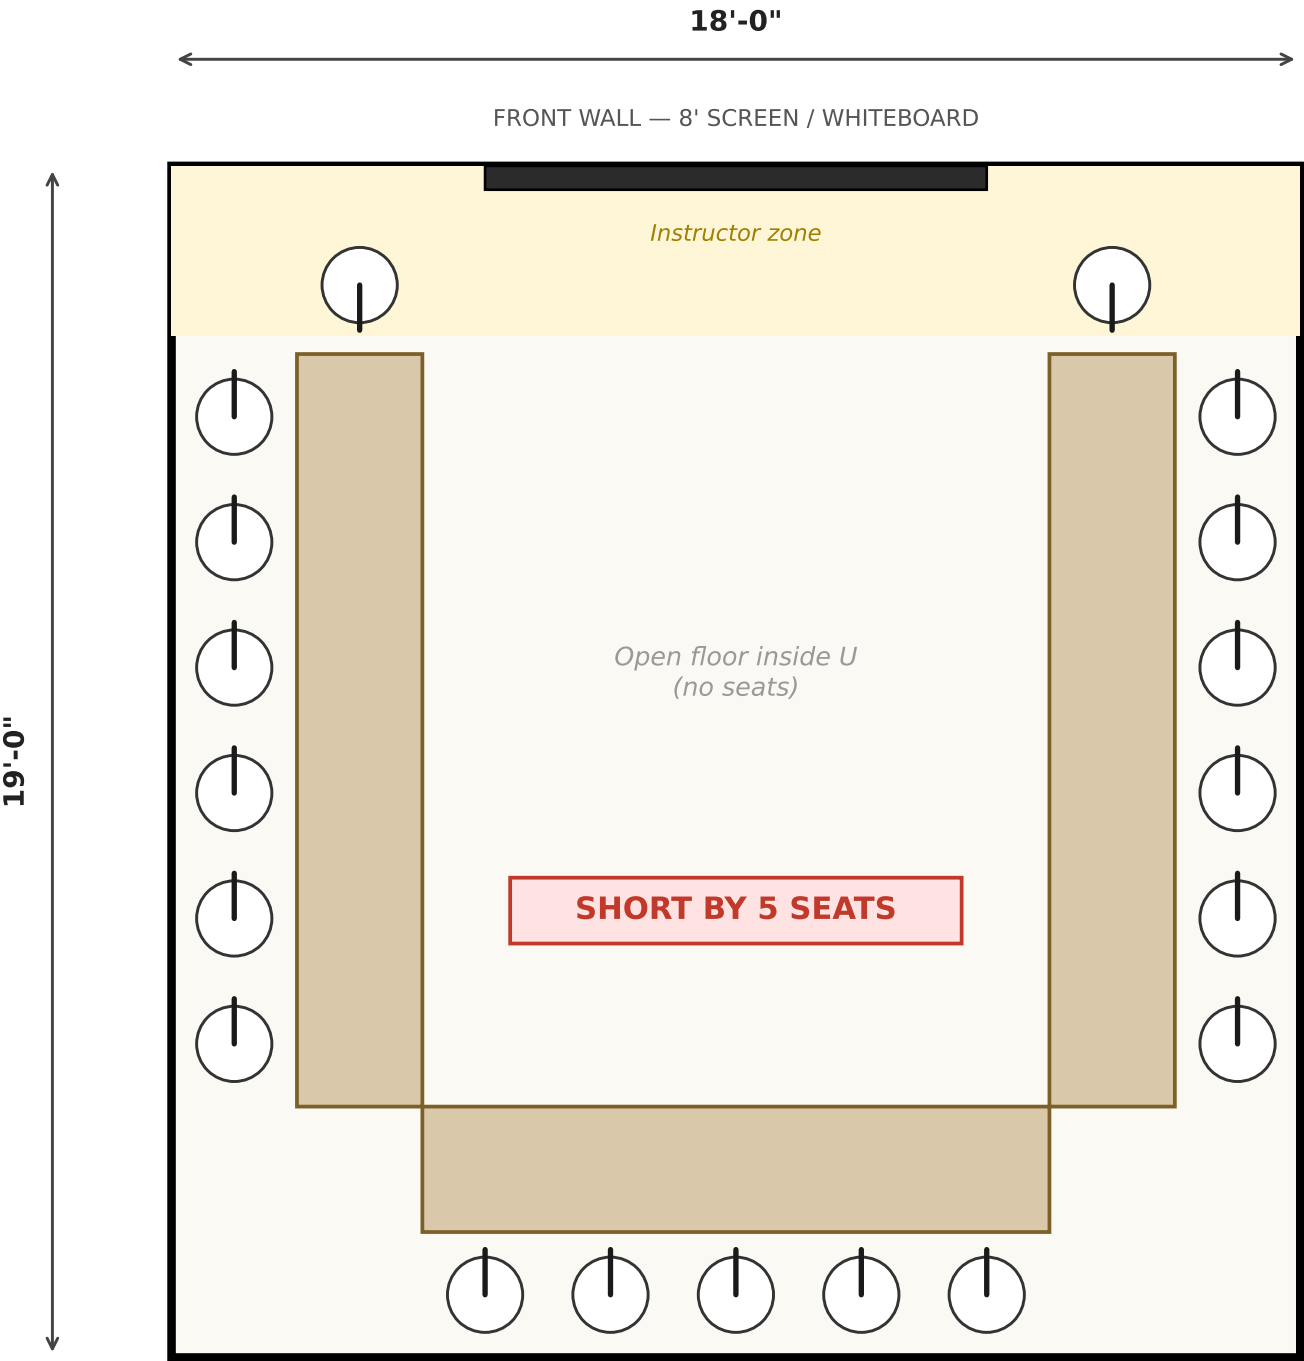

Arms 6+6 · back 5 · 2 end seats = MAX 19 seats ✗ (5 short of 24)

Option 2 — Recommended: Modified U with centre spine

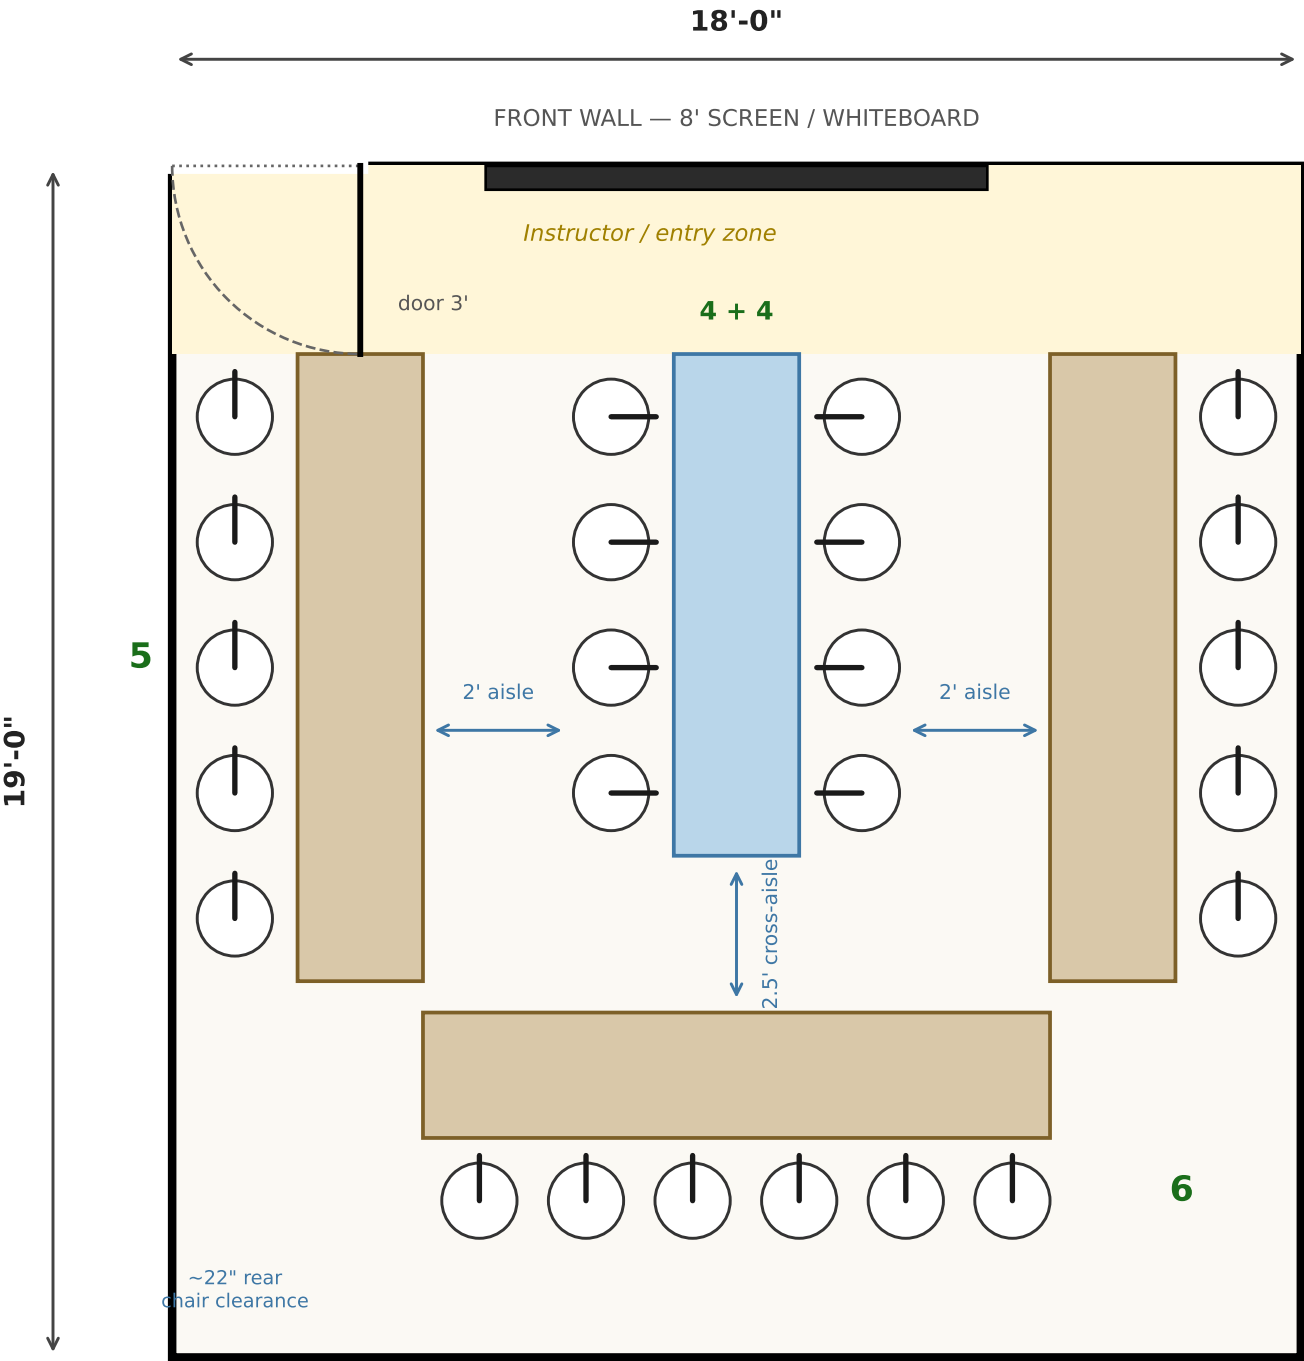

U: 16 seats + centre spine: 8 seats = 24 seats ✓ (all aisles ≥ 24")

Tables 24" deep, modular (6'x2' / 4'x2') · seat pitch 24" (back row 20") · cut list: 3x (6'x2') + 5x (4'x2') · 24 task chairs · scale 1 unit = 1 ft

Tip: put the spine table on casters — wheel it aside in minutes to convert to a pure U for presentations (16 seats).

Training Lab 18' x 19' (342 sq ft) - Seating for 24 - Design Notes

Companion drawing on page 1 (scale 1 unit = 1 ft; screen wall at top).

1. Why a pure U / C shape cannot seat 24

Usable U-perimeter with 24" tables, 24" seat pitch, $\geq 24"$ clearances:

left arm 12 ft = 6 | right arm 12 ft = 6 | back 10 ft = 5 | end seats = 2

=> pure-U maximum = 19 seats. Five short, with dead floor in the middle.

The open centre of the U is the wasted asset this design recovers.

2. Recommended layout: Modified U with centre spine (24 seats)

Outer U (16): left arm 5 + right arm 5 (24" pitch) + back row 6 (20" pitch).

Centre spine (8): one 8 ft table on the room centreline, 4 + 4 facing each other.

Front wall: 8 ft screen/whiteboard, 3 ft instructor/entry zone.

Entry: 3 ft door, front-left corner, swings into the instructor zone.

3. Clearances (all pass)

Side aisles (U arms <-> spine): 24" each.

Cross-aisle (back row <-> spine): 30".

Rear chair clearance behind back row: ~22".

Front instructor/entry zone: 36".

4. Furniture cut list

3 x (6' x 2') table tops + 5 x (4' x 2') table tops (modular).

Arms = 6'+4' each; back = 6'+4'; spine = 4'+4'.

24 task chairs (+1 spare recommended); spine on locking casters.

Castor tip: wheel the spine aside for a pure-U presentation mode (16 seats).

5. Services & safety

Power/data: under-spine floor box or overhead bus; ≥ 24 outlets on 2 circuits.

24 people in 342 sq ft = ~14 sq ft/person: verify cooling/ventilation.

Confirm door width, egress and aisle minima against local fire/occupancy code.

6. Variant if all 24 must face the screen

Replace the spine with two straight 8 ft rows of 4 inside the U (16+8=24).

Every seat faces the screen, but inter-row aisles shrink to ~18".