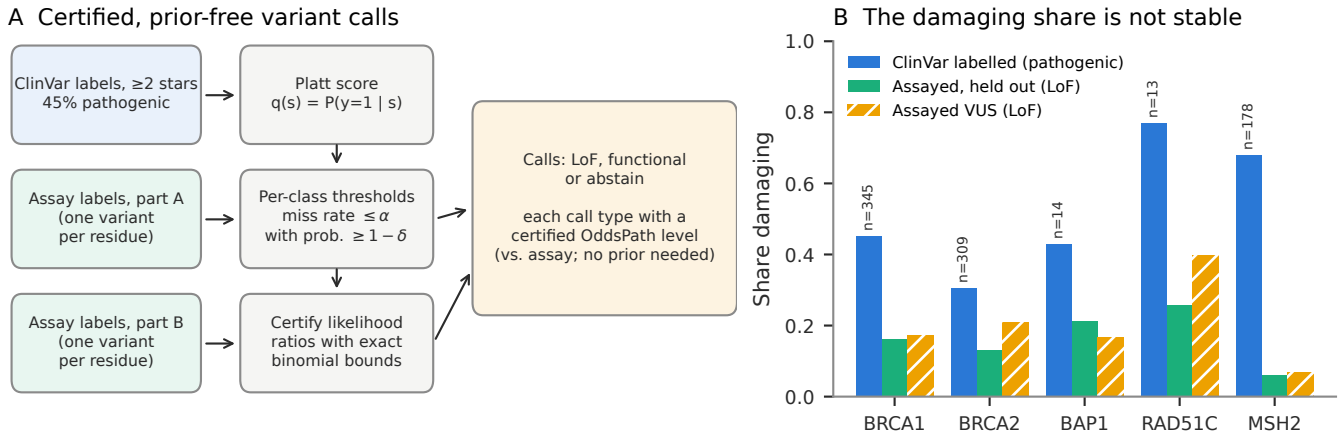
A Certified, prior-free variant calls
ClinVar labels, ≥2 stars
45% pathogenic
Platt score
q(s) = P(y=1 | s)
Assay labels, part A
(one variant
per residue)
Per-class thresholds
miss rate ≤ α
with prob. ≥ 1 − δ
Assay labels, part B
(one variant
per residue)
Certify likelihood
ratios with exact
binomial bounds
Calls: LoF, functional
or abstain
each call type with a
certified OddsPath level
(vs. assay; no prior needed)
B The damaging share is not stable
Share damaging
1.0
0.8
0.6
0.4
0.2
0.0
ClinVar labelled (pathogenic)
Assayed, held out (LoF)
Assayed VUS (LoF)
n=345
n=309
n=14
n=13
n=178
BRCA1
BRCA2
BAP1
RAD51C
MSH2