
RSLogix Micro Project Report

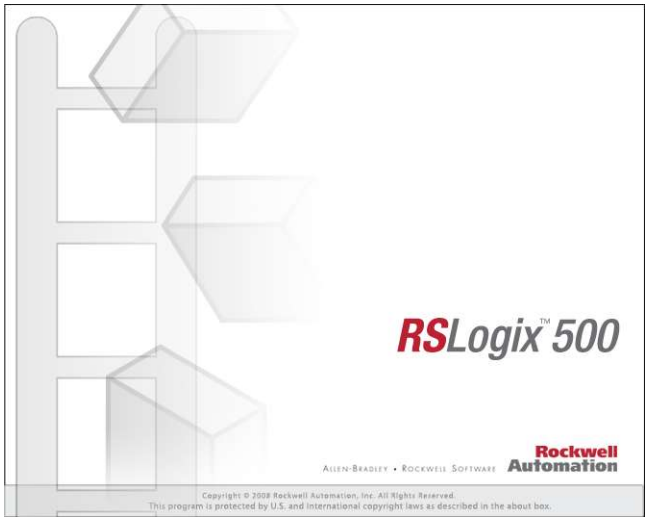

Processor Information

Processor Type: Bul.1763 MicroLogix 1100 Series B

Processor Name: UNTITLED

Total Memory Used: 261 Instruction Words Used - 53 Data Table Words Used

Total Memory Left: 6395 Instruction Words Left

Program Files: 7

Data Files: 9

Program ID: 41f5

I/O Configuration

0	Bul.1763	MicroLogix 1100 Series B
1		
2		
3		
4		

Channel Configuration

CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex
   CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Edit Resource/Owner Timeout: 60
   CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Passthru Link ID: 1
   CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Write Protected: No
   CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Comms Servicing Selection: Yes
   CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Message Servicing Selection: Yes
   CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex 1st AWA Append Character: \d
   CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex 2nd AWA Append Character: \a

   Source ID: 1 (decimal)
   Baud: 19200
   Parity: NONE
   Control Line : No Handshaking
   Error Detection: CRC
   Embedded Responses: Auto Detect
   Duplicate Packet Detect: Yes
   ACK Timeout(x20 ms): 50
   NAK Retries: 3
   ENQ Retries: 3

CHANNEL 1 (SYSTEM) - Driver: Ethernet
   CHANNEL 1 (SYSTEM) - Driver: Ethernet Edit Resource/Owner Timeout: 60
   CHANNEL 1 (SYSTEM) - Driver: Ethernet Passthru Link ID: 1
   CHANNEL 1 (SYSTEM) - Driver: Ethernet Write Protected: No
   CHANNEL 1 (SYSTEM) - Driver: Ethernet Comms Servicing Selection: Yes
   CHANNEL 1 (SYSTEM) - Driver: Ethernet Message Servicing Selection: Yes

   Hardware Address: 00:00:00:00:00:00
   IP Address: 0.0.0.0
   Subnet Mask: 0.0.0.0
   Gateway Address: 0.0.0.0
   Msg Connection Timeout (x 1mS): 15000
   Msg Reply Timeout (x mS): 3000
   Inactivity Timeout (x Min): 30
   Bootp Enable: Yes
   Dhcp Enable No
   SNMP Enable: No
   HTTP Enable: Yes
   Auto Negotiate Enable: Yes
   Port Speed Enable: 10/100 Mbps Full Duplex/Half Duplex
   Contact:
   Location:


Program File List


Name	Number	Type	Rungs	Debug	Bytes
[SYSTEM]	0	SYS	0	No	0
	1	SYS	0	No	0
MAIN	2	LADDER	5	No	39
IO	3	LADDER	11	No	246
CONTROLS	4	LADDER	8	No	194
ALARM	5	LADDER	9	No	253
CONDITIONS	6	LADDER	7	No	226

Data File List


Name	Number	Type	Scope	Debug	Words	Elements	Last
OUTPUT	0	O	Global	No	12	4	O:3
INPUT	1	I	Global	No	18	6	I:5
STATUS	2	S	Global	No	0	66	S:65
BINARY	3	B	Global	No	2	2	B3:1
TIMER	4	T	Global	No	9	3	T4:2
COUNTER	5	C	Global	No	3	1	C5:0
CONTROL	6	R	Global	No	3	1	R6:0
INTEGER	7	N	Global	No	4	4	N7:3
FLOAT	8	F	Global	No	2	1	F8:0

LAD 2 - MAIN --- Total Rungs in File = 5

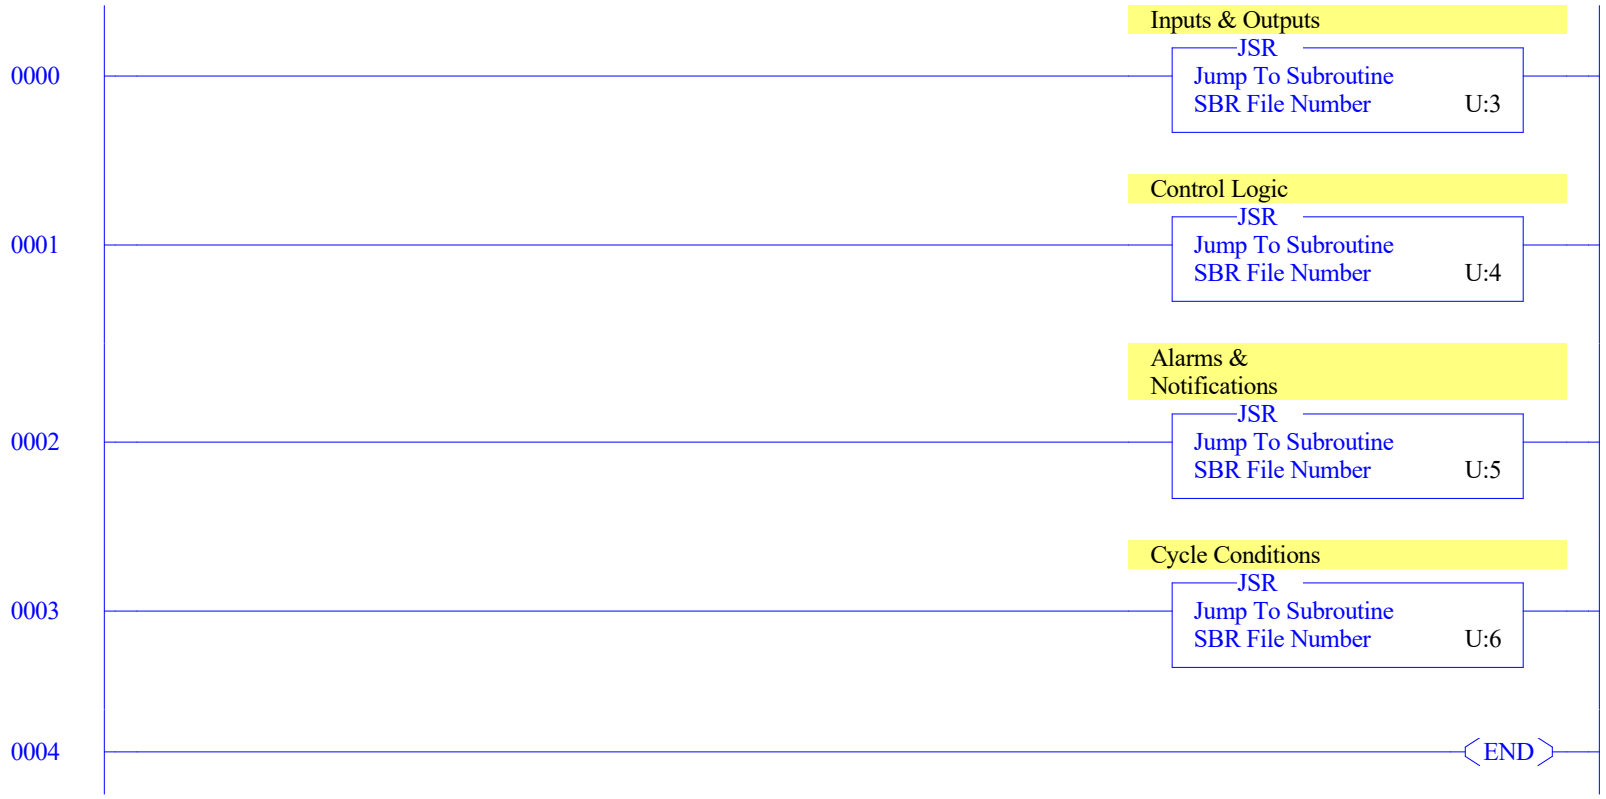


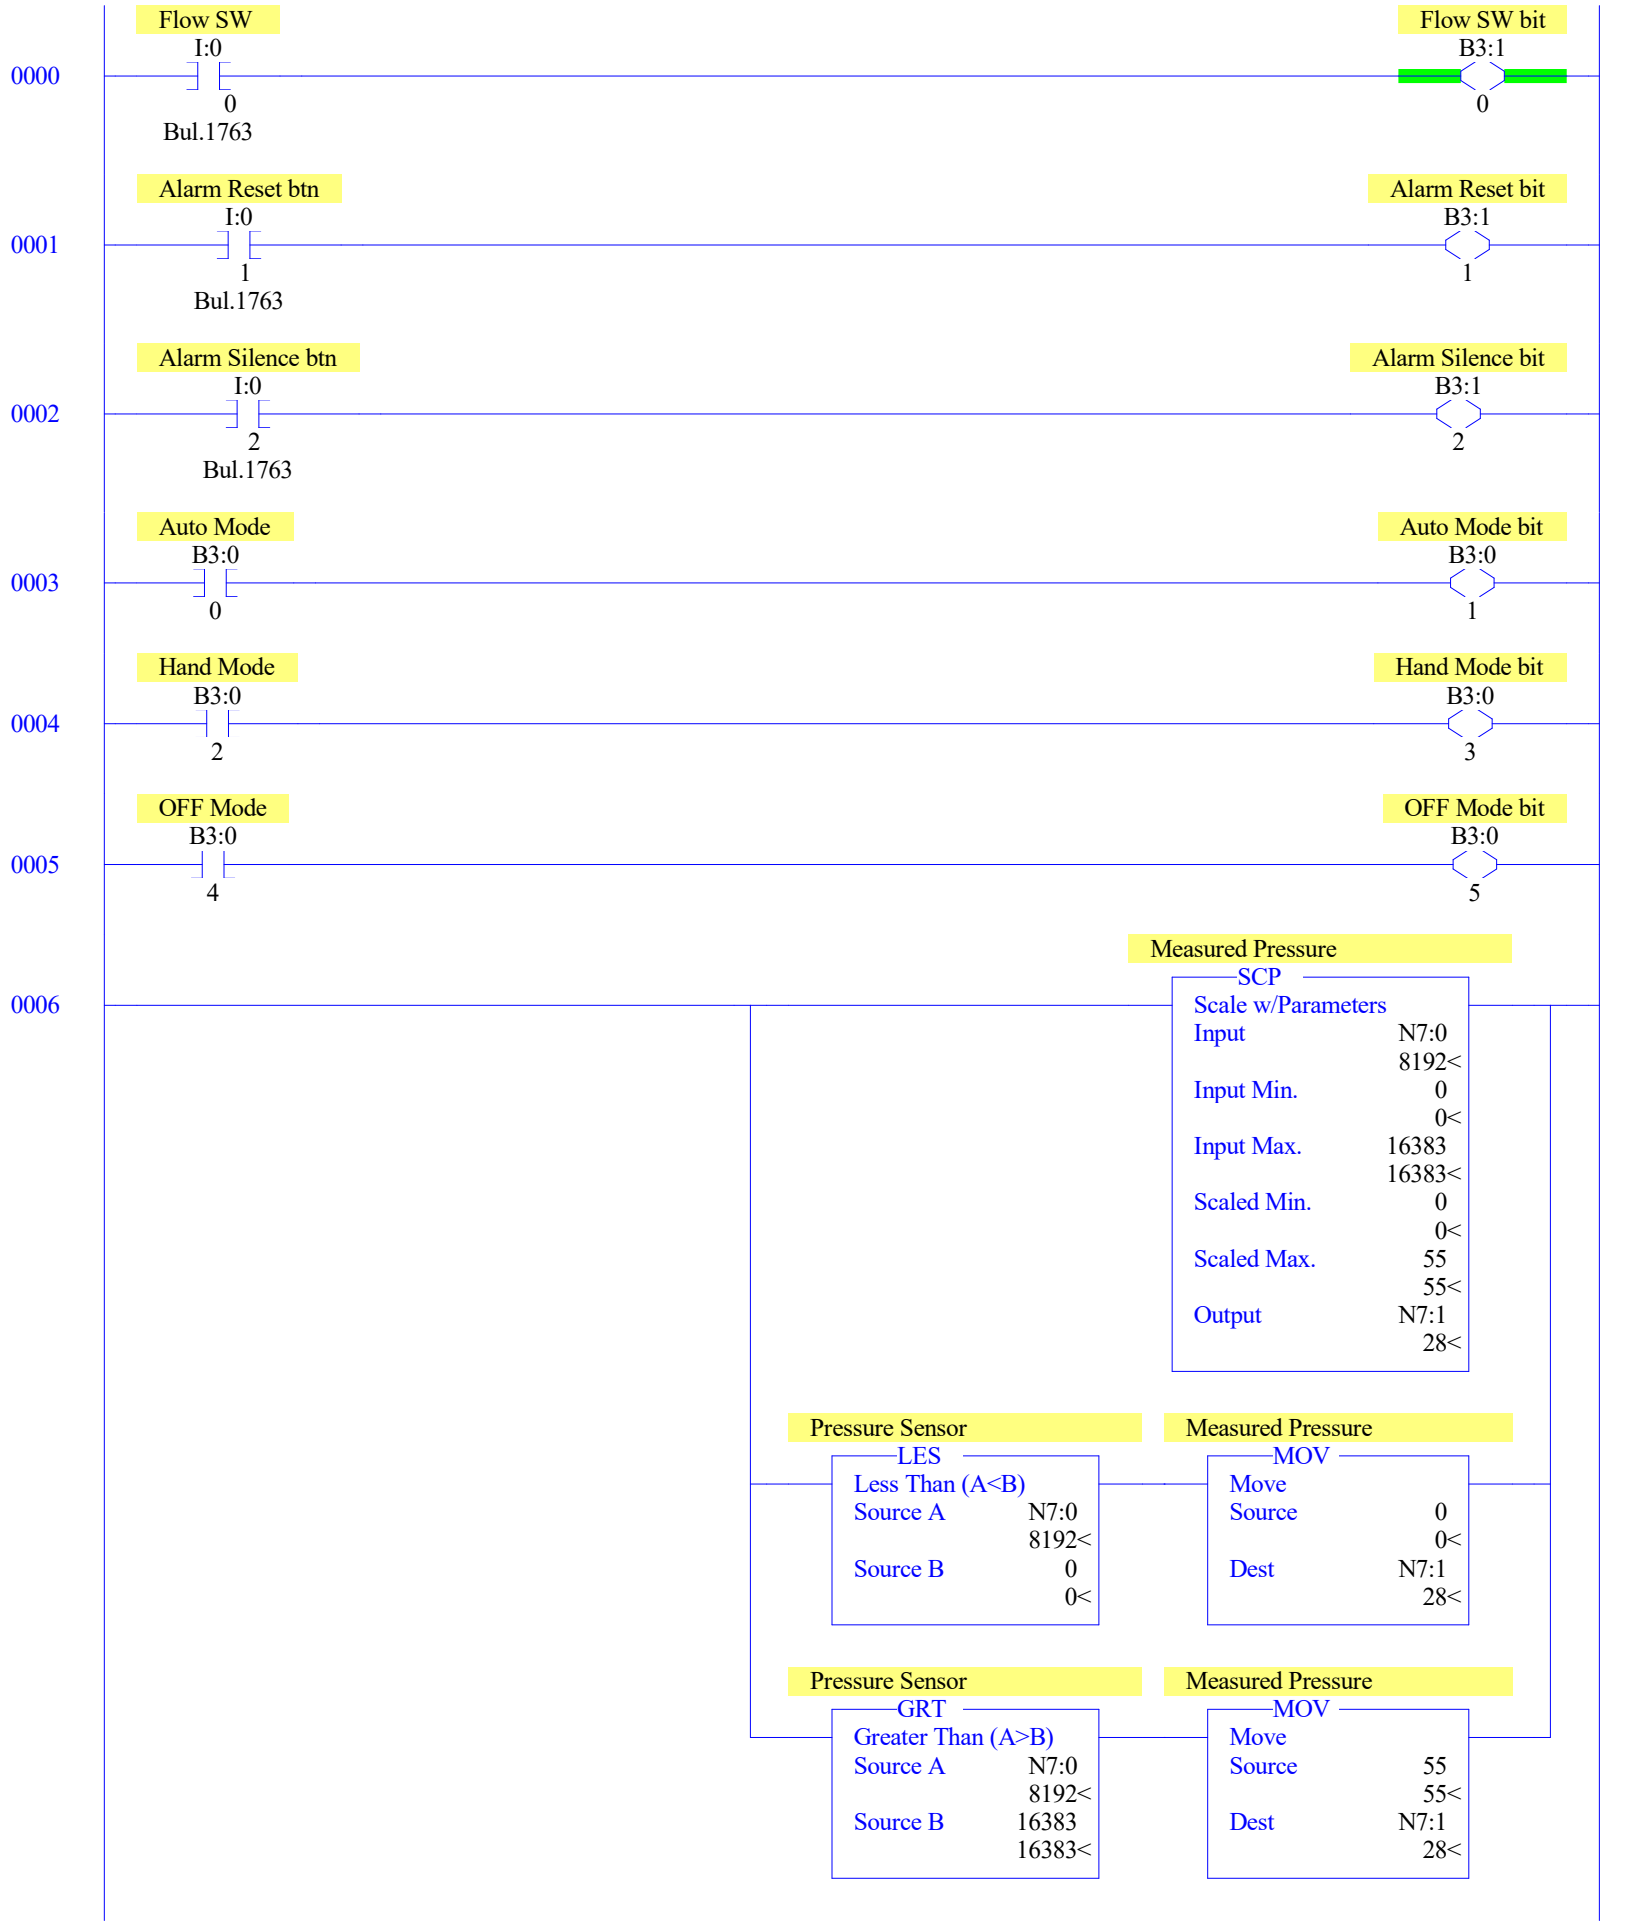
0000
Flow SW
I:0
0
Bul.1763
Flow SW bit
B3:1
0
0001
Alarm Reset btn
I:0
1
Bul.1763
Alarm Reset bit
B3:1
1
0002
Alarm Silence btn
I:0
2
Bul.1763
Alarm Silence bit
B3:1
2
0003
Auto Mode
B3:0
0
Auto Mode bit
B3:0
1
0004
Hand Mode
B3:0
2
Hand Mode bit
B3:0
3
0005
OFF Mode
B3:0
4
OFF Mode bit
B3:0
5
0006
Measured Pressure
SCP
Scale w/Parameters
Input N7:0 8192<
Input Min. 0 0<
Input Max. 16383 16383<
Scaled Min. 0 0<
Scaled Max. 55 55<
Output N7:1 28<
Pressure Sensor
LES
Less Than (A<B)
Source A N7:0 8192<
Source B 0 0<
Measured Pressure
MOV
Move
Source 0 0<
Dest N7:1 28<
Pressure Sensor
GRT
Greater Than (A>B)
Source A N7:0 8192<
Source B 16383 16383<
Measured Pressure
MOV
Move
Source 55 55<
Dest N7:1 28<



Pump bit
B3:0
6
Pump
O:0
0
Bul.1763
0007
Flow Alarm Notification
B3:0
14
Flow Fault Indicator bit
O:0
1
Bul.1763
0008
Pressure Alarm Notification
B3:1
10
Pressure Fault Indicator
O:0
2
Bul.1763
0009
0010
END

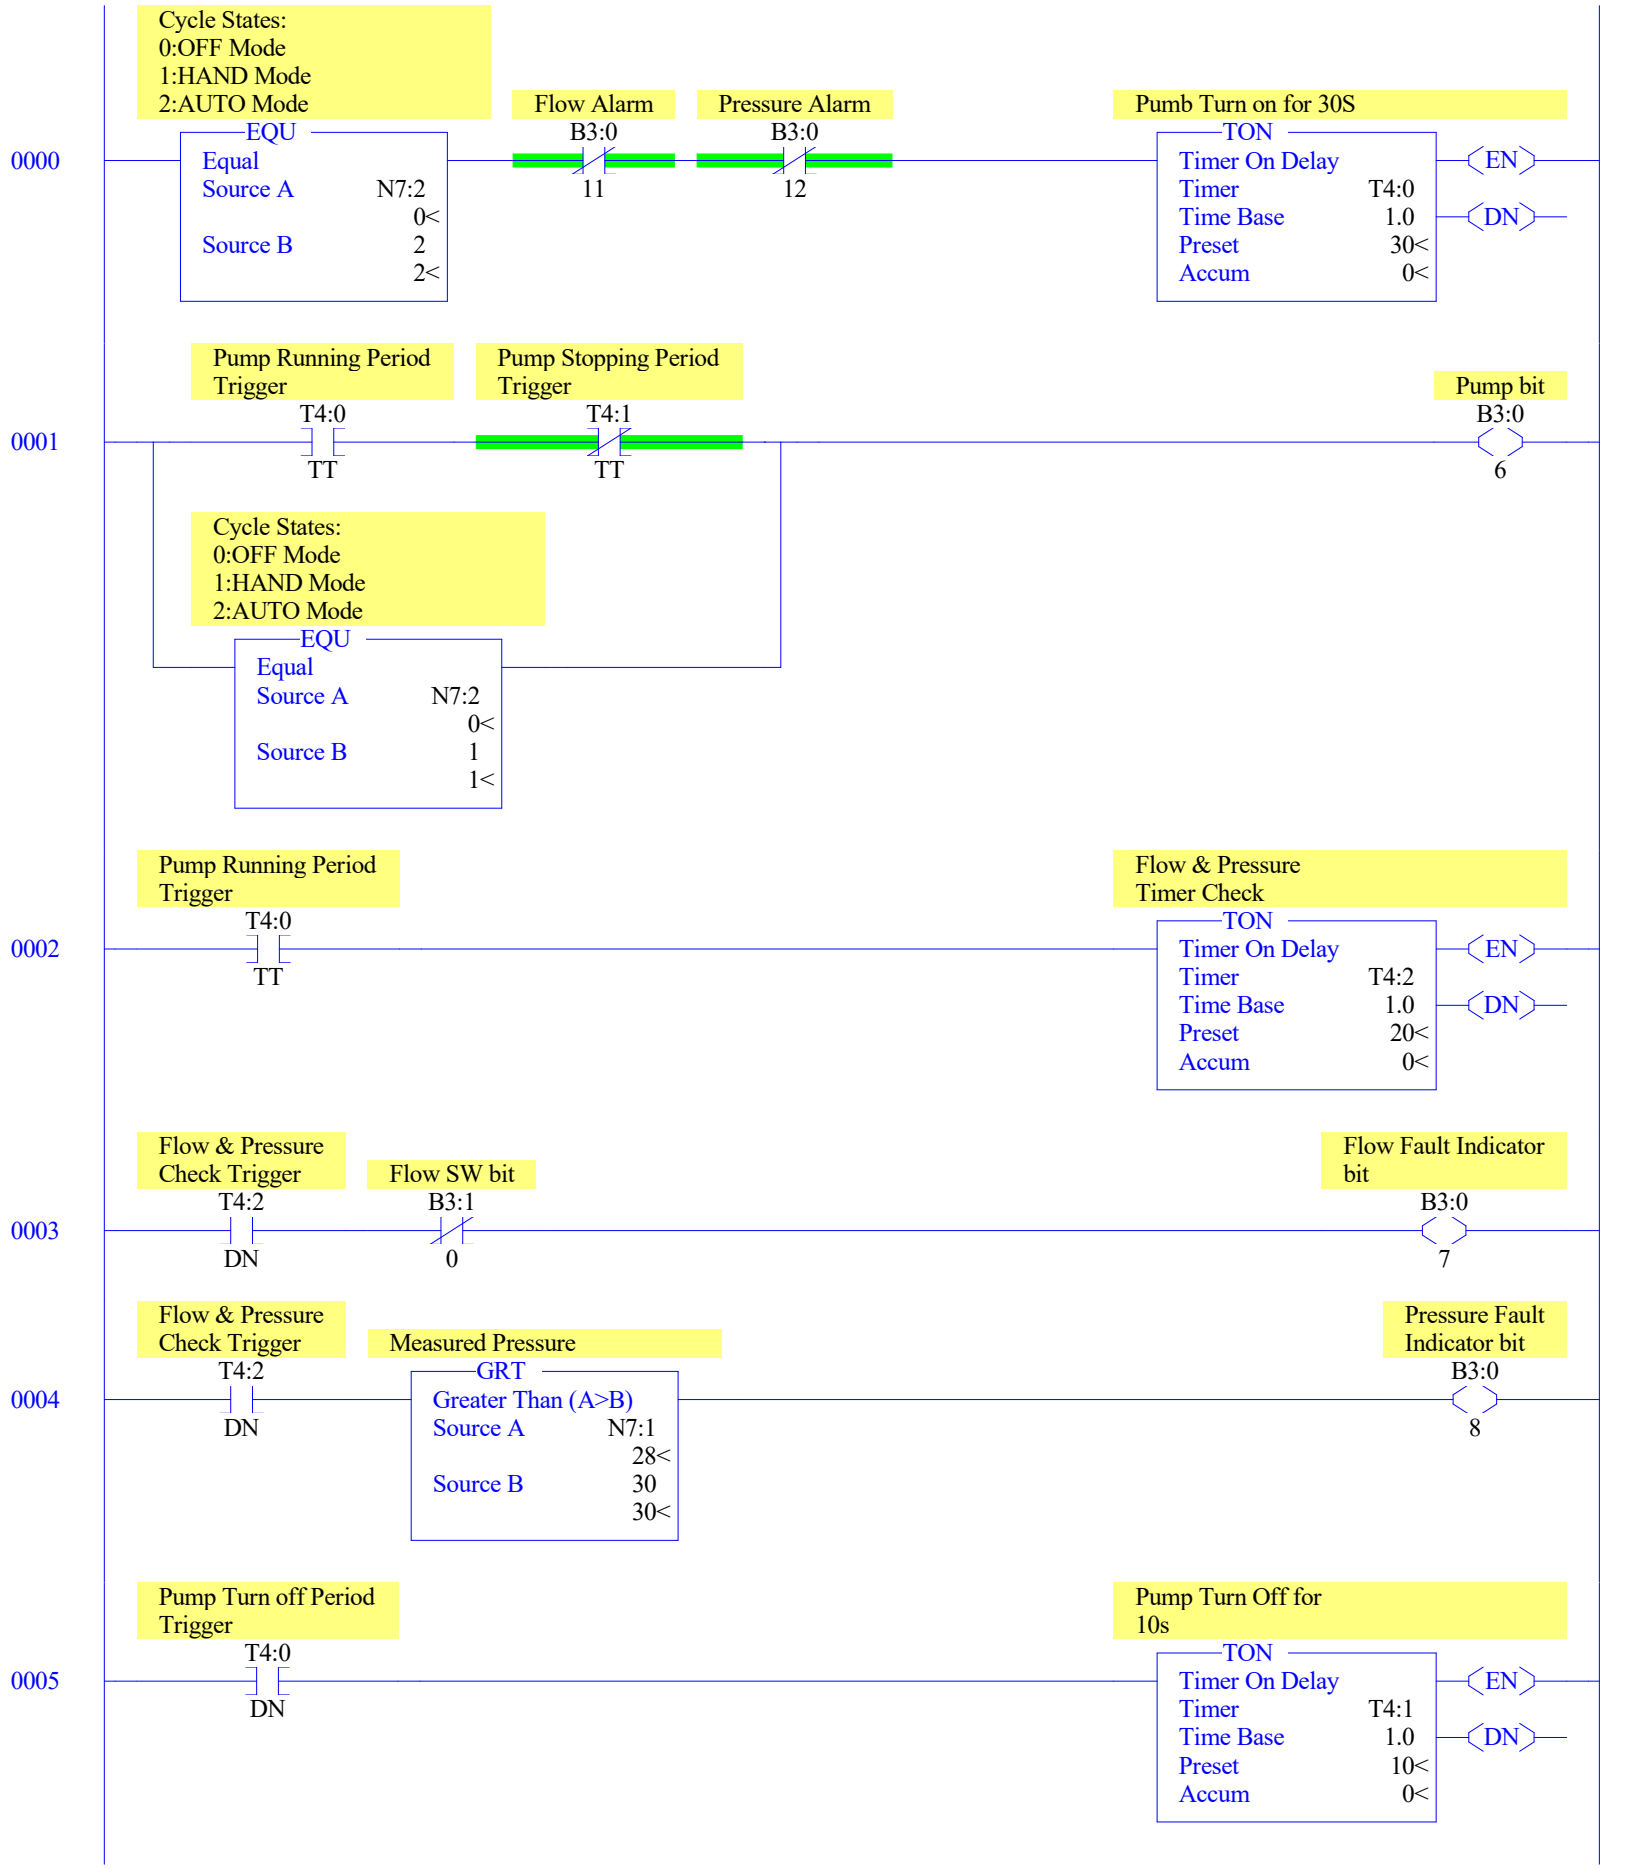
Cycle States:
0:OFF Mode
1:HAND Mode
2:AUTO Mode
Flow Alarm
B3:0
11
Pressure Alarm
B3:0
12
Pumb Turn on for 30S
0000
EQU
Equal
Source A N7:2 0<
Source B 2 2<
TON
Timer On Delay
Timer T4:0
Time Base 1.0
Preset 30<
Accum 0<
EN
DN
Pump Running Period Trigger
T4:0
TT
Pump Stopping Period Trigger
T4:1
TT
Pump bit
B3:0
6
0001
Cycle States:
0:OFF Mode
1:HAND Mode
2:AUTO Mode
EQU
Equal
Source A N7:2 0<
Source B 1 1<
Pump Running Period Trigger
T4:0
TT
Flow & Pressure Timer Check
0002
TON
Timer On Delay
Timer T4:2
Time Base 1.0
Preset 20<
Accum 0<
EN
DN
Flow & Pressure Check Trigger
T4:2
DN
Flow SW bit
B3:1
0
Flow Fault Indicator bit
B3:0
7
0003
Flow & Pressure Check Trigger
T4:2
DN
Measured Pressure
GRT
Greater Than (A>B)
Source A N7:1 28<
Source B 30 30<
Pressure Fault Indicator bit
B3:0
8
0004
Pump Turn off Period Trigger
T4:0
DN
Pump Turn Off for 10s
TON
Timer On Delay
Timer T4:1
Time Base 1.0
Preset 10<
Accum 0<
EN
DN
0005


LAD 4 - CONTROLS --- Total Rungs in File = 8

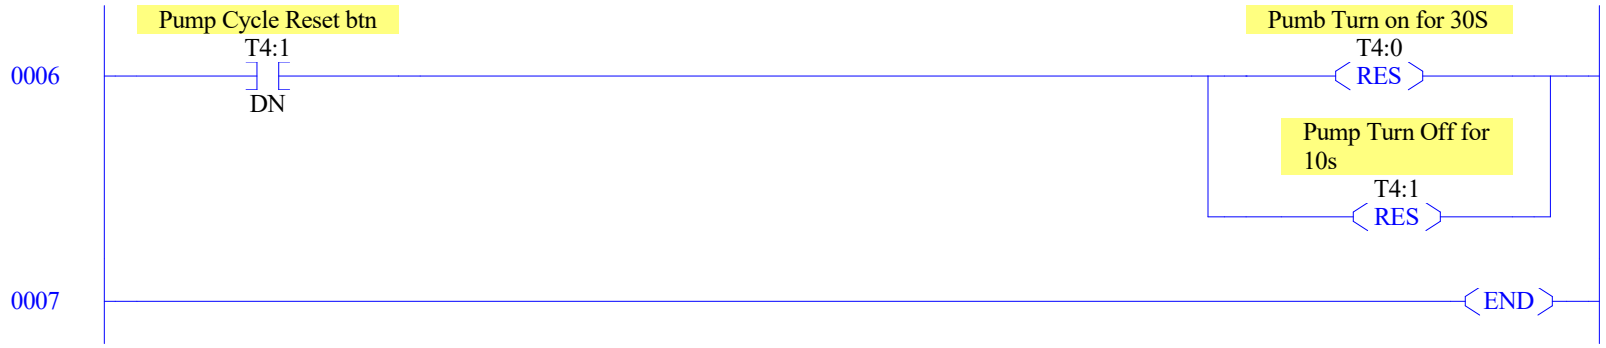



LAD 5 - ALARM --- Total Rungs in File = 9

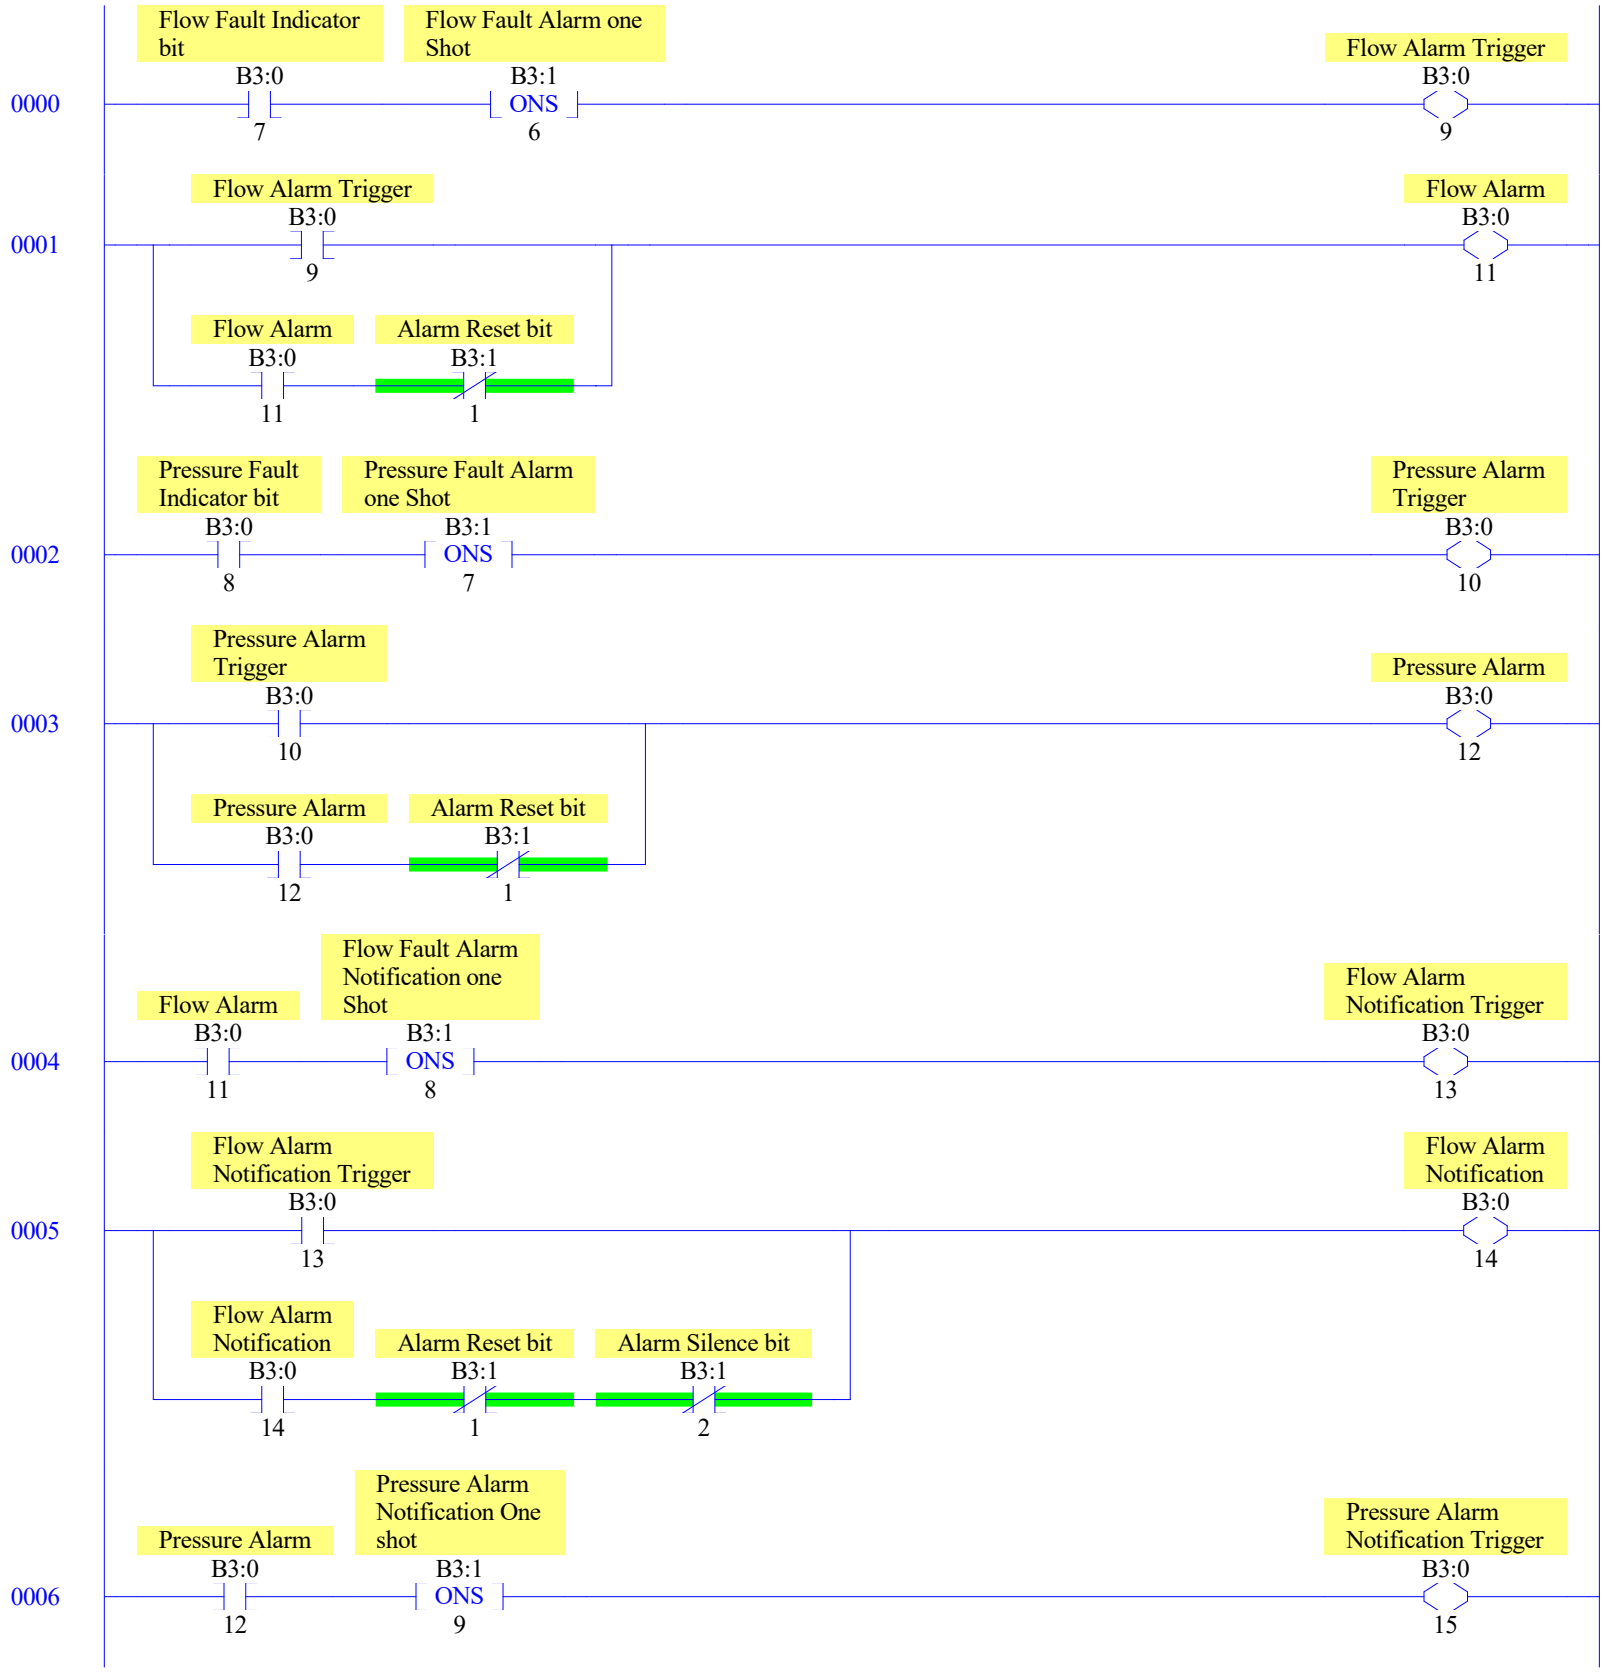

LAD 5 - ALARM --- Total Rungs in File = 9

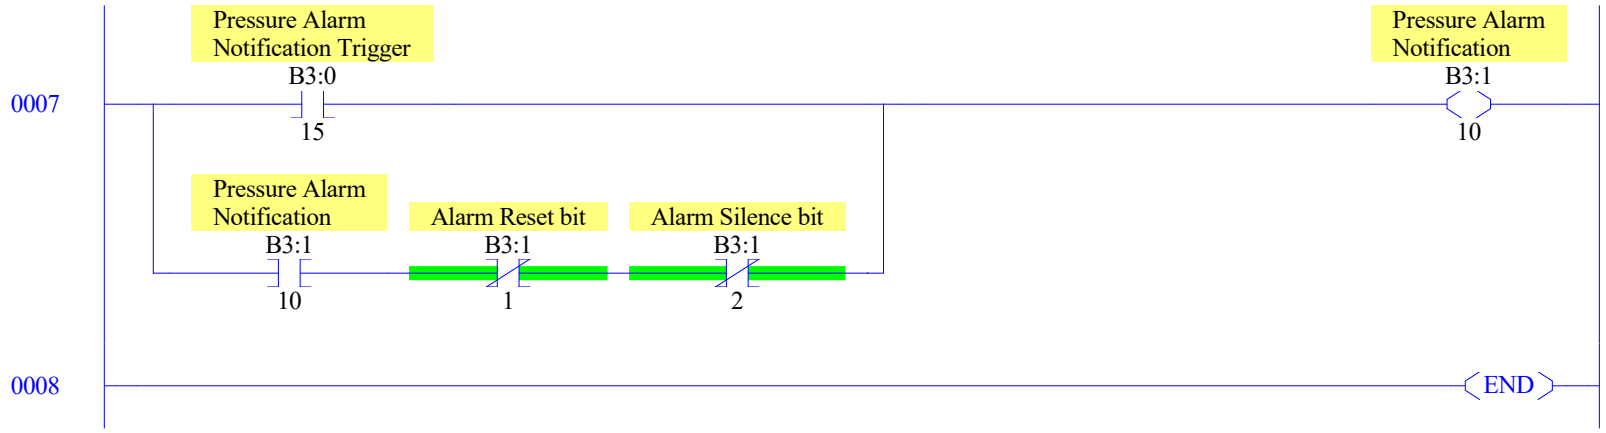

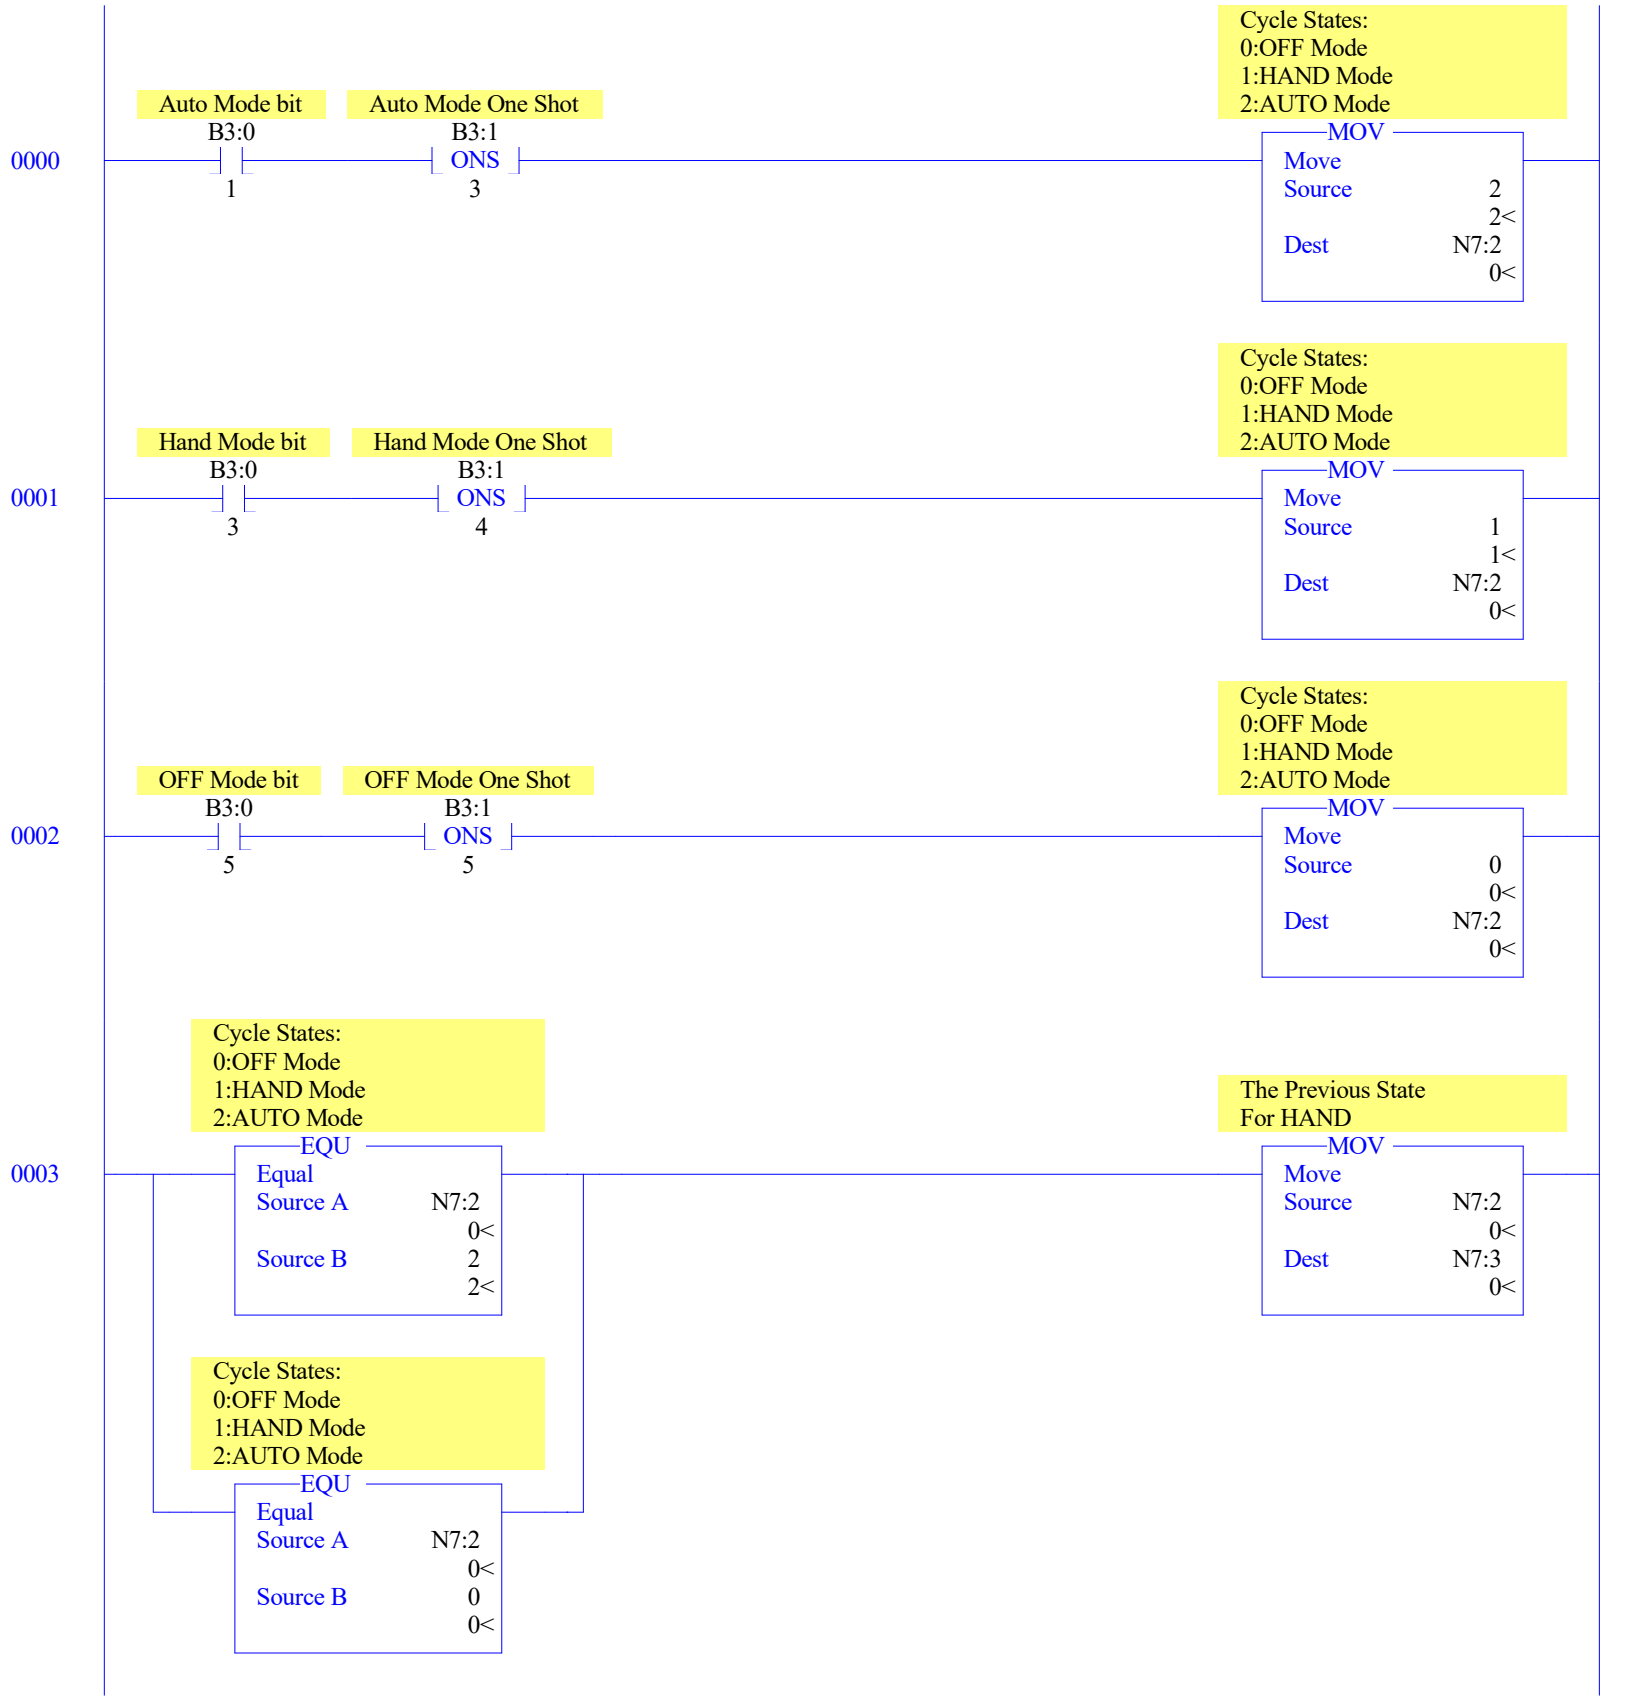
0000
Auto Mode bit
B3:0
1
Auto Mode One Shot
B3:1
ONS
3
Cycle States:
0:OFF Mode
1:HAND Mode
2:AUTO Mode
MOV
Move
Source 2
2<
Dest N7:2
0<
0001
Hand Mode bit
B3:0
3
Hand Mode One Shot
B3:1
ONS
4
Cycle States:
0:OFF Mode
1:HAND Mode
2:AUTO Mode
MOV
Move
Source 1
1<
Dest N7:2
0<
0002
OFF Mode bit
B3:0
5
OFF Mode One Shot
B3:1
ONS
5
Cycle States:
0:OFF Mode
1:HAND Mode
2:AUTO Mode
MOV
Move
Source 0
0<
Dest N7:2
0<
0003
Cycle States:
0:OFF Mode
1:HAND Mode
2:AUTO Mode
EQU
Equal
Source A N7:2
0<
Source B 2
2<
The Previous State
For HAND
MOV
Move
Source N7:2
0<
Dest N7:3
0<
Cycle States:
0:OFF Mode
1:HAND Mode
2:AUTO Mode
EQU
Equal
Source A N7:2
0<
Source B 0
0<

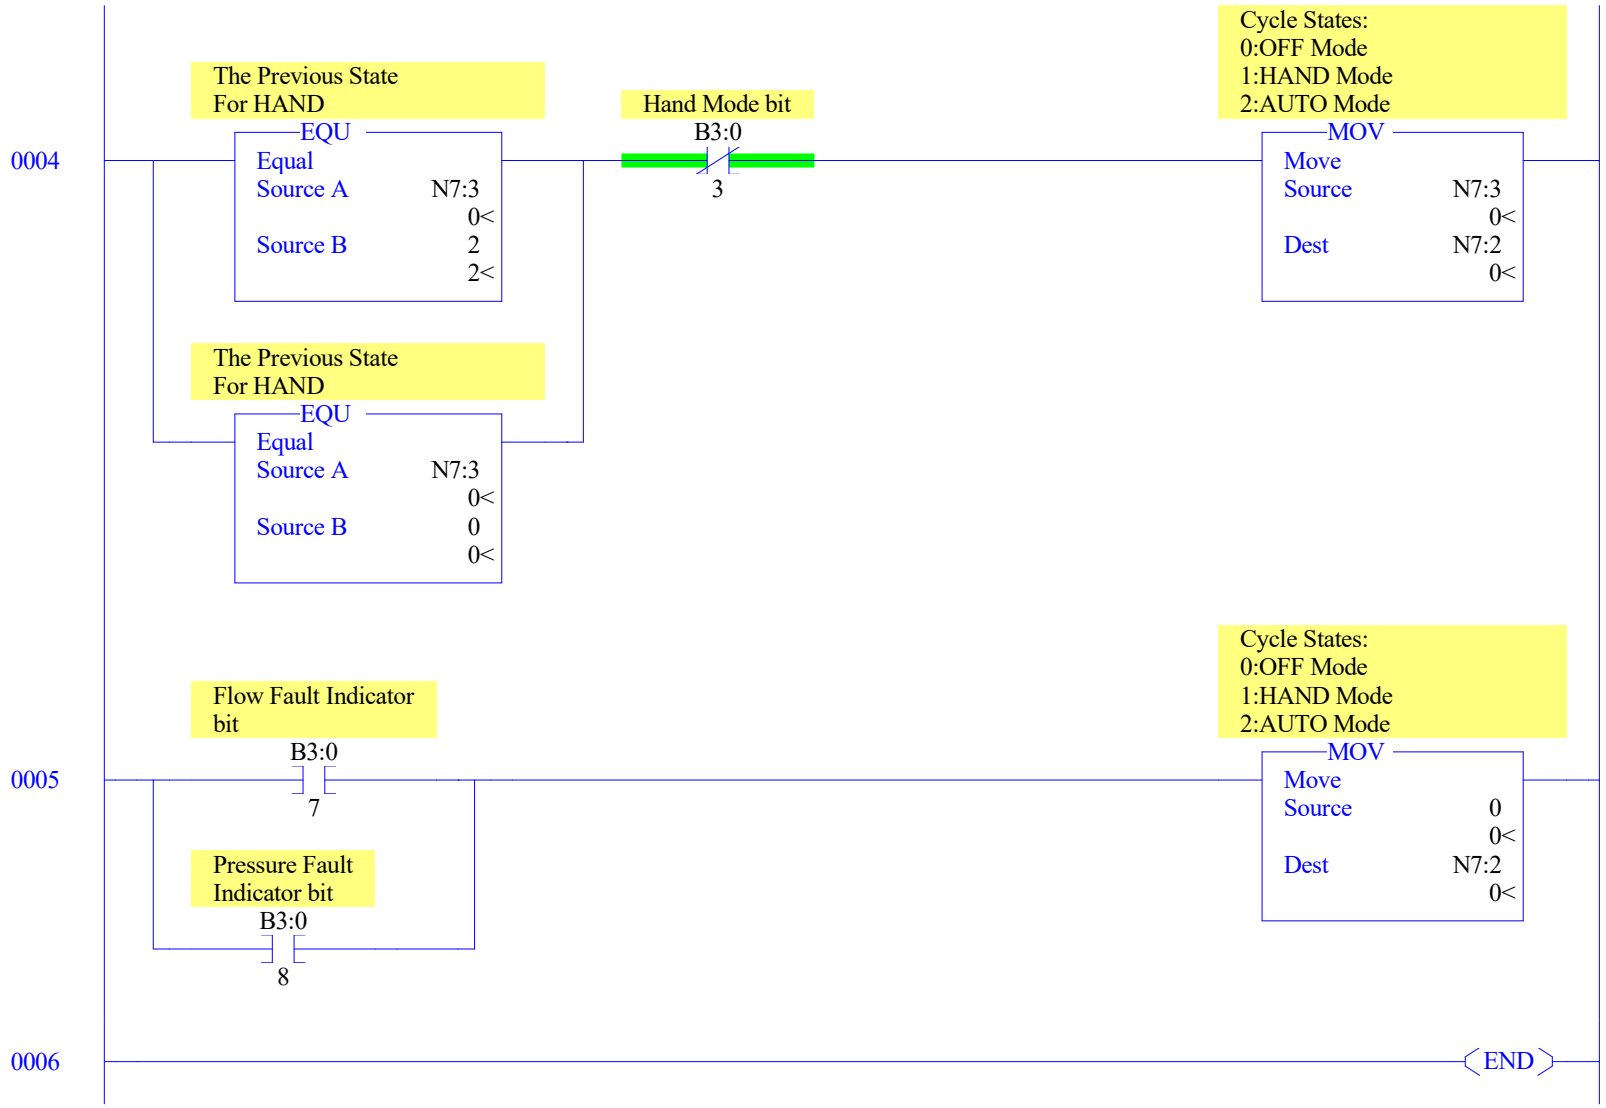
Cycle States:
0:OFF Mode
1:HAND Mode
2:AUTO Mode
The Previous State
For HAND
Hand Mode bit
B3:0
3
EQU
Equal
Source A N7:3
0<
Source B 2
2<
MOV
Move
Source N7:3
0<
Dest N7:2
0<
The Previous State
For HAND
EQU
Equal
Source A N7:3
0<
Source B 0
0<
0004
Cycle States:
0:OFF Mode
1:HAND Mode
2:AUTO Mode
Flow Fault Indicator
bit
B3:0
7
Pressure Fault
Indicator bit
B3:0
8
MOV
Move
Source 0
0<
Dest N7:2
0<
0005
0006
END

Data File O0 (bin) -- OUTPUT

Offset	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0		
O:0.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
O:0.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
O:0.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
O:0.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B

Data File I1 (bin) -- INPUT

Offset	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0		
I:0.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
I:0.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
I:0.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
I:0.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
I:0.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B-Analog
I:0.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B-Analog

Data File S2 (hex) -- STATUS

Main

Processor Mode S:1/0 - S:1/4 = Remote Run
On Power up Go To Run (Mode Behavior) S:1/12 = 0
First Pass S:1/15 = No
Free Running Clock S:4 = 0000-0000-0000-0000

Proc

OS Catalog Number S:57 = 1100
OS Series S:58 = A
OS FRS S:59 =
Processor Catalog Number S:60 =
Processor Series S:61 = A
Processor FRN S:62 =
User Program Type S:63 = 8001h
Compiler Revision Number S:64 =

Scan Times

Maximum (x10 ms) S:22 = 0
Watchdog (x10 ms) S:3 (high byte) = 10
Last 100 uSec Scan Time S:35 = 0
Scan Toggle Bit S:33/9 = 0

Math

Math Overflow Selected S:2/14 = 0
Overflow Trap S:5/0 = 0
Carry S:0/0 = 0
Overflow S:0/1 = 0
Zero Bit S:0/2 = 0
Sign Bit S:0/3 = 0
Math Register (lo word) S:13 = 0
Math Register (high word) S:14-S:13 = 0
Math Register (32 Bit) S:14-S:13 = 0

Chan 0

Processor Mode S:1/0- S:1/4 = Remote Run
Node Address S:15 (low byte) = 0
Baud Rate S:15 (high byte) = ?
Channel Mode S:33/3 = 0
Comms Active S:33/4 = 0
Incoming Cmd Pending S:33/0 = 0
Msg Reply Pending S:33/1 = 0
Outgoing Msg Cmd Pending S:33/2 = 0

Debug

Suspend Code S:7 = 0
Suspend File S:8 = 0

Errors

Fault Override At Power Up S:1/8 = 0
Startup Protection Fault S:1/9 = 0
Major Error Halt S:1/13 = 0
Overflow Trap S:5/0 = 0
Control Register Error S:5/2 = 0
Major Error Executing User Fault Rtn. S:5/3 = 0
Battery Low S:5/11 = 0
Input Filter Selection Modified S:5/13 = 0
ASCII String Manipulation error S:5/15 = 0
Fault Routine S:29 = 0
Major Error S:6 = 0h
Error Description:

Protection

Deny Future Access S:1/14 = No
Data File Overwrite Protection Lost S:36/10 = False

Mem Module

Memory Module Loaded On Boot S:5/8 = 0
Password Mismatch S:5/9 = 0
Load Memory Module On Memory Error S:1/10 = 0
Load Memory Module Always S:1/11 = 0
On Power up Go To Run (Mode Behavior) S:1/12 = 0
Program Compare S:2/9 = 0
Data File Overwrite Protection Lost S:36/10 = 0

Forces

Forces Enabled S:1/5 = Yes
Forces Installed S:1/6 = No

Data File B3 (bin) -- BINARY

Offset	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	(Symbol) Description
B3:0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
B3:1	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	1	

Data File T4 -- TIMER

Offset	EN	TT	DN	BASE	PRE	ACC	(Symbol) Description
T4:0	0	0	0	1.0 sec	30	0	Pumb Turn on for 30S
T4:1	0	0	0	1.0 sec	10	0	Pump Turn Off for 10s
T4:2	0	0	0	1.0 sec	20	0	Flow & Pressure Timer Check

Data File C5 -- COUNTER

Offset	CU	CD	DN	OV	UN	UA	PRE	ACC	(Symbol)	Description
C5:0	0	0	0	0	0	0	0	0		

Data File R6 -- CONTROL

Offset	EN	EU	DN	EM	ER	UL	IN	FD	LEN	POS	(Symbol)	Description
R6:0	0	0	0	0	0	0	0	0	0	0		

Data File N7 (dec) -- INTEGER

Offset	0	1	2	3	4	5	6	7	8	9
N7:0	8192	28	0	0						

Data File F8 -- FLOAT

Offset	0	1	2	3	4
F8:0	0				

Address/Symbol Database

Address	Symbol	Scope	Description	Sym Group	Dev. Code	ABV	BLW
B3:0/0			Auto Mode				
B3:0/1			Auto Mode bit				
B3:0/2			Hand Mode				
B3:0/3			Hand Mode bit				
B3:0/4			OFF Mode				
B3:0/5			OFF Mode bit				
B3:0/6			Pump bit				
B3:0/7			Flow Fault Indicator bit				
B3:0/8			Pressure Fault Indicator bit				
B3:0/9			Flow Alarm Trigger				
B3:0/10			Pressure Alarm Trigger				
B3:0/11			Flow Alarm				
B3:0/12			Pressure Alarm				
B3:0/13			Flow Alarm Notification Trigger				
B3:0/14			Flow Alarm Notification				
B3:0/15			Pressure Alarm Notification Trigger				
B3:1/0			Flow SW bit				
B3:1/1			Alarm Reset bit				
B3:1/2			Alarm Silence bit				
B3:1/3			Auto Mode One Shot				
B3:1/4			Hand Mode One Shot				
B3:1/5			OFF Mode One Shot				
B3:1/6			Flow Fault Alarm one Shot				
B3:1/7			Pressure Fault Alarm one Shot				
B3:1/8			Flow Fault Alarm Notification one Shot				
B3:1/9			Pressure Alarm Notification One shot				
B3:1/10			Pressure Alarm Notification				
B3:7			Flow Fault Indicator bit				
I:0/0			Flow SW				
I:0/1			Alarm Reset btn				
I:0/2			Alarm Silence btn				
N7:0			Pressure Sensor				
N7:1			Measured Pressure				
N7:2			Cycle States: 0:OFF Mode 1:HAND Mode 2:AUTO Mode				
N7:3			The Previous State For HAND				
O:0/0			Pump				
O:0/1			Flow Fault Indicator bit				
O:0/2			Pressure Fault Indicator				
S:0			Arithmetic Flags				
S:0/0			Processor Arithmetic Carry Flag				
S:0/1			Processor Arithmetic Underflow/ Overflow Flag				
S:0/2			Processor Arithmetic Zero Flag				
S:0/3			Processor Arithmetic Sign Flag				
S:1			Processor Mode Status/ Control				
S:1/0			Processor Mode Bit 0				
S:1/1			Processor Mode Bit 1				
S:1/2			Processor Mode Bit 2				
S:1/3			Processor Mode Bit 3				
S:1/4			Processor Mode Bit 4				
S:1/5			Forces Enabled				
S:1/6			Forces Present				
S:1/7			Comms Active				
S:1/8			Fault Override at Powerup				
S:1/9			Startup Protection Fault				
S:1/10			Load Memory Module on Memory Error				
S:1/11			Load Memory Module Always				
S:1/12			Load Memory Module and RUN				
S:1/13			Major Error Halted				
S:1/14			Access Denied				
S:1/15			First Pass				
S:2/0			STI Pending				
S:2/1			STI Enabled				
S:2/2			STI Executing				
S:2/3			Index Addressing File Range				
S:2/4			Saved with Debug Single Step				
S:2/5			DH-485 Incoming Command Pending				
S:2/6			DH-485 Message Reply Pending				
S:2/7			DH-485 Outgoing Message Command Pending				
S:2/15			Comms Servicing Selection				
S:3			Current Scan Time/ Watchdog Scan Time				
S:4			Time Base				
S:5/0			Overflow Trap				
S:5/2			Control Register Error				
S:5/3			Major Err Detected Executing UserFault Routine				
S:5/4			M0-M1 Referenced on Disabled Slot				
S:5/8			Memory Module Boot				
S:5/9			Memory Module Password Mismatch				
S:5/10			STI Overflow				
S:5/11			Battery Low				
S:6			Major Error Fault Code				
S:7			Suspend Code				
S:8			Suspend File				
S:9			Active Nodes				
S:10			Active Nodes				

Address/Symbol Database

Address	Symbol	Scope	Description	Sym Group	Dev. Code	ABV	BLW
S:11			I/O Slot Enables				
S:12			I/O Slot Enables				
S:13			Math Register				
S:14			Math Register				
S:15			Node Address/ Baud Rate				
S:16			Debug Single Step Rung				
S:17			Debug Single Step File				
S:18			Debug Single Step Breakpoint Rung				
S:19			Debug Single Step Breakpoint File				
S:20			Debug Fault/ Powerdown Rung				
S:21			Debug Fault/ Powerdown File				
S:22			Maximum Observed Scan Time				
S:23			Average Scan Time				
S:24			Index Register				
S:25			I/O Interrupt Pending				
S:26			I/O Interrupt Pending				
S:27			I/O Interrupt Enabled				
S:28			I/O Interrupt Enabled				
S:29			User Fault Routine File Number				
S:30			STI Setpoint				
S:31			STI File Number				
S:32			I/O Interrupt Executing				
S:33			Extended Proc Status Control Word				
S:33/0			Incoming Command Pending				
S:33/1			Message Reply Pending				
S:33/2			Outgoing Message Command Pending				
S:33/3			Selection Status User/DF1				
S:33/4			Communicat Active				
S:33/5			Communicat Servicing Selection				
S:33/6			Message Servicing Selection Channel 0				
S:33/7			Message Servicing Selection Channel 1				
S:33/8			Interrupt Latency Control Flag				
S:33/9			Scan Toggle Flag				
S:33/10			Discrete Input Interrupt Reconfigur Flag				
S:33/11			Online Edit Status				
S:33/12			Online Edit Status				
S:33/13			Scan Time Timebase Selection				
S:33/14			DTR Control Bit				
S:33/15			DTR Force Bit				
S:34			Pass-thru Disabled				
S:34/0			Pass-Thru Disabled Flag				
S:34/1			DH+ Active Node Table Enable Flag				
S:34/2			Floating Point Math Flag Disable,Fl				
S:35			Last 1 ms Scan Time				
S:36			Extended Minor Error Bits				
S:36/8			DII Lost				
S:36/9			STI Lost				
S:36/10			Memory Module Data File Overwrite Protection				
S:37			Clock Calendar Year				
S:38			Clock Calendar Month				
S:39			Clock Calendar Day				
S:40			Clock Calendar Hours				
S:41			Clock Calendar Minutes				
S:42			Clock Calendar Seconds				
S:43			STI Interrupt Time				
S:44			I/O Event Interrupt Time				
S:45			DII Interrupt Time				
S:46			Discrete Input Interrupt- File Number				
S:47			Discrete Input Interrupt- Slot Number				
S:48			Discrete Input Interrupt- Bit Mask				
S:49			Discrete Input Interrupt- Compare Value				
S:50			Processor Catalog Number				
S:51			Discrete Input Interrupt- Return Number				
S:52			Discrete Input Interrupt- Accumulat				
S:53			Reserved/ Clock Calendar Day of the Week				
S:55			Last DII Scan Time				
S:56			Maximum Observed DII Scan Time				
S:57			Operating System Catalog Number				
S:58			Operating System Series				
S:59			Operating System FRN				
S:61			Processor Series				
S:62			Processor Revision				
S:63			User Program Type				
S:64			User Program Functional Index				
S:65			User RAM Size				
S:66			Flash EEPROM Size				
S:67			Channel 0 Active Nodes				
S:68			Channel 0 Active Nodes				
S:69			Channel 0 Active Nodes				
S:70			Channel 0 Active Nodes				
S:71			Channel 0 Active Nodes				
S:72			Channel 0 Active Nodes				
S:73			Channel 0 Active Nodes				
S:74			Channel 0 Active Nodes				

Address/Symbol Database

Address	Symbol	Scope	Description	Sym Group	Dev. Code	ABV	BLW
S:75			Channel 0 Active Nodes				
S:76			Channel 0 Active Nodes				
S:77			Channel 0 Active Nodes				
S:78			Channel 0 Active Nodes				
S:79			Channel 0 Active Nodes				
S:80			Channel 0 Active Nodes				
S:81			Channel 0 Active Nodes				
S:82			Channel 0 Active Nodes				
S:83			DH+ Active Nodes				
S:84			DH+ Active Nodes				
S:85			DH+ Active Nodes				
S:86			DH+ Active Nodes				
T4:0			Pumb Turn on for 30S				
T4:0/1			Alarm Reset btn				
T4:0/DN			Pump Turn off Period Trigger				
T4:0/TT			Pump Running Period Trigger				
T4:1			Pump Turn Off for 10s				
T4:1/DN			Pump Cycle Reset btn				
T4:1/TT			Pump Stopping Period Trigger				
T4:2			Flow & Pressure Timer Check				
T4:2/DN			Flow & Pressure Check Trigger				
T4:2/TT			Flow & Pressure Check Trigger				
U:3			Inputs & Outputs				
U:4			Control Logic				
U:5			Alarms & Notifications				
U:6			Cycle Conditions				

Instruction Comment Database

Address	Instruction	Description

Symbol Group Database

Group_Name	Description