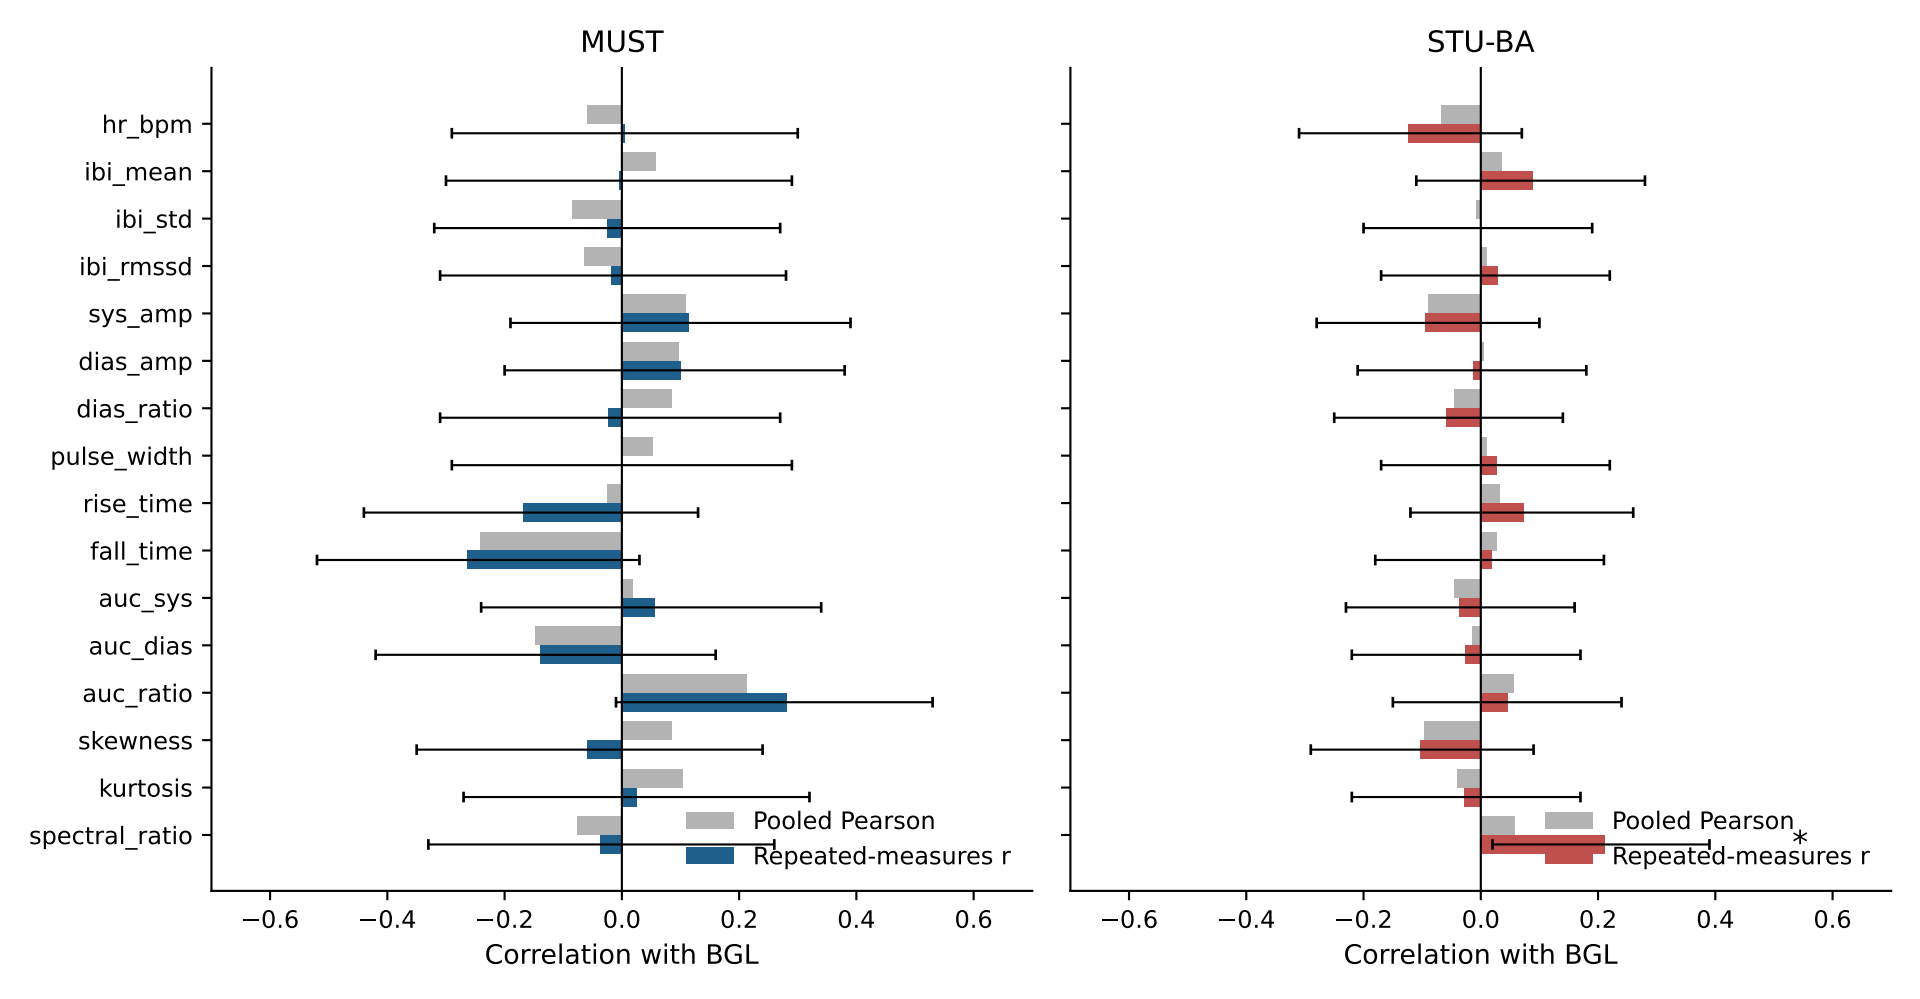
MUST
STU-BA
hr_bpm
ibi_mean
ibi_std
ibi_rmssd
sys_amp
dias_amp
dias_ratio
pulse_width
rise_time
fall_time
auc_sys
auc_dias
auc_ratio
skewness
kurtosis
spectral_ratio
Pooled Pearson
Repeated-measures r
*
−0.6
−0.4
−0.2
0.0
0.2
0.4
0.6
Correlation with BGL