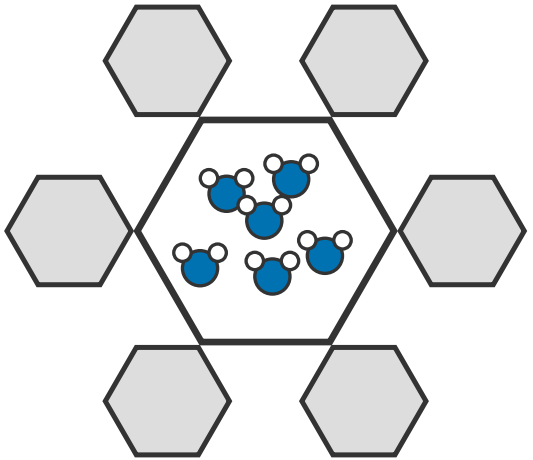

MOF or COF + water

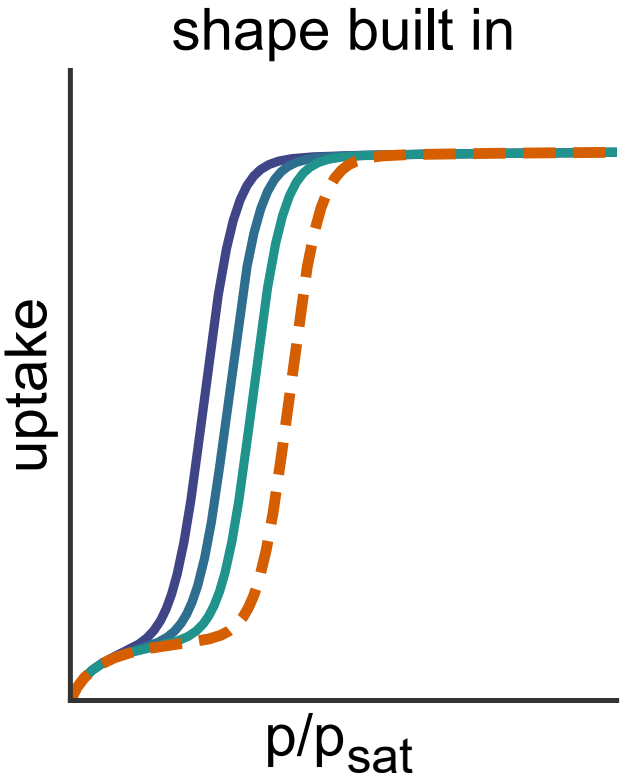

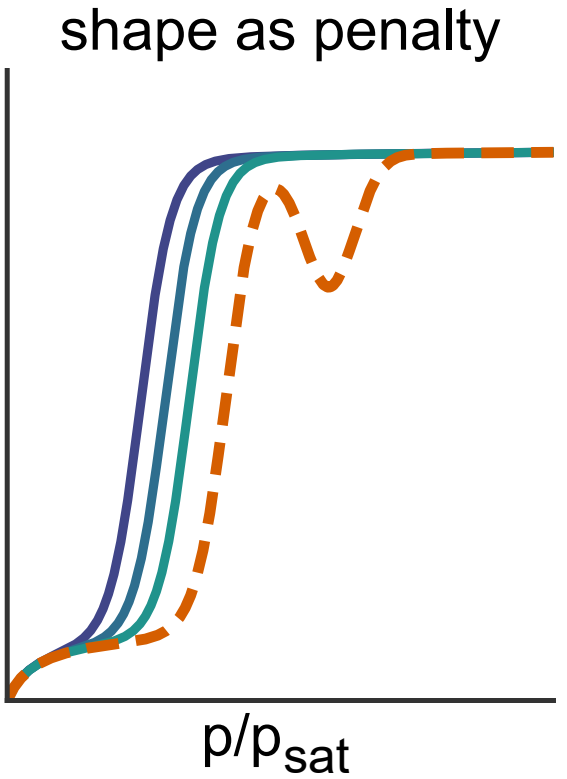

training temperatures

new temperature