


JAYAPRAKASH NARAYAN COLLEGE OF ENGINEERING

Dharmapur, Mahabubnagar – 509 001

AFFILIATED TO JAWAHARLAL NEHRU TECHNOLOGICAL UNIVERSITY,
Kukatpally, Hyderabad – 500072, Telangana, India.

A minor project report on

“PLANNING, ANALYSIS AND DESIGN OF INDIRAMMA INDLU BY MANUAL PROCESS”



A Dissertation submitted to the Jawaharlal Nehru Technological University, Hyderabad in
partial fulfillment of the requirement for the award of degree of

BACHELOR OF TECHNOLOGY
in
CIVIL ENGINEERING

Submitted by

S.A. RAHMAN
ANJALI K
SIDDARTHA V
AMERSALEEM

(24365A0125)
(24365A0102)
(24365A0121)
(23361A0102)

Under the Guidance of
SK. SHANAVAZ AHMED
M.Tech Structural Engineering
HOD

DEPARTMENT OF CIVIL ENGINEERING



JAYAPRAKASH NARAYAN COLLEGE OF ENGINEERING

Dharmapur, Mahabubnagar (509 001), Telangana State, India.

Office: +918886680001, +918886680012, 9951946677, web: www.jpnce.ac.in

2025-2026

JAYAPRAKASH NARAYAN COLLEGE OF ENGINEERING

Dharmapur, Mahabubnagar – 509 001

AFFILIATED TO JAWAHARLAL NEHRU TECHNOLOGICAL UNIVERSITY,

Kukatpally, Hyderabad – 500072, Telangana, India

DEPARTMENT OF CIVIL ENGINEERING



CERTIFICATE

Certified that the work entitled “**PLANNING, ANALYSIS AND DESIGN OF INDIRAMMA INDLU BY MANUAL PROCESS**” is a bonafied work carried out by **S.A. RAHMAN (24365A0125), ANJALI K (24365A0102), SIDDARTHA V (24365A0121), AMERSALEEM (23361A0102)** in partial fulfillment for the award of Bachelor of Engineering in civil Engineering of the **Jawaharlal Nehru Technological University, Hyderabad** during the year 2025-26. It is certified that all corrections / suggestions indicated for Internal assessment have been incorporated in the Report deposited in the department library. The project report has been approved as it satisfies the academic requirements in respect of Project work prescribed for the said Degree.

Guide :

Head of the Department

SK. SHANAVAZ AHMED
(HOD)

SK. SHANAVAZ AHMED
HOD CIVIL ENGG.

INTERNAL EXAMINER
EXAMINER

EXTERNAL

ACKNOWLEDGEMENT

There are many people instrumental for the successful completion of this dissertation work. First, we owe thanks to Almighty, my parents my deepest gratitude, as nothing would have been possible without their constant support and encouragement.

The heights reached by the great men did not come in a single fight, but they, on their way stepped on successes crossing all the stones of failures. Accordingly, we now take up this privilege of remembering with gratitude those people behind the success of my project, which really pushed me across the stones of failure.

As APJ Abdul Kalam sir has said, “A good teacher explains, a better teacher demonstrates but the best teacher inspires”, this is how my guide Asst. Prof. **Mr.SK. SHANAVAZ AHMED** sir guided us through our project work. We would like to thank him for permitting us to undertake the dissertation work under his able guidance, for his / her very useful suggestions, support and guidance. They have been pillars of strength, and their presence has inspired me to do all the better and there aren’t enough words to describe it.

We would be failing in my duty if we don’t thank our beloved **HOD Mr. SK. SHANAVAZ AHMED** sir and our **Principal, Mr. P Krishnamurthy** sir for their constant encouragement and resolve. Lastly, we would like to thank our beloved Chairman sir **Mr. K S Ravi Kumar** sir for providing all the necessities for completion of my thesis.

We also take this opportunity in expressing my gratitude and respect to my project Coordinator Asst prof Mr. **Ravi Kumar** sir for his cooperation and support in all aspects.

We finally take this opportunity in expressing my gratitude and respect to all my department faculty, those who have directly and indirectly helped and encouraged me during this project.

DECLARATION

We, **S.A. RAHMAN (24365A0125), ANJALI K (24365A0102), SIDDARTHA V (24365A0121), AMERSALEEM (23361A0102)** students of 3th year B.Tech in Civil Engineering, JAYAPRAKASH NARAYAN COLLEGE OF ENGINEERING, hereby declare that under the supervision of our guide **Asst. Prof. SK. SHANAVAZ AHMED** sir of civil Dept., JAYAPRAKASH NARAYAN COLLEGE OF ENGINEERING, have independently carried out the project titled **“PLANNING, ANALYSIS AND DESIGN OF INDIRAMMA INDLU BY MANUAL PROCESS”** and submitted it in partial fulfillment of the requirement for the award of degree of Bachelor of Engineering in Civil Engineering by the Jawaharlal Nehru Technological University, Hyderabad during the academic year 2025-26.

S.A. RAHMAN	(24365A0125)
ANJALI K	(24365A0102)
SIDDARTHA V	(24365A0121)
AMERSALEEM	(23361A0102)

Date:

Place: Mahabubnagar.

ABSTRACT

In today's economic climate for many families, the dream of constructing a safe, permanent home is blocked by high costs and technical difficulties. To help overcome this, the Telangana Government launched the 'Indiramma Indlu' scheme, providing a ₹5,00,000 subsidy to help citizens build their own houses. However, having the funds is only the first step; beneficiaries still need proper engineering to ensure their homes are safe, affordable, and well-planned.

This project brings that government initiative to life for a real beneficiary, **Smt. B. Kanakamma**. Our goal is to take the technical stress out of the construction process by providing a complete, ready-to-use house plan that strictly follows the National Building Code and specific government guidelines.

We tackled this in two practical steps. First, we focused on the architecture: giving the house its shape, allocating rooms, setting exact dimensions, and placing columns within a tight 590 sq ft space so it functions as a comfortable home. Second, we took those drawings and performed a full structural analysis. By manually designing the concrete Columns, beams, and Slabs, we ensured that the house is not just economical to build, but physically strong enough to last a lifetime. Ultimately, this project is about using civil engineering to turn a government subsidy into a safe, permanent reality for a family.

Keywords: Indiramma Indlu Scheme, Beneficiary, National Building Codes, Government guideline, Architecture, Comfortable home, Structural Analysis.

List of Figures

S. No.	DESCRIPTION	PAGE.NO
1	Figure 1.1: Lodging or Rooming House	6
2	Figure 1.2: Single family private dwelling	7
3	Figure 1.3: Dormitories.	7
4	Figure 1.4: Apartment houses	8
5	Figure 1.5: Hotels	8
6	Figure 1.6: Flow chart	9
7	Figure 1.7: Site plan	10
8	Figure 1.8: Plot size	11
9	Figure 2.1: Plot area	12
10	Figure 2.2: Net Plot Area	13
11	Figure 3.1: Imposed load on roof	18
12	Figure 3.2: Imposed load on floor slabs	18
13	Figure 3.3: Roof slab loads.	20
14	Figure 3.4: Load calculation in frame A1-B1-C1	21
15	Figure 3.5: Frame A1-B1-C1 with loads	21
16	Figure 3.6: Load calculation in frame A2-B2-C2	22
17	Figure 3.7: Frame A2-B2-C2 with loads	22
18	Figure 3.8: Load calculation in frame A3-B3-C3	23
19	Figure 3.9: Frame A3-B3-C3 with loads	23
20	Figure 3.10: Load calculation in frame A1-A2-A3	24
21	Figure 3.11: Frame A1-A2-A3 with loads	24
22	Figure 3.12: Load calculation in frame B1-B2-B3	25
23	Figure 3.13: Frame B1-B2-B3 with loads	25
24	Figure 3.14: Load calculation in frame C1-C2-C3	26
25	Figure 3.15: Frame C1-C2-C3 with loads	26
26	Figure 3.16: Frame A1-B1-C1.	28
27	Figure 3.17: Rotation and Displacement Contribution.	30
28	Figure 3.18: Final End Moments.	33
29	Figure 3.19: Bending Moment Diagram.	34
30	Figure 3.20: Reactions.	35

31	Figure 3.21: Bending Moment and Shear Force Diagram of A1-B1-C1.	36
32	Figure 3.22: Bending Moment and Shear Force Diagram of A2-B2-C2.	37
33	Figure 3.23: Bending Moment and Shear Force Diagram of A3-B3-C3.	37
34	Figure 3.24: Bending Moment and Shear Force Diagram of A1-A2-A3	38
35	Figure 3.25: Bending Moment and Shear Force Diagram of B1-B2-B3	38
36	Figure 3.26: Bending Moment and Shear Force Diagram of C1-C2-C3	39
37	Figure 4.1: Floor slab	44
38	Figure 4.2: Bending moment diagram {frame A1-B1-C1}	54
39	Figure 4.3: Reinforcement details of beam A1-B1-C1.	63
40	Figure 4.4: Classification of column based on position and loading	67
41	Figure 4.5: Total Loads and moments on A1 column.	69
42	Figure 4.6: Total Loads and moments on B1 column.	71
43	Figure 4.7: Area of Footing	74
44	Figure 4.8: One way Shear	75
45	Figure 4.9: Staircases	78
46	Figure 5.1: ground floor plan	83
47	Figure 5.2: Footing layout	84
48	Figure 5.3: Column layout	85
49	Figure 5.4: Beam layout	86
50	Figure 5.5: Footing reinforcement	87
51	Figure 5.6: Slab reinforcement	88
52	Figure 5.7: Staircase reinforcement	89

List of Tables

S. No.	DESCRIPTION	PAGE.NO
1	Table 3.1: Unit weight of the materials used	17
2	Table 3.2: Rotation Factor.	29
3	Table 3.3: Displacement Factor.	30
4	Table 4.1: Partial safety factor for material strength	43
5	Table 4.2: Partial safety factor for loads	43
6	Table 4.3: Roof slab details.	51
7	Table 4.4: Design of Main Reinforcement.	64
8	Table 4.5: Design of Shear Reinforcement (Stirrups)	65
9	Table 4.6: Design of Columns C1, A2, B2, C2, A3, B3 & C3.	73
10	Table 4.7: Design of footing B1, C1, A2, B2, C2, A3, B3 & C3	77

INDEX

Certificate	II
Acknowledgment	III
Declaration	IV
Abstract	V
List of Figures	VI
List of Tables	VIII
DESCRIPTION	PAGE.NO
CHAPTER 1: INTRODUCTION	01
1.1: The Indiramma Indlu Scheme	01
1.2: Statutory Framework and Government Orders (G.O.)	02
1.3: Technical Specifications and Planning for G+0 Housing	03
1.4: Execution Strategy and Project Management	04
1.5: Challenges and Risk Mitigation in Implementation	05
1.6: Classification of Buildings	06
1.7: Methodology	09
1.8: Project Details	09
CHAPTER 2: PLANNING	12
2.1: Road widening width	12
2.2: Setbacks	13
2.3: Requirements of parts of buildings	13
2.4: Plinth & Carpet Area	15
CHAPTER 3: CALCULATION OF LOAD & ANALYSIS	16
3.1: Types of loads	16
3.2: Load calculation on slab	17
3.3: Load distribution from slab to beams	19
3.4: Structural frames	21
3.5: Methods of analysis	27
3.6: Analysis by Kani's method	28
CHAPTER 4: DESIGNING	40
4.1: Methods of design of reinforced concrete	40
4.2: Philosophy of limit state design	41
4.3: Code of practice for R.C.C. design	43
4.4: Design of Roof Slab	44
4.5: Design of Beams	52
4.6: Column Design	66
4.7: Footing Design	74
CHAPTER 5: DRAWINGS	83
Conclusion	90
References	91
Appendix	92

CHAPTER 1

INTRODUCTION

Building construction is a core branch of engineering dedicated to creating safe, functional, and durable structures. While having a secure shelter remains a fundamental human need, the modern reality of constructing a house presents major financial and technical barriers. Today, escalating material costs and high labor charges make independent homebuilding incredibly expensive. As a result, constructing a safe home is often entirely out of reach for the common man, whereas wealthier individuals can easily afford large, luxurious houses.

To address this critical economic gap, the Government of Telangana introduced the 'Indiramma Indlu' housing scheme. This initiative is specifically designed to provide safe and affordable housing for the poor. It delivers vital financial assistance directly to families who already own a plot of land but lack the funds required to actually construct a house.

Based on this government initiative, the focus of this project is the "Planning, Analysis and designing of Indiramma indlu by manual process". The primary objective is to engineer a highly efficient, single-story (G+0) residential building that maximizes space while strictly adhering to the scheme's economic constraints.

What defines this project is its engineering methodology: the entire structural design is executed completely manually. Instead of relying on automated structural software, every phase—from architectural planning and load calculations to structural analysis and the final design of concrete elements—is calculated strictly by hand. This rigorous manual approach demonstrates a deep understanding of structural behavior and ensures that the final building is safe, durable, and fully compliant with Indian Standard codes.

1.1 THE INDIRAMMA INDLU SCHEME

The "Indiramma Indlu" (Indiramma Housing) Scheme is a flagship social welfare initiative launched by the Government of Telangana on March 11, 2024, under the leadership of Chief Minister A. Revanth Reddy. The scheme was conceptualized to address the critical housing deficit among the Economically Weaker Sections (EWS), Below Poverty Line (BPL) families, and marginalized communities across the state.

Housing is not merely a structural provision; it is a fundamental driver of socio-economic stability. For decades, low-cost housing schemes have struggled with inadequate technical execution, poor material quality, and bureaucratic bottlenecks. The Indiramma Indlu scheme aims to rectify these historical failures by combining direct financial assistance with strict technical oversight.

For a Civil Engineering project focusing on Mahabubnagar and the wider Telangana region, this scheme presents a perfect case study in balancing cost constraints with structural integrity. The Phase 1 target encompasses the construction of 4.5 lakh houses across 119 constituencies with a staggering budget allocation of ₹22,000 crores.

The scheme strategically shifts the power of construction back to the beneficiary, heavily guided by state engineering wings to ensure safety and quality in every G+0 structure built.

1.1.1 Primary Objectives

- **Eradication of Homelessness:** Providing permanent, secure, and dignified housing for landless and homeless citizens in Telangana.
- **Financial Empowerment:** Offering direct financial aid of ₹5 lakh per household to eliminate the reliance on exploitative private loans.
- **Social Inclusion:** Earmarking specific quotas for Scheduled Castes (SC), Scheduled Tribes (ST), Backward Classes (BC), minorities, and transgender persons. Notably, 10,000 houses are reserved specifically for Chenchu tribal families via the Integrated Tribal Development Agency (ITDA).
- **Honoring Activists:** Allocating 250 sq. meter plots of land to individuals who actively participated in the Telangana Statehood Movement.

1.2 STATUTORY FRAMEWORK AND GOVERNMENT ORDERS (G.O.)

Understanding the bureaucratic and legal foundation is crucial for the execution strategy. The scheme operates strictly under a series of Government Orders that dictate everything from fund disbursement to committee formations.

1.2.1 G.O. MS No. 7 – The Master Guideline

Issued on **March 9, 2024**, by the Transport, Roads & Buildings (Housing) Department, **G.O. MS No. 7** serves as the foundational text for the scheme.

- **Commencement:** Officially sanctions the commencement of the Indiramma Indlu scheme for houseless families.
- **Technical Mandates:** It specifies that all houses must have an RCC (Reinforced Cement Concrete) roof. The minimum built-up area is mandated at 400 square feet, which must include a kitchen and an attached or detached sanitary toilet.
- **Execution Modality:** It outlines that the construction will be beneficiary-led. However, technical guidance and phase-wise monitoring will be provided by government-appointed engineering personnel to ensure strict adherence to safety standards.

1.2.2 G.O. Ms. No. 33 – Grassroots Committees

Issued on **October 11, 2024**, this order mandates the formation of **Indiramma Committees** at the Gram Panchayat and Municipal Ward levels.

- **Purpose:** To decentralize the monitoring process and ensure transparency in beneficiary selection.

- **Role in Execution:** For a civil engineer managing these projects, these committees serve as the primary point of contact for resolving local site disputes, material transport logistics, and community coordination.

1.2.3 G.O. Rt No. 50 & Mobile App Integration

Issued early on **January 31, 2024**, this mandate focuses on Aadhaar Authentication under Section 7 of the Aadhaar Act, 2016. Subsequent circulars (like the one on December 12, 2024) introduced a mobile application developed by the Centre for Good Governance (CGG) for real-time field verification of the 80.54 lakh Praja Palana applications.

Beneficiary Typology and Assistance Model

The G.O.s divide the beneficiaries into two distinct execution tracks:

1. **Beneficiaries with Land:** Families owning a small plot receive ₹5 lakh in financial assistance (₹6 lakh for SC/ST categories) disbursed in staged installments tied to construction milestones.
2. **Landless Beneficiaries:** The government takes on the responsibility of allocating a land parcel measuring 70-80 square yards (or 250 sq. meters for Telangana movement activists) alongside the ₹5 lakh construction grant.

1.3 TECHNICAL SPECIFICATIONS AND PLANNING FOR G+0 HOUSING

For a Civil Engineering execution strategy, the focus must shift from political guidelines to concrete, steel, and structural mechanics. The mandate for a 590 sq. ft. G+0 house requires meticulous manual planning to ensure the ₹5 lakh budget is not exceeded while maintaining a safe, durable structure.

1.3.1 Avoidance of Over-Engineering

In low-cost rural and semi-urban housing, over-reliance on complex software analysis can lead to unnecessary, cost-inflating designs. For a standard 590 sq. ft. single-story (G+0) structure, manual drafting and calculating loads based on fundamental Strength of Materials and Theory of Structures is far more efficient and practical than using heavy analytical software. A clear, well-drafted 2D plan detailing load paths and room dimensions is the core of the execution strategy.

1.3.2 Spatial Planning & Layout

- **Dimensions:** Minimum 400 sq. ft.
- **Components:** One multi-purpose living area, one bedroom, a dedicated kitchen space, and a toilet/bath area (often planned slightly separate from the main living area in rural contexts for hygiene and ventilation).
- **Ventilation:** Standardized window placements to ensure cross-ventilation, reducing the need for artificial cooling.

1.3.3 Structural Design Parameters

- **Foundation:** Given the typical hard soil conditions in the Deccan Plateau region, a standard strip footing or isolated column footings of minimal depth (typically 1.2m to 1.5m) are sufficient.
- **Superstructure (Brick/Block Masonry):** To optimize costs, load-bearing masonry walls (using high-quality fly ash bricks or standardized red clay bricks) are preferred over a fully framed RCC structure for G+0. Walls are typically 9 inches for the exterior and 4.5 inches for interior partitions.
- **RCC Detailing:** The G.O. strictly mandates an RCC roof. This is where your expertise in RCC design is critical. The slab thickness should be optimized (typically 100mm to 125mm for small spans) using standard M20 grade concrete.
- **Steel Structures:** While the primary structure is RCC and masonry, minor steel elements (Fe500 grade) for lintels, sunshades, and door frames must be calculated precisely to avoid material wastage. Reinforcement detailing in the slab must balance safety against wind/live loads with strict budget constraints.

1.4 EXECUTION STRATEGY AND PROJECT MANAGEMENT

To successfully execute an Indiramma Indlu project, a Civil Engineer must act as both a technical guide and a project manager. The ₹5 lakh budget is tight; therefore, the execution strategy must revolve around zero material wastage and localized supply chains.

1.4.1 Material Procurement

- **Local Sourcing:** In districts like Mahabubnagar, sourcing coarse aggregate, fine aggregate (sand), and bricks locally drastically reduces transportation overheads.
- **Standardization:** Using standardized doors and windows across multiple units allows for bulk manufacturing discounts.

1.4.2 Phase-Wise Construction and The L-Stage Checks

The financial assistance is not handed over as a lump sum. It is strictly tied to physical progress, monitored by government engineering wings. Your project plan must align perfectly with these stages:

1. **L1 Stage (Basement/Plinth Level):** * *Action:* Excavation, foundation laying, and raising the structure to the plinth level.
 - *Quality Check:* The inspecting officer checks the alignment, trench depth, and the quality of baseline materials (sand cleanliness, brick strength).
 - *Fund Release:* The first installment is released upon L1 approval.

2. **L2 Stage (Lintel/Roof Level):** * *Action:* Raising the masonry walls to the lintel level and preparing the formwork and reinforcement for the RCC slab.
 - *Quality Check:* Verification of room sizes against the approved drafted plan, wall thickness, and visual inspection of steel reinforcement before the concrete pour.
 - *Fund Release:* Second installment.
3. **L3 Stage (Completion):** * *Action:* Pouring the RCC slab, curing, plastering, flooring, and finalizing basic electrical and plumbing (water and toilet) connections.
 - *Quality Check:* Final structural inspection, ensuring the RCC roof is solid, the toilet is functional, and the minimum 400 sq. ft. mandate is met.
 - *Fund Release:* Final installment.

1.5 CHALLENGES AND RISK MITIGATION IN IMPLEMENTATION

No engineering project is without hurdles, and public housing is notorious for ground-level friction. A comprehensive documentation must address these risks.

1.5.1 Bureaucratic and Financial Delays

- **The Risk:** Government funds often face delays due to budget approvals or administrative bottlenecks. Slow fund releases stall construction, leaving partially built structures exposed to weather.
- **Mitigation Strategy:** Beneficiaries must be counseled on staging their material purchases. Engineers should plan construction schedules that avoid leaving critical elements (like open trenches or un-poured slabs) exposed during the monsoon season.

1.5.2 Material Quality Control

- **The Risk:** To save money, beneficiaries might procure sub-standard cement or under-gauged steel, jeopardizing the RCC roof's integrity.
- **Mitigation Strategy:** Visual checks and basic on-site material testing (like the slump test for concrete workability or field tests for brick strength) must be heavily emphasized in the execution strategy.

1.5.3 Documentation and Land Disputes

- **The Risk:** Missing BPL cards, unresolved land ownership on ancestral property, or un-regularized plots (which ties into LRS schemes) can halt the L1 approval entirely.
- **Mitigation Strategy:** Pre-construction clearance is vital. The technical team must ensure the land is free of legal encumbrances before any physical excavation begins.

1.6 CLASSIFICATION OF BUILDINGS:

According to National Building Code of India, 1983, all buildings whether existing or to be constructed are classified based on the character of occupancy in one of the following groups,

- GROUP-A : Residential Buildings
- GROUP-B : Educational Buildings
- GROUP-C : Institutional Buildings
- GROUP-D : Assembly Buildings
- GROUP-E : Business Buildings
- GROUP-F : Mercantile Buildings
- GROUP-G : Industrial Buildings
- GROUP-H : Storage Buildings
- GROUP-I : Hazardous Buildings

In this project the government new house scheme “Indiramma indlu” is for Residential building, the definition and the examples of buildings in Group-A residential building are given below.

GROUP-A: Residential Buildings:

These include any building in which sleeping accommodation is provided for normal residential purposes with or without cooking or dining or both facilities.

Buildings and structures under group –A are further subdivided as below:

Subdivision A-1: Lodging or rooming houses:



Figure 1.1: Lodging or Rooming House.

These include any building or group of buildings under the same management. These are provided with a separate sleeping accommodation for a total of not more than 15 persons either on temporary or permanent basis. These may be with or without dining facilities, but no facilities for cooking.

Subdivision A-2: One- or two-family private dwelling:



Figure 1.2: Single family private dwelling.

These include any private dwelling which is occupied by members of a single family having sleeping accommodation for not more than 20 persons.

Subdivision A-3: Dormitories:



Figure 1.3: Dormitories.

These include any building in which group sleeping accommodation is provided with or without dining facilities. In the persons will not be the members of same family.

EX : School and college dormitories, student's and other hostels and military barracks.

Subdivision A-4: Apartment houses (Flats) :



Figure 1.4: Apartment houses.

These include any building or structure in which living quarters are provided for three or more families. They live independently of each other with independent cooking facilities.

EX: Apartment houses, mansions.

Subdivision A-5: Hotels:



Figure 1.5: Hotels.

These include any building or group of buildings under the single management. In this sleeping accommodation with or without dining facilities is provided for hire to more than 15 persons who are purely temporary.

EX: Hotels, Inns, Clubs & motels.

1.7 METHODOLOGY:

Methodology of the project is as follows:

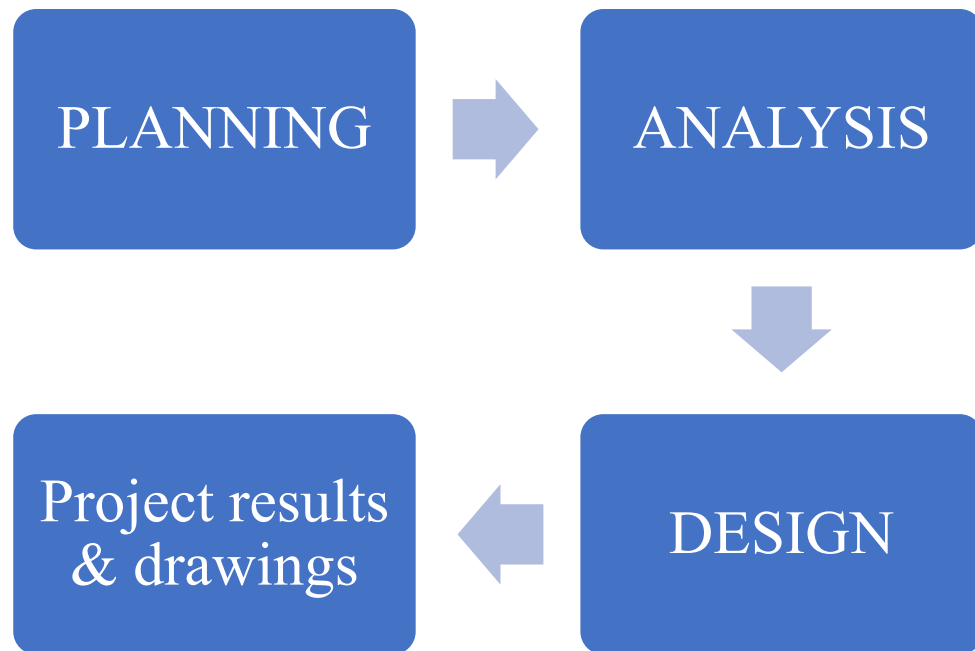


Figure 1.6: Flow chart.

1.8 PROJECT DETAILS:

In this project, we didn't just want to use Random Dimensions for Plot, So the first thing we did was visit a real site of beneficiary who got Shortlisted in this Scheme. Instead of guessing standard dimensions, we surveyed an actual plot of land handed out under the Indiramma Indlu scheme. Getting our boots on the ground meant we could design a house that is actually ready to be built in the real world. We got a plinth area of 54.82m^2 (590sq. ft).

The Government order says beneficiaries to strictly follow the approved plan of two rooms, kitchen and toilet, with plinth area between 400 to 600 sq. ft. Our plinth area is 590sq. ft. So our plot is under the guideline and Eligible for this Scheme.

During the site visit, we gathered these exact real-world details:

- **The Beneficiary:** The plot belongs to Smt. B. Kanakamma. Understanding her family's daily needs helped us create a room layout that is actually practical for them to live in.
- **The Location:** The site is located in Mannapur Village, Kothapalle Mandal, in the Narayanpet District.

- **Plot Size & Facing:** We measured the site boundaries and recorded a total plot size of **8.05m x 6.81m**. The plot faces **North**, which is a huge detail—it told us exactly where to place the main entrance and how to arrange the windows to get the best natural light and airflow.
- **House Dimensions:** After leaving the required empty space around the edges of the plot, we locked in a final building area (plinth area) of **590 sq. ft.** The actual floor plan of the house is designed at **5.9m x 6.68m**.

Using this real site data and keeping the government's strict budget in mind, we set our final structural rules. The building is designed as a simple single-story (G+0) house with a 3.0m ceiling height. For all of our manual calculations, we are using **M20 grade concrete** and **Fe-500 grade steel**.

For the economical and safety purpose a proper design is needed, we have done the planning with reference to “National Building code 2016” for interior and exterior plans. these plans are molded in AutoCAD software for drawings. The structural analysis is done manually whereas the designing of various structural components (such as slab, beams, columns, footing etc.) is carried out using “Bureau of Indian Standard Code books” (Given in reference) according to ‘limit state method’. The site plan and plot size are shown in figure 1.7 & 1.8.

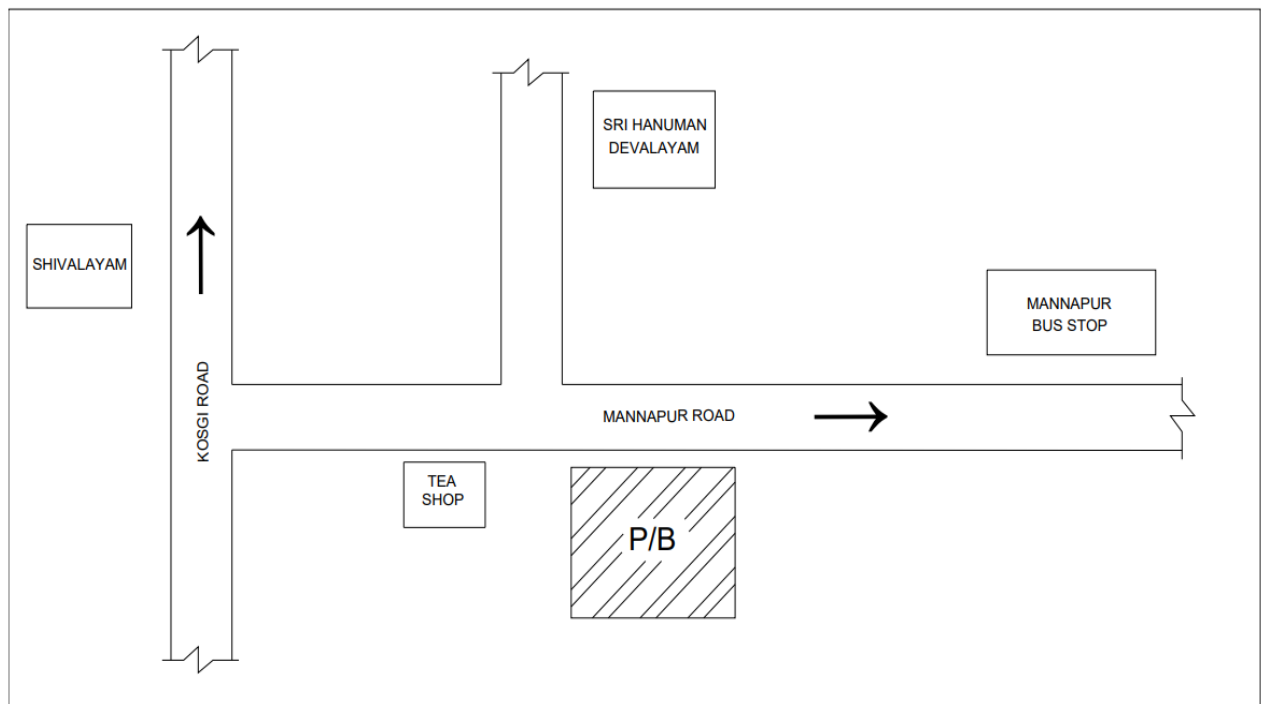


Figure 1.7: Location plan.



Figure 1.8: Plot size.

CHAPTER 2

PLANNING

The term "planning" in building construction refers to the strategic arrangement of all building units across all floors and levels. It encompasses not only the horizontal layout but also the vertical elevation, ensuring that the spaces enclosed by walls, floors, and roofs are optimized for their intended use.

During the planning phase, it is critical to keep the general purpose of the building at the forefront. Because each building type has unique requirements to fulfill its purpose effectively, deep consideration must be given to the functional and utility aspects of the design. For this specific Indiramma Indlu housing scheme project, the design focuses on maximizing space utility for multiple residential flats while adhering to statutory regulations.

The main considerations guiding this planning process include:

- ✚ Human habitation needs and spatial requirements.
- ✚ Climatic conditions and their effects on ventilation and lighting.
- ✚ Adherence to Building Bye-laws for legal planning and construction.
- ✚ Available finance and economic feasibility.
- ✚ Overall comfort, safety, and structural economy.

2.1 Road Widening Width: Proper Road access is essential for future urban development. The specification for the road widening width is adopted from G.O.Ms.No.168. According to these guidelines, a road widening width for future road development must be provided at a minimum of 4.5 m from the center line of the existing road.



Figure 2.1: Plot area.

2.2 Setbacks Setbacks ensure adequate natural light, ventilation, and fire safety access around the structure. The specifications for setbacks are also derived from Table 3 of G.O.Ms.No.168. For this plot, a 1.5m free space is provided at the front of the building, while 0.5m of free space is maintained on the sides and the rear as setbacks.

After deducting these setbacks from the gross plot area of 9.05m x 8.81m (79.73 m²), the resulting net plot area available for the main building footprint is 8.05m x 6.81m (54.82 m²). This net area serves as the boundary for the primary structural planning.

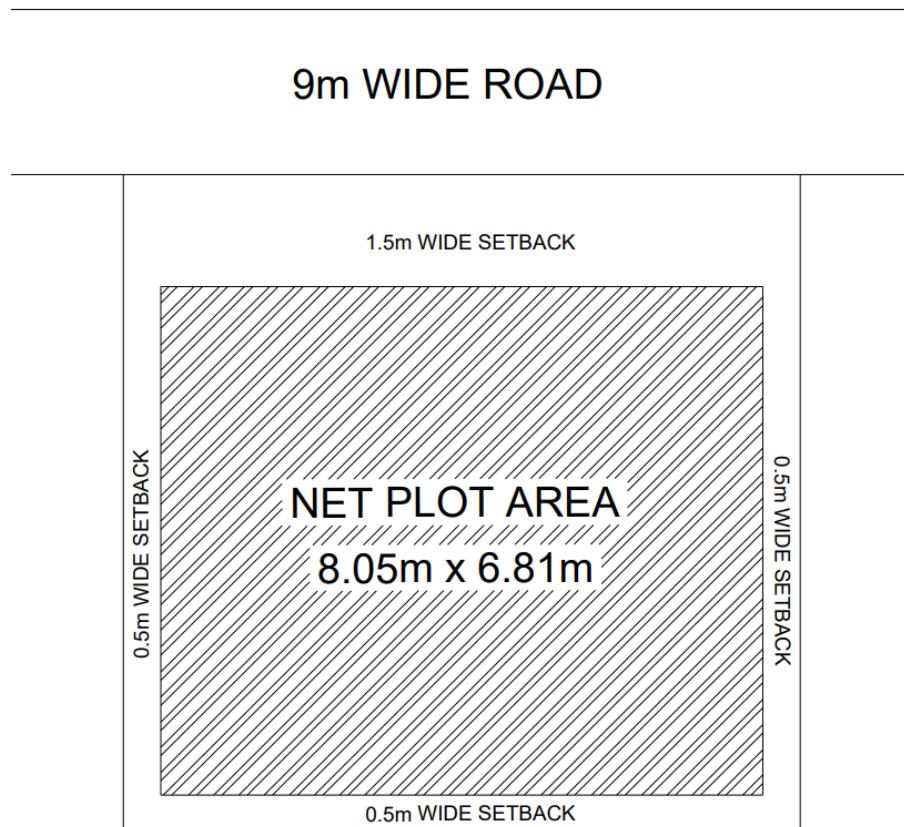


Figure 2.2: Net Plot Area.

2.3 REQUIREMENTS OF PARTS OF BUILDINGS

To ensure safety, livability, and compliance with the Telangana State Government guidelines for the **Indiramma Indlu Scheme**, the specifications for the building's components follow the mandatory scheme provisions combined with the "National Building Code (NBC) 2016 Part 3: Development Control Rules and General Building Requirements" for Low-Income Housing (EWS).

The scheme explicitly mandates a **G+0 pucca structure**, an **RCC roof**, and a minimum built-up area of **400 sq. ft. (approx. 37.16 m²)**. The requirements for various parts of the building are strictly in accordance with these parameters.

2.3.1 Plinth

- **Main Building:** The plinth of the single-story main building must be located relative to the surrounding ground level to guarantee adequate site drainage. The height of the plinth shall not be less than 450 mm from the surrounding ground level to prevent water logging and ensure a durable foundation.
- **Plinth Area Constraints:** As per the scheme's standard layout guidelines, the total constructed plinth area (built-up area) must meet the minimum requirement of 400 sq. ft. to qualify for the full government financial assistance.

2.3.2 Habitable Rooms

- **Height:** The vertical clearance of all human habitation rooms must not be less than 2.75 m, measured from the finished floor surface to the lowest point of the ceiling (bottom of the RCC slab). The clear headroom under any structural beam shall be at least 2.4 m.
- **Size:** To fit efficiently within the 400 sq. ft. layout, the primary habitable room shall have an area of not less than 9.5 m² with a minimum width of 2.4 m. For the secondary room (bedroom), the area must be at least 7.5 m², with a minimum width of 2.1 m.

2.3.3 Kitchen

- **Height:** Kitchen height must not be less than 2.75 m from the floor to the lowest ceiling point.
- **Size:** A separate kitchen is a mandatory inclusion under the Indiramma Indlu scheme. The kitchen must have a minimum floor area of 4.5 m² (or 3.3 m² as per minimum EWS standards to conserve space) with a minimum width of 1.5 m.
- **Other Requirements:** Every kitchen must have a proper sink connected to a grated waste pipe, an impermeable floor, and adequate ventilation openings as specified by NBC 20.1.1.

2.3.4 Bathrooms and Water-Closet

- **Height:** Minimum height is 2.1 m from floor to ceiling.
- **Size:** A sanitary toilet facility is mandatory. Independent bathrooms must be at least 1.8 m² (minimum width 1.2 m), and independent water-closets must be 1.1 m² (minimum width 0.9 m). Combined bath and water-closet units, as utilized in this plan to optimize the 400 sq. ft. footprint, must have a floor area of not less than 2.8 m² with a minimum width of 1.2 m.
- **Other Requirements:** At least one wall must open to the external air. Surfaces must be impervious up to 1 m high, and floors must slope toward the drain. A ventilation shaft or exhaust opening of at least 0.3 m² is required.

2.3.5 Parapet and Roof

- **Roof Specification:** An **RCC (Reinforced Cement Concrete) roof** is strictly mandatory for this scheme to ensure a permanent, weather-resistant structure.
- **Parapet:** Parapet walls on the RCC roof edges shall be maintained between 1.0 m and 1.2 m in height from the finished floor level for optimal safety.

2.3.6 Boundary Wall

Standard boundary walls around the allotted plot (typically 250 sq. yards for landless beneficiaries) should have a maximum height of 1.5 m above the front street's center line. Corner plots restrict solid boundary wall heights to 0.75 m for a length of 10 m at intersections to maintain clear sightlines for traffic.

2.3.7 Staircase

- **Minimum clear width:** As this is a G+0 single-family low-cost dwelling, an internal or external staircase may be provided strictly for access to the RCC roof (allowing for future vertical expansion by the beneficiary). Following NBC standards for Low-Income Housing (EWS), a minimum clear width of 0.9 m is sufficient.
- **Treads & Risers:** The minimum tread width is optimized to 250 mm for single-family dwellings. To conserve space within the plot footprint, the maximum riser height can be up to 190 mm.
- **Headroom:** A minimum clear headroom of 2.2 m must be maintained throughout the staircase flight and under any landings.

2.3.8 Exit Requirements Given the single-story (G+0) nature and the compact 400 sq. ft. footprint of the dwelling, complex corridor routing is not applicable. Exit requirements are straightforwardly met through direct access from the main living area to the exterior. All door placements and widths are designed to ensure immediate, unobstructed egress to the outside to ensure rapid evacuation capabilities.

2.4 Plinth & Carpet Area Applying the mandatory scheme specifications to the allotted plot area, the designed layout achieves a highly efficient footprint that maximizes the living space while remaining strictly within the budget and guidelines. We have established a total **plinth area (built-up area) of exactly 400 sq. ft. (approx. 37.16 m²)** to qualify for the full government financial assistance.

Subtracting the area occupied by the external and internal walls, the floor plan yields an optimized net **carpet area**.

The ground floor layout details the spatial arrangement of the mandatory components: the primary living area, the bedroom, the separate kitchen, and the combined bath/WC unit. This arrangement optimizes internal circulation, natural lighting, and cross-ventilation within the compact boundary, as detailed in the AutoCAD floor plans in Figure 2.3.

CHAPTER 3

CALCULATION OF LOADS & ANALYSIS

3.1 Types of loads:

1. Dead load
2. Live load
3. Wind load
4. Earth quake load

3.1.1 Dead load (DL):

Dead load is a permanent and stationary vertical load which is subjected to the structure mainly due to the self-weight of the structural components such as beams, slabs, columns and walls etc. it also includes the weight of permanently fixed equipment. The dead load acts on the structure throughout its life time.

The dead load can be calculated by multiplying the volume of the structural component and the unit weight of the material. The unit weights of the different materials are given in the IS 875 part-1 : 1987.

3.1.2 Live load (LL):

Live load also called as imposed load, these are the loads which are moving or movable without any acceleration or impact. These loads are subjected to the structure occupancy of the building including weights of movable partitions or furniture etc.

Live loads keep on changing from time to time. The minimum values of live loads to be assumed are given in IS 875 (part 2)–1987. It depends upon the intended use of the building.

3.1.3 Wind load:

These types of loads are imposed by the wind. The structure should be strong enough with the heavy dead weights and anchored to the ground to resist this wind load. If not, the building foundation may fail. Wind load acts horizontally towards roofs, walls and columns.

The specifications for wind loads are given in IS 875 part 3 : 1987,

As per National Building Code Structure of 15 m height and above is to be considered for wind load.

3.1.4 Earth quake load:

Earthquake forces constitute to both vertical and horizontal forces on the building. The total vibration caused by earthquake may be resolved into three mutually perpendicular directions, usually taken as vertical and two horizontal directions. The movement in vertical direction do not cause forces in superstructure to any significant extent. But the horizontal movement of the building at the time of earthquake is to be considered while designing.

As our plot is not in the earthquake prone area, we have not considered the earth quake loads in this project.

3.2 Load calculation on slab:

The slab is divided into smaller slabs resting on beams, each slab acts as the continuous slab. The loads on the slabs are calculated as follows:

3.2.1 Dead load calculation:

The dead load can be calculated by multiplying the volume of the structural component and the unit weight of the material used. The unit weights of the materials used,[which are taken from the IS 875 part-1 : 1987] are given below.

S. No	Materials	Unit weight KN/m ³
1	Reinforced cement concrete	25
2	Plain cement concrete	24
3	Common burnt clay Bricks	15.7-18.85

Table 3.1: unit weight of the materials used.

Slab load:

The slab thickness is assumed as 100 mm.

Self-weight of the slab	$= 1 \times 1 \times 0.10 \times 25$
	$= 2.50 \text{ KN/m}^2$
Weight of weathering course	$= 1 \text{ KN/m}^2$
Dead Load	$= 3.5 \text{ KN/m}^2$

Parapet load:

Self-weight of the parapet wall	$= 1 \times 1 \times 0.1 \times 18$
	$= 1.8 \text{ KN/m}$

Beam load:

Self-weight of the beam	$= 1 \times 0.23 \times 0.3 \times 25$
	$= 1.725 \text{ KN/m}$

Wall load:

Self-weight of the 9" wall	$= 1 \times 0.23 \times 2.7 \times 18 = 11.18 \text{ KN/m}$
Self-weight of the 4" wall	$= 1 \times 0.10 \times 2.7 \times 18 = 4.86 \text{ KN/m}$

3.2.2 Live load calculation:

Live load on roof slab:

The live load on roof [which is given in IS 875 part 2 -1987, page No. 14, table No. 2] is shown in

TABLE 2 IMPOSED LOADS ON VARIOUS TYPES OF ROOFS			
(Clause 4.1)			
Sl. No.	TYPE OF ROOF	UNIFORMLY DISTRIBUTED IMPOSED LOAD MEASURED ON PLAN AREA	MINIMUM IMPOSED LOAD MEASURED ON PLAN
(1)	(2)	(3)	(4)
i)	Flat, sloping or curved roof with slopes up to and including 10 degrees		
	a) Access provided	1.5 kN/m ²	3.75 kN uniformly distributed over any span of one metre width of the roof slab and 9 kN uniformly distributed over the span of any beam or truss or wall
	b) Access not provided except for maintenance	0.75 kN/m ²	1.9 kN uniformly distributed over any span of one metre width of the roof slab and 4.5 kN uniformly distributed over the span of any beam or truss or wall

figure 3.1.

Figure 3.1: Imposed load on roof.

The imposed load on the roof slab is taken as 1.5 KN /m² because the access is provided to the roofs.

Live Load on floor slab:

Live load on floor slab based on occupancy is shown in figure 3.2. [which is given in IS 875 part 2 - 1987, page No. 7, table No. 1].

TABLE 1 IMPOSED FLOOR LOADS FOR DIFFERENT OCCUPANCIES			
(Clauses 3.1, 3.1.1 and 4.1.1)			
Sl. No.	OCCUPANCY CLASSIFICATION	UNIFORMLY DISTRIBUTED LOAD (UDL)	CONCENTRATED LOAD
(1)	(2)	(3)	(4)
		kN/m ²	kN
i)	RESIDENTIAL BUILDINGS		
	a) Dwelling houses:		
	1) All rooms and kitchens	2.0	1.8
	2) Toilet and bath rooms	2.0	—
	3) Corridors, passages, staircases including fire escapes and store rooms	3.0	4.5
	4) Balconies	3.0	1.5 per metre run concentrated at the outer edge

Figure 3.2: Imposed load on floor slabs.

The imposed load on the floor slab is taken as 2 KN /m² for all rooms & kitchen and for corridors & balconies the load is taken as 3KN/m².

3.3 Load distribution from slab to beams:

Load is distributed in beams based on type of slab (according to ly/lx ratio).

Type of slab based on ly/lx ratio:

One-way slab: if the ly/lx ratio of the slab is greater than or equal to 2 then the slab is considered as one-way slab.

two-way slab: if the ly/lx ratio of the slab is less than 2 then the slab is considered as two-way slab.

Where,

ly = longer span of the slab

lx = shorter span of the slab

In case of one-way slab, the loads are distributed evenly on both longer sides of slab in the form of rectangles which can be calculated by multiplying load and the area of rectangle.

In case of two-way slab, the loads are distributed to the beams in the form of triangles and trapezoids. The following formulas are used to calculate the distributed loads on beams.

For triangle - $\frac{wl_x}{3}$

For trapezoid - $\frac{wl_x}{2} \left(1 - \frac{1}{3\beta^2}\right)$

Where,

$$\beta = \frac{l_y}{l_x}$$

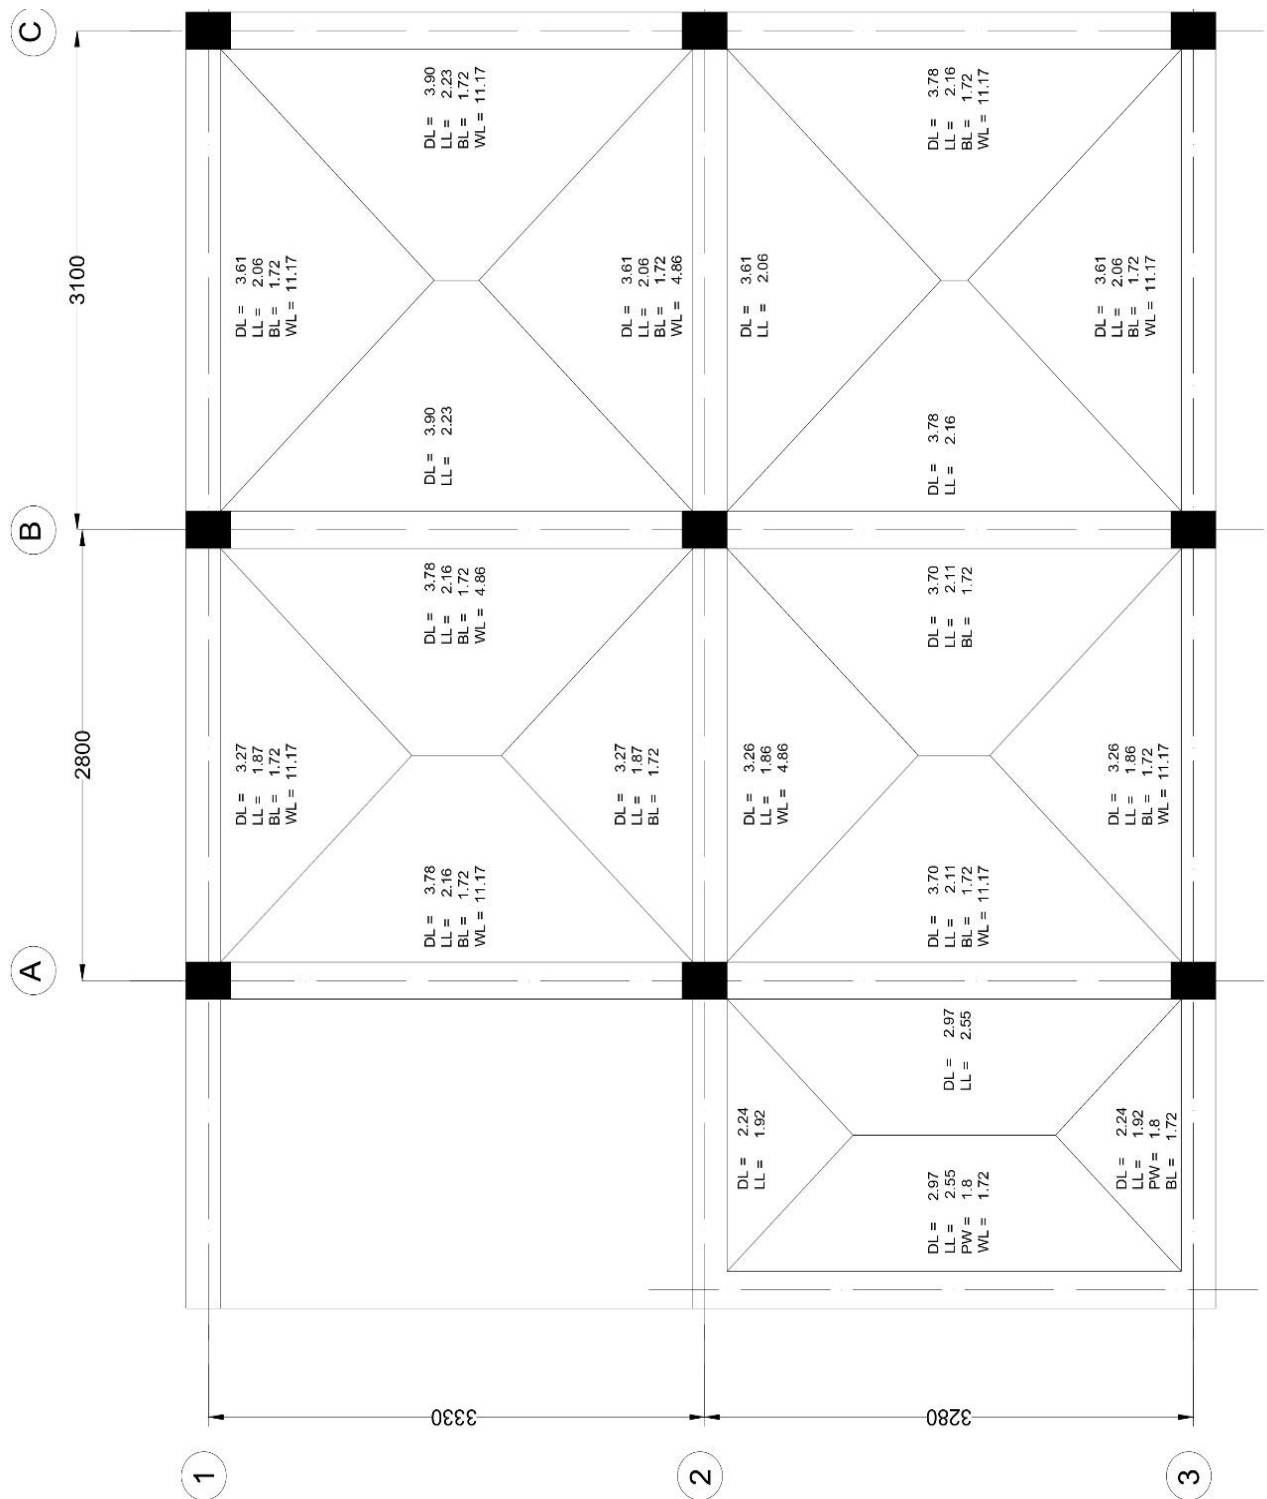


Figure 3.3: Roof slab loads.

3.4 Structural frames:

3.4.1 Loads on structural frames:

The loads coming from slabs and walls and the self-weight of the beam are taken as the uniformly distributed load (UDL) and the load which is transferred to the main beam(which are supported or directly connected to the columns) by the sub beams (which are supported by main beams or connected to the main beams) in the form of support reactions is taken as point load

The following figures shows the structural frames caring loads.

(Note: DL= Dead Load, BL = Beam Load, PW = Parapet Load, WL = Wall Load, LL= Live Load).

Frame A1-B1-C1:

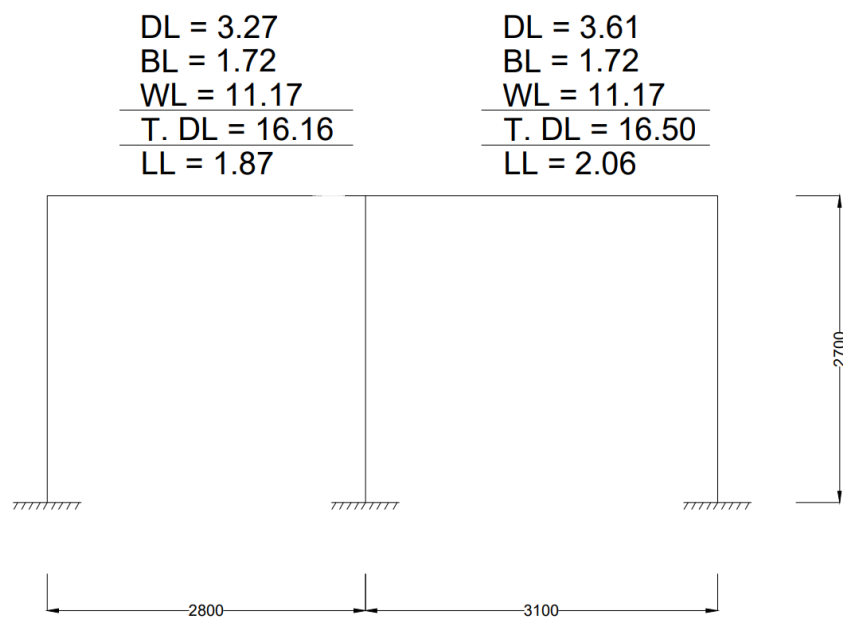


Figure 3.4: Load calculation in frame A1-B1-C1.

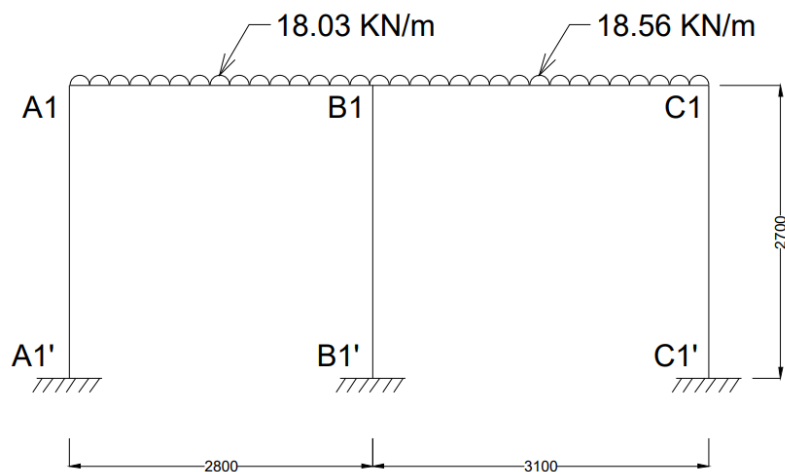


Figure 3.5: Frame A1-B1-C1 with loads.

Frame A2-B2-C2:

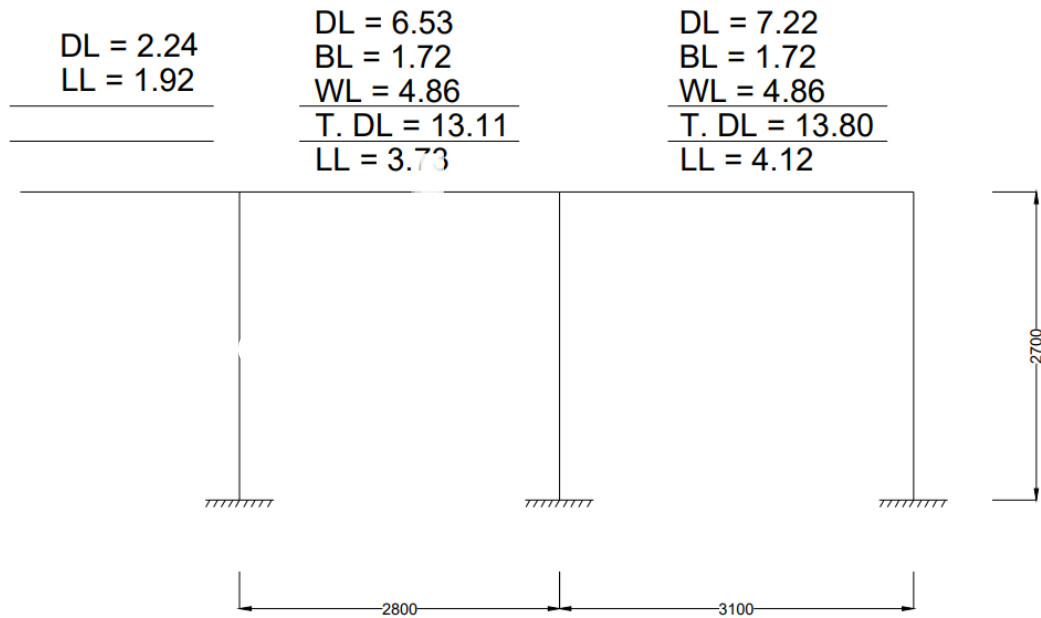


Figure 3.6: Load calculation in frame A2-B2-C2.

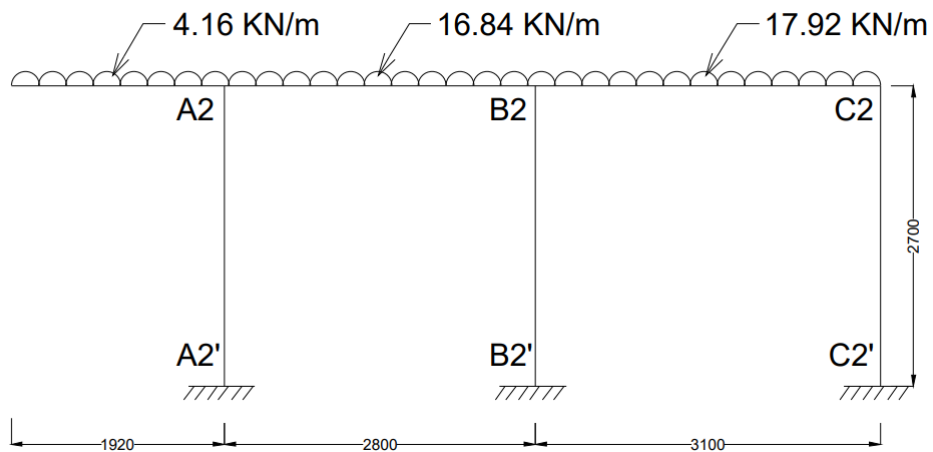


Figure 3.7: Frame A2-B2-C2 with loads.

Frame A3-B3-C3:

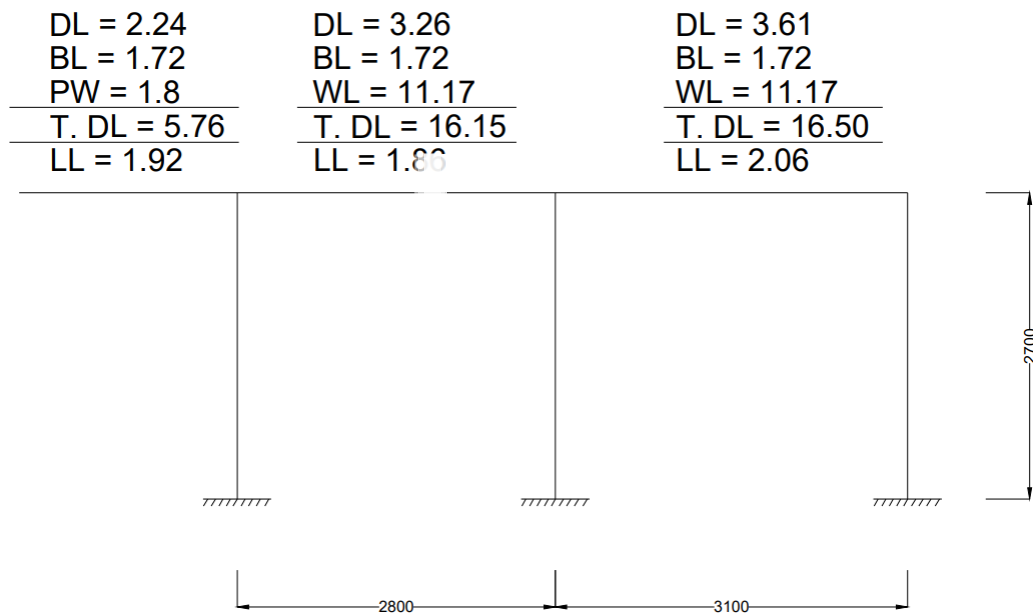


Figure 3.8: Load calculation in frame A3-B3-C3.

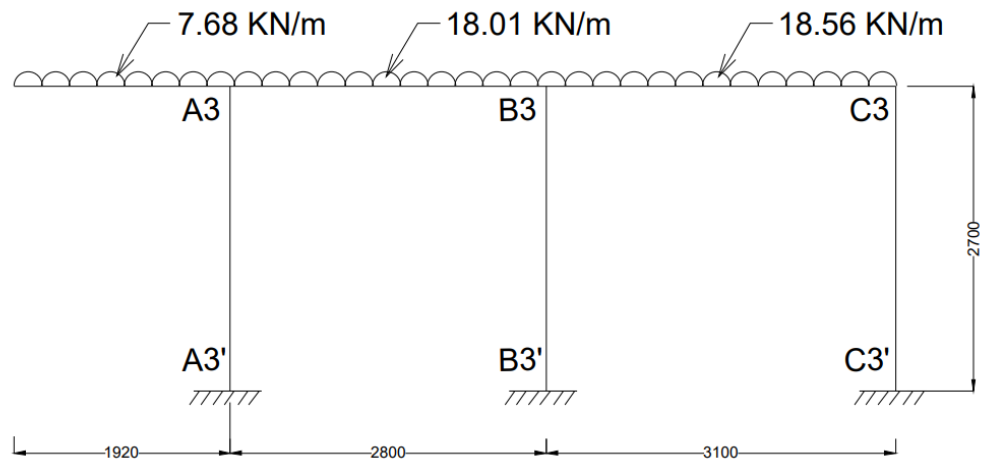


Figure 3.9: Frame A3-B3-C3 with loads.

Frame A1-A2-A3:

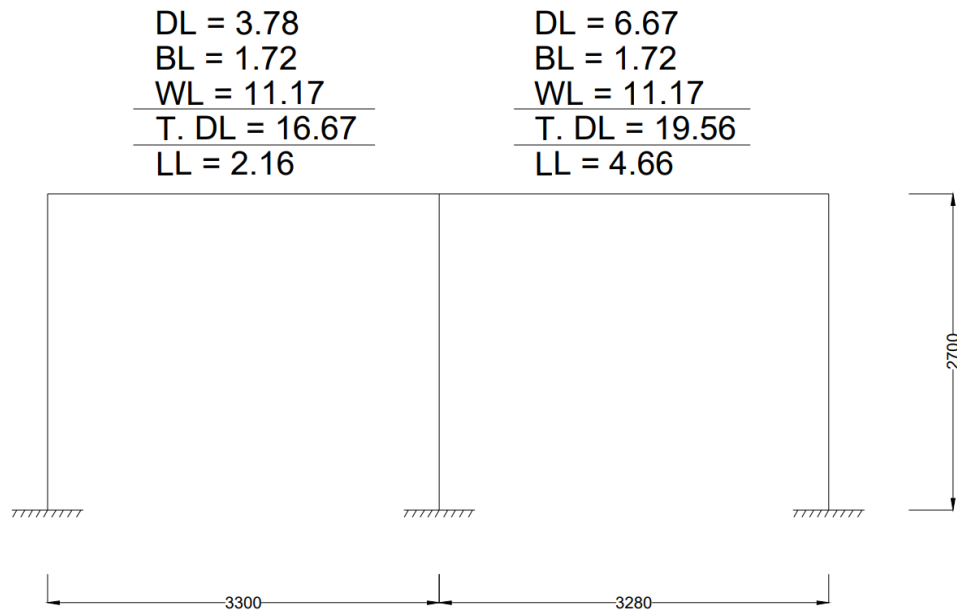


Figure 3.10: Load calculation in frame A1-A2-A3.

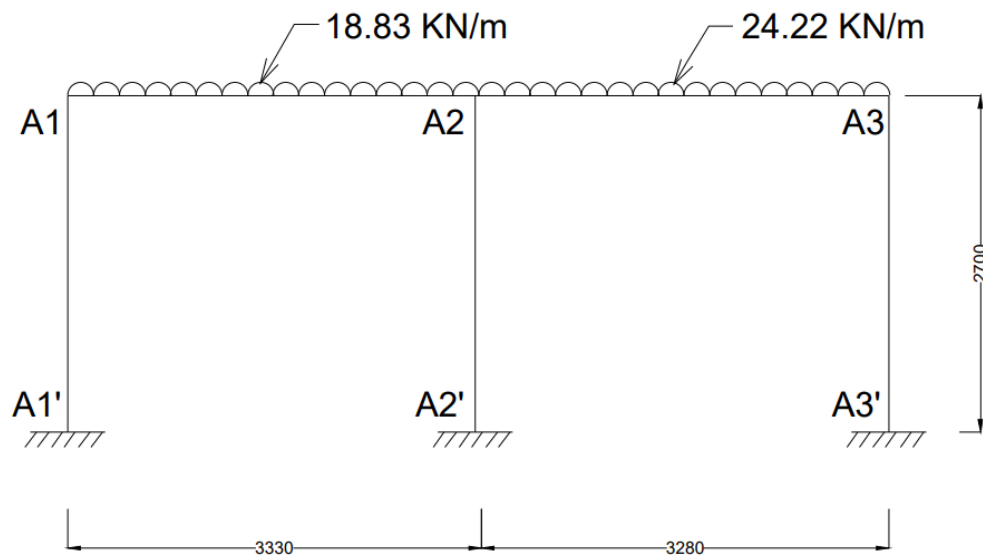


Figure 3.11: Frame A1-A2-A3 with loads.

Frame B1-B2-B3:

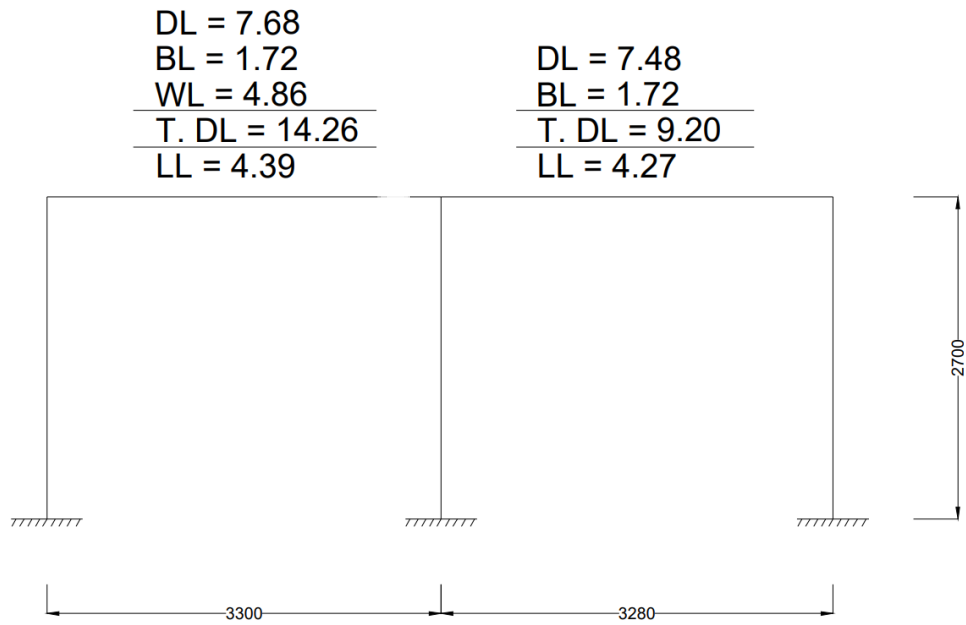


Figure 3.12: Load calculation in frame B1-B2-B3.

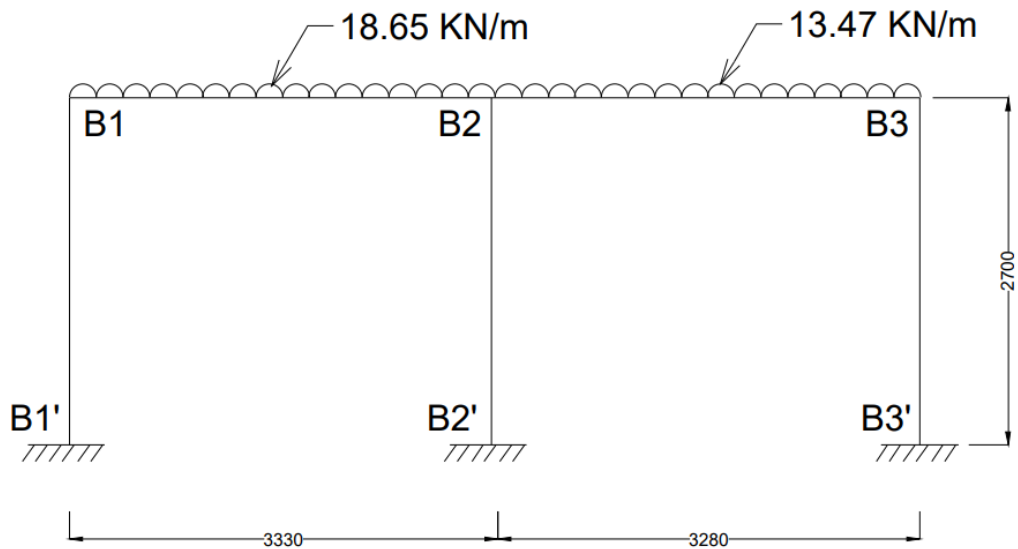


Figure 3.13: Frame B1-B2-B3 with loads.

Frame C1-C2-C3:

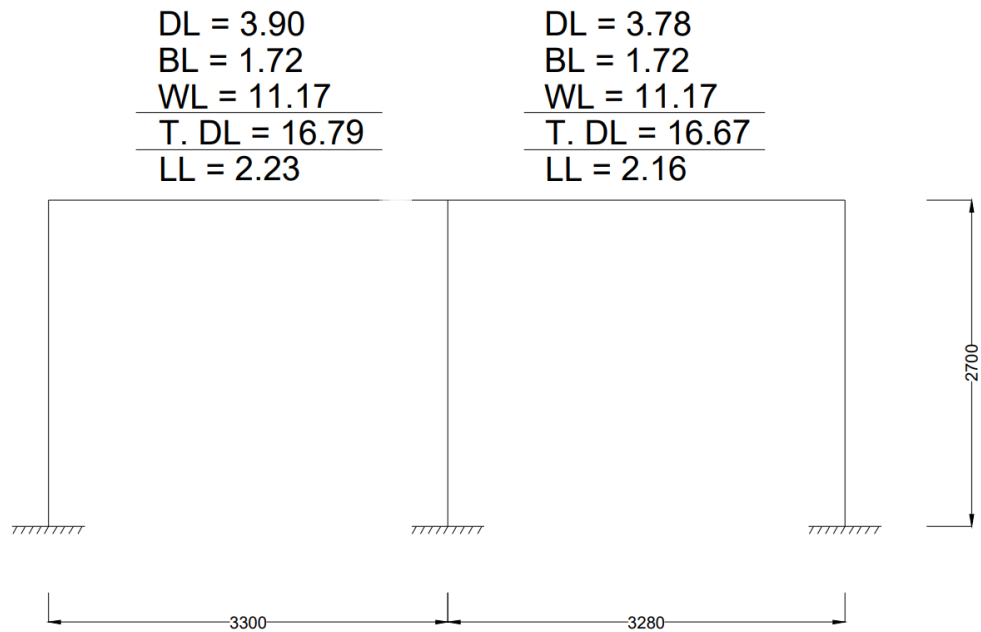


Figure 3.14: Load calculation in frame C1-C2-C3.

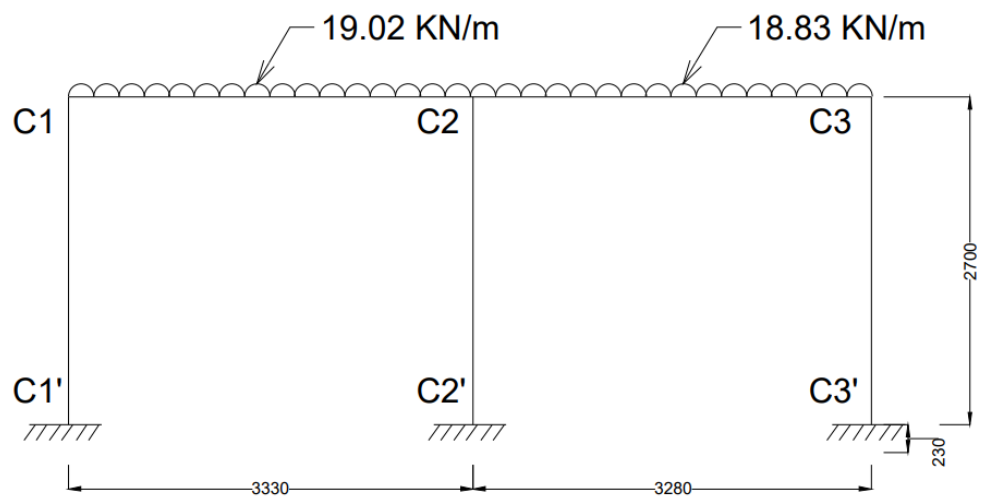


Figure 3.15: Frame C1-C2-C3 with loads.

3.5 METHODS OF ANALYSIS:

The structural analysis is a mathematical algorithm process by which the response of a structure to specified loads and actions is determined. This response is measured by determining the internal forces or stress resultants and displacements or deformations throughout the structure.

To get various forces and moments in the members (or) frames, it is necessary to analyze the frame and then designed. The following are some methods used in frame analysis.

1. Slope Deflecting Method.
2. Moment Distribution Method.
3. Kani's Method.
4. Substitute Frame Method.
5. Finite Element Method.
6. Cantilever Method.
7. Portal Method.
8. Factor Method.
9. Matrix Method.
10. Column Analogy Method.

3.5.1 Kani's Method:

Gasper Kani, a German engineer, developed another distribution procedure based on slope deflection equations. This method is very useful for the analysis of multistorey frames. The greatest advantage of this method is, even if a mistake is committed in distribution in one of the cycles, it converges finally to the correct answer. Even today, many practising engineers who are not familiar with computer methods, use Kani's method for the analysis of 3 to 4 storey building frames.

This method is first explained for structures with fixed ends. Then, the modifications to handle simply supported and overhanging ends are discussed. Analysis of symmetric frames making use of the symmetry is also explained, after which an analysis of general frames is taken up.

3.6 ANALYSIS by Kani's Method:

Analysis of Frame A1-B1-C1

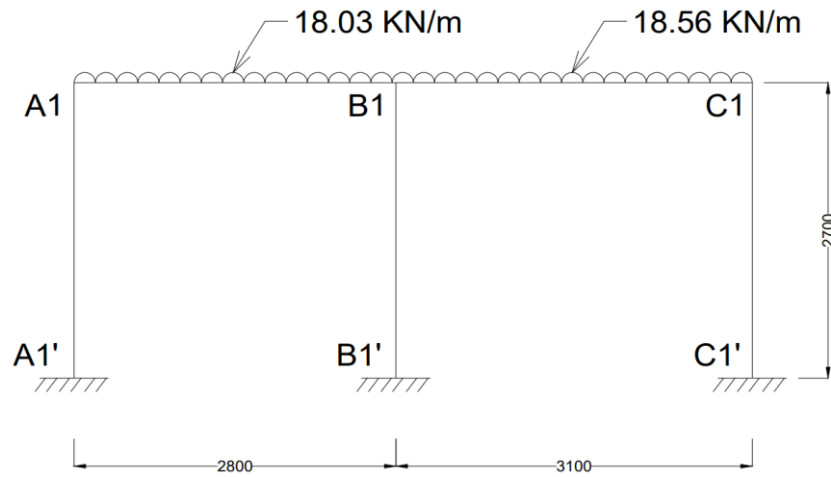


Figure 3.16: Frame A1-B1-C1

Step 1: Fixed End Moments

$$MF_{A_1B_1} = \frac{-WL^2}{12} = \frac{-18.03 \times 2.8^2}{12} = -11.78 \text{ KN-m}$$

$$MF_{B_1A_1} = \frac{WL^2}{12} = \frac{18.03 \times 2.8^2}{12} = +11.78 \text{ KN-m}$$

$$MF_{B_1C_1} = \frac{-WL^2}{12} = \frac{-18.56 \times 3.1^2}{12} = -14.86 \text{ KN-m}$$

$$MF_{C_1B_1} = \frac{WL^2}{12} = \frac{18.56 \times 3.1^2}{12} = +14.86 \text{ KN-m}$$

Fixed end moments in All the columns are zero.

i.e,

$$MF_{A_1A_1'} = MF_{A_1'A_1} = MF_{B_1B_1'} = MF_{B_1'B_1} = MF_{C_1C_1'} = MF_{C_1'C_1} = 0$$

Step 2: Rotation Factor $\left(R.F = -\frac{1}{2} \left(\frac{k}{\Sigma k} \right) \right), \left(k = \frac{4EI}{L} \right)$

Joints	Members	Stiffness (k)	Σk	R.F
A1	A1B1	1.428EI	2.909EI	-0.245
	A1A1'	1.481EI		-0.255
B1	B1A1	1.428EI	4.200EI	-0.170
	B1C1	1.290EI		-0.154
	B1B1'	1.481EI		-0.176
C1	C1B1	1.290EI	2.771EI	-0.233
	C1C1'	1.481EI		-0.267

Table 3.2: Rotation Factor

Stiffness (k) $\left(k = \left(\frac{4EI}{L} \right) \right)$

$$K_{A1B1} = \left(\frac{4EI}{2.8} \right) = 1.428EI$$

$$K_{A1A1'} = \left(\frac{4EI}{2.7} \right) = 1.481EI$$

$$K_{B1A1} = \left(\frac{4EI}{2.8} \right) = 1.428EI$$

$$K_{B1C1} = \left(\frac{4EI}{3.1} \right) = 1.290EI$$

$$K_{B1B1'} = \left(\frac{4EI}{2.7} \right) = 1.481EI$$

$$K_{C1B1} = \left(\frac{4EI}{3.1} \right) = 1.290EI$$

$$K_{C1C1'} = \left(\frac{4EI}{2.7} \right) = 1.481EI$$

Rotation Factor $\left(R.F = -\frac{1}{2} \left(\frac{k}{\Sigma k} \right) \right)$

$$R.F_{A1B1} = -\frac{1}{2} \left(\frac{1.428EI}{2.909EI} \right) = -0.245$$

$$R.F_{A1A1'} = -\frac{1}{2} \left(\frac{1.481EI}{2.909EI} \right) = -0.255$$

$$R.F_{B1A1} = -\frac{1}{2} \left(\frac{1.428EI}{4.200EI} \right) = -0.170$$

$$R.F_{B1C1} = -\frac{1}{2} \left(\frac{1.290EI}{4.200EI} \right) = -0.154$$

$$R.F_{B1B1'} = -\frac{1}{2} \left(\frac{1.481EI}{4.200EI} \right) = -0.176$$

$$R.F_{C1B1} = -\frac{1}{2} \left(\frac{1.290EI}{2.771EI} \right) = -0.233$$

$$R.F_{C1C1'} = -\frac{1}{2} \left(\frac{1.481EI}{2.771EI} \right) = -0.267$$

Sum of Stiffness Σk at Joints

$$A1: 1.428EI + 1.481EI = 2.909EI$$

$$B1: 1.428EI + 1.290EI + 1.481EI = 4.200EI$$

$$C1: 1.290EI + 1.481EI = 2.771EI$$

Step 3: Displacement Factor $\left(D.F = -\frac{3}{2} \left(\frac{k}{\Sigma k} \right) \right)$

Storey	Members	k	Σk	D.F
1	A1A1'	1.481EI	4.444EI	-0.5
	B1B1'	1.481EI		-0.5
	C1C1'	1.481EI		-0.5

Table 3.3: Displacement Factor

Stiffness (k) $\left(k = \left(\frac{4EI}{L} \right) \right)$

$$K_{A1A1'} = \left(\frac{4EI}{2.7} \right) = 1.481EI$$

$$K_{B1B1'} = \left(\frac{4EI}{2.7} \right) = 1.481EI$$

$$K_{C1C1'} = \left(\frac{4EI}{2.7} \right) = 1.481EI$$

Sum of Stiffness Σk at Storey

$$\Sigma k = 1.481EI + 1.481EI + 1.481EI = 4.444EI$$

Displacement Factor $\left(D.F = -\frac{3}{2} \left(\frac{k}{\Sigma k} \right) \right)$

$$D.F_{A1A1'} = -\frac{3}{2} \left(\frac{1.481EI}{4.444EI} \right) = -0.5$$

$$D.F_{B1B1'} = -\frac{3}{2} \left(\frac{1.481EI}{4.444EI} \right) = -0.5$$

$$D.F_{C1C1'} = -\frac{3}{2} \left(\frac{1.481EI}{4.444EI} \right) = -0.5$$

Rotation and Displacement Contribution

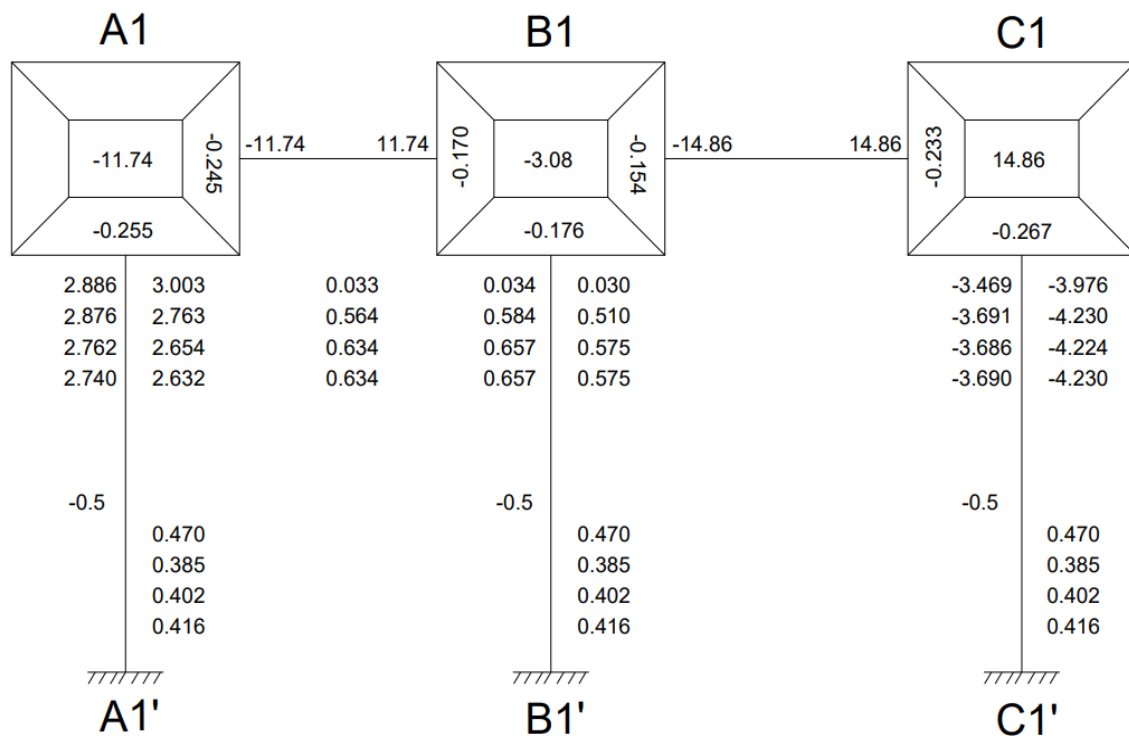


Figure 3.17: Rotation and Displacement Contribution

Cycle 1

Joint Rotation ($C.V. = R.F \times [\sum FEM + NCV + FCV]$)

$$M_{A1B1} = -0.245 \times [-11.78 + 0 + 0] = 2.886$$

$$M_{A1A1'} = -0.255 \times [-11.78 + 0 + 0] = 3.003$$

$$M_{B1A1} = -0.170 \times [-3.08 + 2.886 + 0] = 0.033$$

$$M_{B1C1} = -0.154 \times [-3.08 + 2.886 + 0] = 0.030$$

$$M_{B1B1'} = -0.176 \times [-3.08 + 2.886 + 0] = 0.034$$

$$M_{C1B1} = -0.233 \times [14.86 + 0.030 + 0] = -3.469$$

$$M_{C1C1'} = -0.267 \times [14.86 + 0.030 + 0] = -3.976$$

Displacement Contribution

For All Columns ($R.V. = D.F \times [\sum Rotations Contribution at Columns]$)

$$M_{A1A1'} + M_{B1B1'} + M_{C1C1'} = -0.5 \times (3.003 + 0.034 + (-3.976)) = 0.470$$

Cycle 2

Joint Rotation ($C.V. = R.F \times [\sum FEM + NCV + FCV]$)

$$M_{A1B1} = -0.245 \times [-11.78 + 0.470 + 0.033] = 2.763$$

$$M_{A1A1'} = -0.255 \times [-11.78 + 0.470 + 0.033] = 2.876$$

$$M_{B1A1} = -0.170 \times [-3.08 + 0.470 + 2.763 + (-3.469)] = 0.564$$

$$M_{B1C1} = -0.154 \times [-3.08 + 0.470 + 2.763 + (-3.469)] = 0.510$$

$$M_{B1B1'} = -0.176 \times [-3.08 + 0.470 + 2.763 + (-3.469)] = 0.584$$

$$M_{C1B1} = -0.233 \times [14.86 + 0.470 + 0.510] = -3.691$$

$$M_{C1C1'} = -0.267 \times [14.86 + 0.470 + 0.510] = -4.230$$

Displacement Contribution

For All Columns ($R.V. = D.F \times [\sum Rotations Contribution at Columns]$)

$$M_{A1A1'} + M_{B1B1'} + M_{C1C1'} = -0.5 \times (2.876 + 0.584 + (-4.230)) = 0.385$$

Cycle 3

Joint Rotation ($C.V. = R.F \times [\sum FEM + NCV + FCV]$)

$$M_{A1B1} = -0.245 \times [-11.78 + 0.385 + 0.564] = 2.654$$

$$M_{A1A1'} = -0.255 \times [-11.78 + 0.385 + 0.564] = 2.762$$

$$M_{B1A1} = -0.170 \times [-3.08 + 0.385 + 2.654 + (-3.691)] = 0.634$$

$$M_{B1C1} = -0.154 \times [-3.08 + 0.385 + 2.654 + (-3.691)] = 0.575$$

$$M_{B1B1'} = -0.176 \times [-3.08 + 0.385 + 2.654 + (-3.691)] = 0.657$$

$$M_{C1B1} = -0.233 \times [14.86 + 0.385 + 0.575] = -3.686$$

$$M_{C1C1'} = -0.267 \times [14.86 + 0.385 + 0.575] = -4.224$$

Displacement Contribution

For All Columns ($R.V. = D.F \times [\sum Rotations Contribution at Columns]$)

$$M_{A1A1'} + M_{B1B1'} + M_{C1C1'} = -0.5 \times (2.762 + 0.657 + (-4.224)) = 0.4025$$

Cycle 4

Joint Rotation ($C.V. = R.F \times [\sum FEM + NCV + FCV]$)

$$M_{A1B1} = -0.245 \times [-11.78 + 0.4025 + 0.634] = 2.632$$

$$M_{A1A1'} = -0.255 \times [-11.78 + 0.4025 + 0.634] = 2.740$$

$$M_{B1A1} = -0.170 \times [-3.08 + 0.4025 + 2.632 + (-3.686)] = 0.634$$

$$M_{B1C1} = -0.154 \times [-3.08 + 0.4025 + 2.632 + (-3.686)] = 0.575$$

$$M_{B1B1'} = -0.176 \times [-3.08 + 0.4025 + 2.632 + (-3.686)] = 0.657$$

$$M_{C1B1} = -0.233 \times [14.86 + 0.4025 + 0.575] = -3.690$$

$$M_{C1C1'} = -0.267 \times [14.86 + 0.4025 + 0.575] = -4.230$$

Displacement Contribution

For All Columns ($R.V. = D.F \times [\sum Rotations Contribution at Columns]$)

$$M_{A1A1'} + M_{B1B1'} + M_{C1C1'} = -0.5 \times (2.740 + 0.657 + (-4.230)) = 0.4165$$

Step 4: Final End Moments

$$M_{ij} = \text{FEM} + 2 \times M_{ij} (\text{Near end Rotation}) + M_{ji} (\text{Far end Rotation}) + M'' (\text{Displacement})$$

Beams (No Sway $M'' = 0$)

$$M_{A1B1} = -11.78 + 2(2.632) + 0.634 = -5.88$$

$$M_{B1A1} = 11.78 + 2(0.634) + 2.632 = 15.68$$

$$M_{B1C1} = -14.86 + 2(0.575) + (-3.690) = -17.40$$

$$M_{C1B1} = 14.86 + 2(-3.690) + 0.575 = 8.05$$

Column (With Sway $M'' = 0.4165$)

$$M_{A1A1'} = 0 + 2(2.740) + 0 + 0.4165 = 5.89$$

$$M_{A1'A1} = 0 + 2(0) + 2.740 + 0.4165 = 3.15$$

$$M_{B1B1'} = 0 + 2(0.657) + 0 + 0.4165 = 1.73$$

$$M_{B1'B1} = 0 + 2(0) + 0.657 + 0.4165 = 1.07$$

$$M_{C1C1'} = 0 + 2(-4.230) + 0 + 0.4165 = -8.04$$

$$M_{C1'C1} = 0 + 2(0) + (-4.230) + 0.4165 = -3.81$$

Equilibrium Check

$$\text{Joint A1} = M_{A1B1} + M_{A1A1'} = -5.88 + 5.89 = 0.01 \approx 0$$

$$\text{Joint A1} = M_{B1A1} + M_{B1C1'} + M_{B1B1'} = 15.68 + (-17.40) + 1.73 = 0.01 \approx 0$$

$$\text{Joint A1} = M_{C1B1} + M_{C1C1'} = 8.05 - 8.04 = 0.01 \approx 0$$

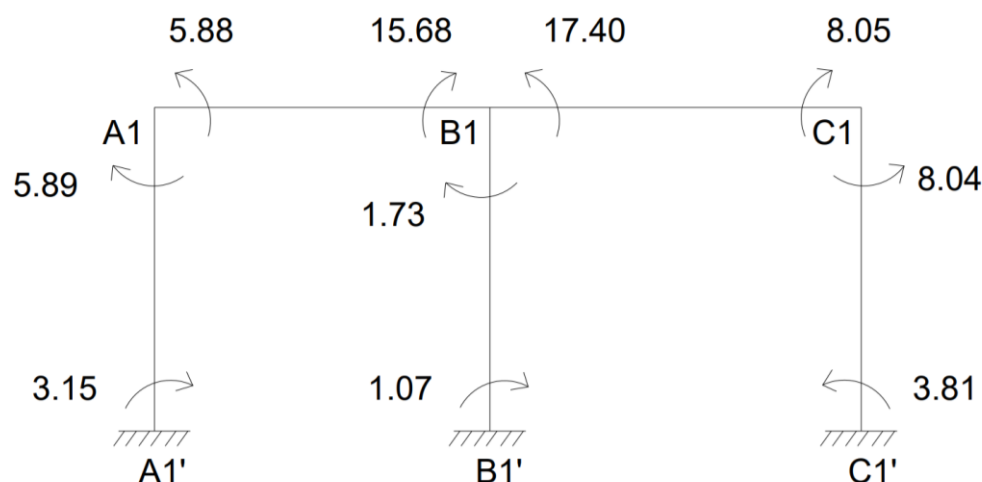


Figure 3.18: Final End Moments

CALCULATION BENDING MOMENT

$$BM_{A1B1} = \frac{WL^2}{8} = \frac{18.03 \times 2.8^2}{8} = 17.67 \text{KN-m}$$

$$BM_{B1C1} = \frac{WL^2}{8} = \frac{18.56 \times 3.1^2}{8} = 22.30 \text{KN-m}$$

BENDING MOMENT DIAGRAM

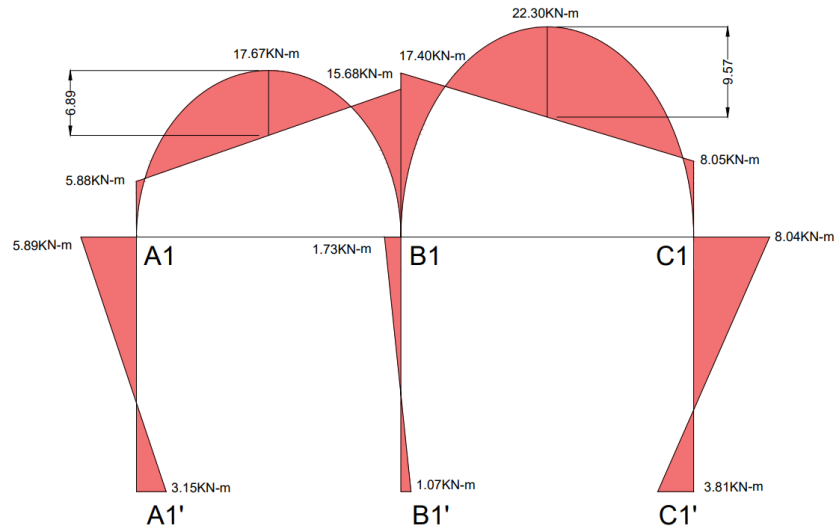


Figure 3.19: Bending Moment Diagram

CALCULATION OF REACTIONS

SPAN A1-B1

Length (L) = 2.8m, UDL (W) = 18.03KN/m

Simply Supported Reactions:

$$R_{\text{total}} = \frac{WL}{2} = \frac{18.03 \times 2.8}{2} = 25.24 \text{KN}$$

Reaction Due to End Moments:

$$R_{\text{moments}} = \frac{M_{B1A1} - M_{A1B1}}{L} = \frac{15.68 - 5.88}{2.8} = 3.50 \text{KN}$$

Final Reactions:

$$R_{A1} = R_{\text{total}} - R_{\text{moments}} = 25.24 - 3.50 = 21.74 \text{KN}$$

$$R_{B1(\text{Left})} = R_{\text{total}} + R_{\text{moments}} = 25.24 + 3.50 = 28.74 \text{KN}$$

SPAN B1-C1

Length (L) = 3.1m, UDL (W) = 18.56KN/m

Simply Supported Reactions:

$$R_{\text{total}} = \frac{WL}{2} = \frac{18.56 \times 3.1}{2} = 28.77\text{KN}$$

Reaction Due to End Moments:

$$R_{\text{moments}} = \frac{M_{B1C1} - M_{C1B1}}{L} = \frac{17.40 - 8.05}{3.1} = 3.02\text{KN}$$

Final Reactions:

$$R_{B1(\text{Right})} = R_{\text{total}} + R_{\text{moments}} = 28.77 + 3.02 = 31.79\text{KN}$$

$$R_{C1} = R_{\text{total}} - R_{\text{moments}} = 28.77 - 3.02 = 25.75\text{KN}$$

Total Reactions:

$$\text{Reaction at Column A1 (R}_{A1}\text{)} = 21.74\text{KN}$$

$$\text{Reaction at Column B1 (R}_{B1}\text{)} = R_{B1(\text{Left})} + R_{B1(\text{Right})} = 28.74 + 31.79 = 60.53\text{KN}$$

$$\text{Reaction at Column C1 (R}_{C1}\text{)} = 25.75\text{KN}$$

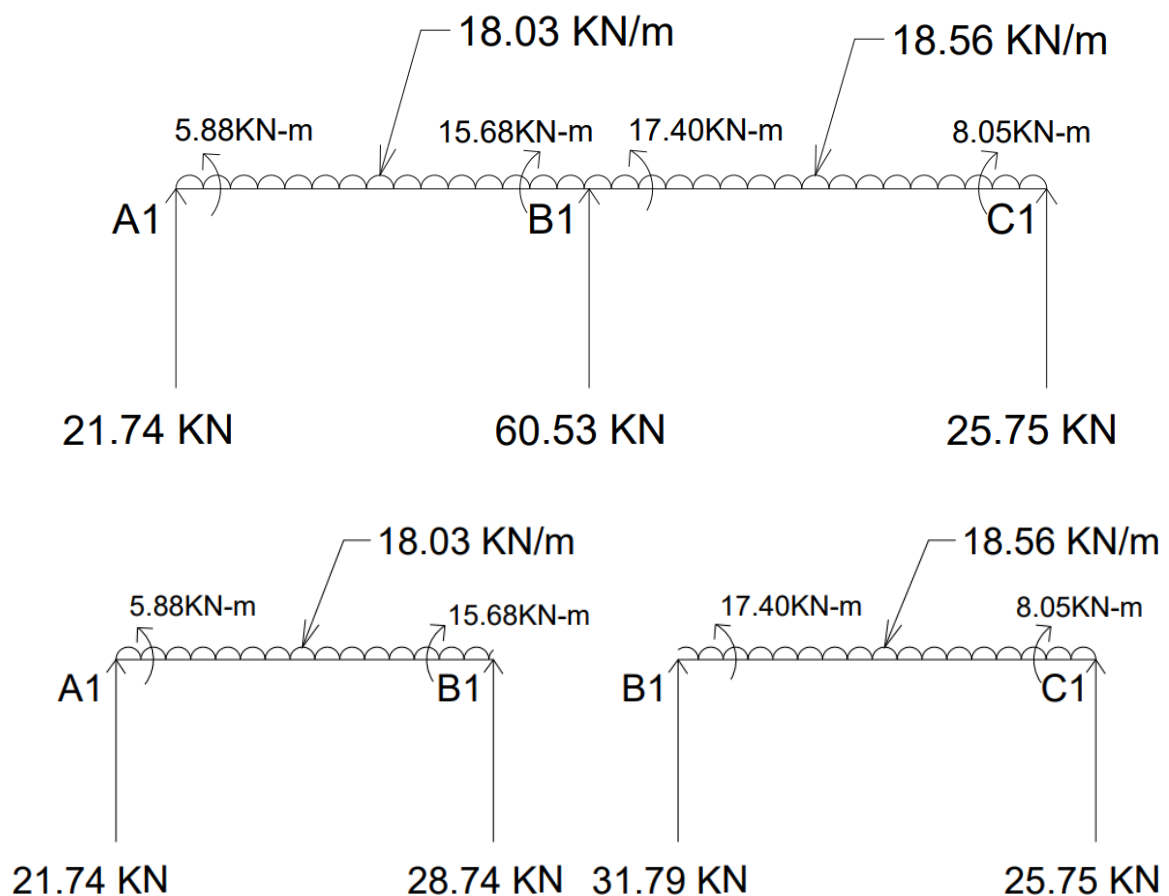


Figure 3.20: Reactions

Shear Force:

$$\text{At C1} = 25.75$$

$$\text{At B1} = 25.75 - 18.56 \times 3.1 = -31.79$$

$$= -31.79 + 60.53 = 28.74$$

$$\text{At A1} = 25.75 + 60.53 - 18.56 \times 3.1 - 18.03 \times 2.8 = -21.74$$

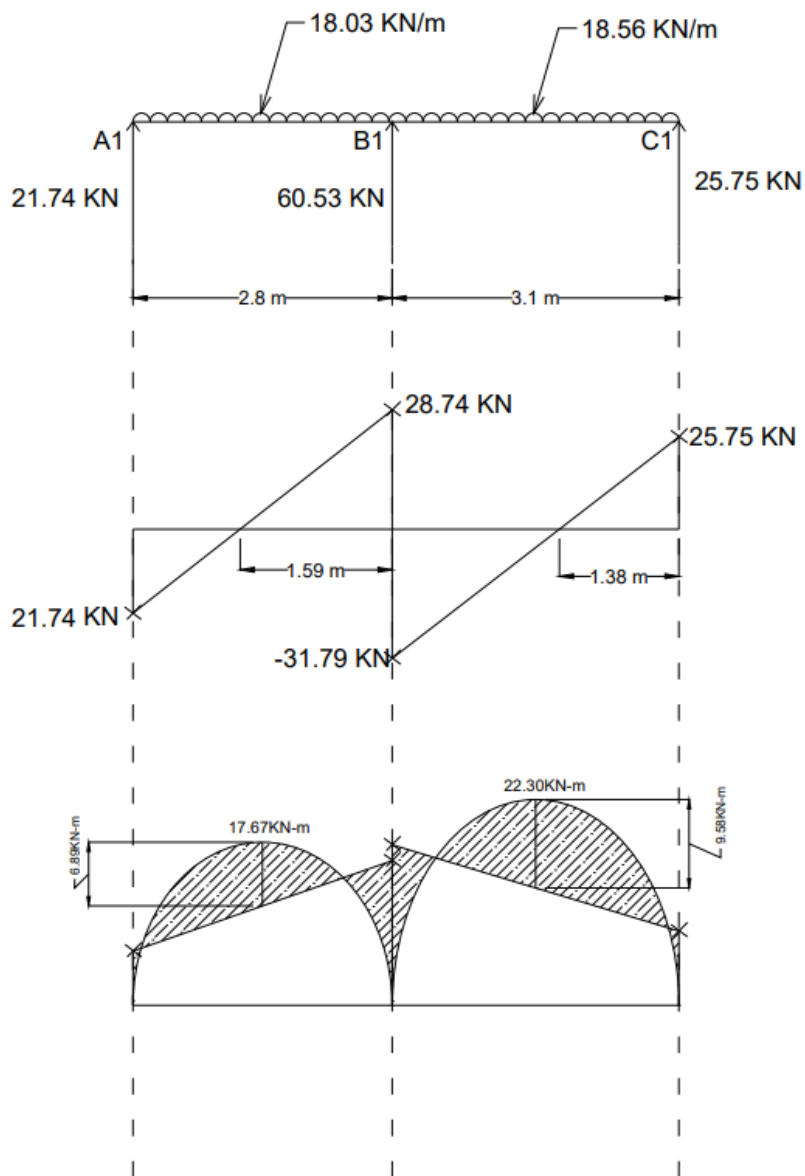


Figure 3.21: Bending Moment and Shear Force Diagram of A1-B1-C1

Analysis of Frame A2-B2-C2

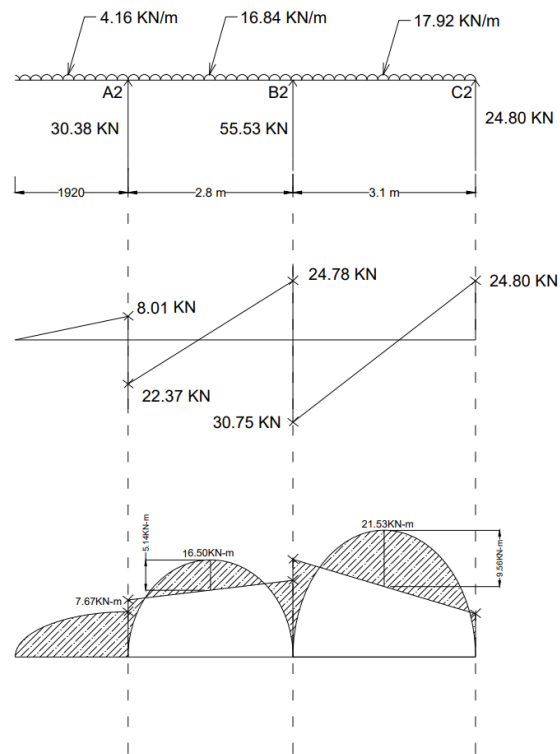


Figure 3.22: Bending Moment and Shear Force Diagram of A2-B2-C2

Analysis of Frame A3-B3-C3

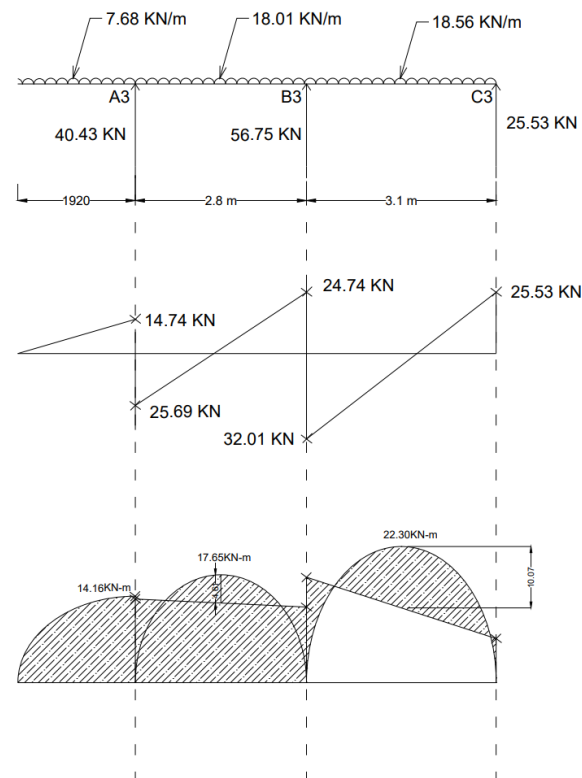


Figure 3.23: Bending Moment and Shear Force Diagram of A3-B3-C3

Analysis of Frame A1-A2-A3

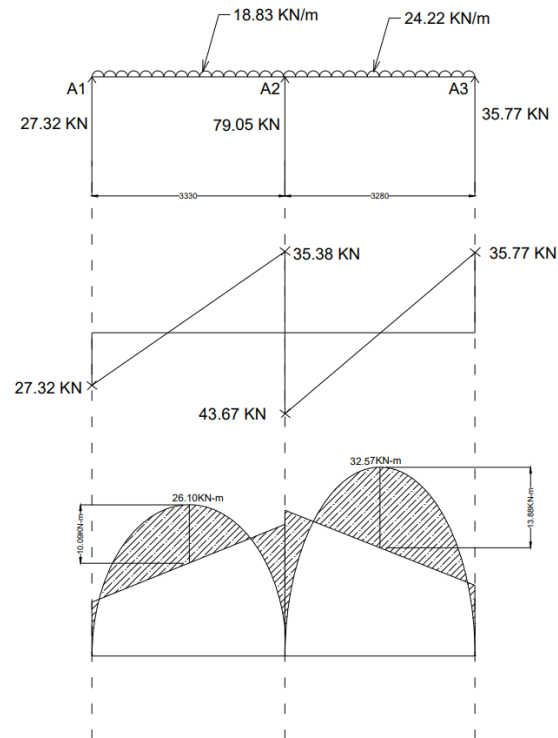


Figure 3.24: Bending Moment and Shear Force Diagram of A1-A2-A3

Analysis of Frame B1-B2-B3

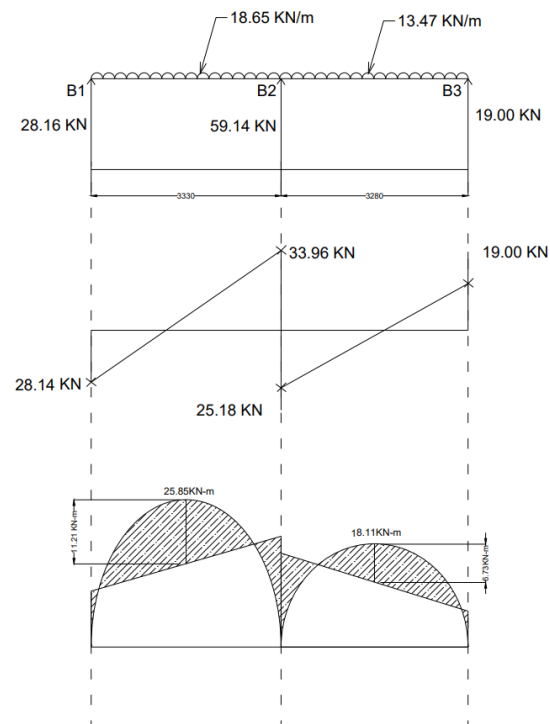


Figure 3.25: Bending Moment and Shear Force Diagram of B1-B2-B3

Analysis of Frame C1-C2-C3

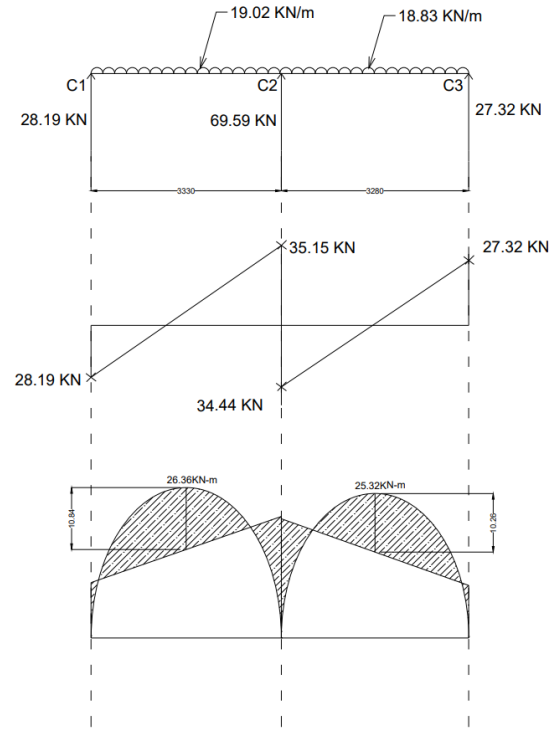


Figure 3.26: Bending Moment and Shear Force Diagram of C1-C2-C3

CHAPTER 4

DESIGNING

4.1 METHODS OF DESIGN OF REINFORCED CONCRETE:

The aim of design is to decide the size of the member and amount of reinforcement required, so that the structure will perform satisfactorily during its life period with minimum cost. The following three methods have been developed for the design of reinforced concrete structures.

- a) Working stress method
- b) Ultimate load method
- c) Limit state method

4.1.1 Working stress method:

Working stress method is based on elastic theory assuming reinforced concrete as elastic material. The stress strain curve of concrete is assumed as linear from zero at the neutral axis to a maximum value at the extreme fiber.

This method adopts permissible stresses which are obtained by dividing ultimate stress by a factor known as factor of safety. For concrete a factor of safety of 3 is used and for steel it is 1.78. This factor of safety account for any uncertainties in estimation of working loads and variation in material properties.

In working stress method, the structural member is designed for working loads such that the stresses developed are within the allowable stress. Hence, the failure criterion is the stress. This method is simple and reasonably reliable.

The drawbacks of this method are

- 1) Stress strain curve for concrete is assumed as linear, which is not true.
- 2) Factor of safety does not predict the true margin of safety.
- 3) The failure criteria assumed is stress but strain criteria is the reliable.
- 4) The effect of the creep and shrinkage of the concrete is ignored.
- 5) This method gives uneconomical section.

This method has been deleted in IS: 456-2000, but the concept of this method is retained for checking the serviceability state of deflections and cracking. Hence, the knowledge of this method is essential and IS: 456-2000 gives it in the appendix.

4.1.2 Ultimate load method:

In ultimate load method, structural elements are designed for ultimate loads which are obtained by multiplying the working loads with a factor known as load factor. Hence, the designer can able to predict the excess load the structure can carry beyond the working load without collapse. Hence, this method gives the true margin of safety. This method considers the actual stress strain curve of concrete and the failure criteria is assumed as ultimate strain.

This method gives very economical sections. However it leads to excessive deformation and cracking. Thus, this method is failed to satisfy the serviceability and durability requirements. To overcome these drawbacks, the limit state method has been developed to take care of both strength and serviceability requirements.

4.1.3 Limit state method:

In the limit state method, the structural elements are designed for ultimate load and checked for serviceability (deflection, cracking etc) at working loads so that the structure is fit for use throughout its life period. The details of this method are given in article 2.1.

4.2 PHILOSOPHY OF LIMIT STATE DESIGN:

A structure may become unfit for use not only when it collapse but when it violates the serviceability requirements such as deflection, cracking etc. the philosophy of limit state method of design is to see that the structure remains fit for use throughout its life period by assuring safety against strength and serviceability requirements i.e. the structure will not reach the limit state in its life time. The acceptable limit for safety against strength and serviceability requirements before failure occurs is called limit state. All the relevant limit state has to be considered in the design. The load and strength of the materials are to be estimated by probabilistic approach (characteristic values). The design loads and strengths are derived from the characteristic values through the use of partial safety factors.

4.2.1 Limit states:

The various limit states to be considered in the design are

- 1) Limit state of collapse
- 2) Limit state of serviceability

Limit state of collapse:

It is the limit state at which the structure is likely to collapse. The structure may collapse due to rupture of one or more critical sections or loss of overall stability due to buckling or overturning. This limit state may correspond to

- a) Flexure
- b) Compression
- c) Shear
- d) torsion

Limit state of serviceability:

Limit state serviceability relate to the performance of the structure at working loads. It is the limit state at which the structure undergone excessive deflection, which adversely affect the finishes causing discomfort to the users and excessive cracking which effects the efficiency or appearance of the structure.

This limit state may correspond to

- a) deflection
- b) cracking
- c) other limit states (vibrations, fire resistance, durability)

4.2.2 Characteristic strength of materials:

The characteristic strength of material is that value of the strength of the material below which not more than 5% of the test results are expected to fall.

For concrete, characteristic strength is compressive strength of 150 mm cubes of 28 days in N/mm², below which not more than 5% of the test results are expected to fall. Concrete grade are specified based on this strength.

For steel, the minimum yield strength or 0.2% proof strength is taken as the characteristic strength of steel.

4.2.3 Characteristic loads:

The maximum working load that the structure has to withstand and for which it has to be designed is called characteristic load. The characteristic loads are calculated based on statistical analysis.

As per code, the characteristic load is defined as that value of load which has 95% probability of not being exceeded during the life of the structure.

As statistical data of loads is not available, dead loads given in IS:875 (Part-1), imposed loads given in IS:875 (Part-2), wind loads given in IS:875 (Part-3), snow loads given in IS:875 (Part-4) and seismic forces given in IS:1893 shall be assumed as the characteristic loads as per IS:456-2000.

4.2.4 Design value and partial safety factors:

Materials: the design strength of materials is obtained by dividing the characteristic strength by a factor known as partial safety factor. The partial safety factor takes in to account variation of material strength, local weakness etc.

The design strength of the materials, is given by

$$\text{Design strength} = \frac{\text{Characteristic strength}}{\text{partial safety factor}}$$

Material	Limit state of collapse	Limit state of serviceability
Steel	1.15	1.0
Concrete	1.5	1.0

Table 4.1: Partial safety factor for material strength

Loads: design loads or factored loads, for which the structure is to be designed, are obtained by multiplying the characteristic load with a factor known as partial safety factor. The partial safety factor takes in to account inaccurate assessment of load, unexpected stress redistribution and variation in dimensional accuracy.

Load combination	Limit state of collapse			Limit state of serviceability		
	DL	LL	WL	DL	LL	WL
DL+LL	1.5	1.5	-	1.0	1.0	
DL+WL	1.5 or 0.9	-	1.5	1.0	-	1.0
DL+LL+WL	1.2	1.2	1.2	1.0	0.8	0.8

Table 4.2: Partial safety factor for loads

4.3 CODE OF PRACTICE FOR R.C.C. DESIGN:

All reinforced concrete structural design in our country should conform to the revised Indian standard code IS: 456-2000, code of practice for plain and reinforced concrete (Forth revision).

The Bureau of Indian Standards have released over the years several hand books to facilitate reinforced concrete structural designers to design routine structural elements quickly by referring to the various tables and graphs presented in the hand books.

The following hand books will serve as useful design aids for structural concrete designers.

- a) SP 16 – 1980 – Design aids for reinforced concrete to IS:456
- b) SP 24 – 1983 – Explanatory hand book on IS:456
- c) SP 34 – 1987 – Hand book on concrete reinforcement and detailing.
- d) SP 23 – 1982 – Hand book on concrete Mixes.

4.4 DESIGN OF ROOF SLAB:

The imposed loads on flat roofs, sloping roofs and curved roofs, due to use or occupancy of the building and the geometry of the types of roofs are given in Table -2 of IS:875(Part 2)-1987.

In our case, the imposed load on the roof slab is taken as **2 KN/m²** because the access is provided to the roofs. [It is given in page. 14, table – 2, clauses 4.1 of IS 875(part -2) – 1987]

For designation point of view, the roof slabs are named S1, S2, S3, and S4. Since each slab panel in our layout has unique dimensions (**2.8m x 3.3m**, **3.1m x 3.3m**, **2.8m x 3.28m**, and **3.1m x 3.28m**), there are no symmetrical groups, and each will be designed individually as shown in the figure below. The slab thickness is taken as **100mm**.

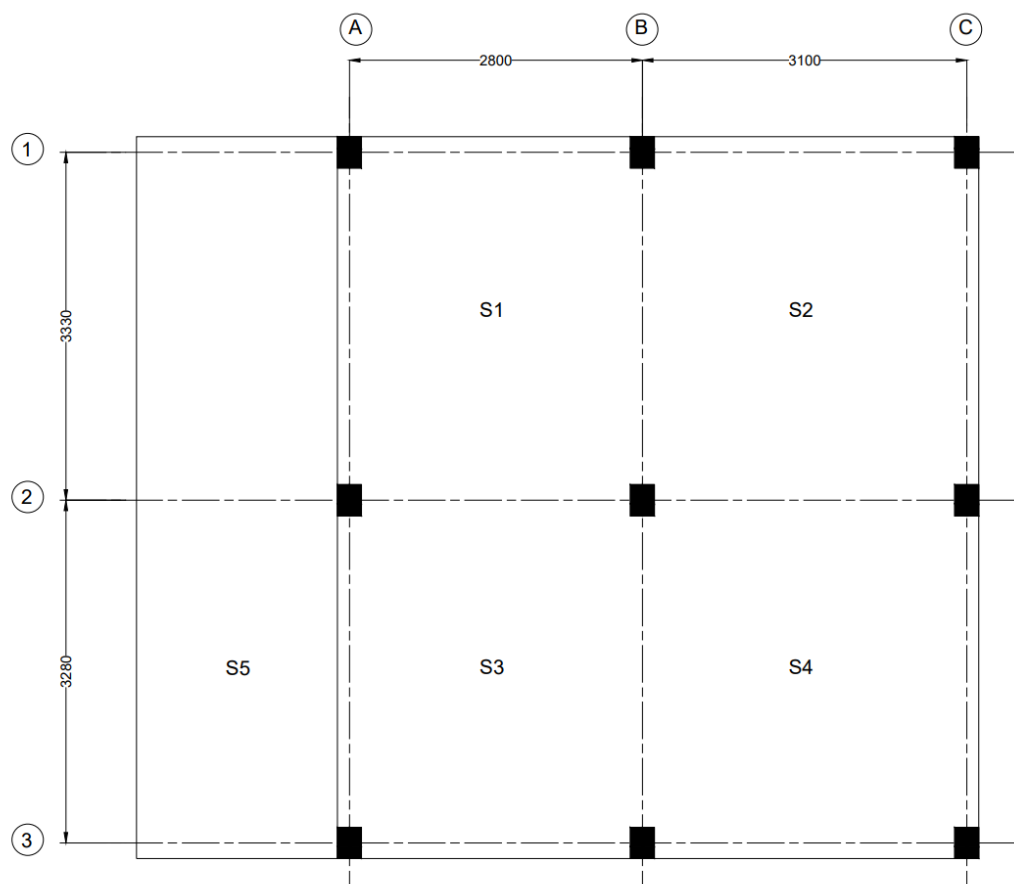


Figure 4.1: Floor Slab.

DESIGN OF SLAB [S1]:

As per Ratio,

$$L_X = 2800 \text{ mm}$$

$$L_Y = 3330 \text{ mm}$$

$$\frac{L_y}{L_x} = \frac{3330}{2800} = 1.19 < 2$$

So the slab should be design as two way slab

Assuming the Depth:

Overall depth of the slab = $d_o = 100 \text{ mm}$

Diameter of the bar in Shorter Span directions = 8 mm

Diameter of the bar in Longer directions = 8 mm

Clear cover = 15 mm

Code limits:

As per IS 456-2000 Overall depth of the slab should be greater of the following

1) $d_o > 100 \text{ mm}$

So it is satisfied.

Diameter of the bar:

The diameter of reinforcing bar shall not exceed one eight of the total thickness of the slab witch is given in page No.48 of IS - 456-2000 in article 26.5.2.2.

$$\begin{aligned} \text{Maximum diameter of the bar} &= \frac{1}{8} d_o \\ &= \frac{1}{8} \times 100 \\ &= 12.5 \text{ mm} > 8 \text{ mm} \end{aligned}$$

Maximum Dia of the bar > selected Dia bar

*So let us adopt **8mm** dia bar

Effective depth:

$$d_{(\text{short})} = 100 - 15 - \frac{8}{2} = 81 \text{ mm}$$

$$d_{(\text{longer})} = 100 - 15 - 8 - \frac{8}{2} = 73 \text{ mm}$$

EFFECTIVE LENGTH:

Shorter span:

[Given in page No.34 of IS - 456-2000 in article 22.2(a).]

It should be least of the following

(Clear Span= 2800-230= 2570mm)

- 1) Clear span + Half of the bearing on either side of the slab
[Bearing = 230mm]

$$= \frac{230}{2} + 2570 + \frac{230}{2}$$

$$= 2800 \text{ mm}$$

- 2) Clear span + Effective Depth

$$= 2570 + 81$$

$$= 2651 \text{ mm}$$

*So take Effective length = **2651mm**

Longer span:

[Given in page No.34 of IS - 456-2000 in article 22.2(a).]

It should be least of the following

(Clear Span= 3330-230= 3100mm)

- 1) Clear span + Half of the bearing on either side of the slab
[Bearing = 230 mm]

$$= \frac{230}{2} + 3100 + \frac{230}{2}$$

$$= 3330 \text{ mm}$$

- 2) Clear span + Effective Depth

$$= 3100 + 73$$

$$= 3173 \text{ mm}$$

*So take Effective length = **3173 mm**

LOADS ON THE SLAB:

As per IS – 875 (Part – 2) – 1987, the imposed loads on the roof slab is taken as 2 KN /m² where the access is provided to the roofs.

[It is given in page. 14, table – 2, cause 1(a) of IS 875(part -2) – 1987]

$$\text{Self weight of the slab} = 1 \times 1 \times 0.100 \times 25$$

$$= 2.5 \text{ KN/m}^2$$

$$\text{Weight of weathering course} = 1 \text{ KN/m}^2$$

$$\text{Imposed load} = 2 \text{ KN/m}^2$$

$$\text{Total Load} = 5.5 \text{ KN/m}^2$$

Now,

$$\text{Factored load} = 1.5 \times 5.5 = 8.25 \text{ KN/m}^2$$

FACTORED BENDING MOMENTS:

$$M_x = \alpha_x W l_x^2$$

$$M_y = \alpha_y W l_x^2$$

The value of α_x and α_y are given in table -26 of the IS 456- 2000 in page.no.91. This values are depends on type of panel and moment consideration.

$$\frac{L_y}{L_x} = \frac{3173}{2651} = 1.196 \cong 1.20$$

$$\alpha_x = (-ve) 0.048 \quad \& \quad (+ve) 0.036$$

$$\alpha_y = (-ve) 0.037 \quad \& \quad (+ve) 0.028$$

$$M_{ux} (+ve) = 0.036 \times 8.25 \times (2.651)^2 = 2.09 \text{ KN-m}$$

$$M_{ux} (-ve) = 0.048 \times 8.25 \times (2.651)^2 = 2.78 \text{ KN-m}$$

$$M_{uy} (+ve) = 0.028 \times 8.25 \times (2.651)^2 = 1.62 \text{ KN-m}$$

$$M_{uy} (-ve) = 0.037 \times 8.25 \times (2.651)^2 = 2.15 \text{ KN-m}$$

CHECK FOR DEPTH:

$$M_u = M_{u'} \lim$$

$$M_u = 0.36 \frac{x_{u \max}}{d} \left(1 - 0.42 \frac{x_{u \max}}{d} \right) b d^2 f_{ck}$$

For 500 grade steel, $x_{u \max} = 0.46d$ which is given in page No.70 of IS - 456-2000 in article 38.1.] Here maximum bending moment is considered to check the thickness.

$$2.78 \times 10^6 = 0.36 \frac{0.46d}{d} \left(1 - 0.42 \frac{0.46d}{d} \right) 1000 \times d^2 \times 20$$

$$d_{(required)} = 32.34 \text{ mm}$$

$$d_{(required)} < d_{(provided)}$$

So the section is safe in bending.

AREA OF REINFORCEMENT IN SLAB (A_{st}):

+ve Reinforcement for shorter span:

$$M_{ux}(+ve) = 0.87 f_y A_{st} d \left(1 - \frac{f_y A_{st}}{bd f_{ck}}\right)$$

$$2.09 \times 10^6 = 0.87 \times 500 \times A_{st} \times 81 \left(1 - \frac{500 \times A_{st}}{1000 \times 81 \times 20}\right)$$

$$A_{st} = 60.50 \text{ mm}^2$$

Minimum Reinforcement:

Code limits:

As per IS 456-2000, the minimum area of steel in slab should be provided 0.12% of gross area for HYSD bars. [It is given in page No.48 of IS - 456-2000 in article 26.5.2.1.]

$$A_{st (minimum)} = 0.12\% \text{ gross area}$$

$$A_{st (minimum)} = \frac{0.12}{100} \times 1000 \times 100 = 120 \text{ mm}^2$$

$$A_{st(required)} < A_{st (minimum)}$$

So provide A_{st} minimum...,

Spacing:

It should be lesser of the following

- 1) $S = \frac{a_{st}}{A_{st}} \times 1000 = \frac{50.26}{120} \times 1000 = 418.83 \text{ mm}$, where $(a_{st} = \frac{\pi}{4} \times 8^2 = 50.26)$
- 2) $S = 3d = 3 \times 81 = 243$
- 3) $S = 300 \text{ mm}$

Let us provide 8mm diameter HYSD bars at 240mm c/c. [$A_{st(provided)} = 209.41 \text{ mm}^2$]

–ve Reinforcement for shorter span:

$$M_{ux}(-ve) = 0.87 f_y A_{st} d \left(1 - \frac{f_y A_{st}}{bd f_{ck}}\right)$$

$$2.78 \times 10^6 = 0.87 \times 500 \times A_{st} \times 81 \left(1 - \frac{500 \times A_{st}}{1000 \times 81 \times 20}\right)$$

$$A_{st} = 81.25 \text{ mm}^2$$

$$A_{st(required)} < A_{st (minimum)}$$

So provide A_{st} minimum...,

Spacing:

It should be lesser of the following

- 1) $S = \frac{a_{st}}{A_{st}} \times 1000 = \frac{50.26}{120} \times 1000 = 418.83 \text{ mm},$ where $(a_{st} = \frac{\pi}{4} \times 8^2 = 50.26)$
- 2) $S = 3d = 3 \times 81 = 243$
- 3) $S = 300 \text{ mm}$

Let us provide 8mm diameter HYSD bars at 240mm c/c.

+ve Reinforcement for longer span:

$$M_{uy}(+ve) = 0.87 f_y A_{st} d \left(1 - \frac{f_y A_{st}}{bd f_{ck}}\right)$$

$$1.62 \times 10^6 = 0.87 \times 500 \times A_{st} \times 73 \left(1 - \frac{500 \times A_{st}}{1000 \times 73 \times 20}\right)$$

$$A_{st} = 51.92 \text{ mm}^2$$

Code limits:

As per IS 456-2000, the minimum area of steel in slab should be provided 0.12% of gross area for HYSD bars. [It is given in page No.48 of IS - 456-2000 in article 26.5.2.1.]

$$A_{st(\text{minimum})} = 0.12\% \text{ gross area}$$

$$A_{st(\text{minimum})} = \frac{0.12}{100} \times 1000 \times 100 = 120 \text{ mm}^2$$

$$A_{st(\text{required})} < A_{st(\text{minimum})}$$

So provide A_{st} minimum...,

Spacing:

It should be least of the following

- 1) $S = \frac{a_{st}}{A_{st}} \times 1000 = \frac{50.26}{120} \times 1000 = 418.83 \text{ mm},$ where $(a_{st} = \frac{\pi}{4} \times 8^2 = 50.26)$
- 2) $S = 3d = 3 \times 73 = 219 \text{ mm}$
- 3) $S = 300 \text{ mm}$

Let us provide 8mm diameter HYSD bars at 210 mm c/c. [$A_{st(\text{provided})} = 239.33 \text{ mm}^2$]

–ve Reinforcement for longer span:

$$M_{uy}(-ve) = 0.87 f_y A_{st} d \left(1 - \frac{f_y A_{st}}{bd f_{ck}}\right)$$

$$2.15 \times 10^6 = 0.87 \times 500 \times A_{st} \times 73 \left(1 - \frac{500 \times A_{st}}{1000 \times 73 \times 20}\right)$$

$$A_{st} = 69.45 \text{ mm}^2$$

$$A_{st(\text{required})} < A_{st(\text{minimum})}$$

So provide A_{st} minimum...,

Spacing:

It should be least of the following

$$1) S = \frac{a_{st}}{A_{st}} \times 1000 = \frac{50.26}{120} \times 1000 = 418.83 \text{ mm}, \quad \text{where } (a_{st} = \frac{\pi}{4} \times 8^2 = 50.26)$$

$$2) S = 3d = 3 \times 73 = 219 \text{ mm}$$

$$3) S = 300 \text{ mm}$$

Let us provide 8mm diameter HYSD bars at 210 mm c/c.

CHECK FOR DEFLECTION:

Basic value for two-way slab is given in page.39, article 24.1 of IS 456-2000.

Basic value (BV) = 40

$$\% \text{ of Steel} = Pt = \frac{A_{st}}{bd} \times 100 = \frac{209.41}{1000 \times 81} \times 100 = 0.26\%$$

Based on Pt value take modification factor (MF) from code IS 456-2000 in page. 38

$$f_s = 0.58 \times 500 \times \frac{120}{209.41} = 166.18 \text{ N/mm}^2$$

$$MF = 2$$

$$d_{(required)} = \frac{l_{eff}}{BV \times MF} = \frac{2651}{40 \times 2} = 33.13 \text{ mm}$$

$$d_{(required)} < d_{(provided)}$$

So the section is safe in deflection.

4.5 DESIGN OF BEAMS:

4.5.1 BEAM:

Beam is a horizontal structural member which transmits loads horizontally along their length to the supports where the loads are generally transformed into vertical forces. The objective of Beams is to withstand vertical loads, shear forces and bending moments.

Depending on the types of supports the beams are classified as:

- Simply supported beam
- Cantilever beam
- Over hanging beam
- Continuous beam
- Fixed beam
- Propped cantilever beam

Code limitations:

In IS-456-2000-page No.48, the limitations and specifications for beam design are given as

Beams:

Tension reinforcement:

a) Minimum reinforcement -The minimum area of tension reinforcement shall be not less than that given by the following:

$$\frac{A_s}{bd} = \frac{0.87}{f_y}$$

Where,

A_s = minimum area of tension reinforcement,

b = breadth of beam or the breadth of the web of T-beam.

d = effective depth, and

f_y = characteristic strength of reinforcement in N/mm²

b) Maximum reinforcement – The maximum area of tension reinforcement shall not exceed 0.04bD.

Compression reinforcement:

The maximum area of compression reinforcement shall not exceed 0.04bD. Compression reinforcement in beams shall be enclosed by stirrups for effective lateral restraint.

Side face reinforcement:

Where the depth of the web in a beam exceeds 750mm, side face reinforcement shall be provided along the two faces. The total area of such reinforcement shall be not less than 0.1 percent of the web area and shall be distributed equally on two faces at a spacing not exceeding 300mm or web thickness whichever is less.

Transverse reinforcement in beams for shear and torsion:

The transverse reinforcement in beams shall be taken around the outer-most tension and compression bars. "In T-beams and I-beams, such reinforcement shall pass around longitudinal bars located close to the outer face of the flange

Maximum spacing of shear reinforcement:

The maximum spacing of shear reinforcement measured along the axis of the member shall not exceed 0.75d for vertical stirrups and d for inclined stirrups at 45°, where d is the effective depth of the section under consideration. In no case shall the spacing exceed 300mm.

Minimum shear reinforcement:

Minimum shear reinforcement in the form of stirrups shall be provided such that:

$$\frac{A_{sv}}{bS_v} \geq \frac{0.4}{0.87f_y}$$

Where,

A_{sv} = total cross-sectional area of stirrup legs effective in shear.

S_v = stirrup Spacing along the Length of the member.

b = breadth of the beam or breadth of the web of flanged beam.

f_y = characteristic strength of the stirrup reinforcement in N/mm² which shall not be taken greater than 415N/mm².

Where the maximum shear stress calculated is less than half the permissible value and in members of minor structural importance such as lintels. This provision need not be complied with.

Minimum reinforcement:

The mild steel reinforcement in either direction in slab shall not be less than 0.15percent of the total cross-sectional area. However, this value can be reduced to 0.12 percent when high strength deformed bars or welded wire fabric are used.

4.5.2 DESIGN OF CONTINUOUS BEAM IN FRAME A1-B1-C1:

ASSUMPTIONS:

Size of the beam

= 230X400mm

Effective cover = 30 mm

Grade of the concrete = M₂₀

Grade of the steel = Fe 500

$f_{ck} = 20 \text{ N/mm}^2$

$f_y = 500 \text{ N/mm}^2$

Effective depth (d)

= D - Effective cover

d = 400-30 = 370mm

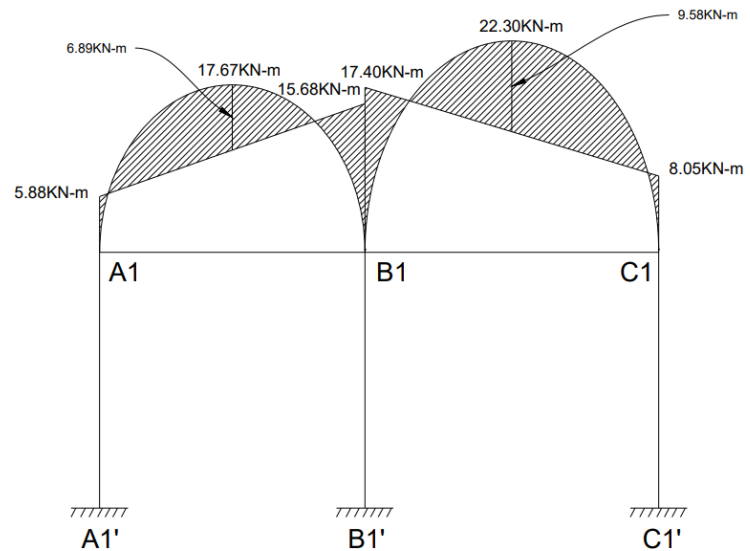


Figure 4.2: Bending moment diagram {frame A1-B1-C1}

Code limits:

As per code if M_u is less than $M_{u,limit}$ then the section is design as a singly reinforced section otherwise it should be design as doubly reinforced section.

$$M_{u,limit} = 0.36 \frac{x_{u,max}}{d} \left(1 - 0.42 \frac{x_{u,max}}{d}\right) b d^2 f_{ck}$$

$$M_{u,limit} = 0.36 \frac{0.46d}{d} \left(1 - 0.42 \frac{0.46d}{d}\right) 230 \times 370^2 \times 20$$

$$M_{u,limit} = 84.14 \text{ kN-m}$$

The minimum and maximum area of steel in beam is given below [It is given in page No.46 of IS - 456-2000 in article 26.5.1.1.]

$$A_{st(minimum)} = \frac{0.85}{f_y} b d$$

$$= \frac{0.85}{500} \times 230 \times 370 = 144.67 \text{ mm}^2$$

$$A_{st(maximum)} = 0.04 b D$$

$$= 0.04 \times 230 \times 400 = 3680 \text{ mm}^2$$

4.5.2.1 AREA OF THE REINFORCEMENT REQUIRED:

Let us consider BEAM A1-B1-C1:

Tension steel in span A1-B1:

$$M = 6.89 \text{ kN} - \text{m}$$

$$M_u = 1.5 \times 6.89 = 10.34 \text{ kN} - \text{m}$$

DEPTH REQUIRED:

$$M_u = M_{u, \text{limit}}$$

$$M_u = 0.36 \frac{x_{u \max}}{d} \left(1 - 0.42 \frac{x_{u \max}}{d}\right) b d^2 f_{ck}$$

For 500 grade steel, $x_{u \max} = 0.46d$ which is given in page No.70 of IS - 456-2000 in article 38.1.] Here bending moment is used to check the thickness.

$$10.34 \times 10^6 = 0.36 \frac{0.46d}{d} \left(1 - 0.42 \frac{0.46d}{d}\right) 230 \times d^2 \times 20$$

$$d_{(\text{required})} = 130 \text{ mm}$$

$$d_{(\text{required})} < d_{(\text{provided})}$$

So, the section is safe in bending.

$$M_u < M_{u, \text{limit}}$$

So, the section is designed as singly reinforced beam.

$$M_u = 0.87 f_y A_{st} d \left(1 - \frac{f_y A_{st}}{b d f_{ck}}\right)$$

$$10.34 \times 10^6 = 0.87 \times 500 \times A_{st} \times 370 \left(1 - \frac{500 \times A_{st}}{230 \times 370 \times 20}\right)$$

$$A_{st} = 65.50 \text{ mm}^2$$

$$A_{st(\text{required})} < A_{st(\text{minimum})}$$

So, provide minimum A_{st}

Provide 2 bars of #10mmØ bars $\{A_{st(\text{provided})} = 157.08 \text{ mm}^2\}$

Tension steel in span B1-C1:

$$M = 9.58 \text{ kN} - \text{m}$$

$$M_u = 1.5 \times 9.58 = 14.37 \text{ kN} - \text{m} < M_{u, \text{limit}}$$

So, the section is designed as singly reinforced beam.

$$M_u = 0.87 f_y A_{st} d \left(1 - \frac{f_y A_{st}}{bd f_{ck}}\right)$$

$$14.37 \times 10^6 = 0.87 \times 500 \times A_{st} \times 370 \left(1 - \frac{500 \times A_{st}}{230 \times 370 \times 20}\right)$$

$$A_{st} = 91.76 \text{ mm}^2$$

$$A_{st(\text{required})} < A_{st(\text{minimum})}$$

So, provide minimum A_{st}

Provide 2 bars of #10mmØ bars $\{A_{st(\text{provided})} = 157.08 \text{ mm}^2\}$

Support steel at A1:

$$M = 5.88 \text{ kN} - \text{m}$$

$$M_u = 1.5 \times 5.88 = 8.82 \text{ kN} - \text{m} < M_{u,\text{limit}}$$

So, the section is designed as singly reinforced beam.

$$M_u = 0.87 f_y A_{st} d \left(1 - \frac{f_y A_{st}}{bd f_{ck}}\right)$$

$$8.82 \times 10^6 = 0.87 \times 500 \times A_{st} \times 370 \left(1 - \frac{500 \times A_{st}}{230 \times 370 \times 20}\right)$$

$$A_{st} = 57.74 \text{ mm}^2$$

$$A_{st(\text{required})} < A_{st(\text{minimum})}$$

Provide 2 bar of #10mmØ bar $\{A_{st(\text{provided})} = 157.08 \text{ mm}^2\}$

Support steel at B1:

$$M = 17.40 \text{ kN} - \text{m}$$

$$M_u = 1.5 \times 17.40 = 26.1 \text{ kN} - \text{m} < M_{u,\text{limit}}$$

So, the section is designed as singly reinforced beam.

$$M_u = 0.87 f_y A_{st} d \left(1 - \frac{f_y A_{st}}{bd f_{ck}}\right)$$

$$26.1 \times 10^6 = 0.87 \times 500 \times A_{st} \times 370 \left(1 - \frac{500 \times A_{st}}{230 \times 370 \times 20}\right)$$

$$A_{st} = 170.72 \text{ mm}^2$$

Provide 2 bar of #12mmØ bar $\{A_{st(\text{provided})} = 226.20 \text{ mm}^2\}$

Support steel at C1:

$$M = 8.05 \text{ kN – m}$$

$$M_u = 1.5 \times 8.05 = 12.08 \text{ kN – m} < M_{u, \text{limit}}$$

So, the section is designed as singly reinforced beam.

$$M_u = 0.87 f_y A_{st} d \left(1 - \frac{f_y A_{st}}{bd f_{ck}}\right)$$

$$12.08 \times 10^6 = 0.87 \times 500 \times A_{st} \times 370 \left(1 - \frac{500 \times A_{st}}{230 \times 370 \times 20}\right)$$

$$A_{st} = 76.78 \text{ mm}^2$$

$$A_{st(\text{required})} < A_{st(\text{minimum})}$$

So, provide minimum A_{st}

Provide 2 bars of #10mmØ bars $\{A_{st(\text{provided})} = 157.08 \text{ mm}^2\}$

4.5.2.2 Check for deflection:

For span A1-B1:

$$d_{req} = \frac{L}{BV \times MF}$$

$$L = 2.8 \text{ m}$$

The BV Value for Continuous Beam (IS – 456 – 2000, page no. 37)

$$BV = 26$$

$$P_t = \frac{A_{st}}{bd} \times 100 = \frac{157.08}{230 \times 370} \times 100 = 0.18$$

From IS – 456 – 2000, page no. 38

$$f_s = 0.58 \times f_y \times \frac{\text{Area of cross – section of steel required}}{\text{Area of cross – section of steel provided}}$$

$$f_s = 0.58 \times 500 \times \frac{65.50}{157.08} = 120.92 \text{ N/mm}^2$$

From the graph, in IS – 456 – 2000, page no. 38

$$MF = 2$$

$$d_{req} = \frac{2800}{26 \times 2} = 53.84 < d_{prov} = 370 \text{ mm}$$

For span B1-C1:

$$d_{req} = \frac{L}{BV \times MF}$$

$$L = 3.1 \text{ m}$$

The BV Value for Continuous Beam (IS – 456 – 2000, page no. 37)

$$BV = 26$$

$$P_t = \frac{A_{st}}{bd} \times 100 = \frac{157.08}{230 \times 370} \times 100 = 0.18$$

From IS – 456 – 2000, page no. 38

$$f_s = 0.58 \times f_y \times \frac{\text{Area of cross – section of steel required}}{\text{Area of cross – section of steel provided}}$$

$$f_s = 0.58 \times 500 \times \frac{91.76}{157.08} = 169.40 \text{ N/mm}^2$$

From the graph, in IS – 456 – 2000, page no. 38

$$MF = 2$$

$$d_{req} = \frac{3100}{26 \times 2} = 59.61 < d_{prov} = 370 \text{ mm}$$

4.5.2.3 Design of shear reinforcement in Slab beams:

Span A1-B1:

Joint A1:

$$V = 21.74 \text{ KN}$$

$$V_u = 32.61 \text{ KN}$$

The nominal shear stress in beam of uniform depth shall be obtained by the following equation.

$$\tau_v = \frac{V_u}{bd}$$

$$= \frac{32.61 \times 1000}{230 \times 370} = 0.38 \text{ N/mm}^2$$

$$P_t = \frac{A_{st}}{bd} \times 100$$

$$= \frac{157.08}{230 \times 370} \times 100 = 0.18\%$$

Under no circumstances, for shear reinforcement, the nominal shear stress in beam τ_v shall not exceed $\tau_{c,max}$. [It is given in page No.73 of IS - 456-2000 in Table No.20]

$$\tau_{c,max} = 2.8 \text{ N/mm}^2$$

$$\tau_v < \tau_{c,max}$$

τ_c Value is given in page 73 of IS 456: 2000. This value is depending on P_t value and grade of concrete. For our condition M₂₀ grade and $P_t = 0.18$ the value is given below

$$\tau_c = 0.30 \text{ N/mm}^2$$

$$\tau_v > \tau_c$$

As per IS 456 : 2000, when the τ_v exceed τ_c value the shear reinforcement shall be provided.[It is given in page No.72 of IS - 456-2000 in article 40.4.]

$$\begin{aligned} V_{us} &= V_u - \tau_c bd \\ &= 32.61 \times 10^3 - 0.3 \times 230 \times 370 = 7.08 \text{ KN} \end{aligned}$$

Shear reinforcement shall be provided to carry a shear equal to $V_u - \tau_c bd$. The strength of the shear reinforcement V_{us} for vertical stirrups is given below [IS 456 : 2000, p.no.73]

$$V_{us} = \frac{0.87 f_f A_{sv} d}{s_v}$$

Using 8mm, 2 legged $F_e 500$ steel stirrups, $A_{sv} = 2 \times \frac{\pi}{4} \times 8^2 = 100.53 \text{ mm}^2$

$$s_v = \frac{0.87 \times 500 \times 100.53 \times 370}{7.08 \times 1000} = 2285.35 \text{ mm}$$

Code limits:

[It is given in page No.47 of IS - 456-2000 in article 26.5.1.5.]

It should be lesser of the following

- 4) $S = 0.75d = 0.75 \times 370 = 277.5 \text{ mm}$
- 5) $S = 300 \text{ mm}$

So, provide 8 mm dia stirrups at 275 mm c/c

Span A1-B1:

Joint B1:

$$V = 28.74 \text{ KN}$$

$$V_u = 43.11 \text{ KN}$$

The nominal shear stress in beam of uniform depth shall be obtained by the following equation.

$$\tau_v = \frac{V_u}{bd}$$

$$= \frac{43.11 \times 1000}{230 \times 370} = 0.51 \text{ N/mm}^2$$

$$P_t = \frac{A_{st}}{bd} \times 100$$

$$= \frac{226.20}{230 \times 370} \times 100 = 0.27\%$$

Under no circumstances, for shear reinforcement, the nominal shear stress in beam τ_v shall not exceed $\tau_{c,max}$. [It is given in page No.73 of IS - 456-2000 in Table No.20]

$$\tau_{c,max} = 2.8 \text{ N/mm}^2$$

$$\tau_v < \tau_{c,max}$$

τ_c Value is given in page 73 of IS 456: 2000. This value is depending on P_t value and grade of concrete. For our condition M₂₀ grade and $P_t = 0.27$ the value is given below

$$\tau_c = 0.37 \text{ N/mm}^2$$

$$\tau_v > \tau_c$$

As per IS 456 : 2000, when the τ_v exceed τ_c value the shear reinforcement shall be provided.[It is given in page No.72 of IS - 456-2000 in article 40.4.]

$$V_{us} = V_u - \tau_c bd$$

$$= 43.11 \times 10^3 - 0.37 \times 230 \times 370 = 11.62 \text{ KN}$$

Shear reinforcement shall be provided to carry a shear equal to $V_u - \tau_c bd$. The strength of the shear reinforcement V_{us} for vertical stirrups is given below [IS 456 : 2000, p.no.73]

$$V_{us} = \frac{0.87 f_f A_{sv} d}{s_v}$$

Using 8mm, 2 legged $F_e 500$ steel stirrups, $A_{sv} = 2 \times \frac{\pi}{4} \times 8^2 = 100.53 \text{ mm}^2$

$$s_v = \frac{0.87 \times 500 \times 100.53 \times 370}{11.62 \times 1000} = 1392.45 \text{ mm}$$

Code limits:

[It is given in page No.47 of IS - 456-2000 in article 26.5.1.5.]

It should be lesser of the following

- 1) $S = 0.75d = 0.75 \times 370 = 277.5 \text{ mm}$
- 2) $S = 300 \text{ mm}$

So, provide 8 mm dia stirrups at 275 mm c/c

Span B1-C1:

Joint B1:

$$V = 31.79 \text{ KN}$$

$$V_u = 47.69 \text{ KN}$$

The nominal shear stress in beam of uniform depth shall be obtained by the following equation.

$$\begin{aligned}\tau_v &= \frac{V_u}{bd} \\ &= \frac{47.69 \times 1000}{230 \times 370} = 0.56 \text{ N/mm}^2\end{aligned}$$

$$\begin{aligned}P_t &= \frac{A_{st}}{bd} \times 100 \\ &= \frac{226.20}{230 \times 370} \times 100 = 0.27\%\end{aligned}$$

Under no circumstances, for shear reinforcement, the nominal shear stress in beam τ_v shall not exceed $\tau_{c,max}$. [It is given in page No.73 of IS - 456-2000 in Table No.20]

$$\tau_{c,max} = 2.8 \text{ N/mm}^2$$

$$\tau_v < \tau_{c,max}$$

τ_c Value is given in page 73 of is 456: 2000. This value is depending on P_t value and grade of concrete. For our condition M20 grade and $P_t = 0.27$ the value is given below

$$\tau_c = 0.37 \text{ N/mm}^2$$

$$\tau_v > \tau_c$$

As per IS 456 : 2000, when the τ_v exceed τ_c value the shear reinforcement shall be provided.[It is given in page No.72of IS - 456-2000 in article 40.4.]

$$\begin{aligned}V_{us} &= V_u - \tau_c bd \\ &= 47.69 \times 10^3 - 0.37 \times 230 \times 370 = 16.20 \text{ KN}\end{aligned}$$

Shear reinforcement shall be provided to carry a shear equal to $V_u - \tau_c bd$. The strength of the shear reinforcement V_{us} for vertical stirrups is given below [IS 456 : 2000, p.no.73]

$$V_{us} = \frac{0.87 f_f A_{sv} d}{S_v}$$

Using 8mm, 2 legged $F_e 500$ steel stirrups, $A_{sv} = 2 \times \frac{\pi}{4} \times 8^2 = 100.53 \text{ mm}^2$

$$S_v = \frac{0.87 \times 500 \times 100.53 \times 370}{16.20 \times 1000} = 998.78 \text{ mm}$$

Code limits:

[It is given in page No.47 of IS - 456-2000 in article 26.5.1.5.]

It should be lesser of the following

- 1) $S = 0.75d = 0.75 \times 370 = 277.5\text{mm}$
- 2) $S = 300\text{mm}$

So, provide 8 mm dia stirrups at 275 mm c/c

Span B1-C1:

Joint C1:

$$V = 25.75 \text{ KN}$$

$$V_u = 38.63 \text{ KN}$$

The nominal shear stress in beam of uniform depth shall be obtained by the following equation.

$$\begin{aligned}\tau_v &= \frac{V_u}{bd} \\ &= \frac{38.63 \times 1000}{230 \times 370} = 0.45 \text{ N/mm}^2\end{aligned}$$

$$\begin{aligned}P_t &= \frac{A_{st}}{bd} \times 100 \\ &= \frac{157.08}{230 \times 370} \times 100 = 0.18\%\end{aligned}$$

Under no circumstances, for shear reinforcement, the nominal shear stress in beam τ_v shall not exceed $\tau_{c,max}$. [It is given in page No.73 of IS - 456-2000 in Table No.20]

$$\tau_{c,max} = 2.8 \text{ N/mm}^2$$

$$\tau_v < \tau_{c,max}$$

τ_c Value is given in page 73 of IS 456: 2000. This value is depending on P_t value and grade of concrete. For our condition M₂₀ grade and $P_t = 0.18$ the value is given below

$$\tau_c = 0.30 \text{ N/mm}^2$$

$$\tau_v > \tau_c$$

As per IS 456 : 2000, when the τ_v exceed τ_c value the shear reinforcement shall be provided.[It is given in page No.72 of IS - 456-2000 in article 40.4.]

$$\begin{aligned}V_{us} &= V_u - \tau_c bd \\ &= 38.63 \times 10^3 - 0.30 \times 230 \times 370 = 13.10 \text{ KN}\end{aligned}$$

Shear reinforcement shall be provided to carry a shear equal to $V_u - \tau_c$ bd. The strength of the shear reinforcement V_{us} for vertical stirrups is given below [IS 456 : 2000, p.no.73]

$$V_{us} = \frac{0.87 f_f A_{sv} d}{s_v}$$

Using 8mm, 2 legged $F_e 500$ steel stirrups,

$$A_{sv} = 2 \times \frac{\pi}{4} \times 8^2 = 100.53 \text{ mm}^2$$

$$s_v = \frac{0.87 \times 500 \times 100.53 \times 370}{13.10 \times 1000} = 1235.14 \text{ mm}^2$$

Code limits:

[It is given in page No.47 of IS - 456-2000 in article 26.5.1.5.]

It should be lesser of the following

- 1) $S = 0.75d = 0.75 \times 370 = 277.5 \text{ mm}$
- 2) $S = 300 \text{ mm}$

So, provide 8 mm dia stirrups at 275 mm c/c

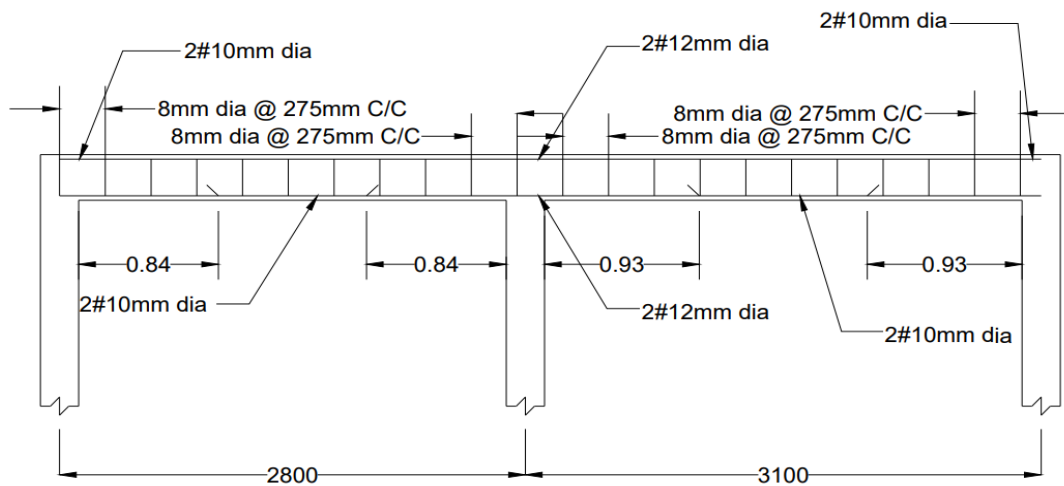


Figure 4.3: Reinforcement details of beam A1-B1-C1.

4.6 COLUMN DESIGN:

4.6.1 COLUMN:

It is a vertical structural member which transfers the compressive loads for, the ceiling. Roof, slab or beam, to the foundation.

It is constructed for, the materials like bricks, stones, timber, steel and other materials which have better compressive strength.

There are numerous types of columns available on basis of shape, type, loading type and slenderness ratio reinforcement.

Column type based on slenderness ratio:

- **Short Column:** if the ratio of effective length to the least lateral dimension is greater than 12 then it is called as long column.
- **Long Column:** if the ratio of effective length to the least lateral dimension is less than 12 then it is called as short column.

Column type based on type based on type of loading:

- **Axially loaded column:** The column which is subjected to loads acting along the longitudinal axis or centroid of the section is called as axially loaded column.
- **Eccentrically loaded column:** Loads which do not act on the longitudinal axis of the column is called as eccentrically loaded column.

Eccentrically loaded columns are then sub-divided into two types:

- **Uni-axial column:** if the eccentricity is with respect to either X-axis or Y-axis then the column is said to be under uni-axial loading.
- **Bi-axial column:** if the eccentricity is with respect to both X-axis and Y-axis then the column is said to be under bi-axial loading.

the types of columns used for column design are shown in the figure below.

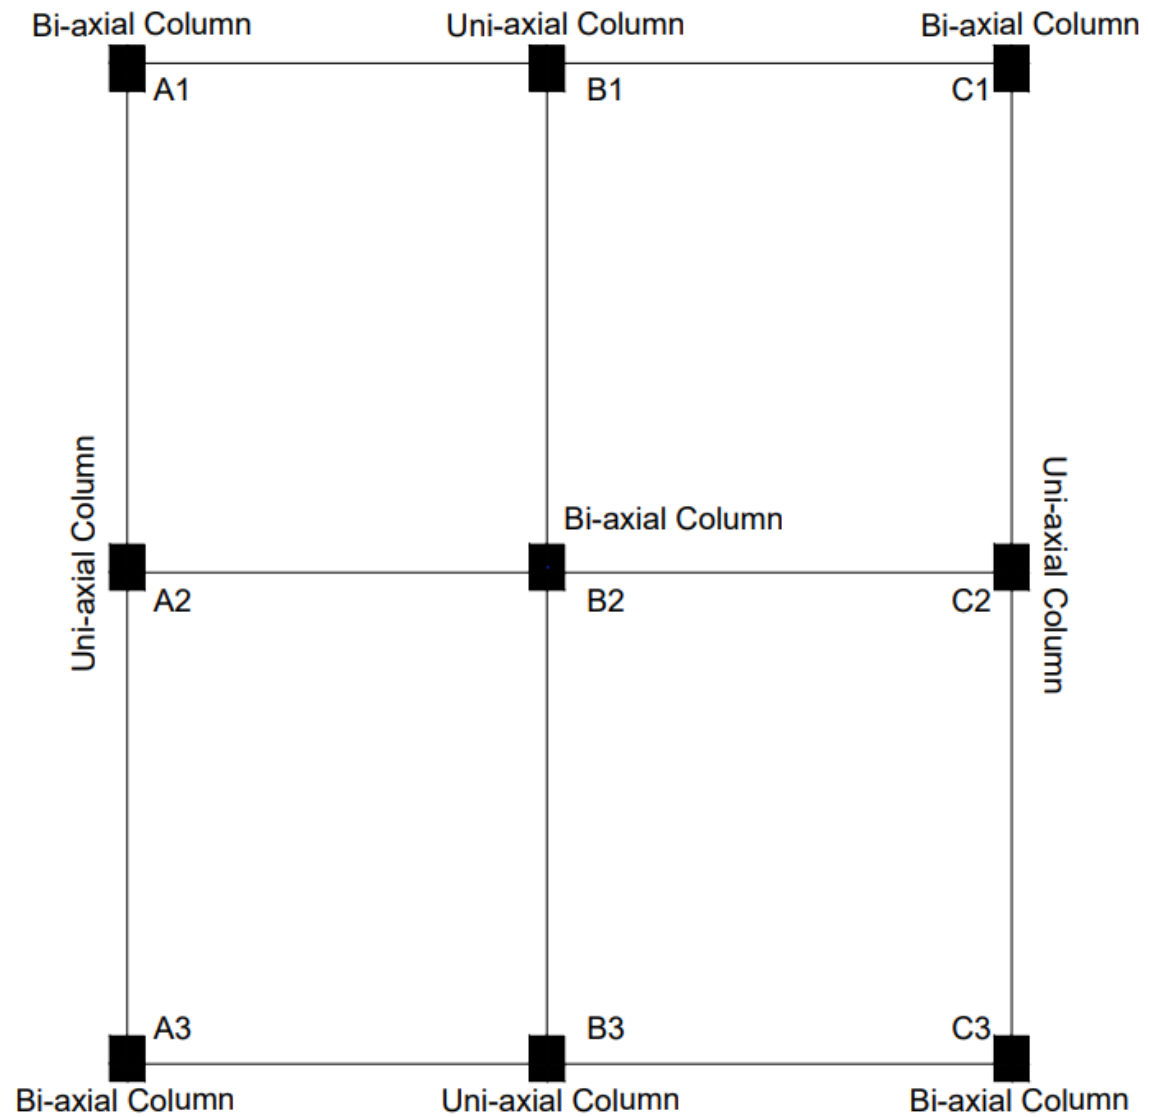


Figure 4.4: Classification of column based on position and loading.

4.6.2 Code limitations:

The limitations and specifications for column design, given in IS-456-2000, page No.48 are

Column:

longitudinal reinforcement:

- The cross-sectional area of longitudinal reinforcement shall not be less than 0.8 percent nor more than 6 percent of the gross cross-sectional area of the column.
- In any column that has a larger cross-sectional area than that required to support the load, the minimum percentage of steel shall be based upon the area of concrete required to resist the direct stress and not upon the current area.
- The minimum number of longitudinal bars provided in to column shall be rectangular in four columns and sic in circular columns.
- The bars shall not be less than 12 mm in diameter.
- Spacing of longitudinal bars measured along the periphery of the column shall not exceed 300 mm.
- In case of pedestals in which the longitudinal reinforcement is not taken in account in calculations, rated strength longitudinal reinforcement not less as 0.15 percent of the cross-sectional area shall be provided.

Pitch and diameter of lateral ties:

- (1) Pitch- The pitch of transverse reinforcement shall be not more than the least of the following distances:
 - The least lateral dimension of the compression members,
 - Sixteen times the smallest diameter of the longitudinal reinforcement bar to be tied, and
 - 300 mm.
- (2) Diameter – the diameter of the polygonal links side or ties shall be not less as one fourth of the largest longitudinal bar. And in no case less than 16 mm.

4.6.3 A1 column – storey-I (Bi-axial Bending):

Size of the column = 230 x 300 mm

Concrete mix = M₂₀

Characteristics strength of reinforcement = 500N/mm²

Factor Load (P_u) = 73.58 KN

Factor moment acting parallel to the large dimension, mix = 13.98 KN-m

Factor moment acting parallel to the short dimension, mix = 8.84 KN-m

Reinforce is distributed equally on four side

Gross Area (A_g) = 230 × 300 = 69000 mm²

Required Minimum Steel: 0.008 × 69000 = 552 mm²

First, we assume a trial reinforcement area. Let's provide **4 bars of 16 mm diameter**.

Area of Steel Provided (A_{sc}) = 4 × 201 = 804 mm²

Assuming % of steel P = 1.17 %

Area of Concrete (A_c): A_g – A_{sc} = 69000 – 804 = 68196 mm²

Assuming Effective Cover = 40mm

Reinforcement Ratio:

$$\frac{P}{f_{ck}} = \frac{1.17}{20} = 0.058$$

Axial Load Ratio:

$$\frac{P_u}{f_{ck} \cdot b \cdot D} = \frac{73.58 \times 10^3}{20 \times 230 \times 300} = 0.053$$

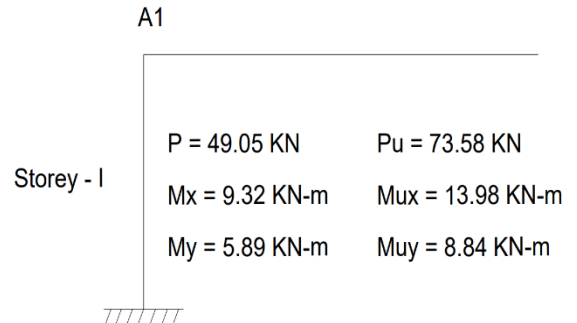


Figure 4.5: Total Loads and moments on A1 column.

Calculate Ultimate Axial Load Capacity

$$P_{uz} = 0.45f_{ck}A_c + 0.75f_yA_{sc}$$

$$P_{uz} = (0.45 \times 20 \times 68196) + (0.75 \times 500 \times 804)$$

$$P_{uz} = 915264\text{N} = 915.264\text{KN}$$

$$\frac{P_u}{P_{uz}} = \frac{73.58}{915.264} = 0.080$$

According to IS 456 Table 10.2 (or SP-16 Chart 64), because $0.080 \leq 0.2$, the value of $\alpha_n = 1.0$.

Determine Uniaxial Moment Capacities (M_{uxl}) & (M_{uyl})

Capacity about the Major Axis XX (M_{uxl})

$$\text{Cover Ratio: } \frac{d'}{D} = \frac{40}{300} = 0.133$$

Referencing **SP-16 Chart 48** (for Fe500, equal reinforcement on 4 sides, $d'/D=0.133$): Looking at the curve for $\frac{P}{f_{ck}} = 0.06$ and $\frac{P_u}{f_{ck}bD^2} = 0.05$, we read the moment parameter:

$$\frac{M_{uxl}}{f_{ck}bD^2} \approx 0.070$$

$$M_{uxl} = 0.070 \times 20 \times 230 \times 300^2 \times 10^{-6}$$

$$M_{uxl} = 28.98 \text{ KN-m}$$

Capacity about the Minor Axis YY (M_{uyl})

$$\text{Cover Ratio: } \frac{d'}{b} = \frac{40}{230} = 0.174$$

Referencing **SP-16 Chart 48** (for Fe500, interpolating between, $d'/D=0.15$ and 0.20):

$$\frac{M_{uyl}}{f_{ck}Db^2} \approx 0.064$$

$$M_{uyl} = 0.064 \times 20 \times 300 \times 230^2 \times 10^{-6}$$

$$M_{uyl} = 20.31 \text{ KN-m}$$

Check Biaxial Bending Interaction Equation

we apply Bresler's empirical formulation (IS 456 Clause 39.6) to ensure the combined stress is less than 1.0.

$$\left(\frac{M_{ux}}{M_{ux1}}\right)^{\alpha_n} + \left(\frac{M_{uy}}{M_{uy1}}\right)^{\alpha_n} \leq 1.0$$

$$\left(\frac{13.98}{28.98}\right)^{1.0} + \left(\frac{8.84}{20.31}\right)^{1.0} \leq 1.0$$

$$0.482 + 0.435 = 0.917$$

Final Verdict Because $0.917 \leq 1.0$, the design is **SAFE**.

The minimum practical reinforcement of **4 bars of 16 mm diameter** (with 8 mm lateral ties at 200 mm c/c) is mathematically proven to handle your frame moments and axial loads under biaxial bending perfectly.

4.6.4 B1 column – storey-II (Uni-axial Bending):

Size of Column = 230 x 300

Concrete mix = M₂₀

$f_{ck} = 20 \text{ N/mm}^2$

$f_y = 500 \text{ N/mm}^2$

Load (P) = 88.69 KN

Factor Load (P_u) = 133.04 KN

Moment in column (M) = 9.81 KN-m

Factor Moment (M_u) = 14.70 KN-m

Arrangement of reinforcement on Four Side

Assuming Effective cover = $d' = 40 \text{ mm}$

$$\frac{d'}{D} = \frac{40}{300} = 0.133$$

Use Chart No. 44 in SP-16

$$\frac{P_u}{f_{ck} \cdot b \cdot D} = \frac{133.04 \times 10^3}{20 \times 230 \times 300} = 0.096$$

$$\frac{M_u}{f_{ck} \cdot b \cdot D^2} = \frac{14.07 \times 10^6}{20 \times 230 \times 300^2} = 0.035$$

On four Sides:

From SP-16 Refer Chart 44 for $\frac{d'}{D} = 0.1$ & $F_y = 415 \text{ N/mm}^2$

$$\frac{P}{f_{ck}} = 0.04$$

$$P = 0.04 \times f_{ck}$$

$$= 0.04 \times 20 = 0.8\%$$

$$A_{sc} = \frac{P}{100} \times bD = \frac{0.8}{100} \times 230 \times 300$$

$$A_{sc} = 552 \text{ mm}^2$$

Provide 4 bars of 16 mm $\emptyset$ (Area provided = $804 \text{ mm}^2 > 552 \text{ mm}^2$)

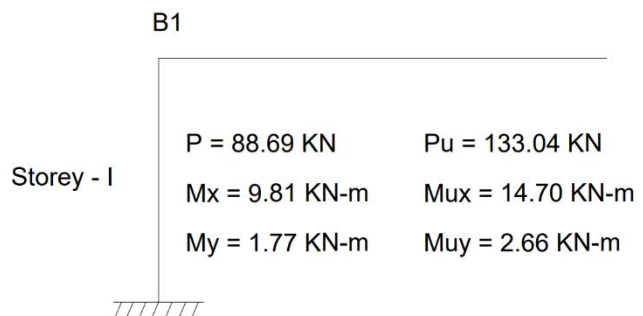


Figure 4.6: Total Loads and moments on B1 column.

Design of ties:

Diameter of ties should not less than

- i) $(16/4) = 4 \text{ mm}$
- ii) 6mm

Pitch:

[it is given in page No.49 of IS – 456 – 2000 in article 26.5.3.2]

It should be lesser of the following:

- i) Least lateral dimension = 230mm
- ii) $16 \times \phi = 16 \times 16 = 256 \text{ mm}$
- iii) 300mm

Hence provide 8mm ϕ ties @ 230mm c/c.

4.7 FOOTING DESIGN:

Design of footing A1:

Column size = 230 x 300 mm

Working load of column (P) = 49.05 KN

Factored Axial load of column (P_u) = 73.58 KN

Grade of concrete = M_{20}

Grade of steel = F_e_{500}

The safe bearing capacity of soil = 200 KN/m^2

Step 1: Size of the footing:

Self-weight of footing = L = 1m, B = 1m, D=0.25m

$$= 2 \times (1 \times 1 \times 0.25) \times 25$$

$$= 2 \times 6.25 \text{KN}$$

$$= 12.50 \text{KN}$$

Total load on the soil = 49.05 + 12.50 = 61.55 KN

$$\text{Area of the footing} = \frac{\text{total load}}{\text{SBC of soil}}$$

$$= \frac{61.55}{200}$$

$$= 0.307 \text{ m}^2$$

Since the required area of 0.307 m^2 is well below our assumed area of 1.0 m^2 (1.0 m $\times$ 1.0 m), the trial dimensions are safe.

adopt 1.0m $\times$ 1.0m rectangular footing.

Step 2: Net Upward Soil Pressure

The upward soil pressure causing bending and shear is calculated using only the factored column load (as the footing's self-weight is counteracted directly by the soil).

$$q_u = \frac{P_u}{\text{Area Provided}} = \frac{73.58}{1.0 \times 1.0} = 73.58 \text{ KN/m}^2$$

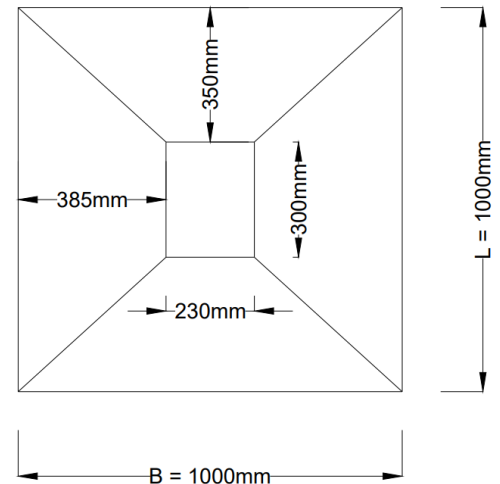


Figure 4.7: Area of Footing

Step 3: Bending Moment & Depth Check

The critical section for maximum bending moment lies at the face of the column.

Cantilever Projection along X-axis:

$$L_x = \frac{1000 - 300}{2} = 350 \text{ mm}$$

Cantilever Projection along Y-axis:

$$L_y = \frac{1000 - 230}{2} = 385 \text{ mm}$$

Taking the maximum projection (0.385 m) to find the governing bending moment:

$$M_u = \frac{q_u \times L_y^2}{2} = \frac{73.58 \times 0.385^2}{2} = 5.45 \text{ KN-m}$$

Minimum Depth Required for Bending (Fe500):

$$M_{u \text{ lim}} = 0.133 \times f_{ck} \cdot B \cdot d^2$$

$$5.45 \times 10^6 = 0.133 \times 20 \times 1000 \times d^2$$

$$d = \sqrt{\frac{5.45 \times 10^6}{2660}} = 45.2 \text{ mm}$$

Provide a safe nominal thickness.

- Adopted Overall Depth (D): 250 mm
- Effective Depth (d):** 250 - 50 (clear cover) - 5 (half bar dia) = 195 mm

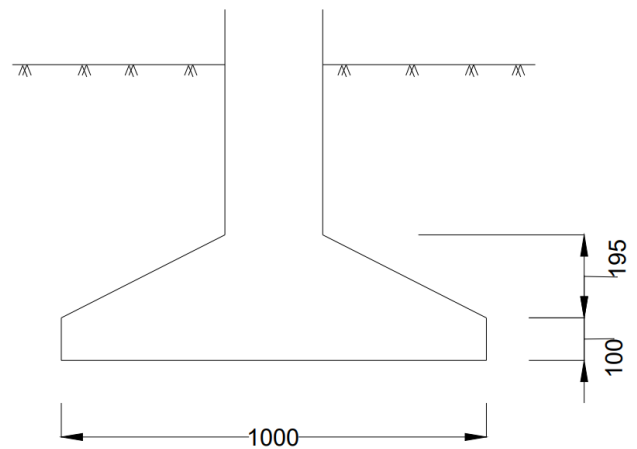


Figure 4.8: One way Shear

Step 4: Area of Tension Steel (IS 456 Clause 26.5.2.1)

Due to the nominal bending moment, the minimum reinforcement criteria governs.

Minimum A_{st} : 0.12% of total cross-sectional area (for HYSD bars).

$$A_{st} = \frac{0.12}{100} \times 1000 \times 250 = 300 \text{ mm}^2$$

Adopted Reinforcement: Provide 10 mm $\varnothing$ bars at 200 mm c/c in both directions.

$$\text{Area Provided } (A_{st, \text{ prov}}): \frac{1000 \times 78.5}{200} = 395 \text{ mm}^2 (> 300 \text{ mm}^2, \text{ hence Safe})$$

Step 5: Check for One-Way Shear (IS 456 Clause 34.2.4.1.a)

The critical section is at a distance 'd' (195 mm) from the column face.

Projection beyond critical section: $385 - 195 = 190$ mm

Factored Shear Force (V_{u1}): $q_u \times (0.19 \times 1.0) = 73.58 \times 0.19 = 13.98$ KN

Nominal Shear Stress (τ_v): $\frac{V_{u1}}{b.d} = \frac{13.98 \times 10^3}{1000 \times 195} = 0.071$ N/mm²

Permissible Shear Stress (τ_c) from IS 456 Table 19:

Percentage of steel (p_t): $\frac{392.5}{1000 \times 195} \times 100 = 0.20\%$

For M20 concrete and $p_t = 0.20\%$, $\tau_c = 0.32$ N/mm²

Verdict: Since $\tau_v(0.071) < \tau_c(0.32)$, the section is **SAFE** in one-way shear.

Step 6: Check for Two-Way / Punching Shear (IS 456 Clause 34.2.4.1.b & 31.6.3)

The critical section is at a distance $\frac{d'}{2}$ (97.5 mm) around the column.

Dimensions of Critical Section: $(300 + 195) \times (230 + 195) = 495$ mm $\times$ 425 mm

Perimeter(b_0): $2 \times (495 + 425) = 1840$ mm²

Area of Critical Section: $0.495 \times 0.425 = 0.21$ m²

Factored Punching Force(V_{u2}): $q_u \times (\text{Total area} - \text{Critical area})$

$= 73.58 \times (1.0 - 0.21) = 58.13$ KN

Punching Shear Stress (τ_v): $\frac{V_{u2}}{b_0.d} = \frac{58.13 \times 10^3}{1840 \times 195} = 0.162$ N/mm²

Permissible Punching Shear Stress ($k_s \cdot \tau_c$):

$k_s = (0.5 + \beta_c)$ where $\beta_c = \frac{230}{300} = 0.76$

$k_s = (0.5 + 0.76) = 1.26$ (Since $k_s > 1$, we take $k_s = 1.0$)

$\tau_c = 0.25 (\sqrt{f_{ck}}) = 0.25 (\sqrt{20}) = 1.118$ N/mm²

Permissible limit $= 1.0 \times 1.118 = 1.118$ N/mm²

Verdict: Since $\tau_v(0.162) < 1.118$ N/mm², the section is **SAFE** against punching shear.

4.8 STAIRCASE DESIGN:

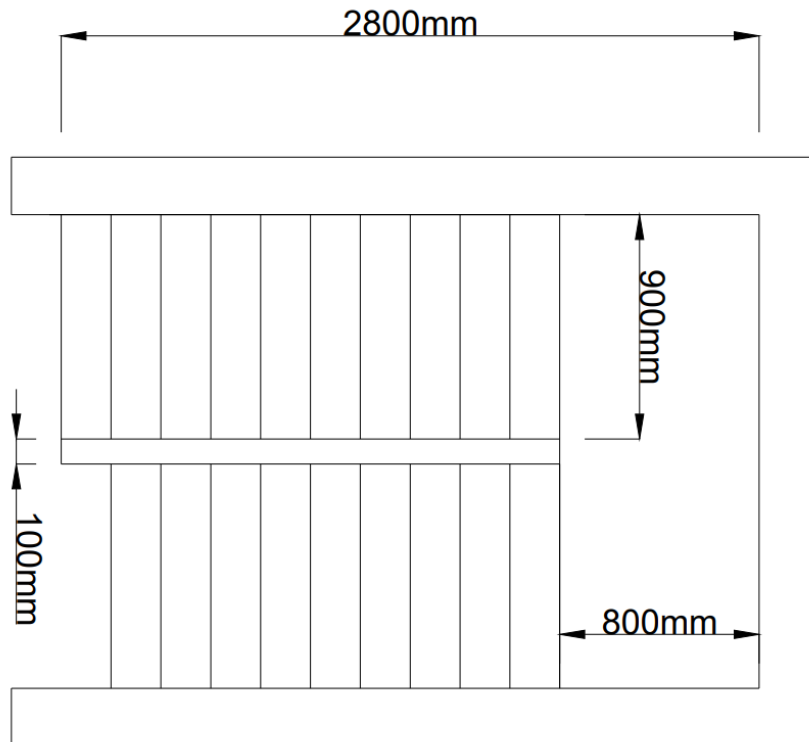


Figure 4.9: staircase.

Each Riser = 150mm

Each Tread = 200mm

No of treads = 10

Length of going = 10 X 200 = 2000mm = 2.0 m

Total length = length of going + width of landing
= 2.0 + 0.8 = 2.8m

Size of staircase room = 2.8 X 1.9

Effective Length:

$$L_{\text{eff}} = \frac{0.23}{2} + 2.8 + \frac{0.23}{2} = 3.03m$$

Depth of the waist slab:

Assuming in between $\frac{l}{25}$ to $\frac{l}{30}$

$$\frac{l}{30} = \frac{3.03}{25} = 0.121$$

$$\frac{l}{30} = \frac{3.03}{30} = 0.101$$

Take $d = 130\text{mm}$

Assume effective cover = 20mm

$$d_0 = 130 + 20(\text{cover}) + 6(\text{half bar dia}) = 156\text{mm}$$

Depth Check:

d_0 Should be greater of the following

$$i) 40 \times \text{Less} = 40 \times 3.95 = 158 \text{ mm}$$

$$ii) 100 \text{ mm}$$

$$d_0 = 156 \text{ mm}$$

Provide 160mm total thickness

Load calculation :

$$\text{Self-weight of slab on slope: } D \times 25 \times \frac{\sqrt{R^2 + T^2}}{T} = 0.16 \times 25 \times \frac{\sqrt{0.15^2 + 0.2^2}}{0.2} = 5 \text{ KN/m}^2$$

$$\text{Dead weight of steps: } 0.5 \times R \times 25 = 0.5 \times 0.15 \times 25 = 1.875 \text{ KN/m}^2$$

$$\text{Live Load: } 3.0 \text{ KN/m}^2$$

$$\text{Floor Finish: } 1.0 \text{ KN/m}^2$$

$$\text{Total Factored Load (W}_u\text{): } 1.5 \times (5.0 + 1.875 + 3.0 + 1.0) = 16.31 \text{ KN/m}^2$$

Maximum Bending Moment:

$$M_u = \frac{W_u \times l^2}{8} = \frac{16.31 \times 3.03^2}{8}$$

$$M_u = 18.72 \text{ KN-m}$$

Depth Required:

$$M_u = M_{u \text{ limit}}$$

$$18.72 \times 10^6 = 0.36 \times 0.46 (1 - 0.42 \times 0.46) \times 1000 \times d^2 \times 20$$

$$d = 82.4 \text{ mm} < d_{\text{prov}}$$

hence the section is Safe

Area of Steel:

$$18.72 \times 10^6 = 0.87 \times 500 \times A_{st} \times 130 \times \left(1 - \frac{500 \times A_{st}}{1000 \times 130 \times 20}\right)$$

$$A_{st} = 355.31$$

$$A_{st \min} = \frac{0.12}{100} \times 1000 \times 160 = 192 \text{ mm}^2$$

$$A_{st} > A_{st \min}$$

$$A_{st} = 355.31 \text{ mm}^2$$

Provide 10 mm $\emptyset$ bars @ 200 c/c

Distribution reinforcement:

Provide Minimum reinforce:

$$A_{st} = \frac{0.12}{100} \times 1000 \times 150 = 192 \text{ mm}^2$$

Provide 8 mm bars @ 250mm c/c

4.9 LINTEL DESIGN:

Design a lintel over a door of 1.2m wide. The height of brick work above the opening is 0.725m, masonry weights 19 KN/m^3 , the brick walls are 230mm thick. Use M_{20} grade concrete and Fe_{500} grade steel.

Solution:

$$f_{CK} = 20 \text{ N/mm}^2$$

$$f_y = 500 \text{ N/mm}^2$$

Depth of beam :

Selecting the depth in range of $\frac{1}{15}$ to $\frac{1}{20}$ based on stiffness.

$$d = \frac{1200}{20}$$

$$d = 60 \text{ mm}$$

Adopt $d = 75 \text{ mm}$

$D = 100 \text{ mm}$. (assuming 25 mm cover)

Width b = width of the wall = 230 mm.

Assume 150mm bearing on walls.

Effective span:

$$\text{Centre to centre of supports} = 1.2 + 0.15 = 1.35 \text{ m}$$

$$\text{Clear span} + d = 1.2 + 0.075 \text{ m} = 1.275 \text{ m}$$

$$\text{Hence, Effective span} = 1.275 \text{ m}$$

Loads :

Assuming 60° dispersion,

height of equilateral triangle.

$$h = l_{\text{eff}} \sin 60^\circ$$

$$h = 1.275 \sin 60^\circ$$

$$h = 1.10 \text{ m}$$

$$1.25h = 1.25 \times 1.10$$

$$= 1.375 > 0.75 \text{ m.}$$

Since your masonry height (0.725 m) is **less** than 1.375 m, the **full rectangular load** must be considered.

$$\begin{aligned} \text{Masonry load } w_m &= 1.275 \times 0.725 \times 0.23 \times 19 \\ &= 4.04 \text{ KN} \end{aligned}$$

$$\begin{aligned} \text{Self weight of the lintel } w_d &= 0.23 \times 0.10 \times 1.275 \times 25 \\ &= 0.73 \text{ KN/m} \end{aligned}$$

$$\text{Total } = 4.77 \text{ KN}$$

$$\text{Total factored load } (W_u) = 7.16 \text{ KN}$$

Factored bending moment is M_U

$$\begin{aligned} M_U &= \frac{w_u l^2}{8} \\ &= \frac{7.16 \times 1.275^2}{8} \\ &= 1.14 \text{ KN-m} \end{aligned}$$

Factored shear force

$$\begin{aligned} V_U &= \frac{w_u l}{2} \\ &= \frac{7.16 \times 1.275}{2} \\ &= 4.56 \text{ KN.} \end{aligned}$$

Depth required:

The minimum depth required to resist bending moment.

$$\begin{aligned} M_U &= 0.138 f_{ck} b d^2 \\ 1.14 \times 10^6 &= 0.133 \times 20 \times 230 \times d^2 \\ d_{\text{req}} &= 43 \\ d_{\text{req}} &= 43 \text{ mm} < 75 \text{ mm.} \end{aligned}$$

hence provided depth is adequate.

Tension reinforcement:

Area of steel is calculated by equating C&T

$$0.87f_y A_{st} = 0.36f_{CK} b x_{u\max}$$

$$\begin{aligned} A_{st} &= \frac{0.36f_{CK} b x_{u\max}}{0.87f_y} \\ &= \frac{0.36 \times 20 \times 230 \times 0.46 \times d_0}{0.87 \times 500} \\ &= 131 \text{ mm}^2 \end{aligned}$$

Provide 2 bars of 10mm Ø, A_{st} provided = 157 mm^2 .

Design of shear reinforcement:

$$\begin{aligned} \text{Nominal shear stress } \tau_v &= \frac{V_U}{bd} \\ &= \frac{4.56 \times 10^3}{230 \times 75} \\ &= 0.264 \text{ N/mm}^2. \end{aligned}$$

provide **minimum shear reinforcement**.

Stirrups: Use 6 mm diameter 2-legged stirrups.

Spacing (S_v) = Lesser of $(0.75 \times 75) = 56$

Adopt: 6 mmØ stirrups @ 50 mm c/c

CHAPTER 5

DRAWINGS

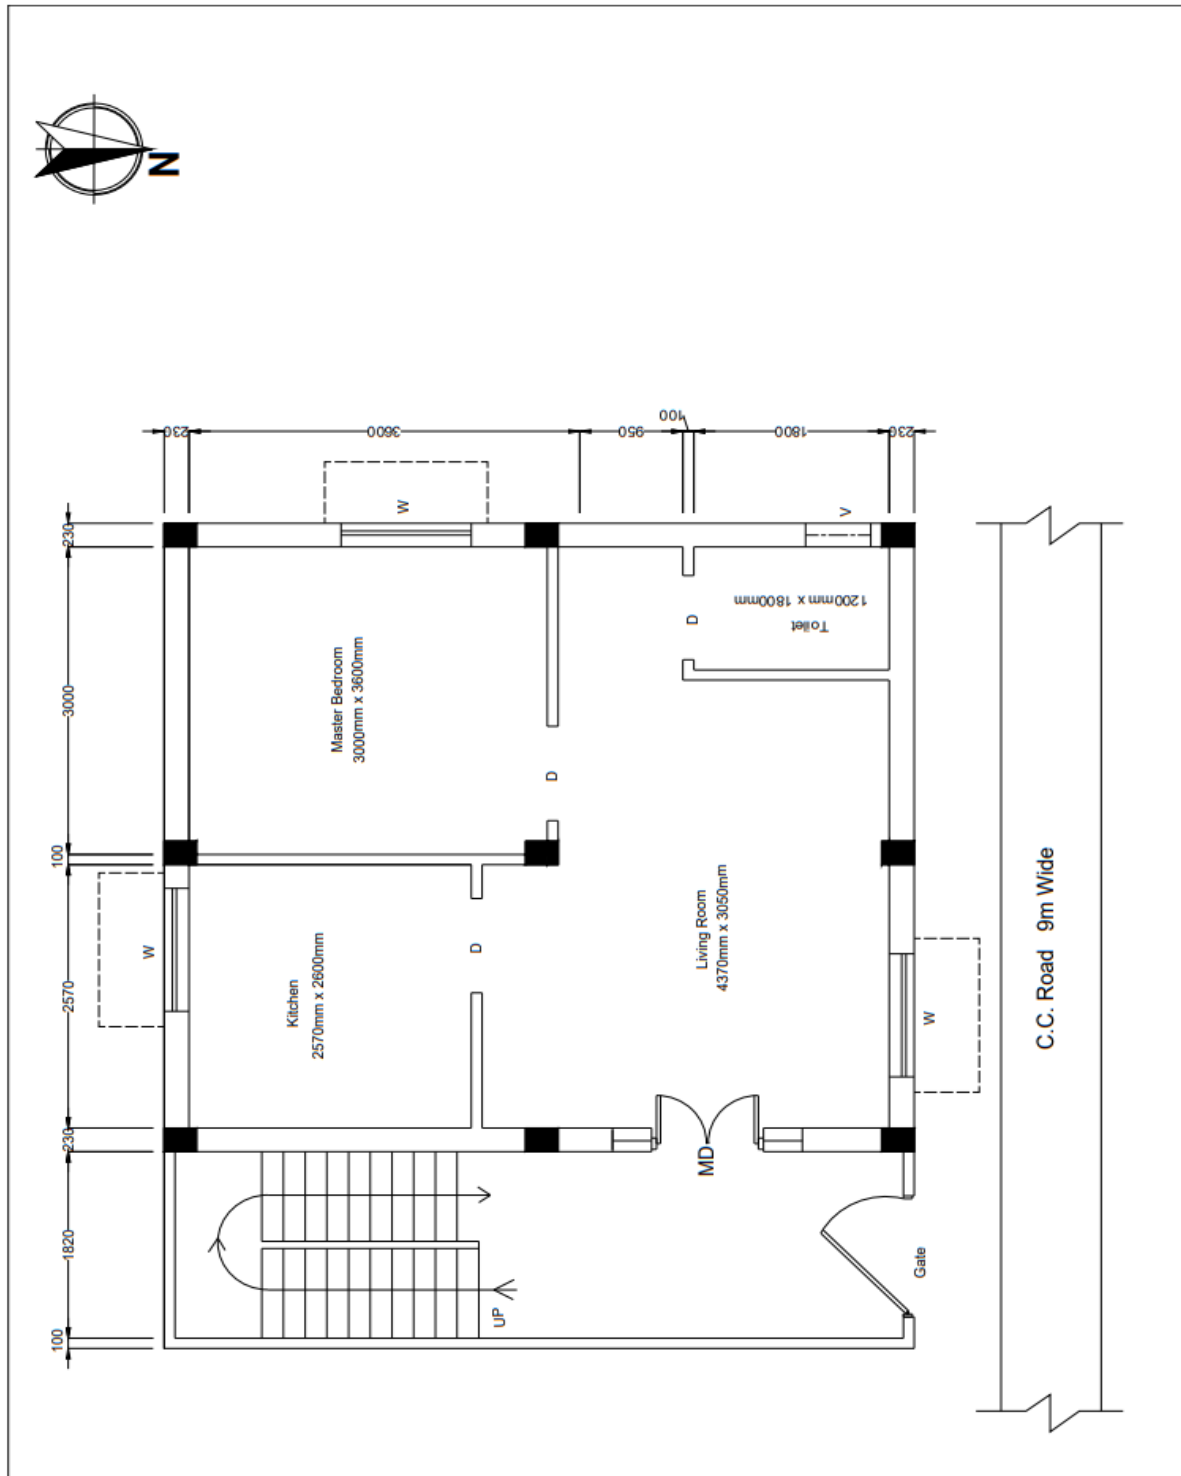


Figure 5.1: ground floor plan

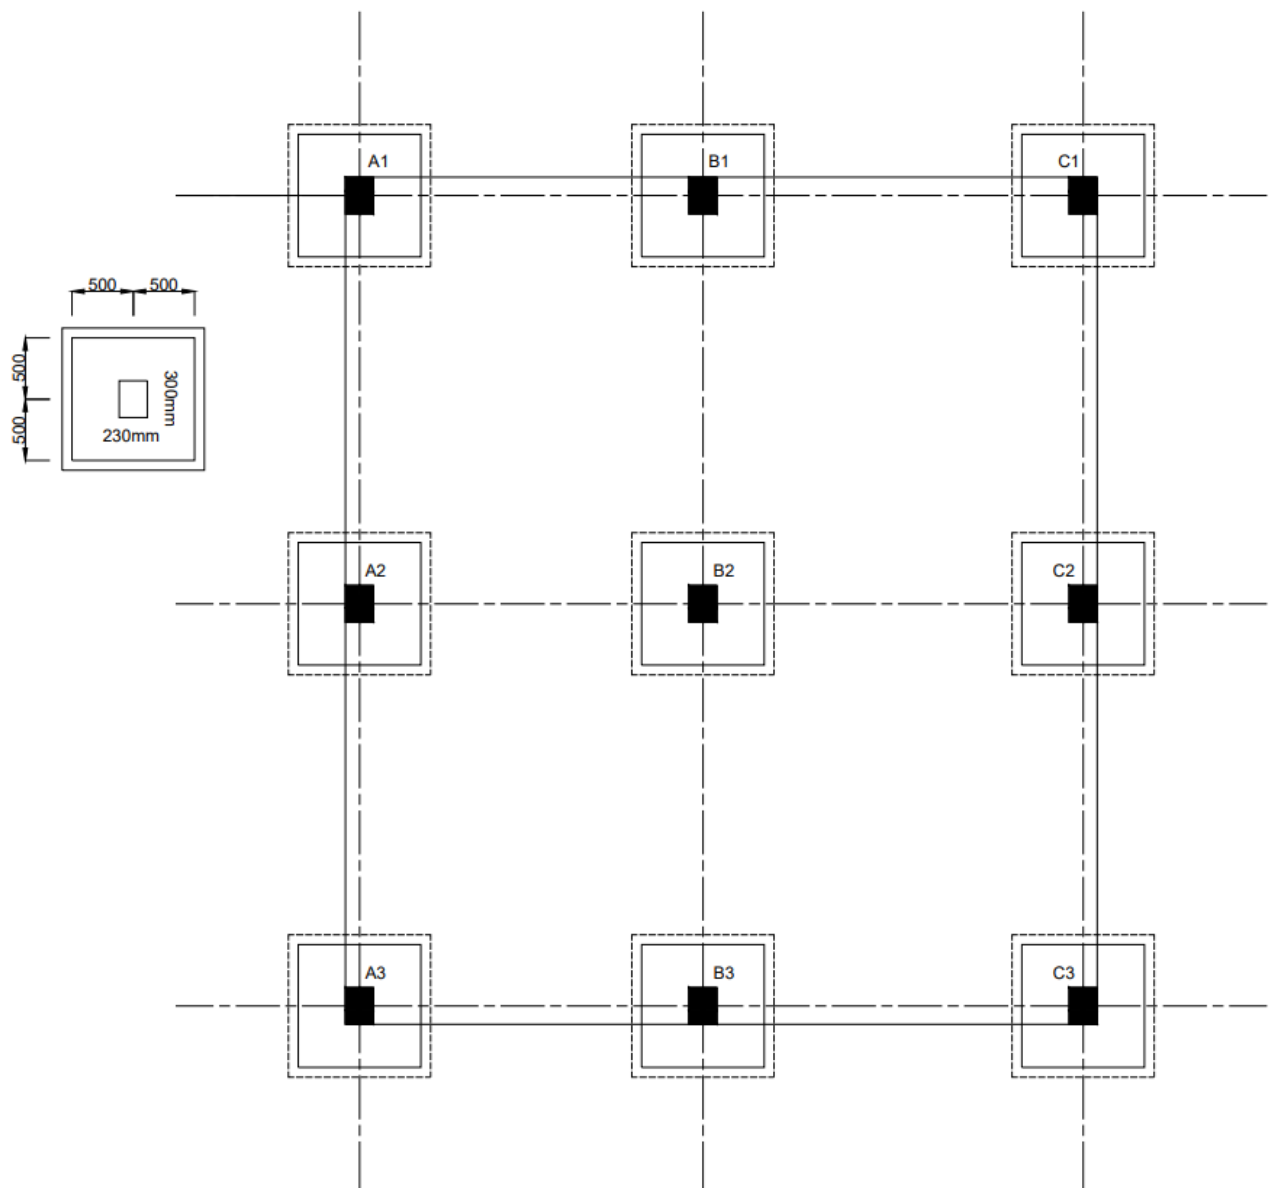


Figure 5.2: Footing layout

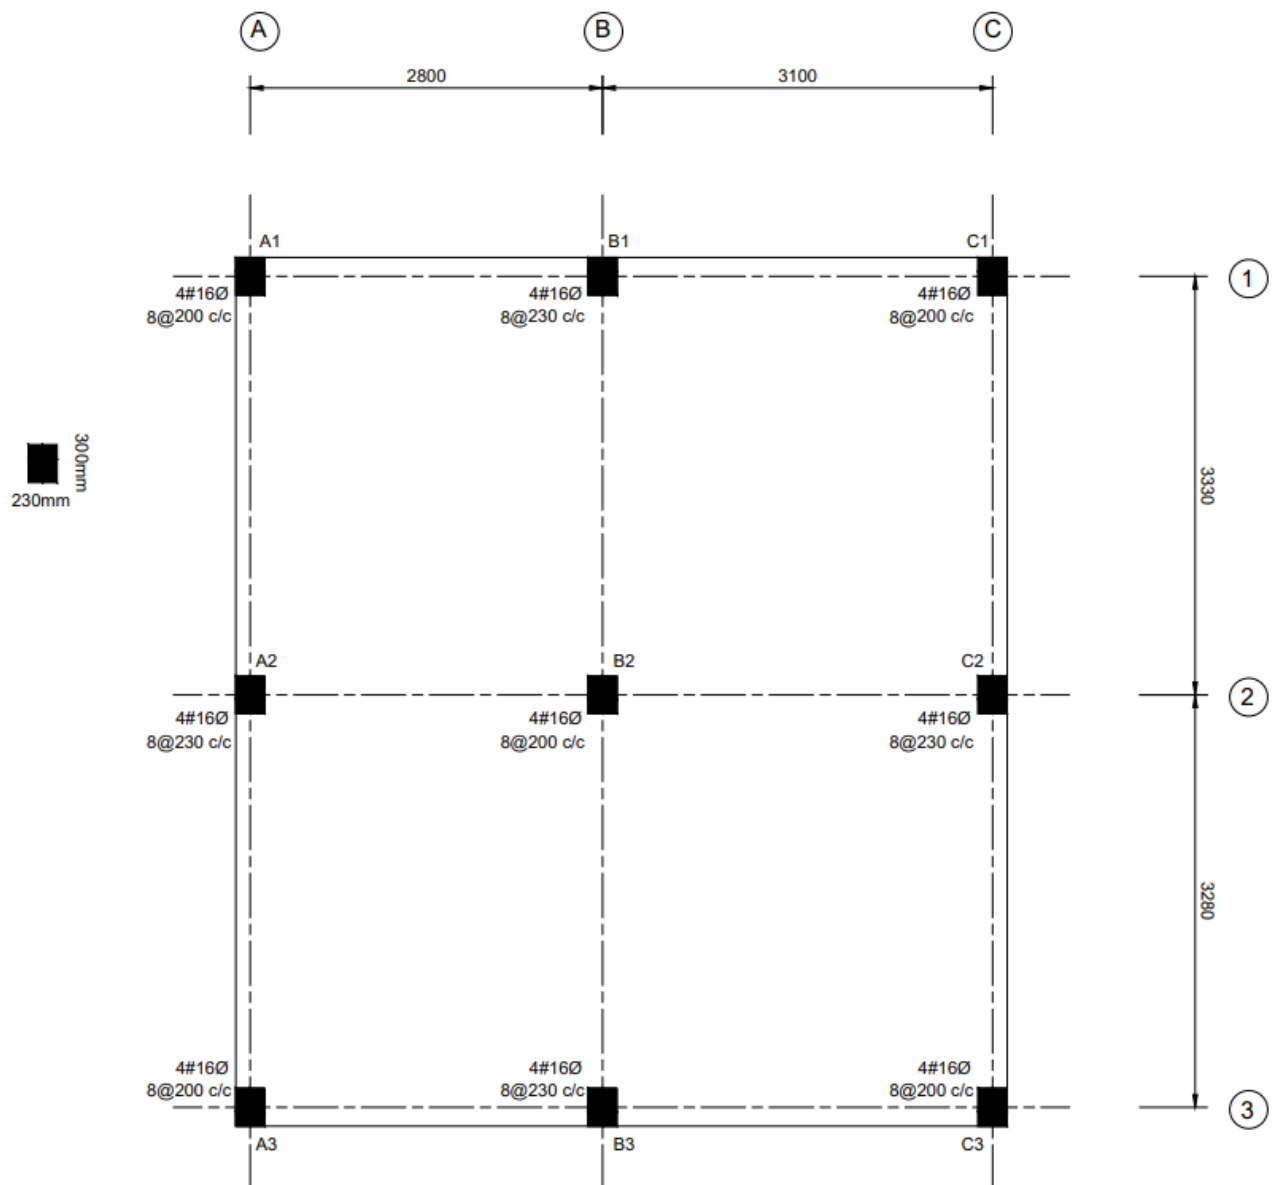


Figure 5.3: Column layout

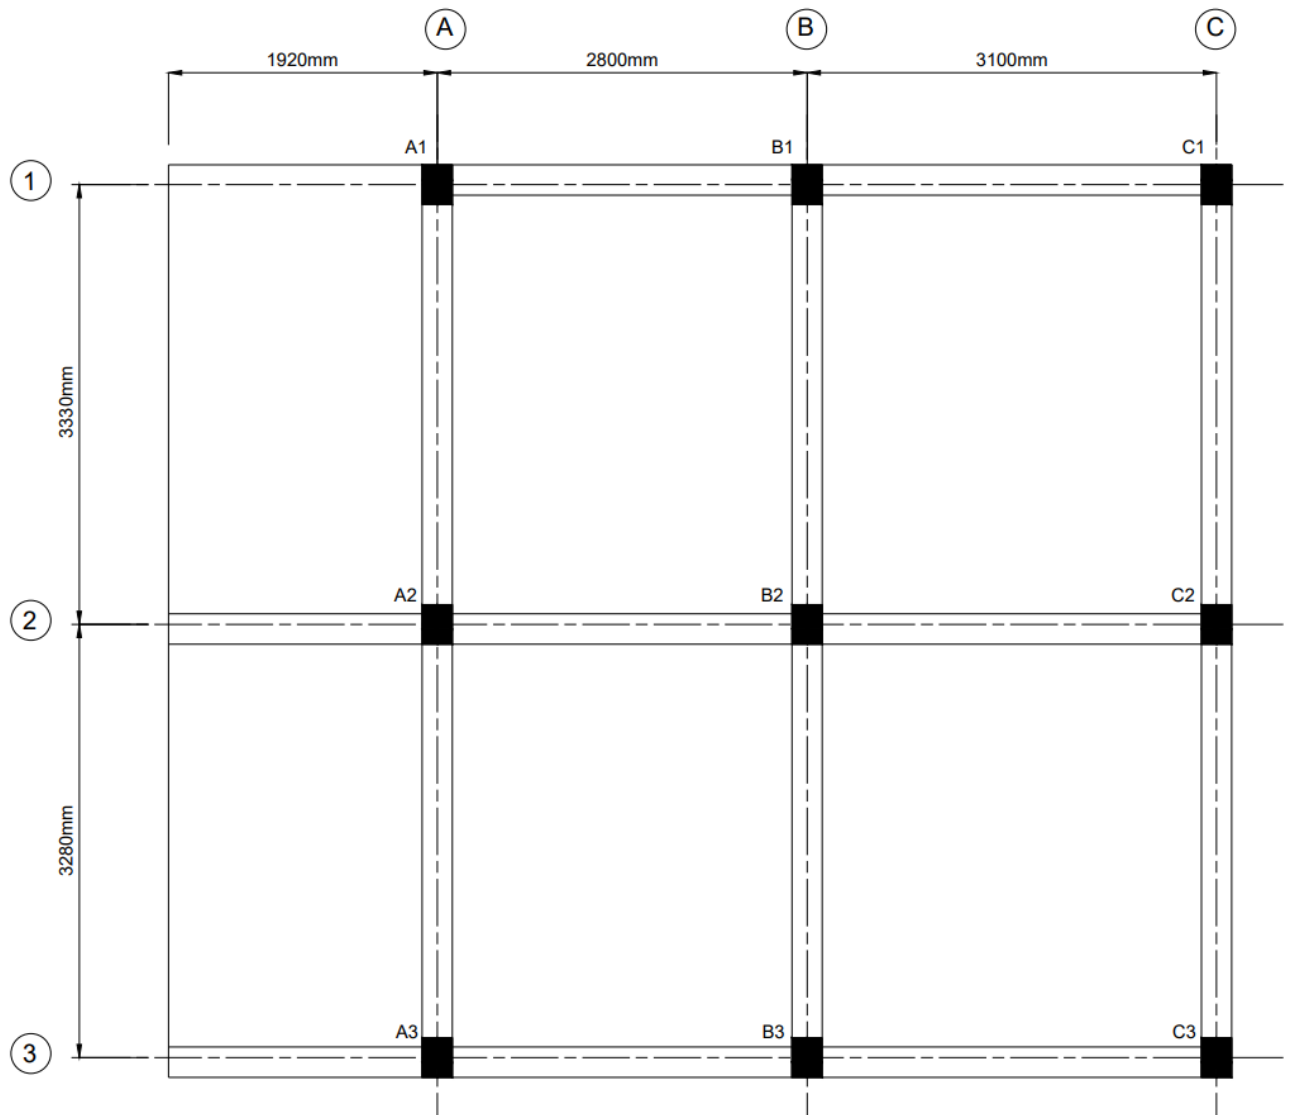


Figure 5.4: Beam layout

REINFORCEMENT DETAILS

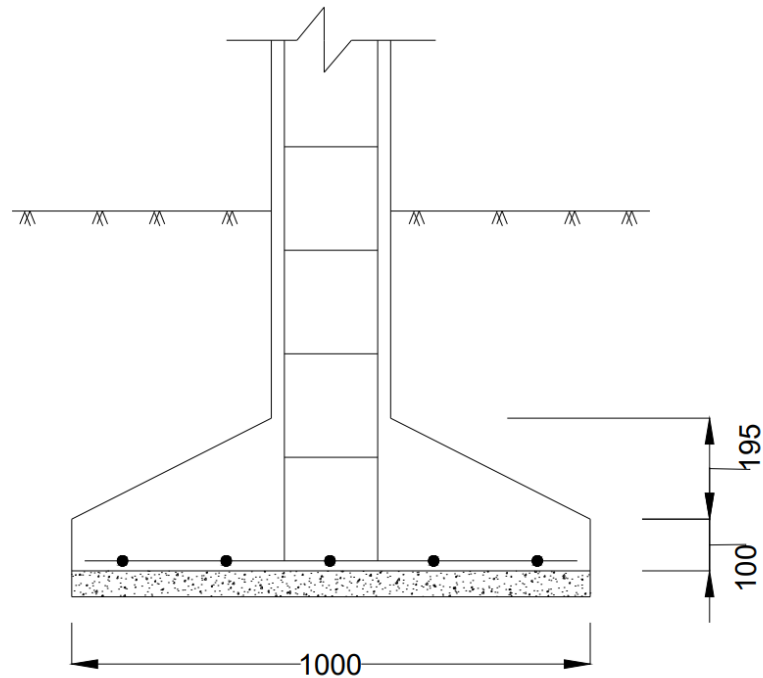
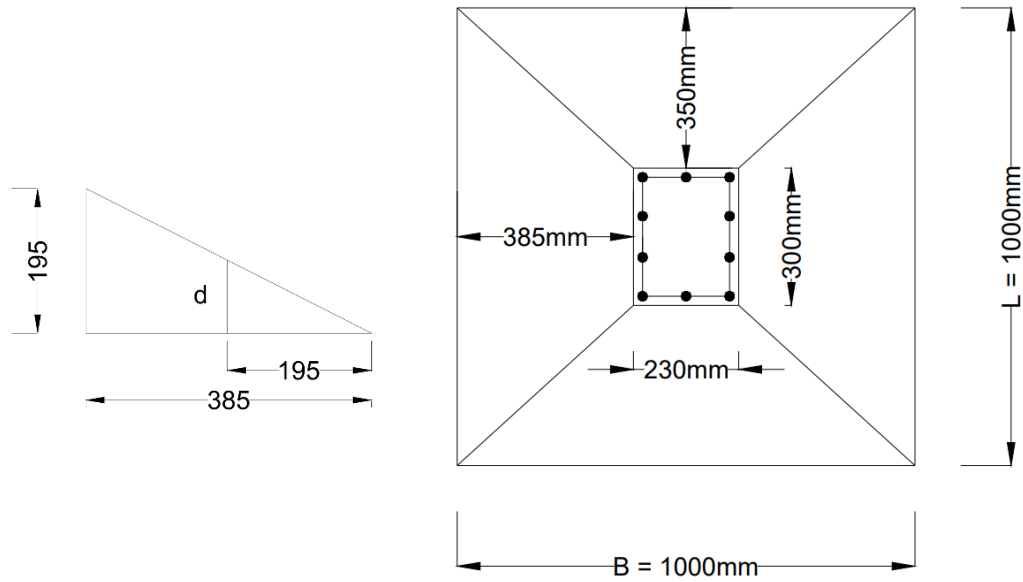


Figure 5.5: Footing reinforcement

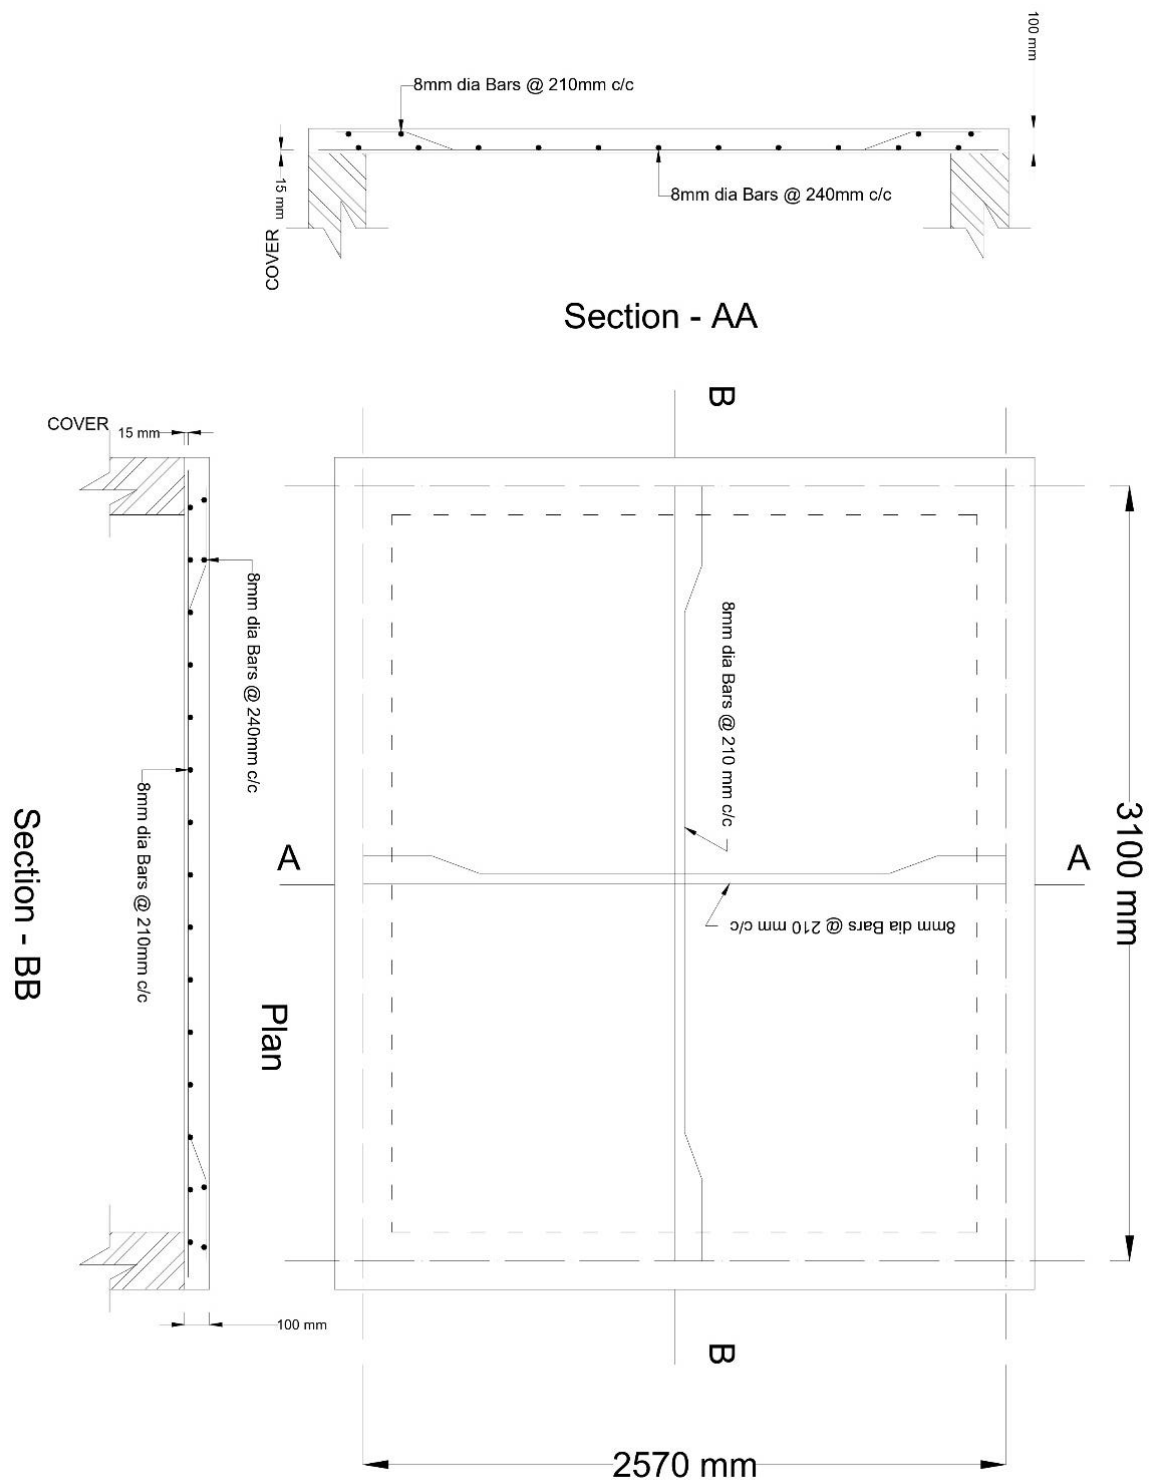


Figure 5.6: Slab reinforcement

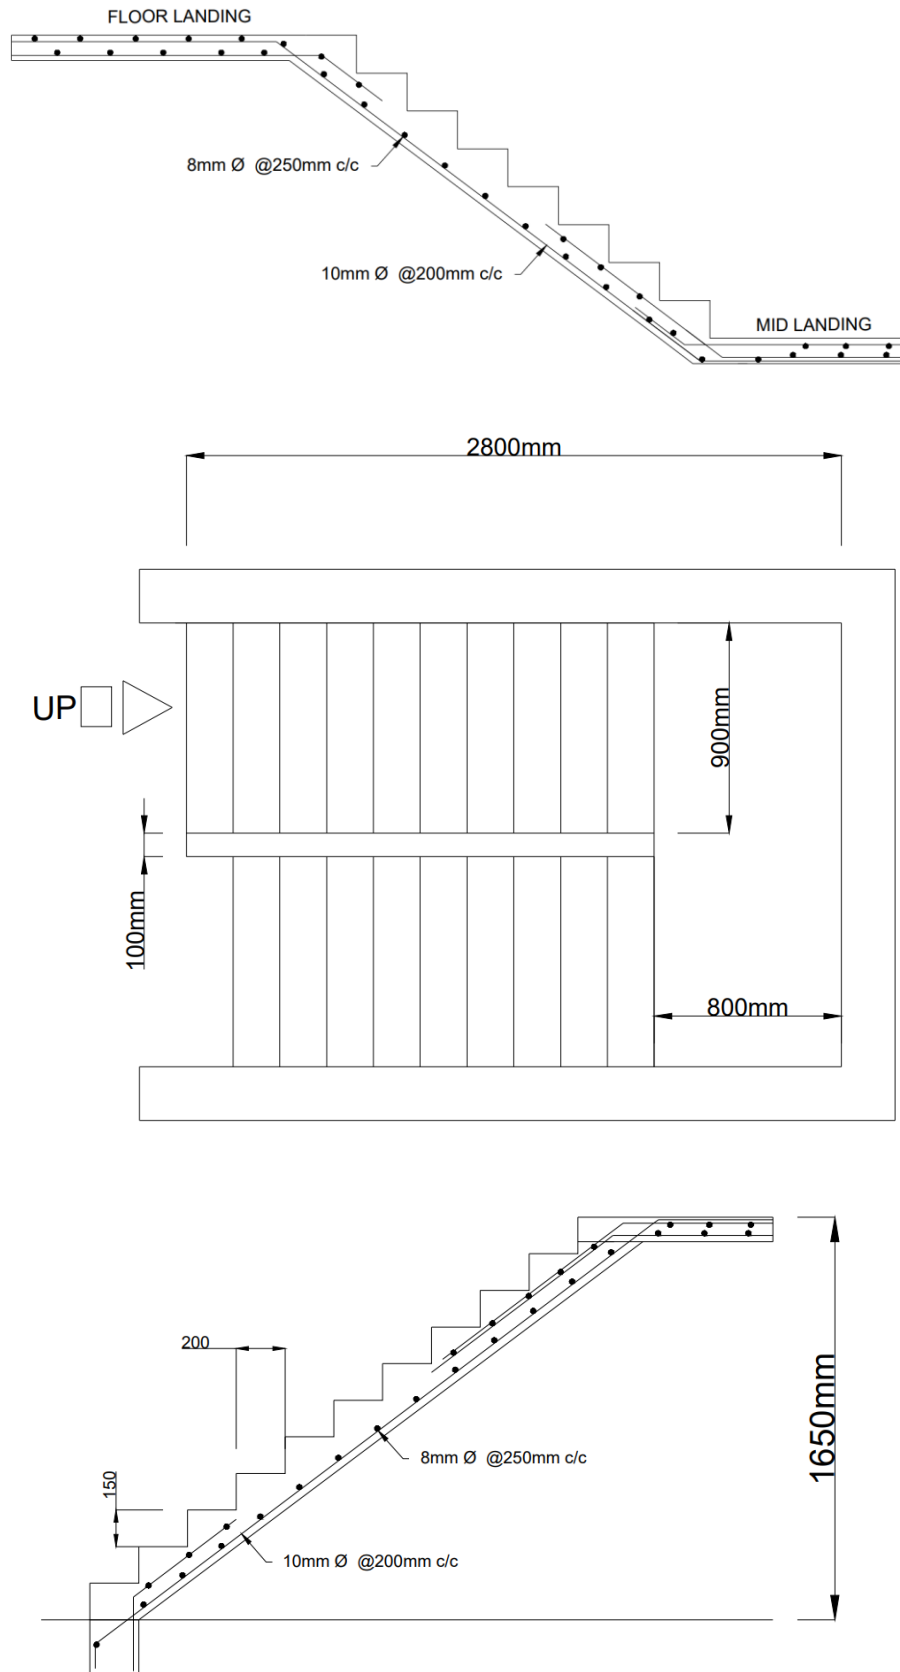


Figure 5.7: Staircase reinforcement