



KIRLOSKAR CHILLERS PRIVATE LIMITED

A Kirloskar Group Company

Enriching Lives

Document No : EB/17-18/05				
Document Name : Release of new version of Screw Selection Software				
Prep. By : AHW	Chkd. By : SNM	Appd. By : SSN	Date : 28/08/17	Total Pages : 4

Engineering Bulletin

We are releasing herewith new version of Screw Selection Software, WCSS Version 1.4.0 & ACSS Version 1.3.9

Highlights of Screw Selection Software WCSS 1.4.0 / ACSS 1.3.9:

- S-I System and I-P System introduced as per AHRI Guidelines
Now two different measurement systems are available in latest version of software. Generally it is recommended to use S-I System only, I-P System is also available for customer convenience. (Refer following guidelines for “How to select measurement system”)
- AHRI Conditions updated for S-I as well as I-P System.
AHRI Conditions for S-I System
Evaporator in/out – 12/7 °C
Condenser in/out – 30/35 °C
Ambient Temp – 35 °C (For Air-Cooled Chillers)


AHRI Conditions for I-P System
Evaporator in/out – 55/44 °F
Condenser in/out – 85/94.3 °F
Ambient Temp – 95 °F (For Air-Cooled Chillers)
- Software updated as per latest AHRI Guidelines which includes
 - Software name and Version number on all report pages
 - All output values are according to their digit significance as per AHRI
 - Major changes in layouts of report pages
- Physical Data for all chiller models is now available in Software Outputs. No need to refer separate ESPs for Physical data, same are obsolete now onwards.
- KCM Part-Load values corrected.
- ACSS – IPLV and NPLV Values bug fixed.
- KWS Models Selection bug fixed and other minor bugs fixed.

Revisions in existing Documents:


- KWS R134a & R407C heat pump rating chart revised.
Revised documents are uploaded on Samanvay and can be referred under “product related” document section.

How to install new version:



1. Uninstall previous version, if any from Control Panel\All Control Panel Items\Programs and Features\KCPL Chiller Selection System
2. Download Setup File (Setup_KCPLChillerSelectionSystem_1.4.0.zip) from Samanvay.
Path: Samanvay – Documents – Product related – software – Setup_KCPLChillerSelectionSystem_1.4.0.zip
3. Extract the zip file on desktop.
4. Run Setup_KCPLChillerSelectionSystem.exe file

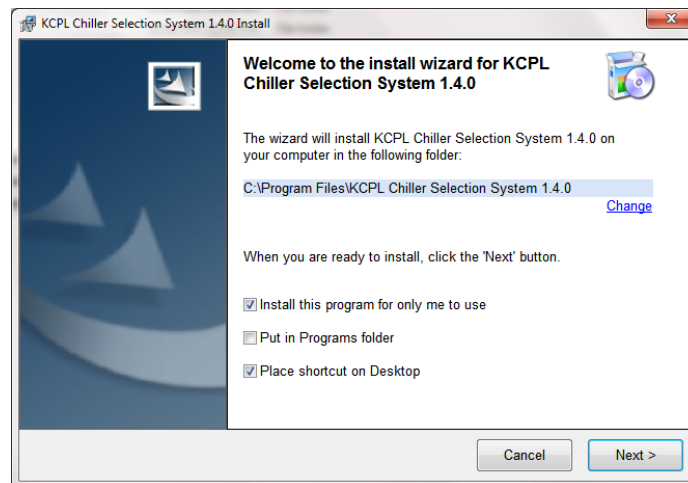


5. Click on next button.

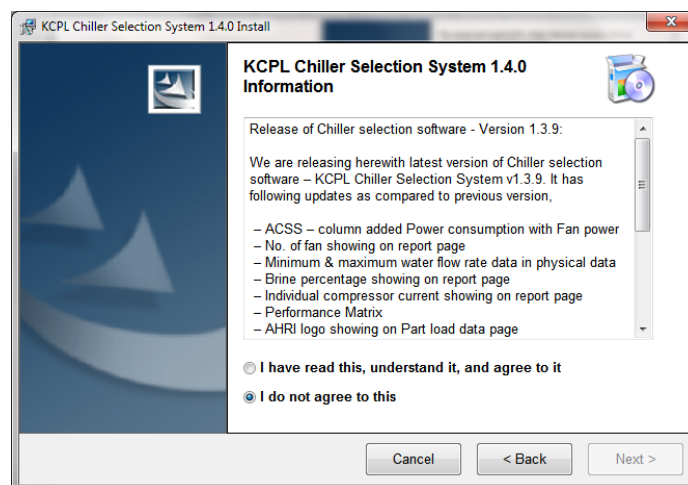

- Click on “I have read this, understand it and agree to it” then click on next button.

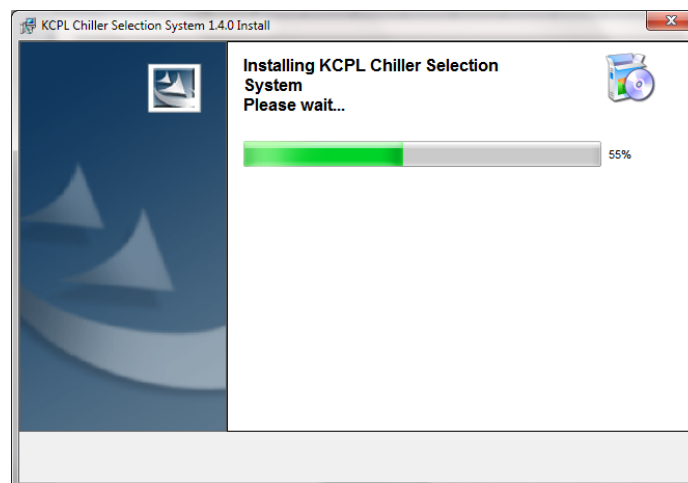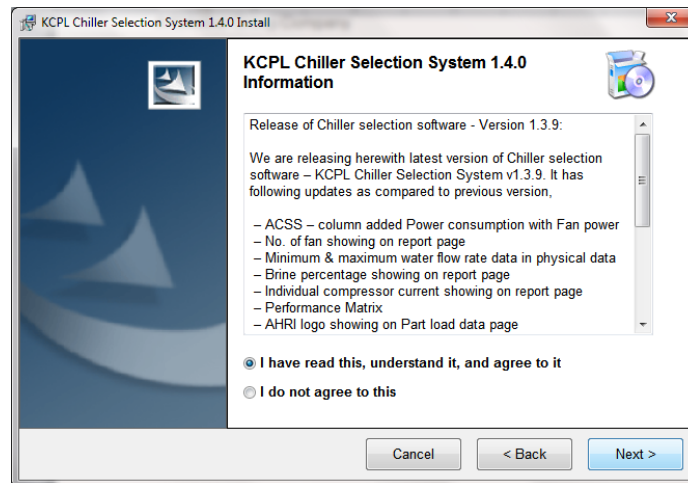

- After that click on ok button. PC restart is necessary.

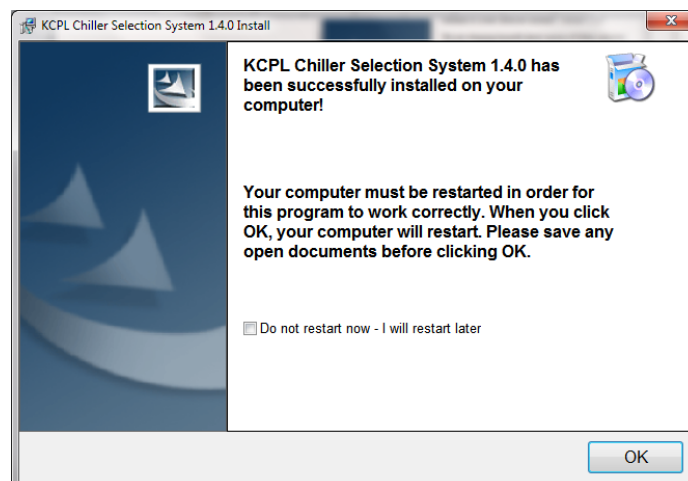



Enriching Lives

KIRLOSKAR CHILLERS PRIVATE LIMITED

A Kirloskar Group Company

How to select measurement system:

1. S-I System will be selected by default, to change it to I-P System refer step 2.



2. After clicking on Select Unit button, this window will pop up and you can change to "I-P System" by selecting "I-P System" and then clicking on "Save" Button.

