

ENGINEERING BULLETIN

Product Release

New program update
for Model –

KWK/I_XXX_1X -14.10.10

KWK/I_XXX_2X -14.10.10

No: EB/20-21/003,
Date: 20th October 2020

Dear Colleague,

We hereby wish to inform you about the official release of new software version of KWK/I single & dual circuit chiller.

In this version we have introduced new 7" touch screen & have made some minor software changes.

Find the below sample screen shot for new display...

➤ New touch screen (Display) as per show in below Fig.



New program update
for Model –

KWK/I_XXX_1X -14.10.10

KWK/I_XXX_2X -14.10.10

- BMS Settings separated for each BMS line.

The screenshot shows a web interface titled "CONFIGURATION SETPOINTS" with a login status of "Supervisory" and a timestamp of "19/10/20 10:20:13". The interface is divided into two columns for "BMS-1" and "BMS-2". Each column has three rows: "Address" (with input boxes containing "1" and "2" respectively), "Protocol" (with dropdown menus set to "Modbus Ext."), and "Baudrate" (with dropdown menus set to "19200").

	BMS-1	BMS-2
Address	1	2
Protocol	Modbus Ext.	Modbus Ext.
Baudrate	19200	19200

- New improved password management.
- Oil Heater operation will be controlled & monitored by controller.
- We have now separated the alarm in two types viz. "Active Alarms" & "History Alarms".
- Active alarms will show the present unacknowledged alarm.
- And History alarm will show the alarm history.
- Alarms will be now notified with "Alarm Bell" icon.


Product Release

New software Version
for KWKI.

Model –

KWK/I_XXX_1X_14.10.10

KWK/I_XXX_2X_14.10.10

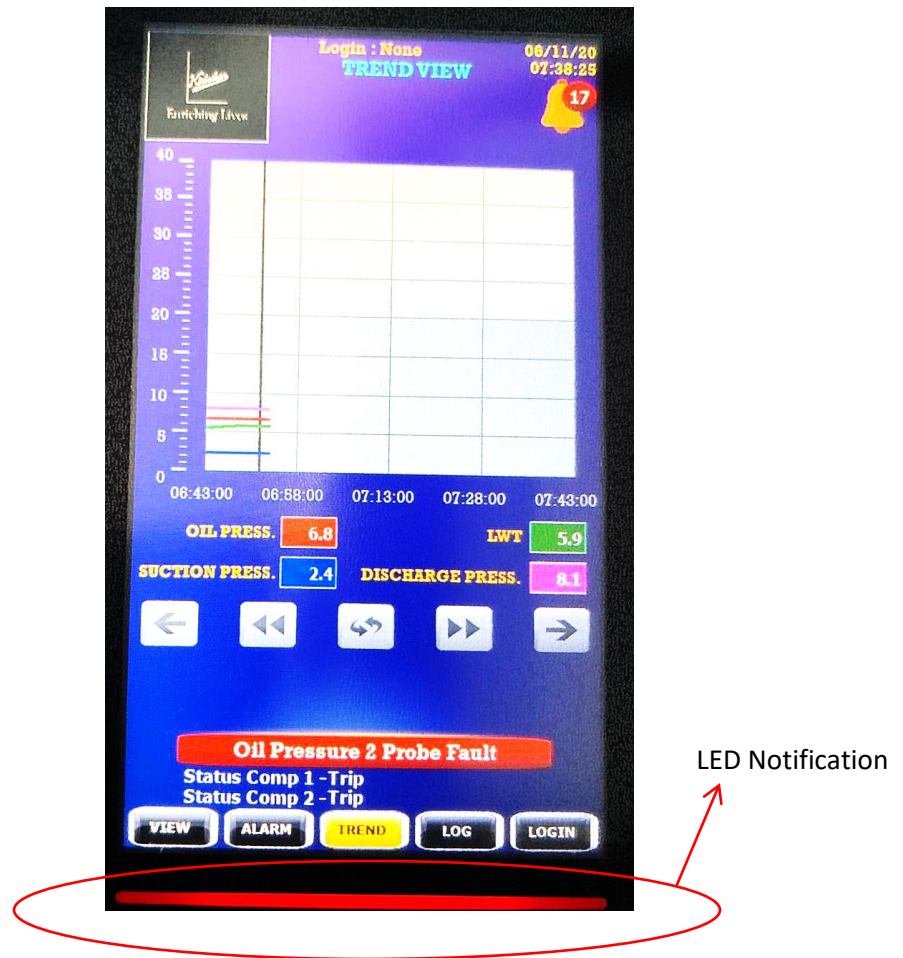

Improved “Trend & Graphs” with new cursor option to see actual trend data, you only need to move cursor and the instant values will be shown for the below parameters.

➤ New HMI has LED indication on bottom which are configured as below,

- Green while running.
- Red Blinking for Alarm.
- White blinking for chiller OFF condition.