

ENGINEERING BULLETIN

Product Options

Factory fitted ATCS control philosophy

No: EB/23-24/02,
11/09/2023

Dear Colleague,

We here by wish to inform you about the official release of factory fitted ATCS control philosophy & settings provided on controller/HMI (Siemens/Carel).

This bulletin covers ATCS operation flow chart & ATCS operation settings options available on screen. Using this documents engineer can commissioned or start ATCS without any trouble.

***Note - for Set points & monitoring of ATCS operation please go through below pages of HMI. (This is common for 7" & 15" HMI)**

ATCS Settings - As shown below on **TIMER SETPOINT** page all required set points available. For operation & settings refer flow chart sequence.

Note* - For settings contact your immediate officer.

Karloskar Chillers

TIMER SETPOINT

04/10/22 Tue 14:16:47

##

POWER ON DELAY	12	SEC
PRE-LUBE TIME	12	SEC
POST LUBE TIME	12	SEC
ALARM DELAY EXP BOARD	123	SEC
DELAY EVAP PUMP	123	SEC
DELAY COND PUMP	123	SEC
HP CUT-OUT ALARM	12	SEC
WINDING PROTECTION ALARM	12	SEC
TRANSITION ALARM	12	SEC

ATCS TIMER DELAY (SEC)

ATCS FWD ON (T1)	123
ATCS HOLD 1 (T2)	123
ATCS REV ON (T3)	123
ATCS HOLD 2 (T4)	1234

CONTROL

CURRENT

TEMPERATURE

PRESSURE

COMPRESSOR

TIMERS

PROBES

CONFIGURATION

EXV OIL T


EXV

VFD

123

CHILLER OVERVIEW ALARM HISTORY **ALARM REALTIME** DATA LOG DIGITAL ALARM LOG DATA LOG ANALOG USER SETPOINT SUPV SETPOINT

This value shall be as per sites condition & approved by immediate officer.

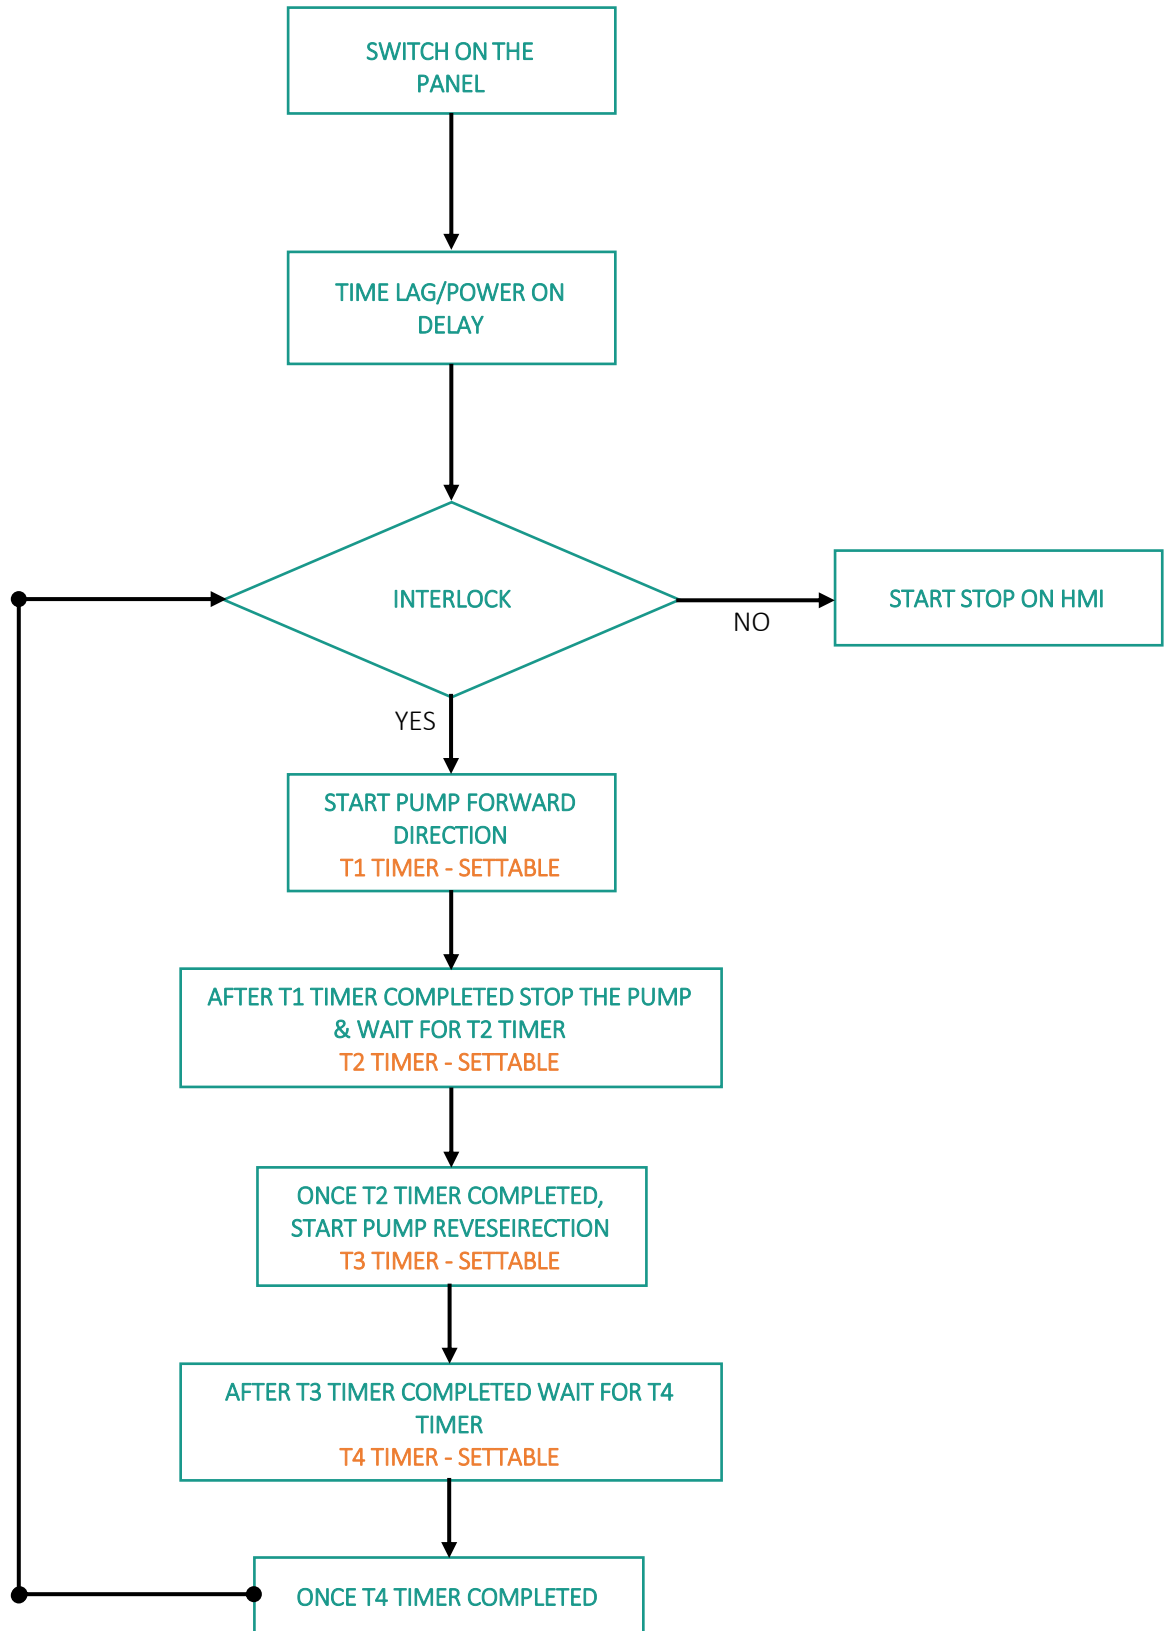

NOTE* INTERLOCK CONDITIONS: - 1) CHILLER ON 2) PUMP MPCB HEALTHY 3) ATCS START ON HMI.

ATCS Overview - As shown below image **ATCS VIEW** page shown all animation related to ATCS operation. **ATCS Healthy FB** means pump **MPU** is healthy.

