



KIRLOSKAR CHILLERS PRIVATE LIMITED

A Kirloskar Group Company

Enriching Lives

ENGINEERING SPECIFICATIONS

Document Name: KCM_XXX_2X Modbus list		
Document No: ESP-17-18-116	Revision: R02	Date: 19/03/2018
Prepared By: HPK	Approved By: SSN	Sheet: 1 of 3

KCM_XXX_2X MODEL				
Descriptions	UOM	Type	Read/Write	Modbus Add
Evaporator Water In Temperature	°C	ANALOG	Read	40005 (Holding Register)
Evaporator Water Out Temperature	°C	ANALOG	Read	40006 (Holding Register)
Condenser IN Temperature	°C	ANALOG	Read	40014 (Holding Register)
Condenser Out Temperature	°C	ANALOG	Read	40015 (Holding Register)
LWT Setpoint	°C	ANALOG	Read/Write	40051 (Holding Register)
Compressor - 1				
Discharge Temperature	°C	ANALOG	Read	40009 (Holding Register)
Suction Temperature	°C	ANALOG	Read	40012 (Holding Register)
Liquid Line Temperature	°C	ANALOG	Read	40013 (Holding Register)
Suction Pressure	Bar	ANALOG	Read	40156 (Holding Register)
Discharge Pressure	Bar	ANALOG	Read	40003 (Holding Register)
Motor Current	Amp	ANALOG	Read	40007 (Holding Register)
Suction Saturation Temperature	°C	ANALOG	Read	40016 (Holding Register)
Suction Superheat	°C	ANALOG	Read	40017 (Holding Register)
Percentage RLA	%	ANALOG	Read	40031 (Holding Register)
Evaporator Approach	-	ANALOG	Read	40022 (Holding Register)
Condenser Approach	-	ANALOG	Read	40032 (Holding Register)
Run Hours- High*	Hrs.	INTEGER	Read	45048 (Holding Register)
Run Hours- Low*	Hrs.	INTEGER	Read	45047 (Holding Register)



KIRLOSKAR CHILLERS PRIVATE LIMITED

A Kirloskar Group Company

Enriching Lives

Compressor - 2				
Discharge Temperature	°C	ANALOG	Read	40037 (Holding Register)
Suction Temperature	°C	ANALOG	Read	40040 (Holding Register)
Liquid Line Temperature	°C	ANALOG	Read	40164 (Holding Register)
Suction Pressure	Bar	ANALOG	Read	40040 (Holding Register)
Discharge Pressure	Bar	ANALOG	Read	40033 (Holding Register)
Motor Current	Amp	ANALOG	Read	40035 (Holding Register)
Suction Saturation Temperature	°C	ANALOG	Read	40016 (Holding Register)
Suction Superheat	°C	ANALOG	Read	40030 (Holding Register)
Percentage RLA	%	ANALOG	Read	40141 (Holding Register)
Evaporator Approach	-	ANALOG	Read	40052 (Holding Register)
Condenser Approach	-	ANALOG	Read	40033 (Holding Register)
Run Hours- High*	Hrs.	INTEGER	Read	45027 (Holding Register)
Run Hours- Low*	Hrs.	INTEGER	Read	45026 (Holding Register)

***Note: Total run hours will be combination of two registers**
Total Run hours = Run Hours High x 1000 + Run Hours Low




KIRLOSKAR CHILLERS PRIVATE LIMITED

A Kirloskar Group Company

Enriching Lives

Protocol Details	
Parity	None
Baud rate	19200
Protocol	Modbus/Modbus Extended
Start bit	1
Stop bit	1
No of bit	8
Communication Interface	RS-485
Interface Connection	2 Wire

The connection with the RS485 network is carried out by means of the plug-in terminal connector on the card. Pin-wiring of the connector is stamped on the card. If the card is placed in the last position of the supervision serial line, pins 2 and 3, you must connect a $120\ \Omega$ - $1/4\ W$ end line resistor, as shown.

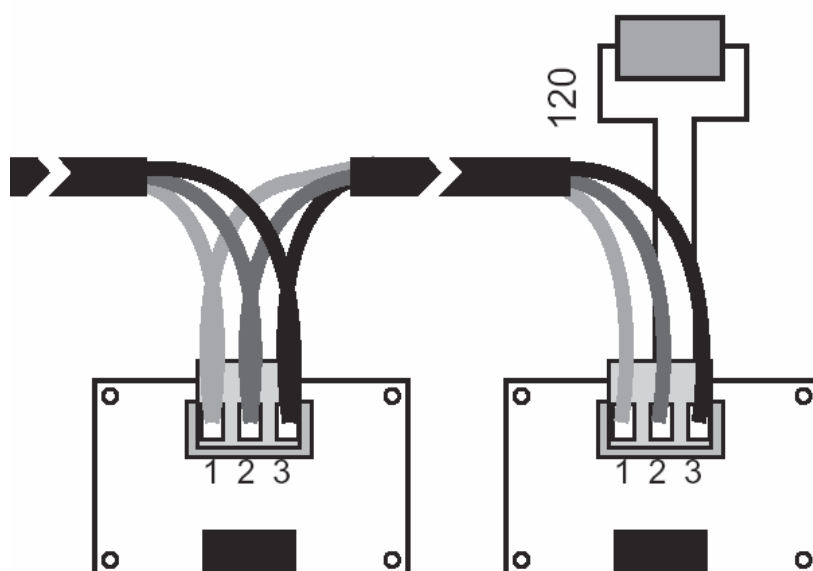

pin	significato <i>meaning</i>
1	GND
2	RX+/TX+
3	RX-/TX-