

HMI MONITERING USING COMMON NETWORK		
Document No: ESP-23-24-010	Revision: R00	Date: 24/11/2023
Prepared By: PJP		Approved By: CGH

This system is used for HMI monitoring through PC

For this system we required hardware and software

- **PC configuration for installation of software for smooth operation:**

Sr.No	Specifications	
1	Processor	I3/I5/I7/I9
2	Minimum Ram	4 GB
3	System type	32 / 64 bit

- **Cable requirement for HMI to PC connectivity:**

Ethernet CAT6 cable are used for the HMI to PC connectivity:

- **Software facility:**


Only for data monitoring **(Not for data saving in PC)**

- **Ethernet switch:**

Ethernet switch (if required)

HMI MONITORING USING COMMON NETWORK		
Document No: ESP-23-24-010	Revision: R00	Date: 24/11/2023
Prepared By: PJP	Approved By: CGH	

- HMI MONITORING USING COMMON NETWORK / INTERNAL PLANT LAN CONNECTIVITY:**

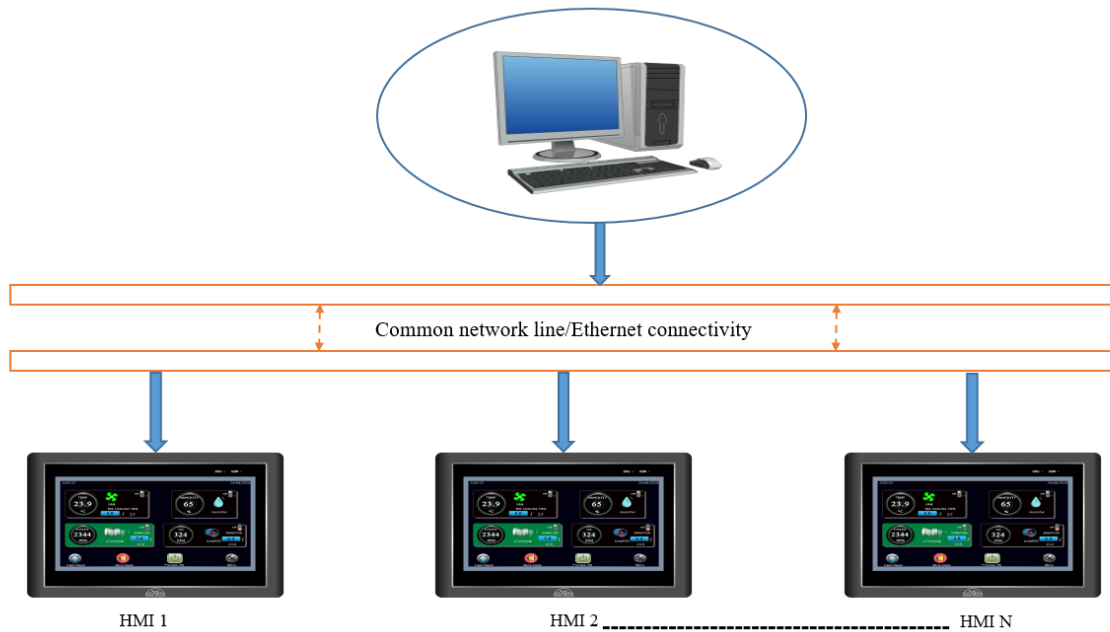

- HMI MONITORING USING ETHERNET SWITCH:**

