

ENGINEERING SPECIFICATIONS

Document Name: KAS Triple Circuit Modbus List		
Document No: ESP-24-25-09	Revision: R00	Date:27-09-2024
Prepared By: PJP	Checked By: AS	Approved By: NMR

KAS Triple Circuit				
Descriptions	UOM	Type	Read/Write	Modbus Add(Holding Register)
Evaporator Water In Temperature	°C	ANALOG	Read	40008
Evaporator Water Out Temperature	°C	ANALOG	Read	40009
LWT Setpoint	°C	ANALOG	Read/Write	40051
Condenser IN Temperature/Ambient	°C	ANALOG	Read	40010
Main On	-	BOOLEAN	Read	00008
Compressor - 1				
Sump Oil Temperature	°C	ANALOG	Read	40023
Discharge Temperature	°C	ANALOG	Read	40014
Suction Temperature	°C	ANALOG	Read	40026
Liquid Line Temperature	°C	ANALOG	Read	40011
Suction Pressure	Bar	ANALOG	Read	40002
Discharge Pressure	Bar	ANALOG	Read	40005
Oil Feed Pressure	Bar	ANALOG	Read	40020
Motor Current	Amp	ANALOG	Read	40017
Suction Superheat	°C	ANALOG	Read	40029
Discharge Superheat	°C	ANALOG	Read	40032
Out Exv	%	ANALOG	Read	40035
Off Com	-	BOOLEAN	Read	00009
Delta Comp	-	BOOLEAN	Read	00035
AI comp trip	-	BOOLEAN	Read	00044
Compressor – 2				
Sump Oil Temperature	°C	ANALOG	Read	40024
Discharge Temperature	°C	ANALOG	Read	40015
Suction Temperature	°C	ANALOG	Read	40027
Liquid Line Temperature	°C	ANALOG	Read	40012
Suction Pressure	Bar	ANALOG	Read	40003
Discharge Pressure	Bar	ANALOG	Read	40006
Oil Pressure	Bar	ANALOG	Read	40021
Motor Current	Amp	ANALOG	Read	40018
Suction Superheat	°C	ANALOG	Read	40030
Discharge Superheat	°C	ANALOG	Read	40033
Out Exv	%	ANALOG	Read	40036
Off Com	-	BOOLEAN	Read	00010
Delta Comp	-	BOOLEAN	Read	00036
AI comp trip	-	BOOLEAN	Read	00045
Compressor – 3				
Sump Oil Temperature	°C	ANALOG	Read	40025
Discharge Temperature	°C	ANALOG	Read	40016
Suction Temperature	°C	ANALOG	Read	40028

ENGINEERING SPECIFICATIONS

Document Name: KAS Triple Circuit Modbus List		
Document No: ESP-24-25-09	Revision: R00	Date:27-09-2024
Prepared By: PJP	Checked By: AS	Approved By: NMR


Liquid Line Temperature	°C	ANALOG	Read	40013
Suction Pressure	Bar	ANALOG	Read	40004
Discharge Pressure	Bar	ANALOG	Read	40007
Oil Feed Pressure	Bar	ANALOG	Read	40022
Motor Current	Amp	ANALOG	Read	40019
Suction Superheat	°C	ANALOG	Read	40031
Discharge Superheat	°C	ANALOG	Read	40034
Out Exv	%	ANALOG	Read	40037
Off Com	-	BOOLEAN	Read	00011
Delta Comp	-	BOOLEAN	Read	00037
Al comp trip	-	BOOLEAN	Read	00046

Protocol Details	
Parity	None
Baud rate	19200
Protocol	Modbus/Modbus Extended
Start bit	1
Stop bit	1
No of bit	8
Communication Interface	RS-485
Interface Connection	2 Wire

The connection with the RS485 network is carried out using the plug-in terminal connector on the card. Pin-wiring of the connector is stamped on the card. If the card is placed in the last position of the supervision serial line, pins 2 and 3, you must connect a 120 Ω - 1/4 W end line resistor, as shown.

ENGINEERING SPECIFICATIONS

Document Name: KAS Triple Circuit Modbus List		
Document No: ESP-24-25-09	Revision: R00	Date:27-09-2024
Prepared By: PJP	Checked By: AS	Approved By: NMR

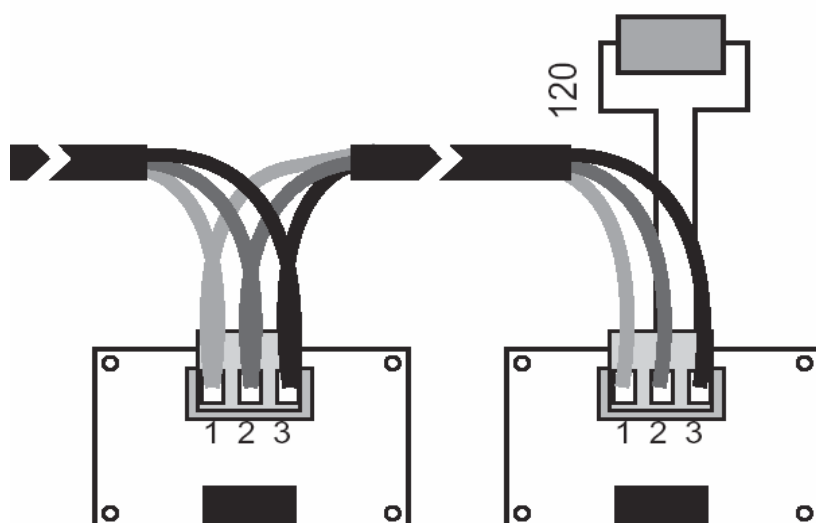

pin	significato <i>meaning</i>
1	GND
2	RX+/TX+
3	RX-/TX-

*Total Run hours/No of starts will be calculated as below *Total run hrs = Run hour H (45023) x 1000 + Run hour L (45024) *Total no of starts = Number of starts H (45019) x 1000 + Number of starts L (45020)