

ENGINEERING SPECIFICATIONS

Document Name: KWF Triple Circuit Modbus List		
Document No: ESP-24-25-11	Revision: R00	Date:30-09-2024
Prepared By: PJP	Checked By: AS	Approved By: NMR

KWF Triple Circuit				
Descriptions	UOM	Type	Read/Write	Modbus Add(Holding Register)
Evaporator Water In Temperature	°C	ANALOG	Read	40008
Evaporator Water Out Temperature	°C	ANALOG	Read	40009
LWT Setpoint	°C	ANALOG	Read/Write	40051
Condenser IN Temperature/Ambient	°C	ANALOG	Read	40010
Condenser OUT Temperature	°C	ANALOG	Read	40011
Liquid Line Temperature	°C	ANALOG	Read	40012
Main OFF	-	BOOLEAN	Read	00008
Chill Wt Flow Switch	-	BOOLEAN	Read	00012
Cond Wt Flow Switch	-	BOOLEAN	Read	00013
Ext Emergency Switch	-	BOOLEAN	Read	00014
Compressor - 1				
Sump Oil Temperature	°C	ANALOG	Read	40022
Discharge Temperature	°C	ANALOG	Read	40013
Suction Temperature	°C	ANALOG	Read	40025
Suction Pressure	Bar	ANALOG	Read	40002
Discharge Pressure	Bar	ANALOG	Read	40005
Oil Feed Pressure	Bar	ANALOG	Read	40019
Motor Current	Amp	ANALOG	Read	40016
Discharge Superheat	°C	ANALOG	Read	40029
Voltage pd Comp	-	BOOLEAN	Read	00002
Wind Protection	-	BOOLEAN	Read	00005
Off Comp	-	BOOLEAN	Read	00009
Oil Level Switch	-	BOOLEAN	Read	00015
Transition Ok Feedback	-	BOOLEAN	Read	00018
Comp ON	-	BOOLEAN	Read	00021
Line Comp	-	BOOLEAN	Read	00032
Delta comp	-	BOOLEAN	Read	00035
AI comp Trip	-	BOOLEAN	Read	00044
Compressor – 2				
Sump Oil Temperature	°C	ANALOG	Read	40023
Discharge Temperature	°C	ANALOG	Read	40014
Suction Temperature	°C	ANALOG	Read	40026
Suction Pressure	Bar	ANALOG	Read	40003
Discharge Pressure	Bar	ANALOG	Read	40006
Oil Pressure	Bar	ANALOG	Read	40020
Motor Current	Amp	ANALOG	Read	40017
Discharge Superheat	°C	ANALOG	Read	40030
Voltage pd Comp	-	BOOLEAN	Read	00003
Wind Protection	-	BOOLEAN	Read	00006

ENGINEERING SPECIFICATIONS

Document Name: KWF Triple Circuit Modbus List		
Document No: ESP-24-25-11	Revision: R00	Date:30-09-2024
Prepared By: PJP	Checked By: AS	Approved By: NMR

Off Comp	-	BOOLEAN	Read	00010
Oil Level Switch	-	BOOLEAN	Read	00016
Transition Ok Feedback	-	BOOLEAN	Read	00019
Comp ON	-	BOOLEAN	Read	00022
Line Comp	-	BOOLEAN	Read	00033
Delta comp	-	BOOLEAN	Read	00036
AI comp Trip	-	BOOLEAN	Read	00045
Compressor – 3				
Sump Oil Temperature	°C	ANALOG	Read	40024
Discharge Temperature	°C	ANALOG	Read	40015
Suction Temperature	°C	ANALOG	Read	40027
Suction Pressure	Bar	ANALOG	Read	40004
Discharge Pressure	Bar	ANALOG	Read	40007
Oil Feed Pressure	Bar	ANALOG	Read	40021
Motor Current	Amp	ANALOG	Read	40018
Discharge Superheat	°C	ANALOG	Read	40031
Voltage pd Comp	-	BOOLEAN	Read	00004
Wind Protection	-	BOOLEAN	Read	00007
Off Comp	-	BOOLEAN	Read	00011
Oil Level Switch	-	BOOLEAN	Read	00017
Transition Ok Feedback	-	BOOLEAN	Read	00020
Comp ON	-	BOOLEAN	Read	00023
Line Comp	-	BOOLEAN	Read	00034
Delta comp	-	BOOLEAN	Read	00037
AI comp Trip	-	BOOLEAN	Read	00046


Protocol Details	
Parity	None
Baud rate	19200
Protocol	Modbus/Modbus Extended
Start bit	1
Stop bit	1
No of bit	8
Communication Interface	RS-485
Interface Connection	2 Wire

The connection with the RS485 network is carried out using the plug-in terminal connector on the card. Pin-wiring of the connector is stamped on the card. If the card is placed in the last position of the supervision serial line, pins 2 and 3, you must

ENGINEERING SPECIFICATIONS

Document Name: KWF Triple Circuit Modbus List		
Document No: ESP-24-25-11	Revision: R00	Date:30-09-2024
Prepared By: PJP	Checked By: AS	Approved By: NMR

connect a 120 Ω - 1/4 W end line resistor, as shown.

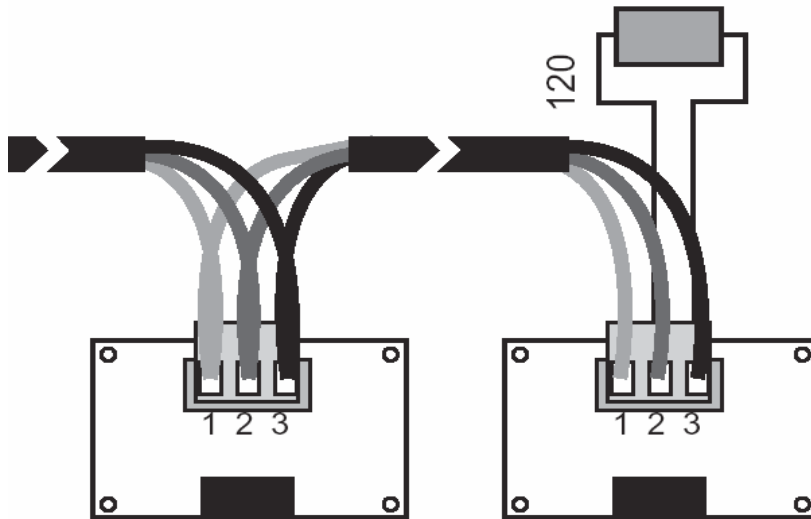

pin	significato <i>meaning</i>
1	GND
2	RX+/TX+
3	RX-/TX-