The grid can run out of room before projects can connect

Electricity needs wires and transformers. Local networks have limits, particularly at busy times.

HOW ELECTRICITY REACHES A PROJECT

Power sources

Wind, solar and other generators produce electricity.

→

Local grid

Wires and transformers carry only a limited amount of power.

→

New project

A factory or battery needs permission to connect and use the grid.

WHAT HAPPENS WHEN THE GRID IS CONGESTED?

If the local network cannot safely carry more power, the grid operator may make projects wait, upgrade the wires or offer a connection with limits.

Grid operator = the company responsible for the network and connection decisions.

Germany: 17,775 battery connection applications to local operators in 2025; 1,429 received offers that year.

BNetzA / SMARD, 2025 battery requests

Companies already tackle the problem. Where could Capflex fit?

A battery stores electricity for later. Flexibility means changing electricity use when the grid is busy.

WHAT ALREADY EXISTS	CAPFLEX'S PROPOSED ROLE
GERMANY / BATTERY PROJECTS Developers build batteries; site platforms such as Ventorio find land and introduce owners.	**Find an industrial site** Review the site's land, electricity-use data and connection terms for a battery developer.
NETHERLANDS / ELECTRICITY FLEXIBILITY Grid operators use GOPACS, an existing platform, to arrange flexible electricity use with businesses and service providers.	**Make that process easier to manage** Test whether service providers need help organising agreements, meter readings and payments.

These are proposed services, not proven gaps or signed customers. Capflex would work alongside GOPACS, not replace it.

Two ways to help projects use the grid

Start with German battery sites; explore Dutch software for flexible electricity use.

01 GERMANY / FIRST OFFER

Find sites for battery projects

A battery developer could pay us to find a factory site and check its land, electricity-use data and connection agreement.

02 NETHERLANDS / SOFTWARE OPPORTUNITY

Help providers track flexible use


Test software that helps service providers track agreements, meter readings and payments when businesses adjust electricity use.

17,775

German battery connection applications to local grid operators in 2025

4.4 GW

Power covered by 769 Dutch flexibility contracts, June 2026




Both offers need validation. GW measures power at a point in time, not electricity actually delivered.

BNetzA / SMARD, 2025 battery requests | Netbeheer Nederland, H1 2026

Turn a factory site into a potential battery project

The developer would buy a site assessment; the local grid operator decides the connection conditions.

ILLUSTRATIVE PHYSICAL ARRANGEMENT

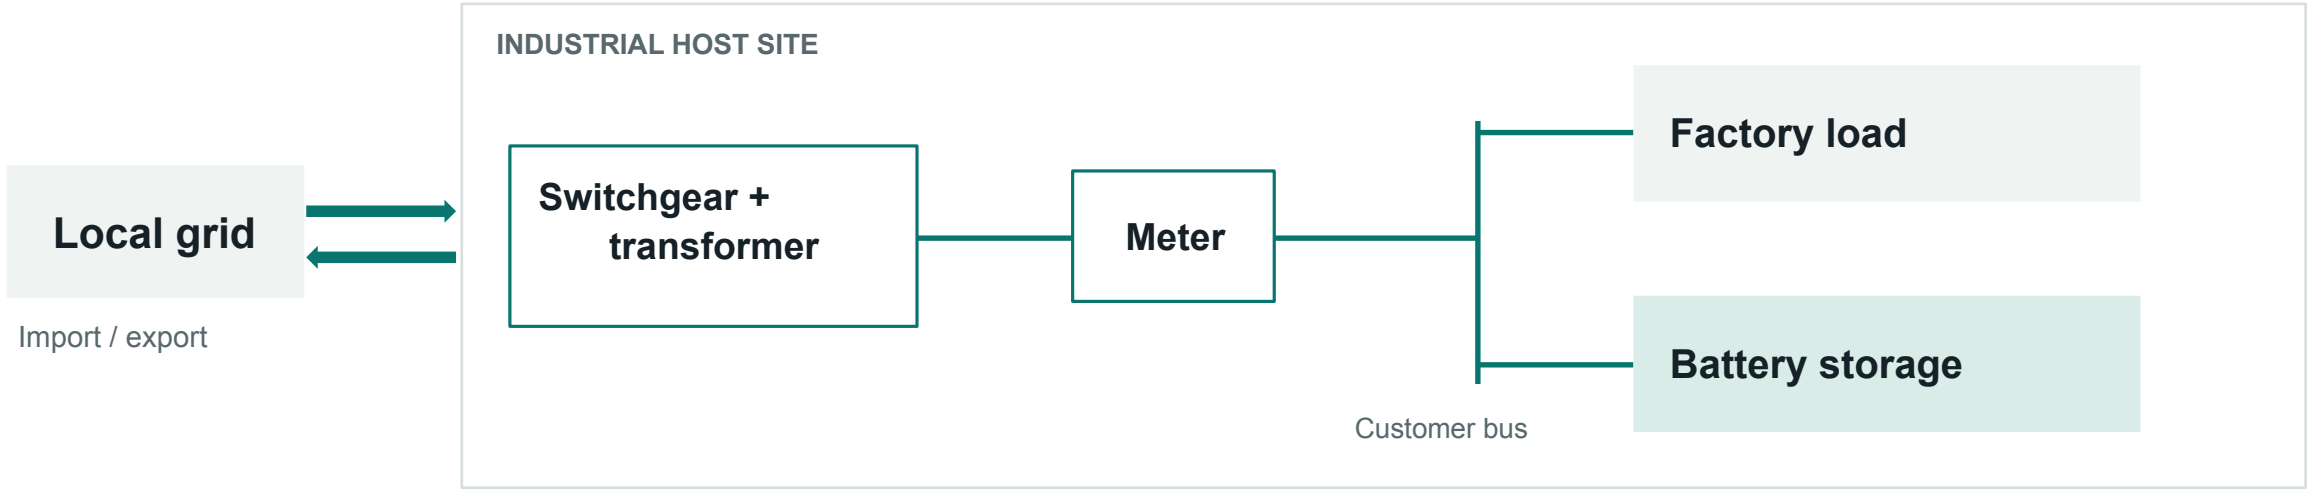

THE DELIVERABLE

Host consent + land + contract limits + meter history + engineering screen + a grid-operator pre-screen request.

Import = power from grid; export = power to grid. Host capacity is not automatically transferable; operator approval is required.

A business changes its electricity use. Who does what?

Example: a factory temporarily reduces its electricity use when the local grid is busy.

ILLUSTRATIVE AGREEMENT TO REDUCE ELECTRICITY USE

1

Agreement

Operator and factory agree when and how much use can be reduced.

2

Request

Operator requests a reduction; a service provider can coordinate the factory.

3

Meter reading

Meter data and the agreement show what was delivered.

4

Payment

Operator payment and any provider / factory split follow the agreement.

CAPFLEX HYPOTHESIS

Help a service provider organise agreements, meter readings and payments if existing tools leave a gap.

GOPACS already coordinates flexibility and has payment-related tools. Capflex would complement it, not replace it.

A large grid bottleneck; the addressable fee pool is still unproven

Observed queue and spending figures establish urgency, not Capflex's revenue or market share.

GERMANY / BATTERY APPLICATIONS TO DISTRIBUTION OPERATORS

Applications received in 2025 **17,775**



Offers on those applications by year-end **1,429**



~8% received an offer that year; an offer is not an energized connection. Applications can duplicate projects.

NETHERLANDS / FLEXIBILITY & CONGESTION

15,498 large-user requests waiting to take electricity from regional grids, 30 June 2026

€132m TenneT congestion-management costs in 2025; not all Dutch operator spending

€1.75–2.34bn Modelled German utility-battery construction spend in 2026, not a Capflex service market.

NL sensitivity: 769 contracts × assumed €1k–5k/site/year = €0.77m–3.85m; contracts are not unique sites or buyers.

Sell project evidence first; develop rights and software selectively

Hypothetical prices are not quoted tariffs. Each model has a different buyer and risk profile.

OFFER / BUYER	POTENTIAL ECONOMICS	WHAT MUST BE TRUE
DE / paid site screen Battery developer pays	**€5k–15k per screen** Proposed fee, unvalidated	Host access and a diligence pack justify more than a bare lead.
DE / develop project rights Project buyer pays rights owner	**$250k–850k gross** 5 MW × $50k–170k/MW	Only if rights are secured and a buyer pays a ready-to-build premium.
NL / flex data workflow Flex provider or energy hub may pay	**€5k–25k setup** + €1k–5k/site/year	A repeated gap, data rights and willingness to pay must be proven.

Price anchor: Ventorio lists a battery-site lead at €1,999 introductory / €3,331.67 list (Nov 2026).

Rights value is gross, not profit or a broker fee: subtract host share, costs, failed projects and financing.

The market is already served. Our distinction must be earned.

Capflex is not the first to find sites, build batteries, coordinate flexibility or provide telemetry.

EXISTING ROLE	EXAMPLE	WHAT THEY ALREADY DO	WHAT CAPFLEX MUST TEST
Industrial batteries	Scale Energy	Develops batteries at industrial sites	Can an independent evidence pack beat a developer's in-house process?
Site leads	Ventorio	Sells consented battery-site leads	Will buyers pay more for connection and engineering evidence?
Congestion market	GOPACS	Coordinates flex; has invoice-line APIs	Is a cross-contract reconciliation gap left after existing tools?
Flex & telemetry	Sympower / Withthegrid	Aggregation, controls and monitoring	Could a provider use our workflow instead of building it?

Potential advantage: permissioned site and contract evidence that improves with repeated work. This is not a proven moat.

The first 90 days: one German site and one Dutch workflow

Targets, not achievements: Bavaria (Bayernwerk or LEW); one Liander territory in the Netherlands.

PERIOD	GERMANY / DEVELOPER + HOST	NETHERLANDS / FLEX PROVIDER OR ENERGY HUB
DAYS 1–30	Interview 20 developers and 10 hosts; identify three live project briefs.	Interview providers, industrial users and hubs; identify one process and payer.
DAYS 31–60	Get host consent and meter data; target a €5k paid kickoff and independent engineering review.	Trace one contract, instruction, meter record and invoice against existing tools.
DAYS 61–90	Deliver the screen; request a grid-operator pre-screen and agree the next milestone.	Proceed only if three parties report the same gap and one buyer will fund a pilot.

STOP / PIVOT	**No paying buyer, no data consent, or no technically acceptable operator path.**

A Dutch workflow could become reusable infrastructure

The strategic bet is a common evidence layer, adapted to the rules and systems of each market.

TODAY

Country-specific work

Germany: site rights and connection evidence.
Netherlands: flex data and reconciliation.

TOMORROW / IF THE WORKFLOW REPEATS

Common evidence model

Consent • contract • meter data
operator response • outcome

Local adapters

Country-specific grid rules, market platforms, data access and counterparties.

€100bn

estimated delayed investment across eight countries

AFRY estimate of project investment held in queues, not annual spending or Capflex's market.

European expansion and a common standard are hypotheses. Validate locally before investing in integrations.