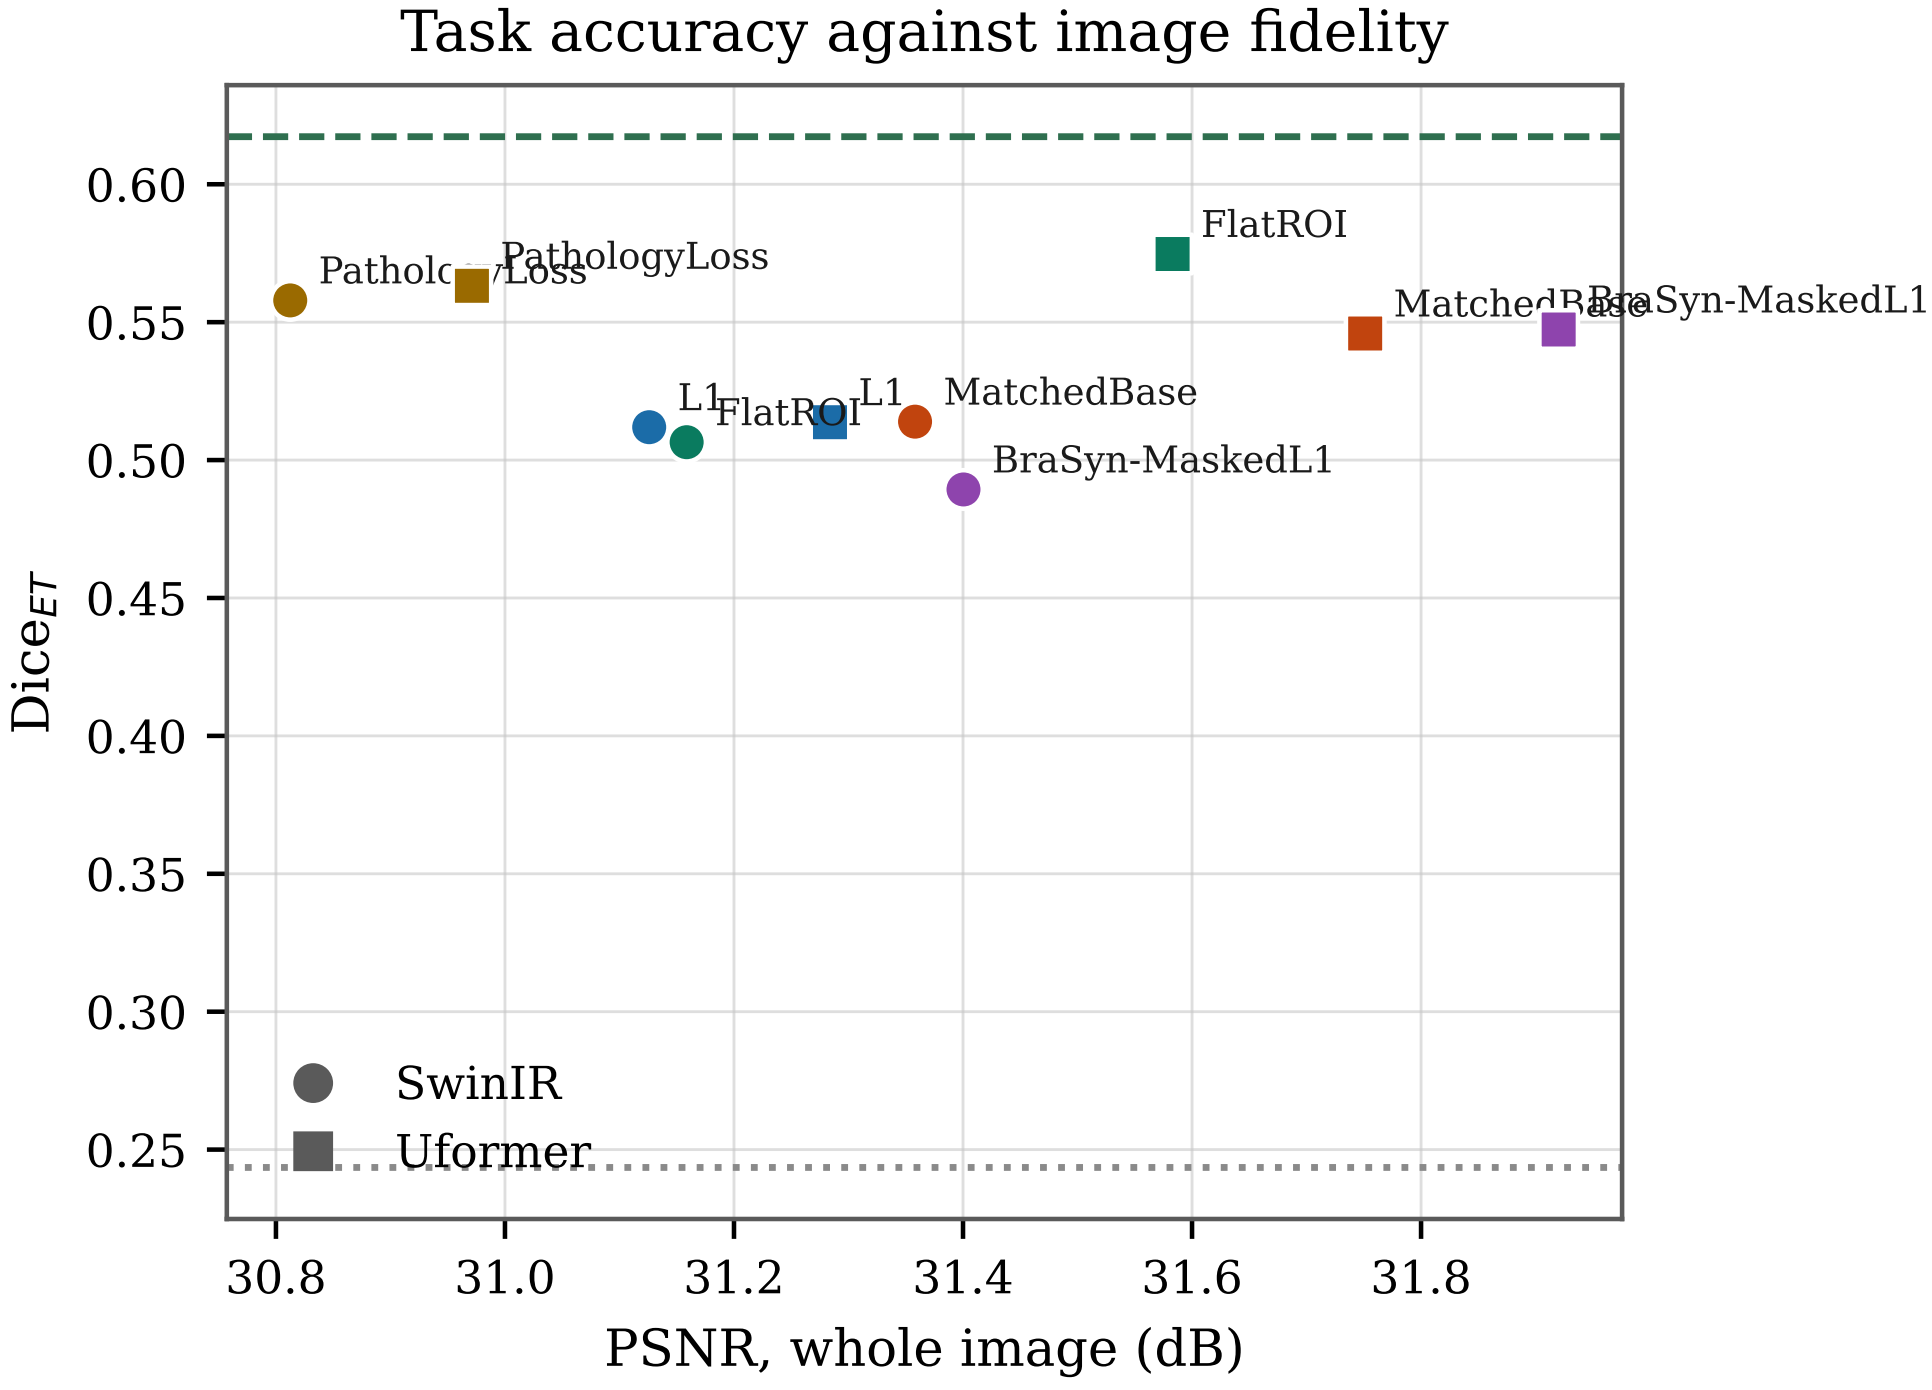
Task accuracy against image fidelity
0.60
0.55
0.50
0.45
0.40
0.35
0.30
0.25
Dice$_{ET}$
PathologyLoss
FlatROI
L1
L1
FlatROI
MatchedBase
BraSyn-MaskedL1
SwinIR
Uformer
30.8
31.0
31.2
31.4
31.6
31.8
PSNR, whole image (dB)