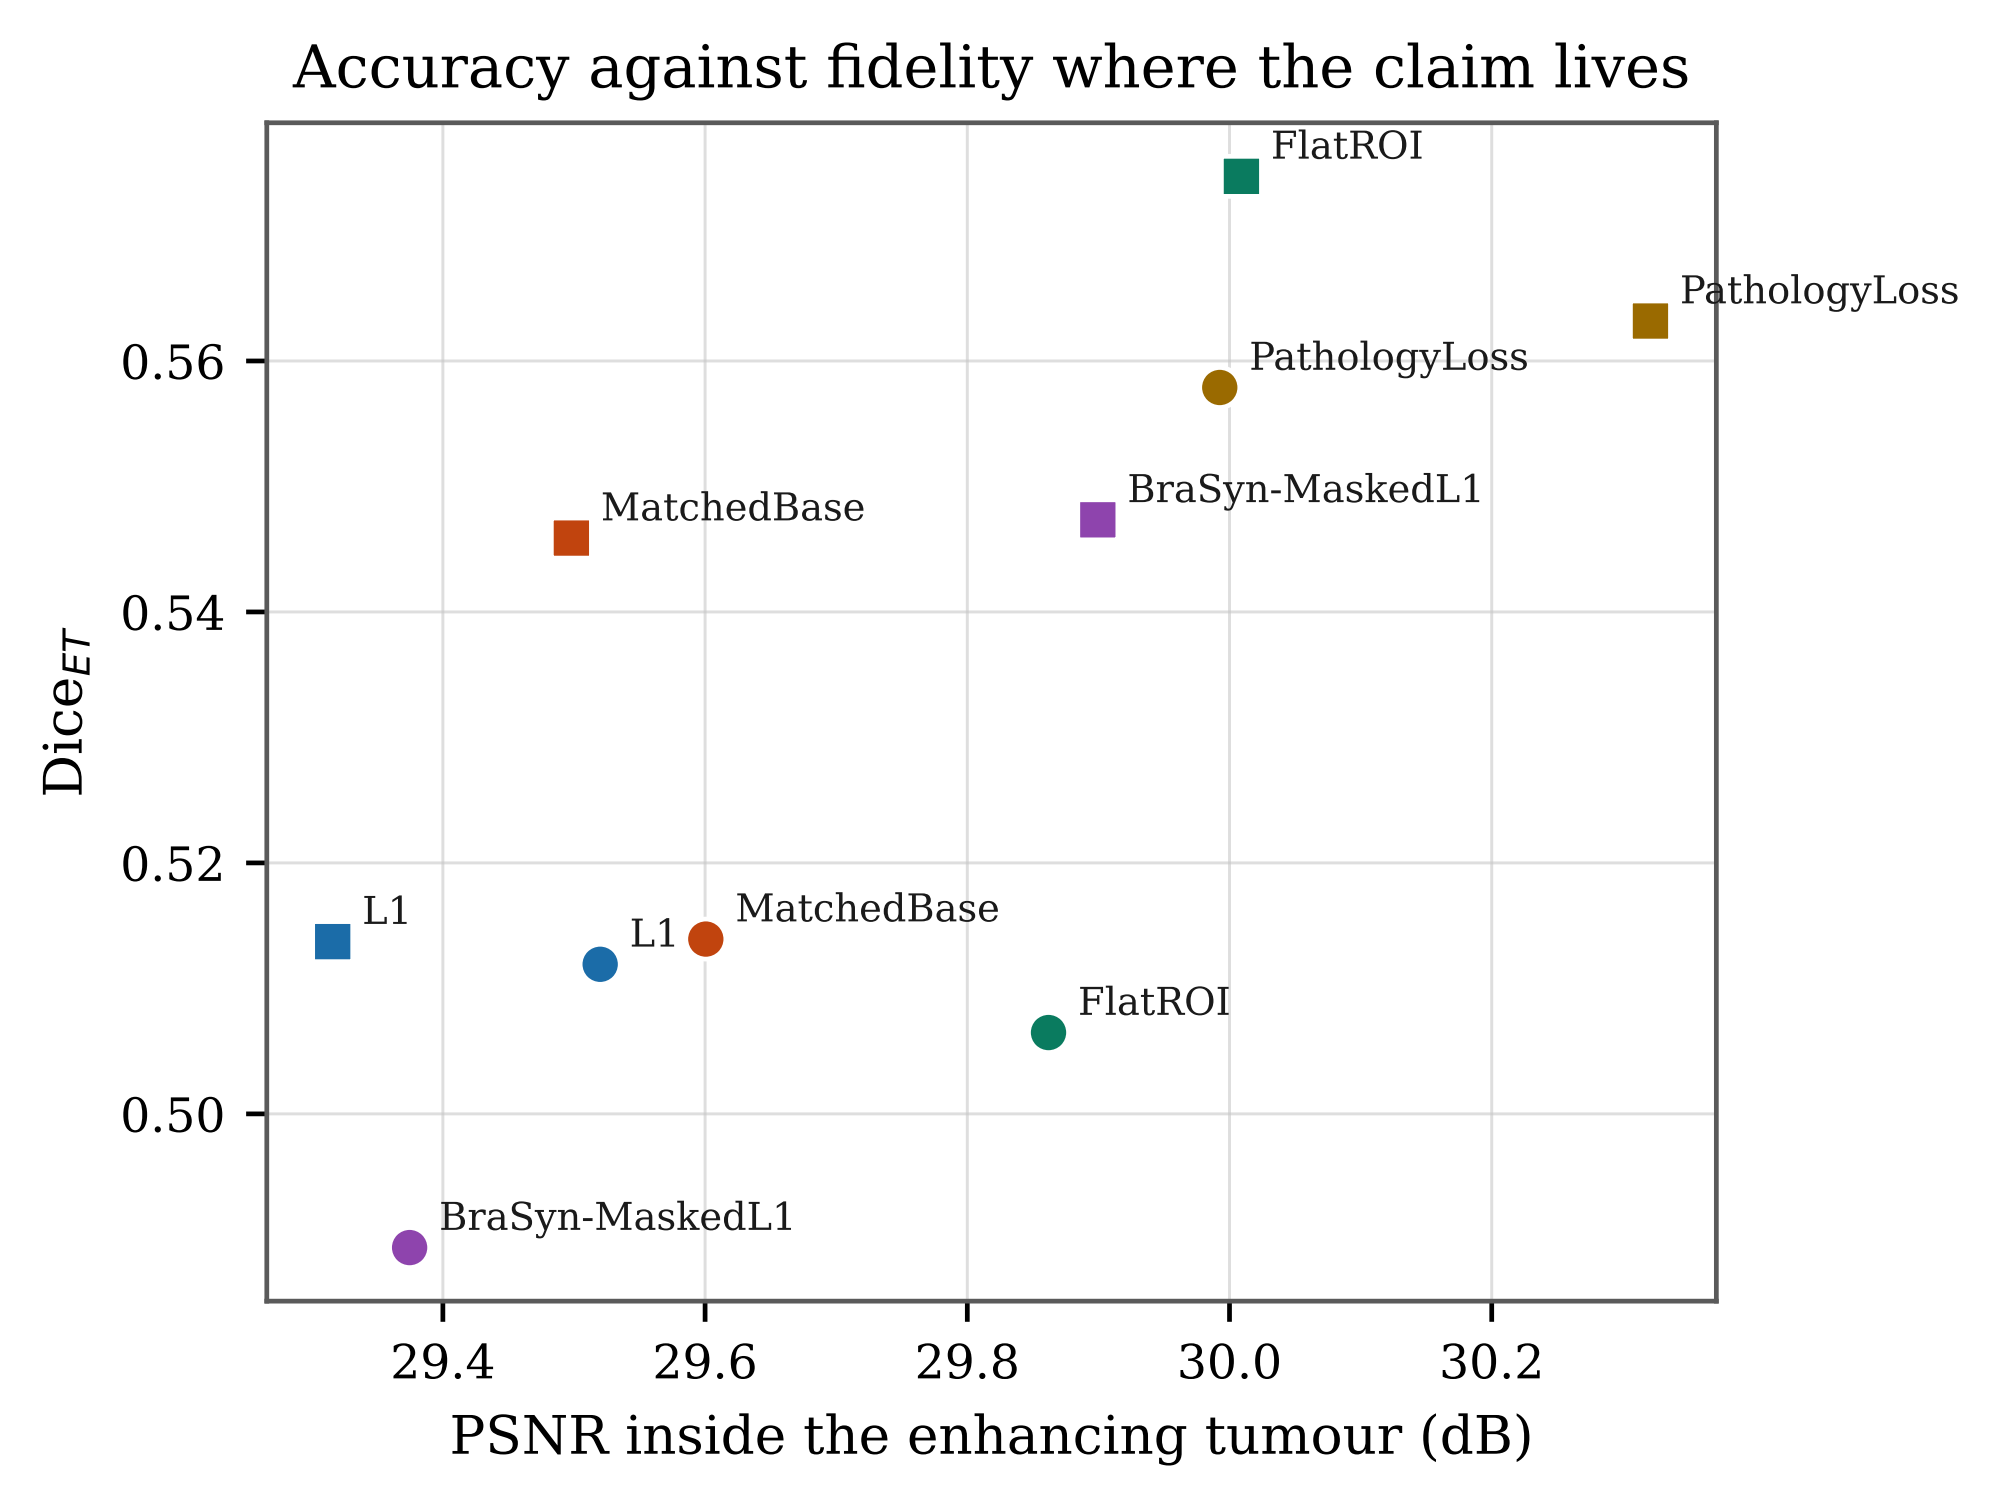
Accuracy against fidelity where the claim lives
FlatROI
PathologyLoss
PathologyLoss
BraSyn-MaskedL1
MatchedBase
L1
MatchedBase
L1
FlatROI
BraSyn-MaskedL1
0.56
0.54
0.52
0.50
Dice$_{ET}$
29.4
29.6
29.8
30.0
30.2
PSNR inside the enhancing tumour (dB)