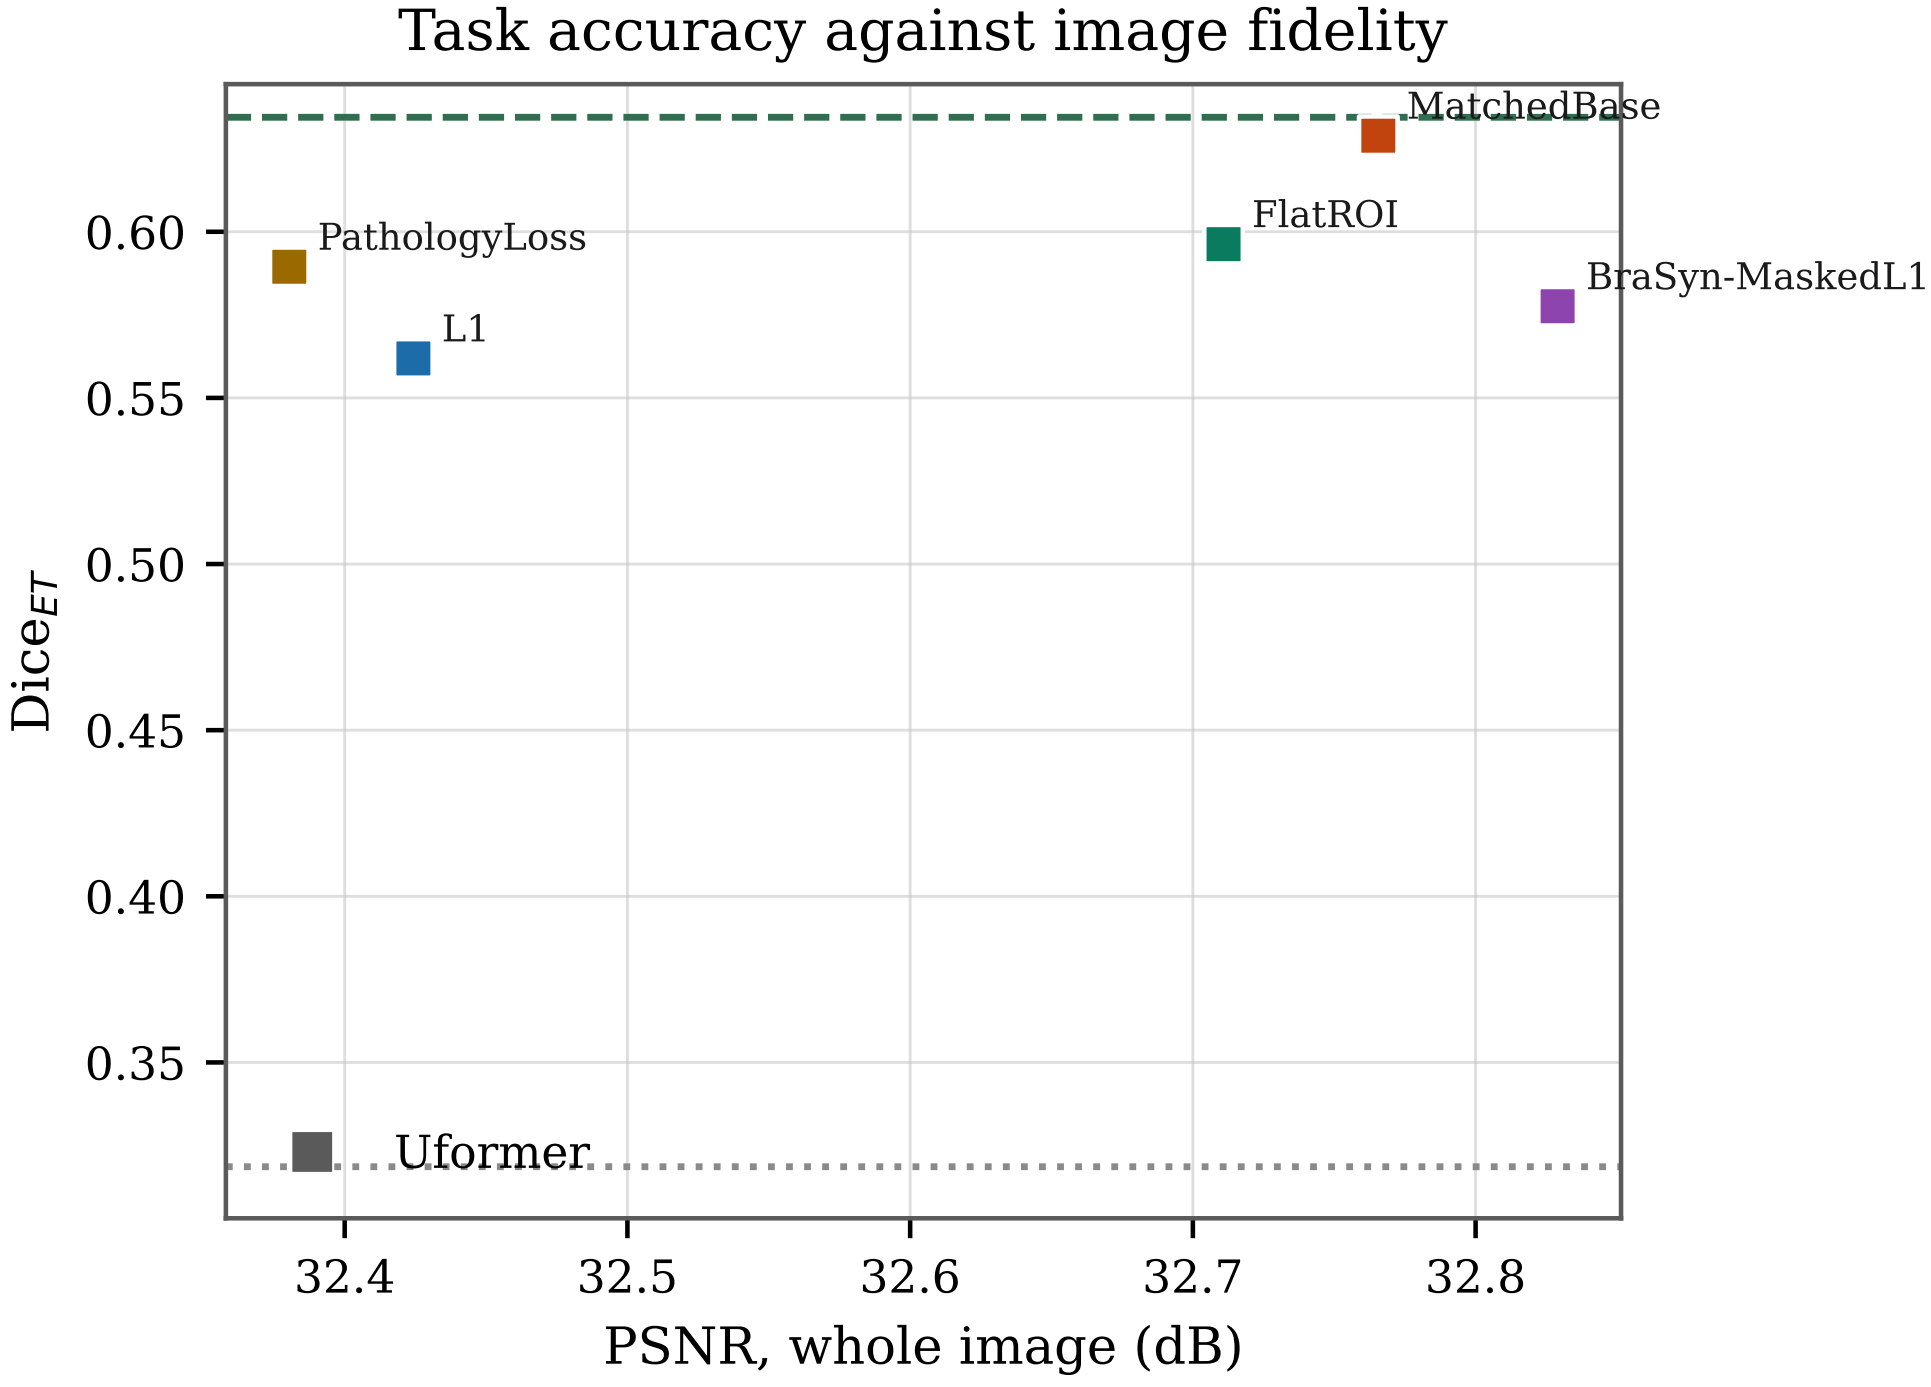
Task accuracy against image fidelity
MatchedBase
FlatROI
BraSyn-MaskedL1
PathologyLoss
L1
Uformer
0.60
0.55
0.50
0.45
0.40
0.35
Dice$_{ET}$
32.4
32.5
32.6
32.7
32.8
PSNR, whole image (dB)