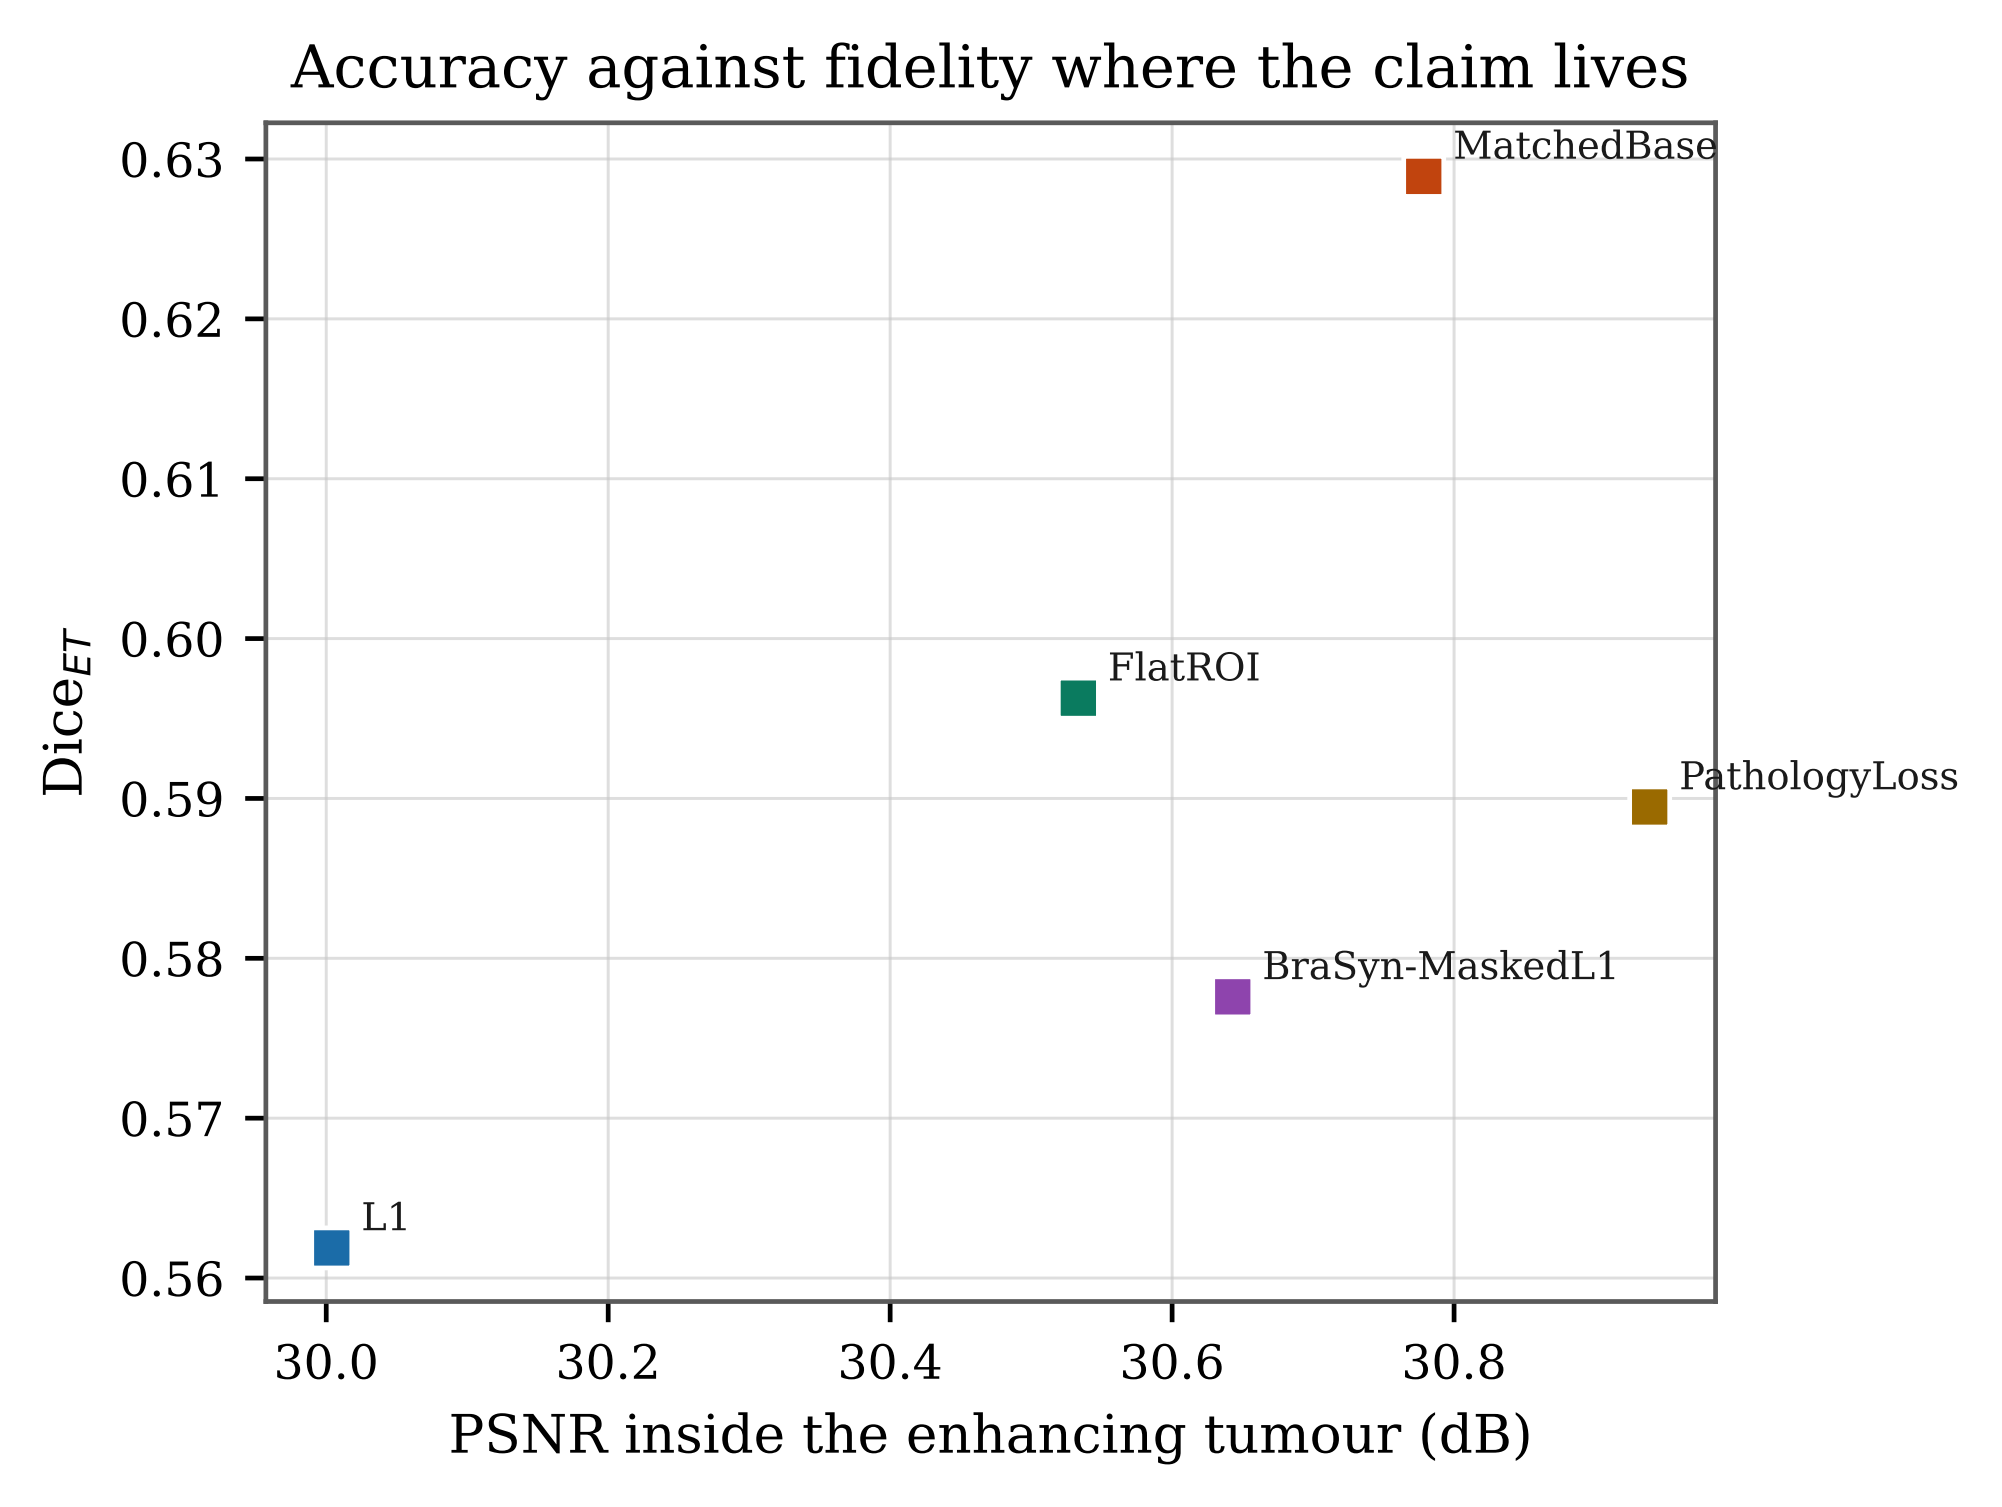
Accuracy against fidelity where the claim lives
MatchedBase
FlatROI
PathologyLoss
BraSyn-MaskedL1
L1
0.63
0.62
0.61
0.60
0.59
0.58
0.57
0.56
Dice$_{ET}$
30.0
30.2
30.4
30.6
30.8
PSNR inside the enhancing tumour (dB)