


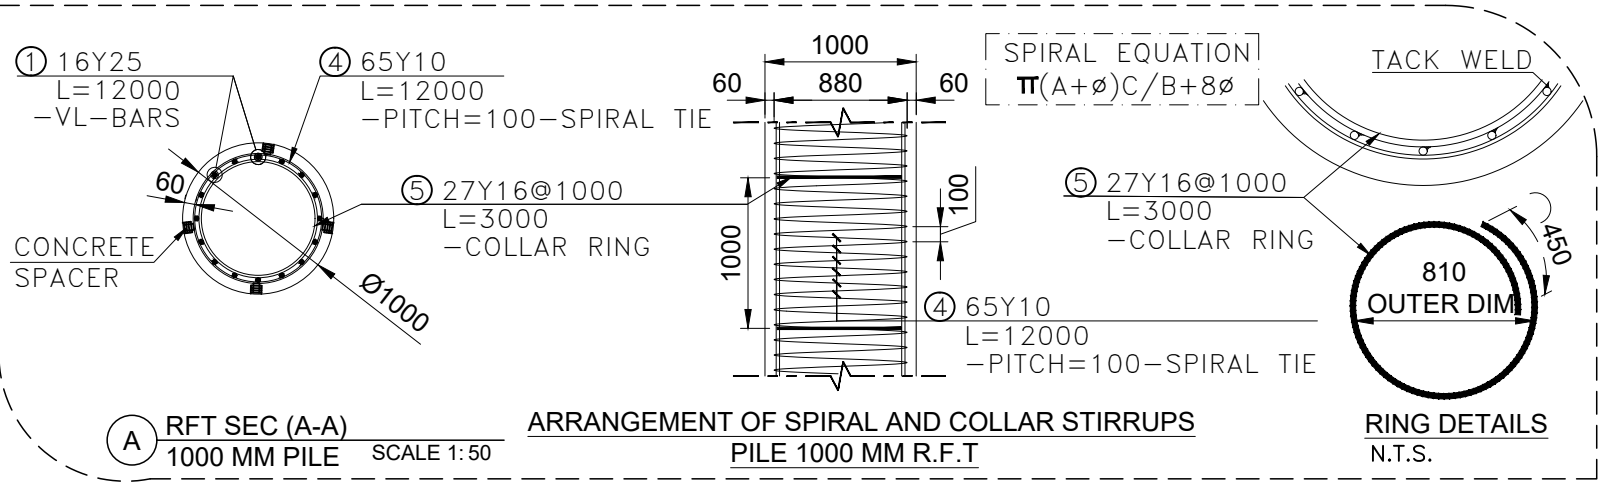

MATERIAL TABLE			
CONCRETE:	EN1992-1-1	EN206-1	MINIMUM COVER
PILES	C25/30	XC2	6cm
PRE CASTED BEAMS:	C35/45	XC4	3cm
REMAINING ELEMENTS	C30/37	XC4	4cm
STEEL:			
REINFORCEMENT STEEL	EN10080-S400C (fyk = 400 MPa - EN 1992-1-1)		
PRESTRESS STEEL	EN10138-3-Y-1860S7-15,7 (S=1,50 cm² - fyd = 1426 MPa)		

NOTES:-

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. ALL DIMENSIONS AND LEVELS MUST BE CHECKED WITH THE PLANNING DRAWINGS.
3. DO NOT MEASURE FROM DRAWINGS. ALL DIMENSION SHOULD BE READ OR COMPUTED.
4. COMPRESSIVE STRENGTH OF REINFORCED CONCRETE SHALL BE NOT LESS THAN THESE VALUES :
 - PILES _____ C25/30
 - PRECASTED BEAMS _____ C35/45
 - REMAINING ELEMENTS _____ C30/37
5. MINIMUM CONCRETE COVER FOR REINFORCEMENT UNLESS OTHERWISE INDICATED ON DRAWINGS SHALL BE AS FOLLOWS:
 - PILES _____ 60 mm
 - PRECASTED BEAMS _____ 30 mm
 - REMAINING ELEMENTS _____ 40 mm
6. STEEL USED OF GRADE 400 MPA.

REINFORCEMENT NOTATION :

01 20 Y 25 - @ 100

↑ SPACING IN (mm.)

↑ NOMINAL DIAMETER OF BAR IN (mm.)

↑ HIGH YIELD STEEL GRADE

↑ QUANTITY NOS OF BARS

BAR MARK

ABBREVIATIONS:			
P	PILE	STAGG.	STAGGERED
AX.	AXIS	S.B.	SIDE BAR
N.T.S.	NOT TO SCALE	ST.	STARTER BAR
B	BOTTOM		
T	TOP		
ADD.	ADDITIONAL		
O.S.	OUTER STIRRUP		
I.S.	INNER STIRRUP		

DESIGN DRAWINGS REFS :	
TTPP-GNR-GH1-WES-EDDW-00005-00008	
TTPP-GNR-GH1-WES-EDDW-00011-00016	
TTPP-GNR-GH1-WES-EDDW-00018	
TTRR-GE-CHIB2-EPC1-OHRNJV-HI-TRN-3239-02	

SPECIFICATIONS REFS :	
GEG-ENG-SPC-0000-TRR-005-004	

03	ISSUED FOR INFORMATION	O.G	09-06-2026
02	ISSUED FOR INFORMATION	O.G	23-05-2026
01	ISSUED FOR INFORMATION	A.A.	01-01-2026
00	ISSUED FOR INFORMATION	A.A.	20-12-2025
REV.	DESCRIPTION	DRAWN BY	DATE

EL GHYRAN BRIDGE - BRIDGE 01



KEY PLAN:

OWNER :

جهاز تنفيذ مشروعات الإسكان والمرافق
Housing and infrastructure board



OWNER'S CONSULTANT :

HILL

Hill International

CONTRACTOR:



PROJECT :

 الطريق الدائرى الثالث بمدينة طرابلس - ليبيا

SHOP DRAWING TITLE :
EL GHYRAN // EL GHYRAN BRIDGE 01
TYPICAL PILE REINFORCEMENT DETAILS
FOR AXIS ((P"1-1" TO P"1-5")) (1/2

Dwg.No:	TTRR-GHY-GHY1-OHRNJV-CDF-05-EDWG-00001		
REVISION	03	DRAWN	A.A
SCALE	AS SHOWN	REVIEWED	A.E.
DATE	JAN.-2026	APPROVED	K.N.