

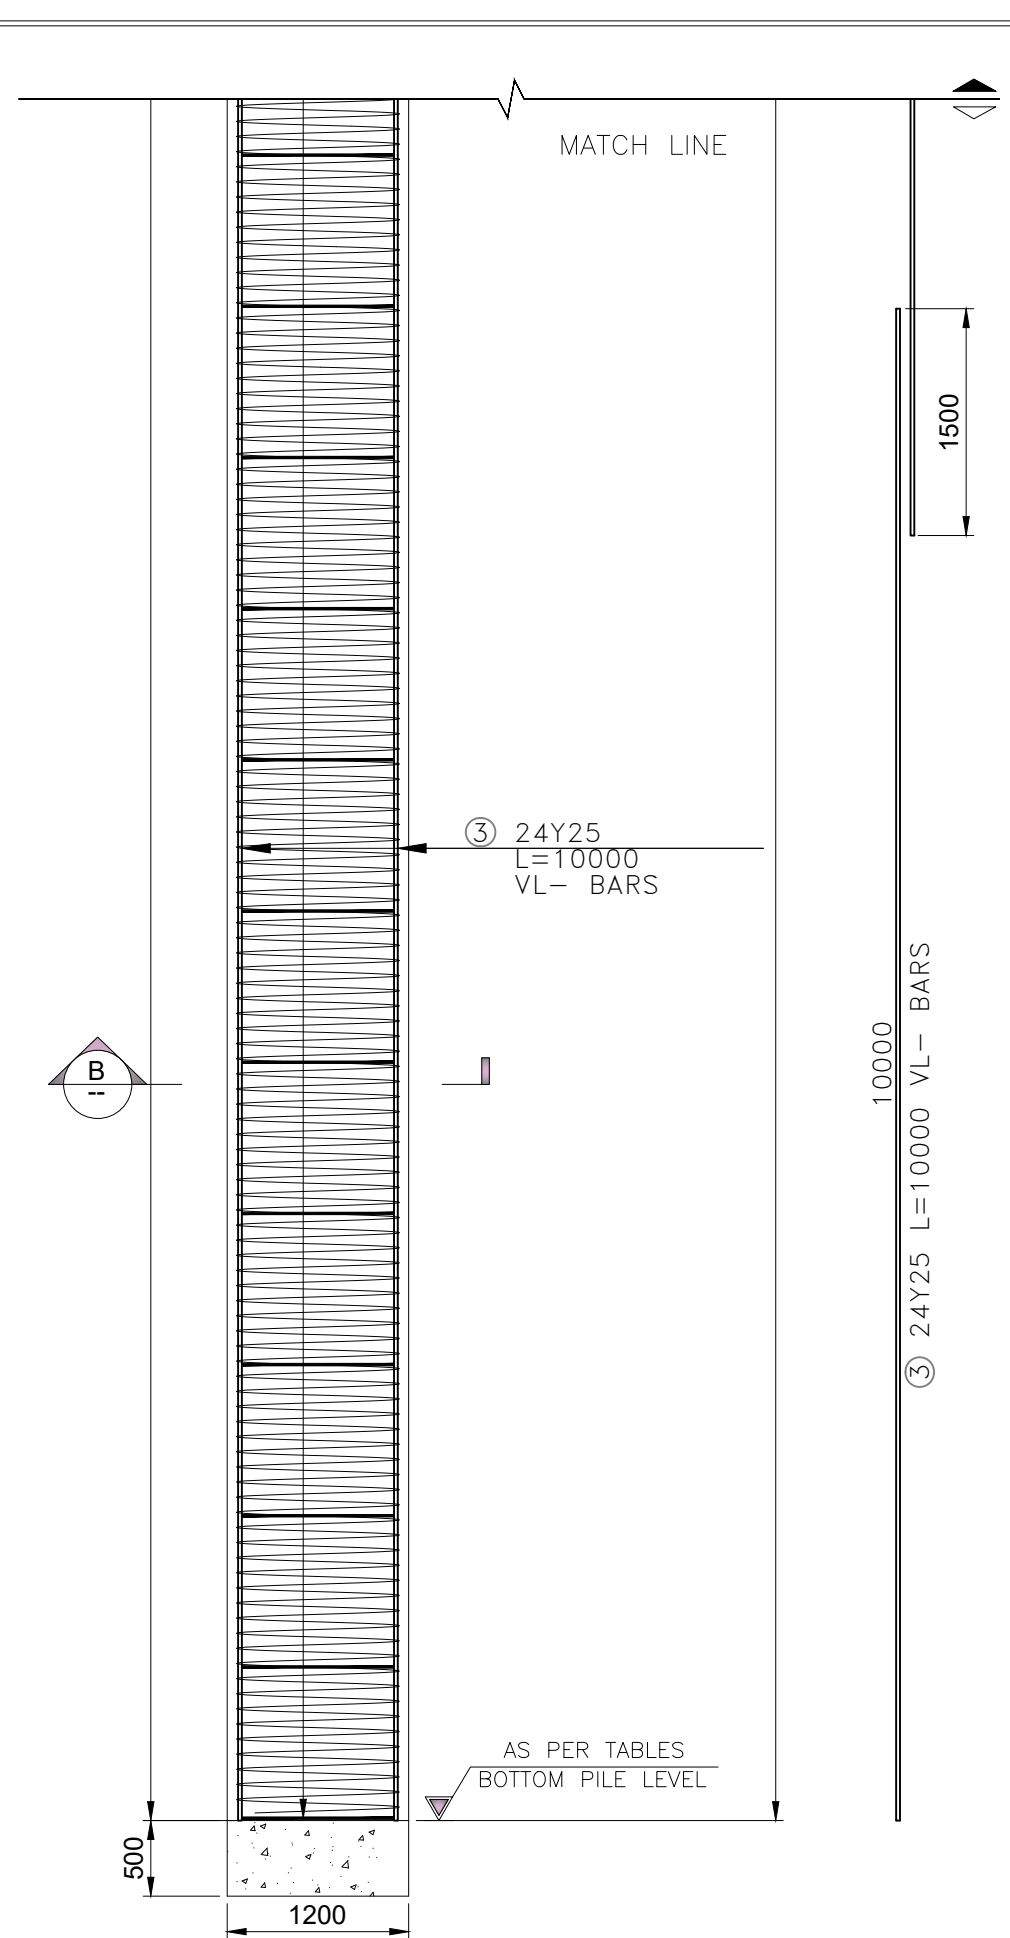


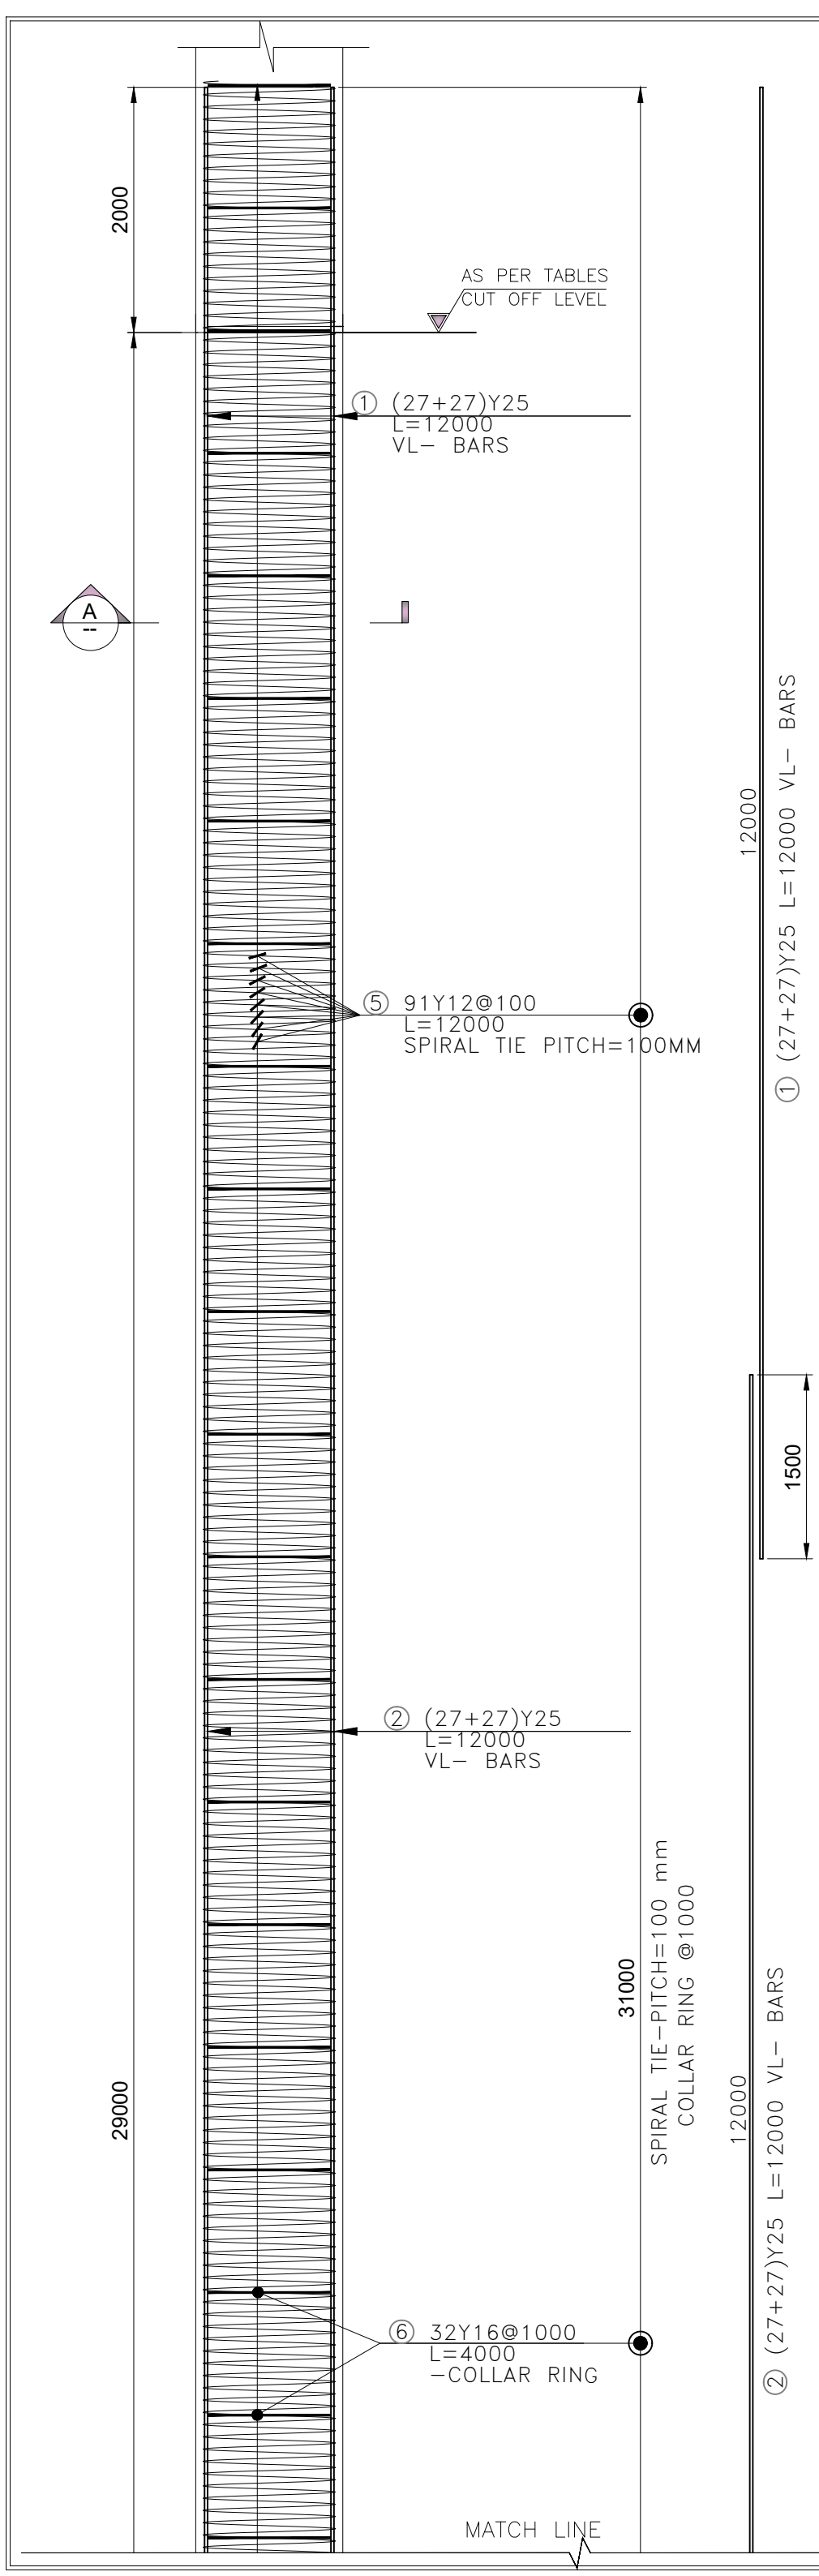

SEC ELEVATION SHOWING PILE REINFORCEMENT DETAILS
1200 MM PILE
SCALE 1:50

MATERIAL TABLE			
CONCRETE:	EN1992-1-1	EN206-1	MINIMUM COVER
PILES	C25/30	XC2	6cm
MONO PILES	C30/37	XC2	6cm
PRE CASTED BEAMS:	C35/45	XC4	3cm
REMAINING ELEMENTS	C30/37	XC4	4cm
STEEL:			
REINFORCEMENT STEEL	EN10080-S400C (fyk = 400 MPa - EN 1992-1-1)		
PRESTRESS STEEL	EN10138-3-Y-1860S7-15,7 (S=1,50 cm² - fyd = 1426 MPa)		

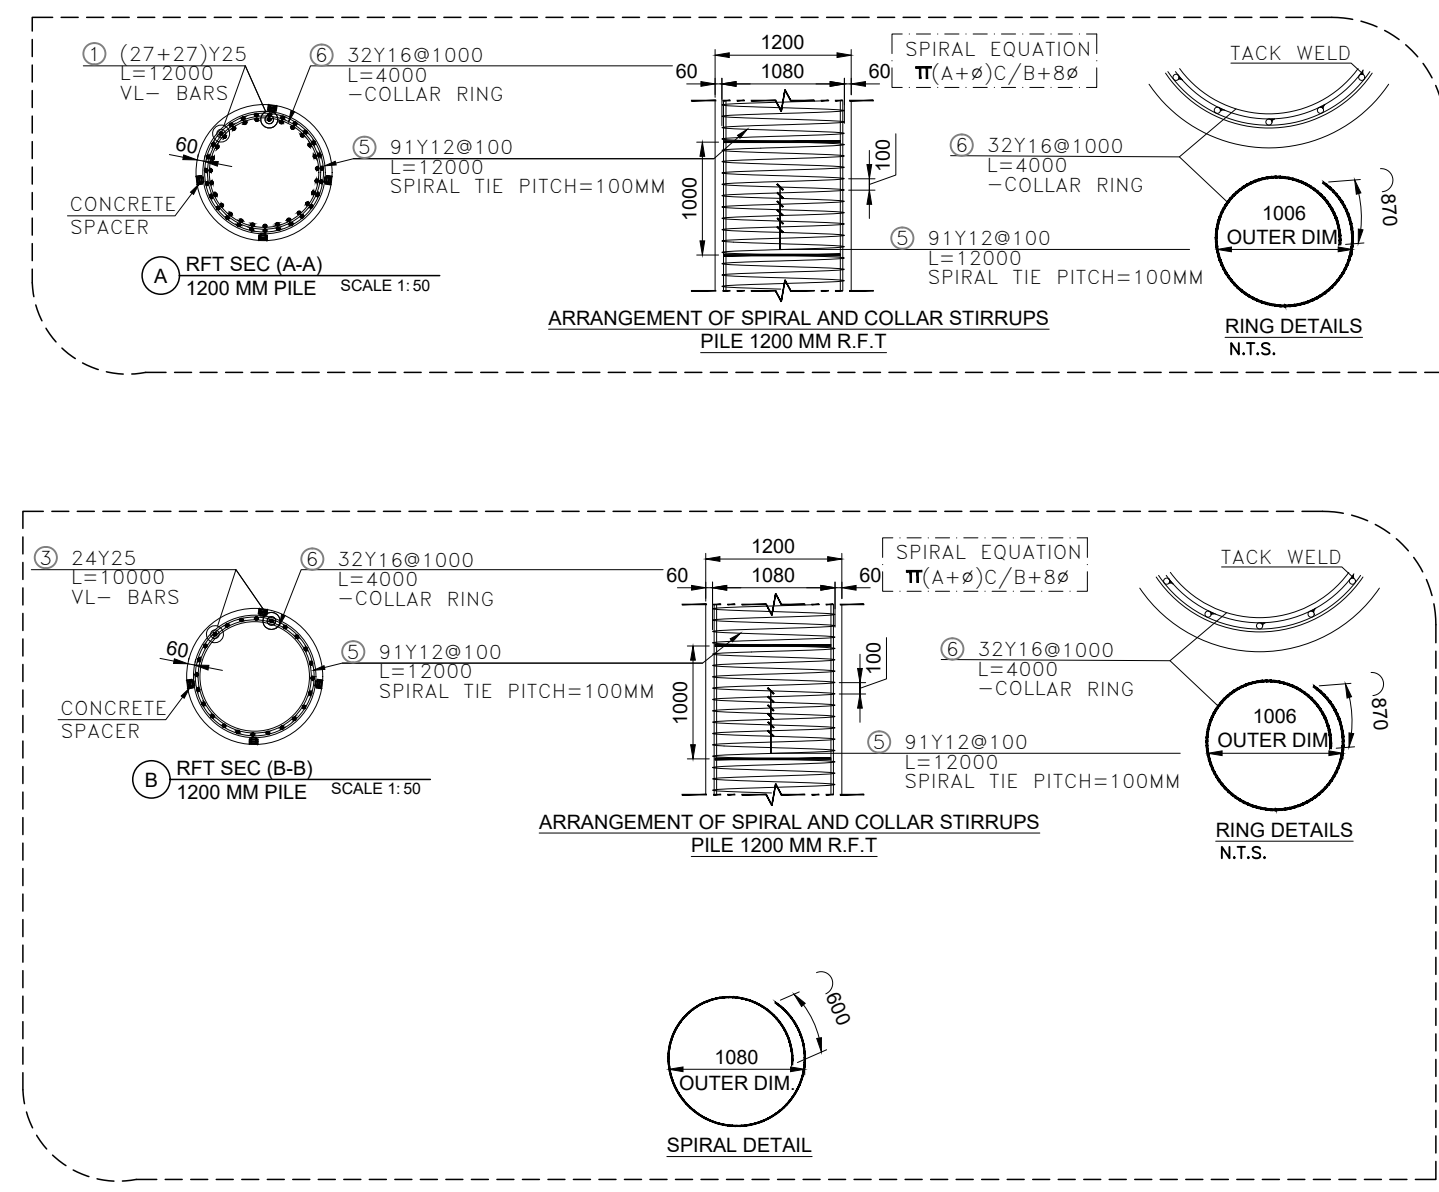

- NOTES:-**
1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
 2. ALL DIMENSIONS AND LEVELS MUST BE CHECKED WITH THE PLANNING DRAWINGS.
 3. DO NOT MEASURE FROM DRAWINGS. ALL DIMENSION SHOULD BE READ OR COMPUTED.
 4. COMPRESSIVE STRENGTH OF REINFORCED CONCRETE SHALL BE NOT LESS THAN THESE VALUES :
 - PILES C25/30
 - MONO PILES C30/37
 - PRECASTED BEAMS C35/45
 - REMAINING ELEMENTS C30/37
 5. MINIMUM CONCRETE COVER FOR REINFORCEMENT UNLESS OTHERWISE INDICATED ON DRAWINGS SHALL BE AS FOLLOWS:
 - PILES 60 mm
 - PRECASTED BEAMS 30 mm
 - REMAINING ELEMENTS 40 mm
 6. STEEL USED OF GRADE 400 MPA.

REINFORCEMENT NOTATION :

① 20 Y 25 - @ 100

SPACING IN (mm.)
NOMINAL DIAMETER OF BAR IN (mm.)
HIGH YIELD STEEL GRADE
QUANTITY NOS OF BARS
BAR MARK

ABBREVIATIONS:

P	PILE	STAGG.	STAGGERED
AX.	AXIS	S.B.	SIDE BAR
N.T.S.	NOT TO SCALE	ST.	STARTER BAR
B	BOTTOM		
T	TOP		
ADD.	ADDITIONAL		
O.S.	OUTER STIRRUP		
I.S.	INNER STIRRUP		

DESIGN DRAWINGS REFS :

TTPP-GNR-GH1-WES-EDDW-0020-02



TTPP-GNR-GH1-WES-EDDW-0064-B

TTRR-GE-CHIB2-EPC1-OHRNJV-HI-TRN-3115-04

SPECIFICATIONS REFS :

GEG-ENG-SPC-0000-TRR-005-04	

REV.	DESCRIPTION	DRAWN BY	DATE
01	ISSUED FOR INFORMATION	O.G	15-04-2026
00	ISSUED FOR INFORMATION	O.G	07-04-2026

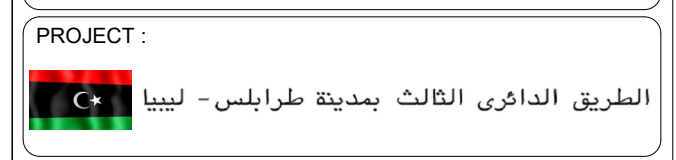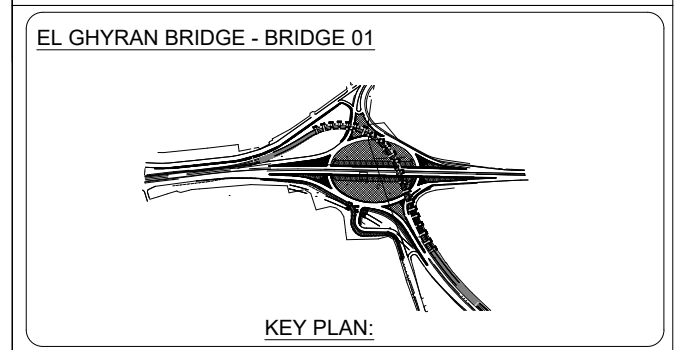

SHOP DRAWING TITLE :

EL GHYRAN // EL GHYRAN BRIDGE 01
TYPICAL PILE REINFORCEMENT DETAILS
FOR AXIS ((P"1-9")) (1/2)

Dwg.No:	TTRR-GHY-GHY1-OHRNJV-CDF-05-EDWG-00013		
REVISION	01	DRAWN	O.G
SCALE	AS SHOWN	REVIEWED	K.N
DATE	APRIL.-2026	APPROVED	K.N.