

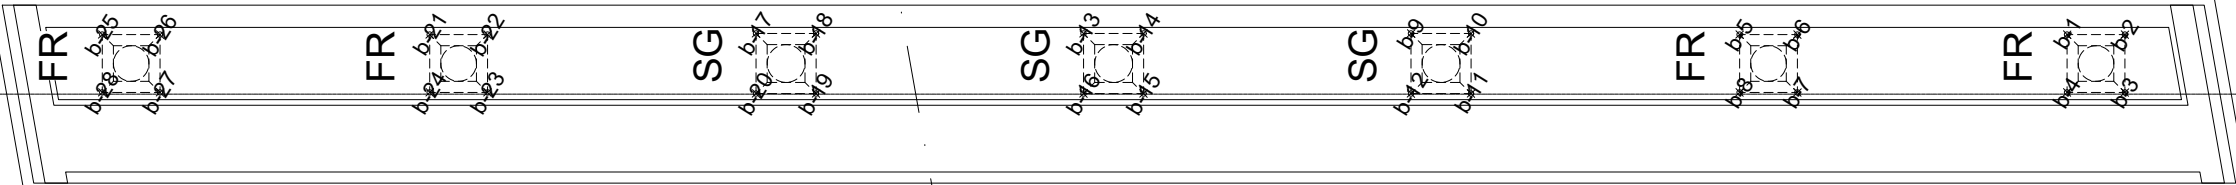
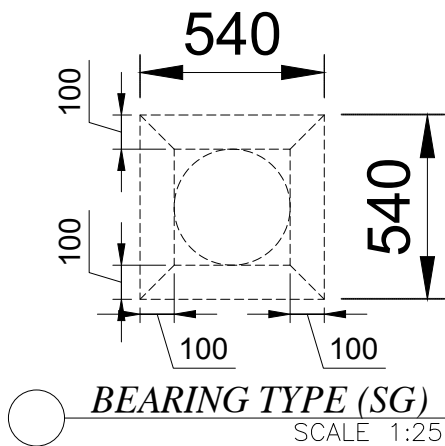


P3

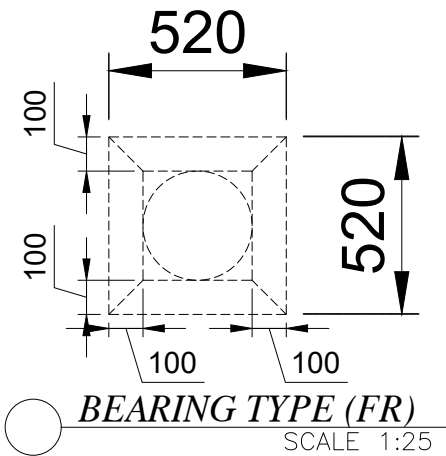

P1

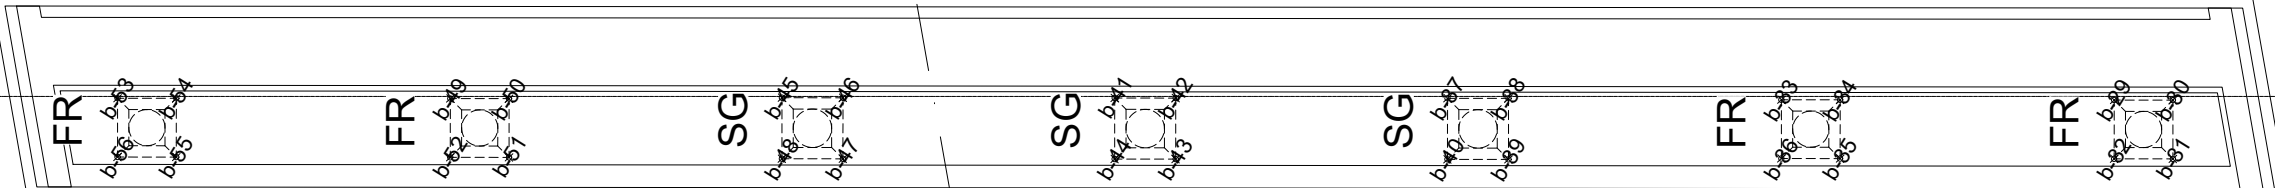

- NOTES:-
1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
 2. ALL DIMENSIONS AND LEVELS MUST BE CHECKED WITH THE PLANNING DRAWINGS.
 3. DO NOT MEASURE FROM DRAWINGS. ALL DIMENSION SHOULD BE READ OR COMPUTED.
 4. COMPRESSIVE STRENGTH OF REINFORCED CONCRETE SHALL BE NOT LESS THAN THESE VALUES :
 - PILES C25/30
 - PRECASTED BEAMS C35/45
 - REMAINING ELEMENTS C30/37
 5. MINIMUM CONCRETE COVER FOR REINFORCEMENT UNLESS OTHERWISE INDICATED ON DRAWINGS SHALL BE AS FOLLOWS:
 - PILES 60 mm
 - PRECASTED BEAMS 30 mm
 - REMAINING ELEMENTS 40 mm
 6. STEEL USED OF GRADE 400 MPA.

REINFORCEMENT NOTATION :

① 20 Y 25 - @ 100

↑ SPACING IN (mm.)

↑ NOMINAL DIAMETER OF BAR IN (mm.)

↑ HIGH YIELD STEEL GRADE

↑ QUANTITY NOS OF BARS



↑ BAR MARK

ABBREVIATIONS:			
P	PILE	B.O.X.	BOTTOM OF CROSS
AX.	AXIS	CONC.	CONCRETE
N.T.S.	NOT TO SCALE	DIM.	DIMENSION
F.	FOOTING CORNER		
C.	COLUMN		
B.O.	BOTTOM OF		
MID.O.X.	MIDDLE OF CROSS		
T.O.X.	TOP OF CROSS		

DESIGN DRAWINGS REFS :	

SPECIFICATIONS REFS :	

00	ISSUED FOR INFORMATION	ES. T.	12-1-2025
REV.	DESCRIPTION	DRAWN BY	DATE

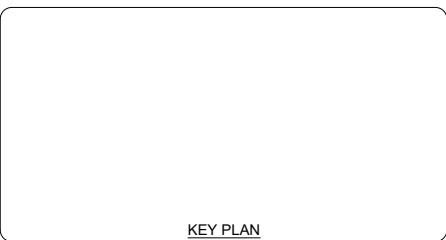

SHOP DRAWING TITLE :			
PHASE 4 // ic 20			
bearing plinth coord			
Dwg.No:	Layout3-Layout1		
REVISION	00	DRAWN	A.A.E.
SCALE	AS SHOWN	REVIEWED	S.KH.
DATE	jan-2025	APPROVED	S.R.