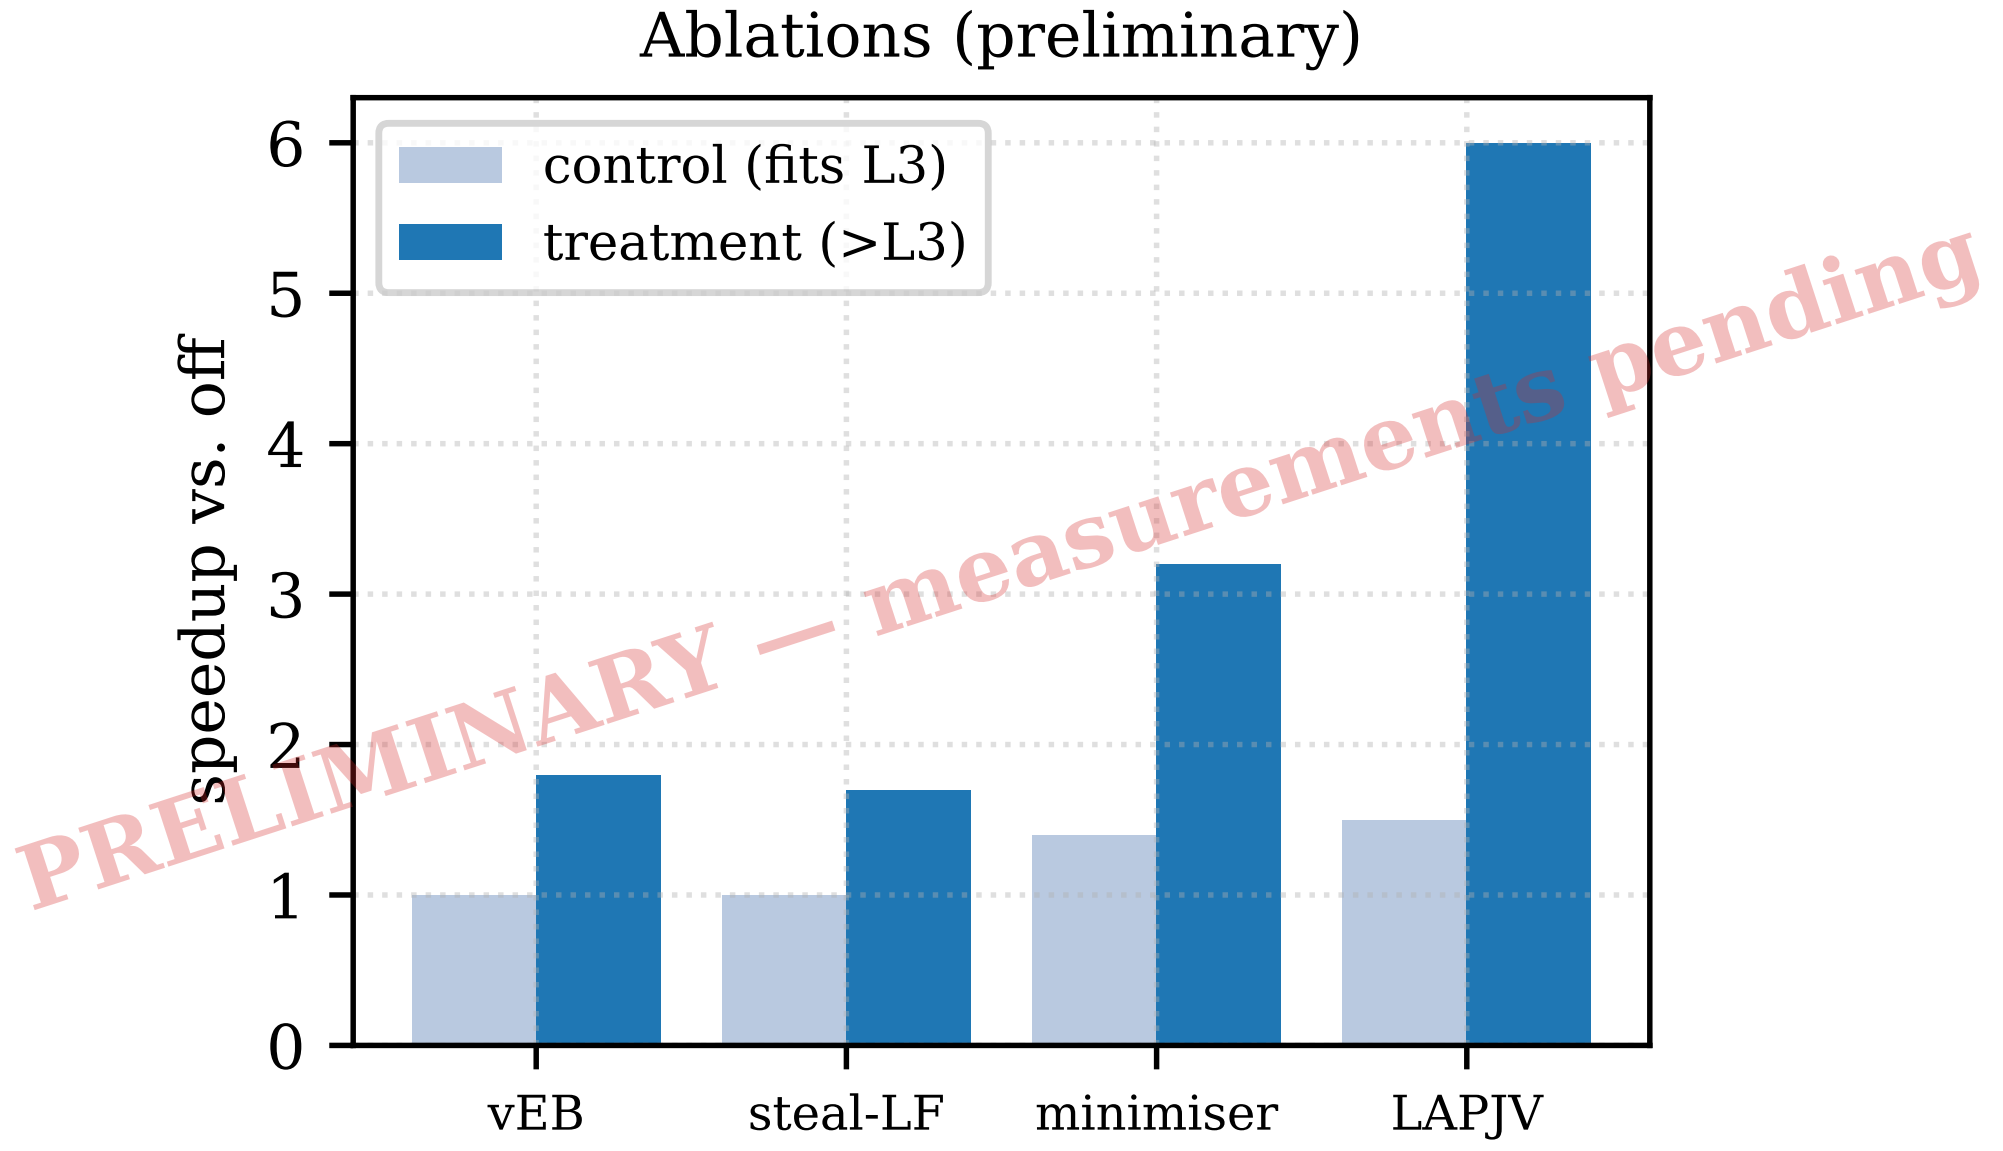
Ablations (preliminary)
control (fits L3)
treatment (>L3)
speedup vs. off
0
1
2
3
4
5
6
vEB
steal-LF
minimiser
LAPJV
PRELIMINARY — measurements pending