



dummy_calib_tsbl_scan_raw {name == 4000 && channels == 0}

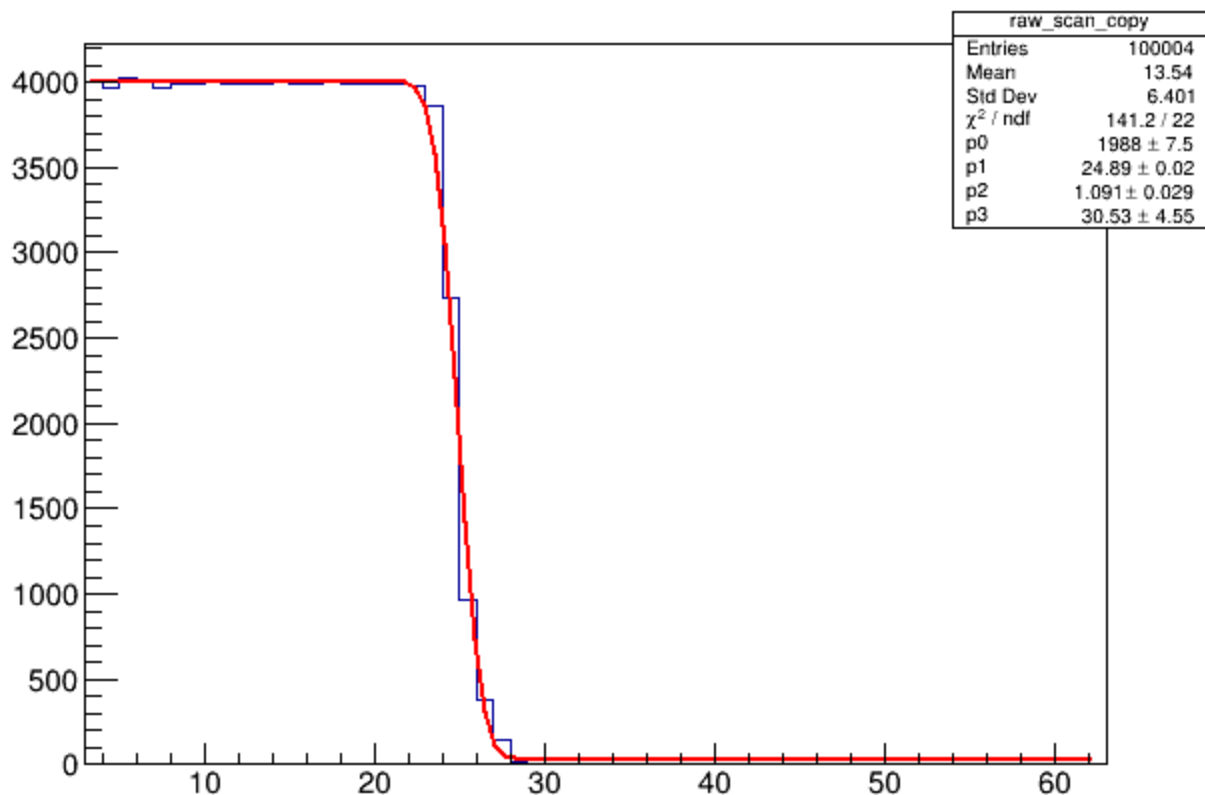


dummy_calib_tsbl_scan_raw {name == 4000 && channels == 1}

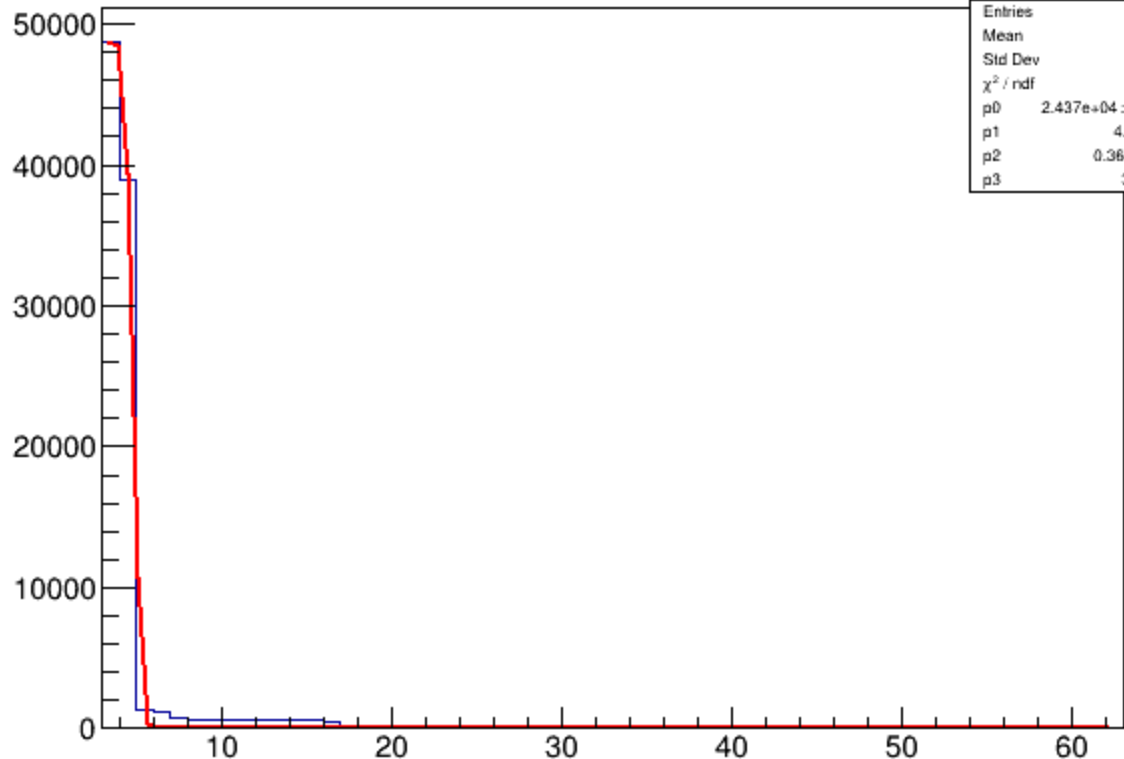


raw_scan_copy	
Entries	99998
Mean	4.006
Std Dev	2.144
χ^2 / ndf	6897 / 13
p0	$2.437\text{e}+04 \pm 1.126\text{e}+02$
p1	4.802 ± 0.005
p2	0.3618 ± 0.0030
p3	33.65 ± 1.40


dummy_calib_tsbl_scan_raw {name == 4000 && channels == 2}

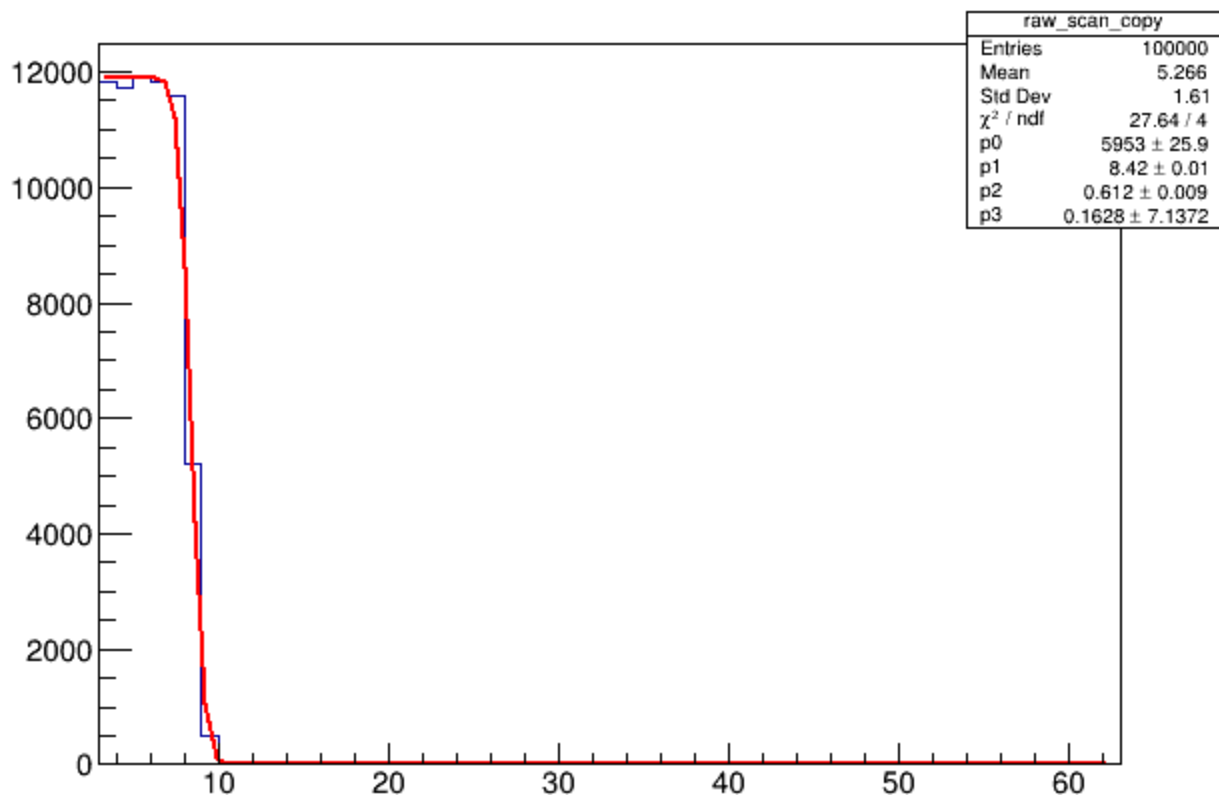


dummy_calib_tsbl_scan_raw {name == 4000 && channels == 3}

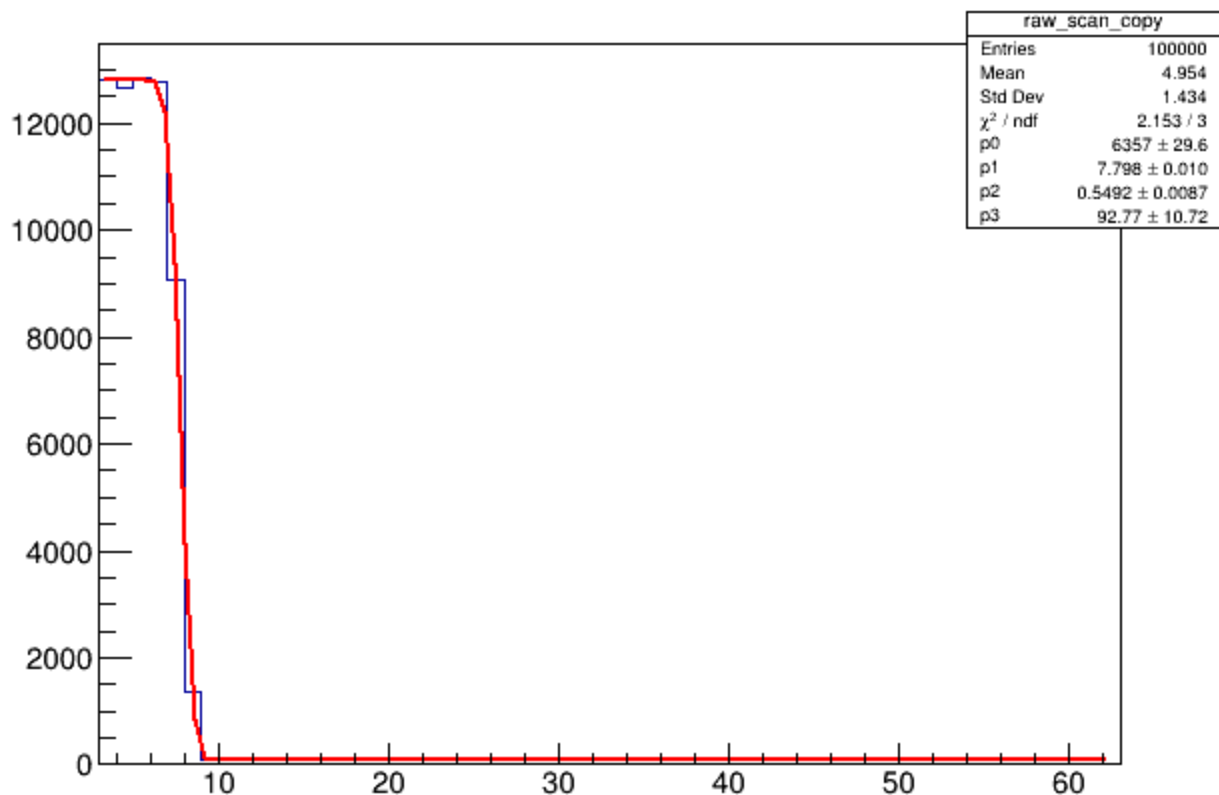


dummy_calib_tsbl_scan_raw {name == 4000 && channels == 4}

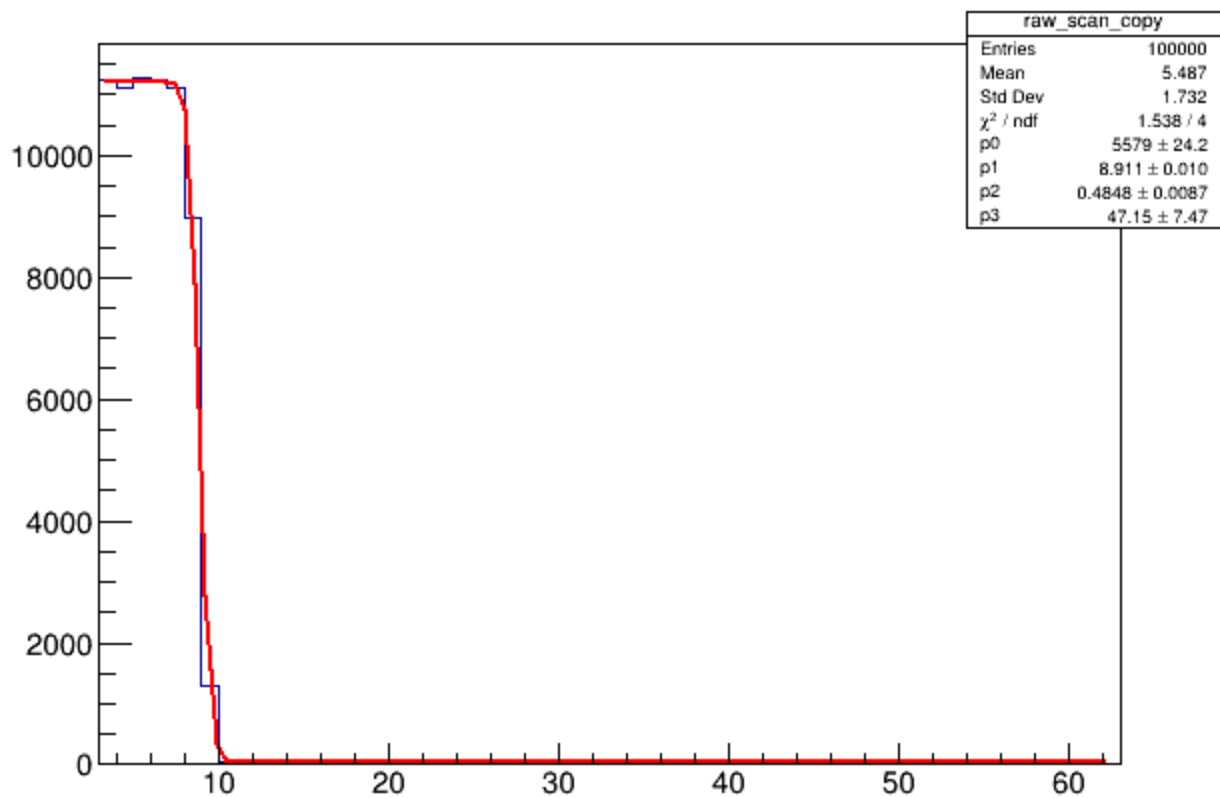

dummy_calib_tsbl_scan_raw {name == 4000 && channels == 5}

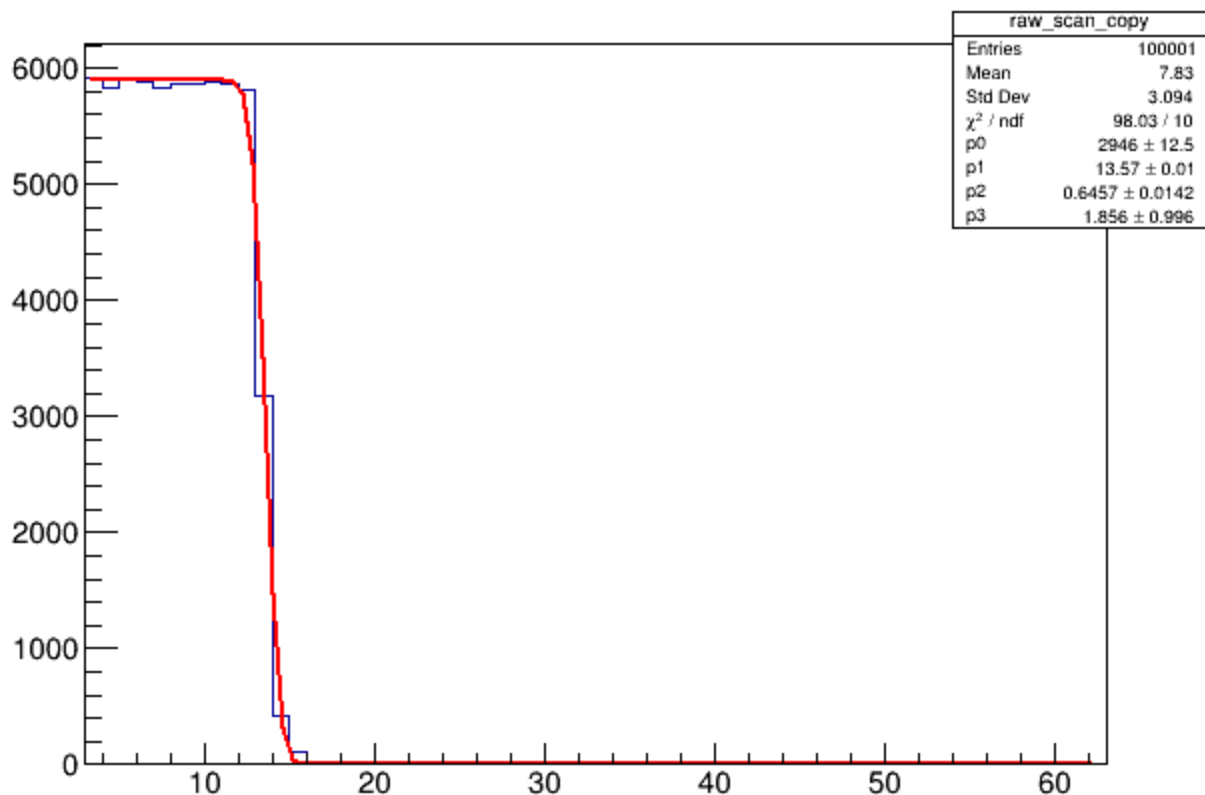

dummy_calib_tsbl_scan_raw {name == 4000 && channels == 6}

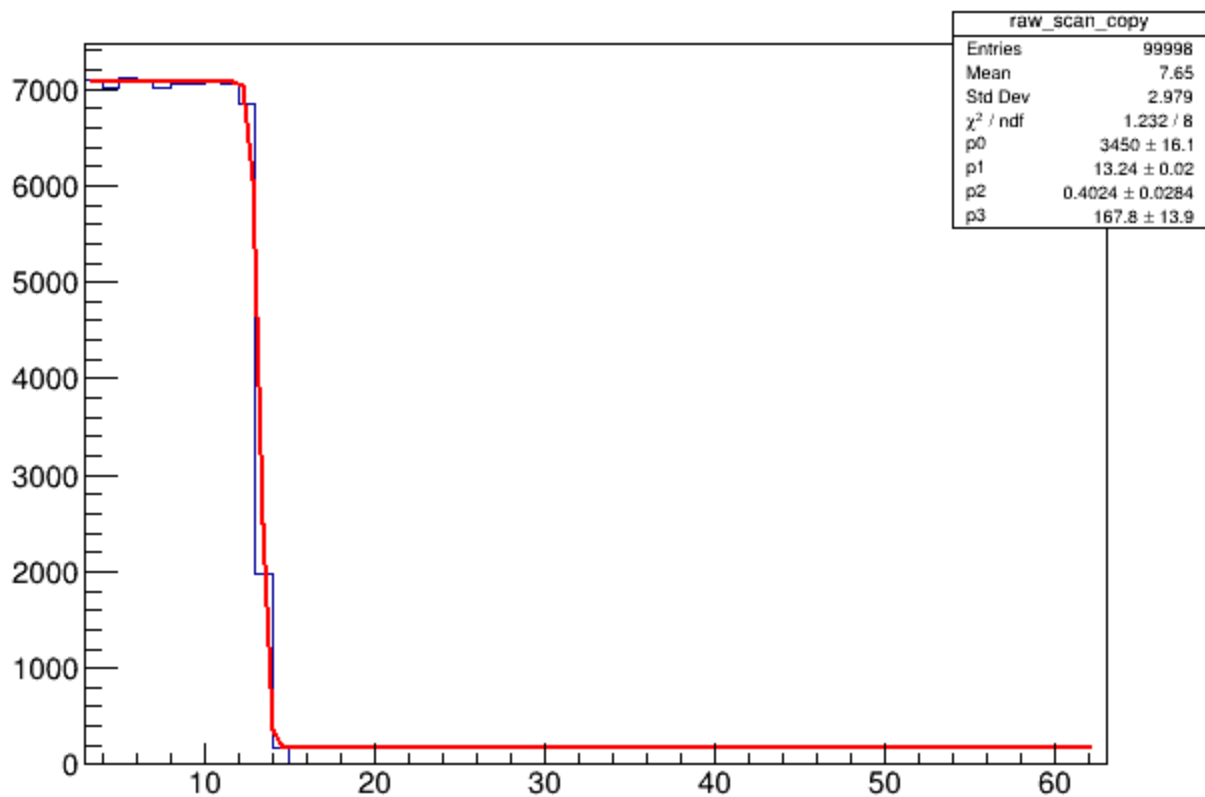

dummy_calib_tsbl_scan_raw {name == 4000 && channels == 7}

