



Reionization;  $N_{poly}=7$  for interferometer;  $N_{poly}=7$  for single element

Pessimistic

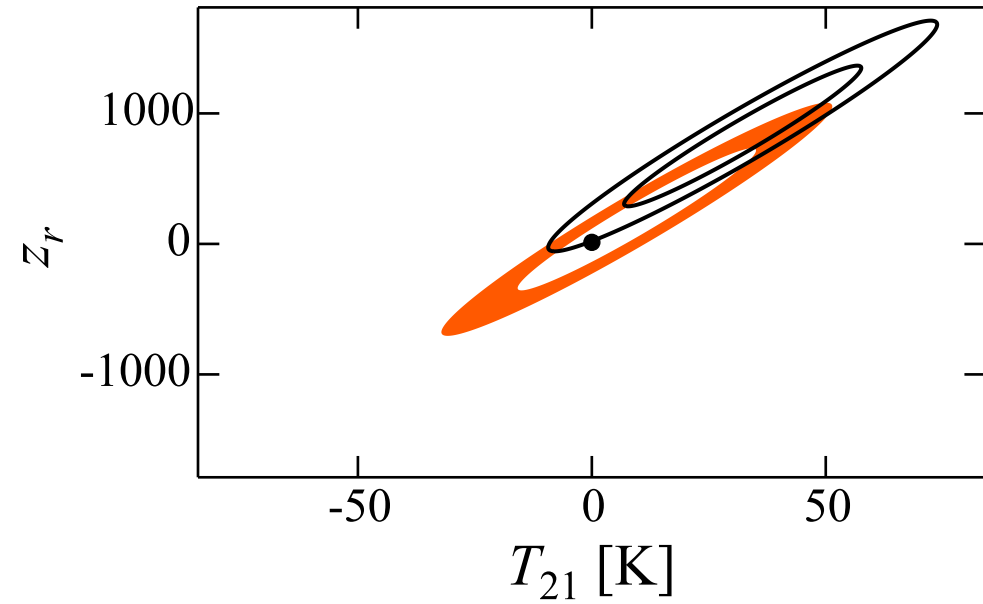

Moderate

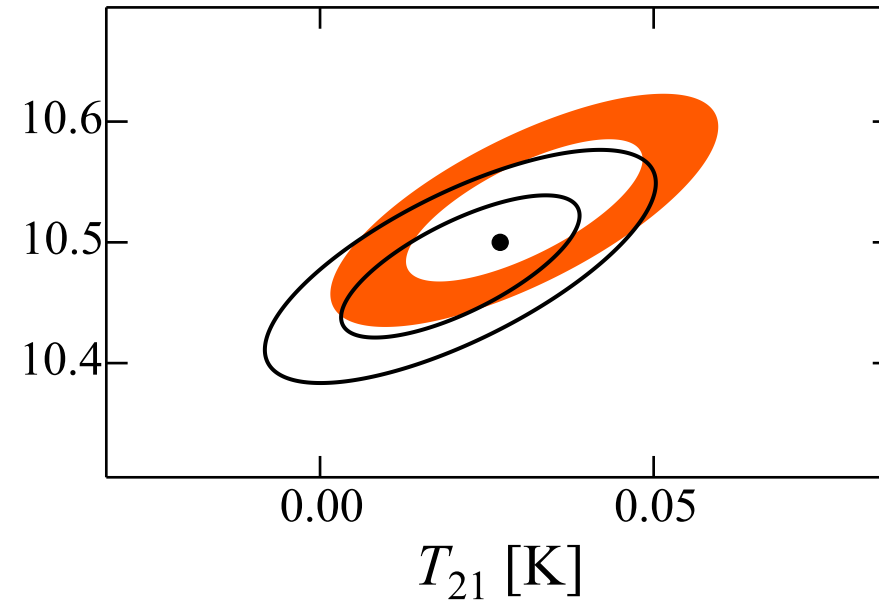

Optimistic

