



Reionization; $N_{poly}=7$ for interferometer; $N_{poly}=6$ for single element

Pessimistic

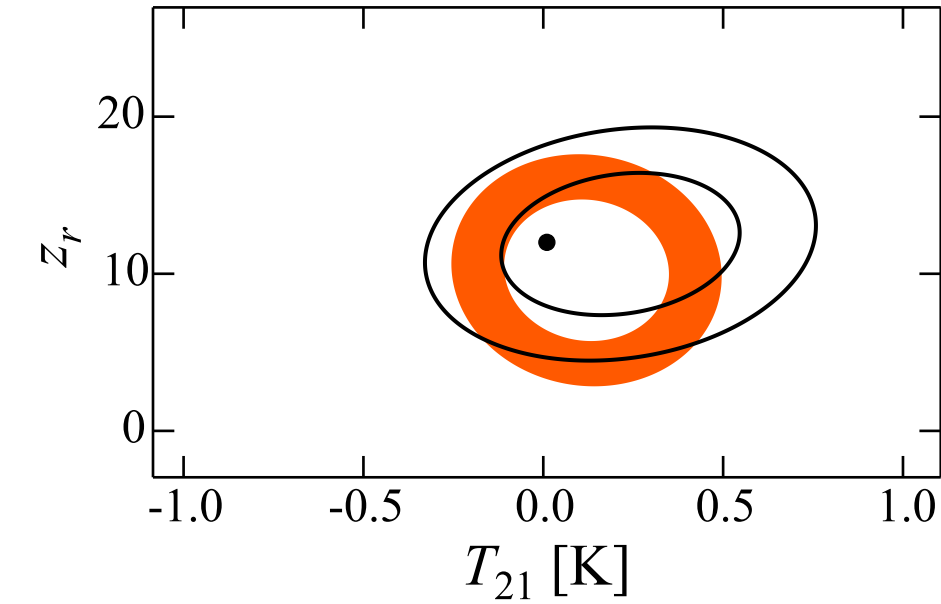

Moderate

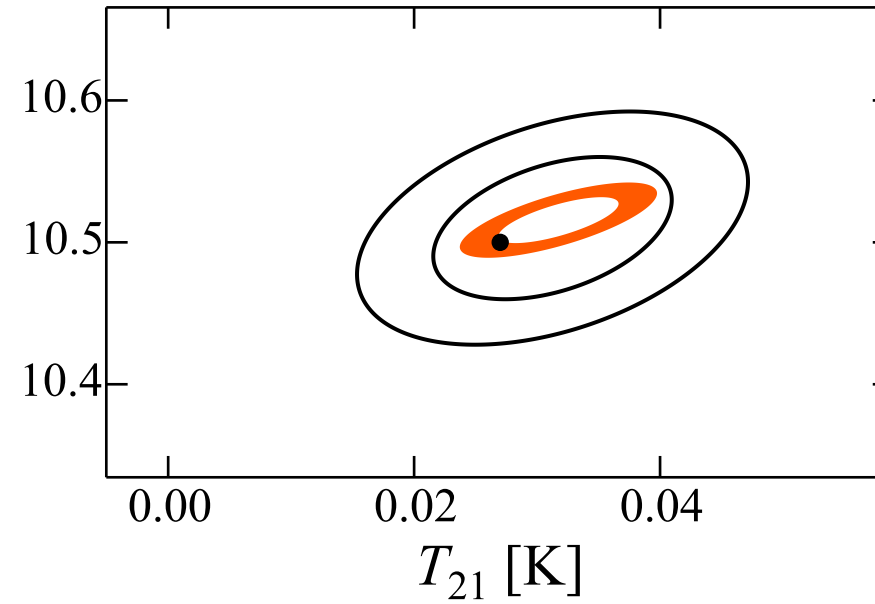

Optimistic

