
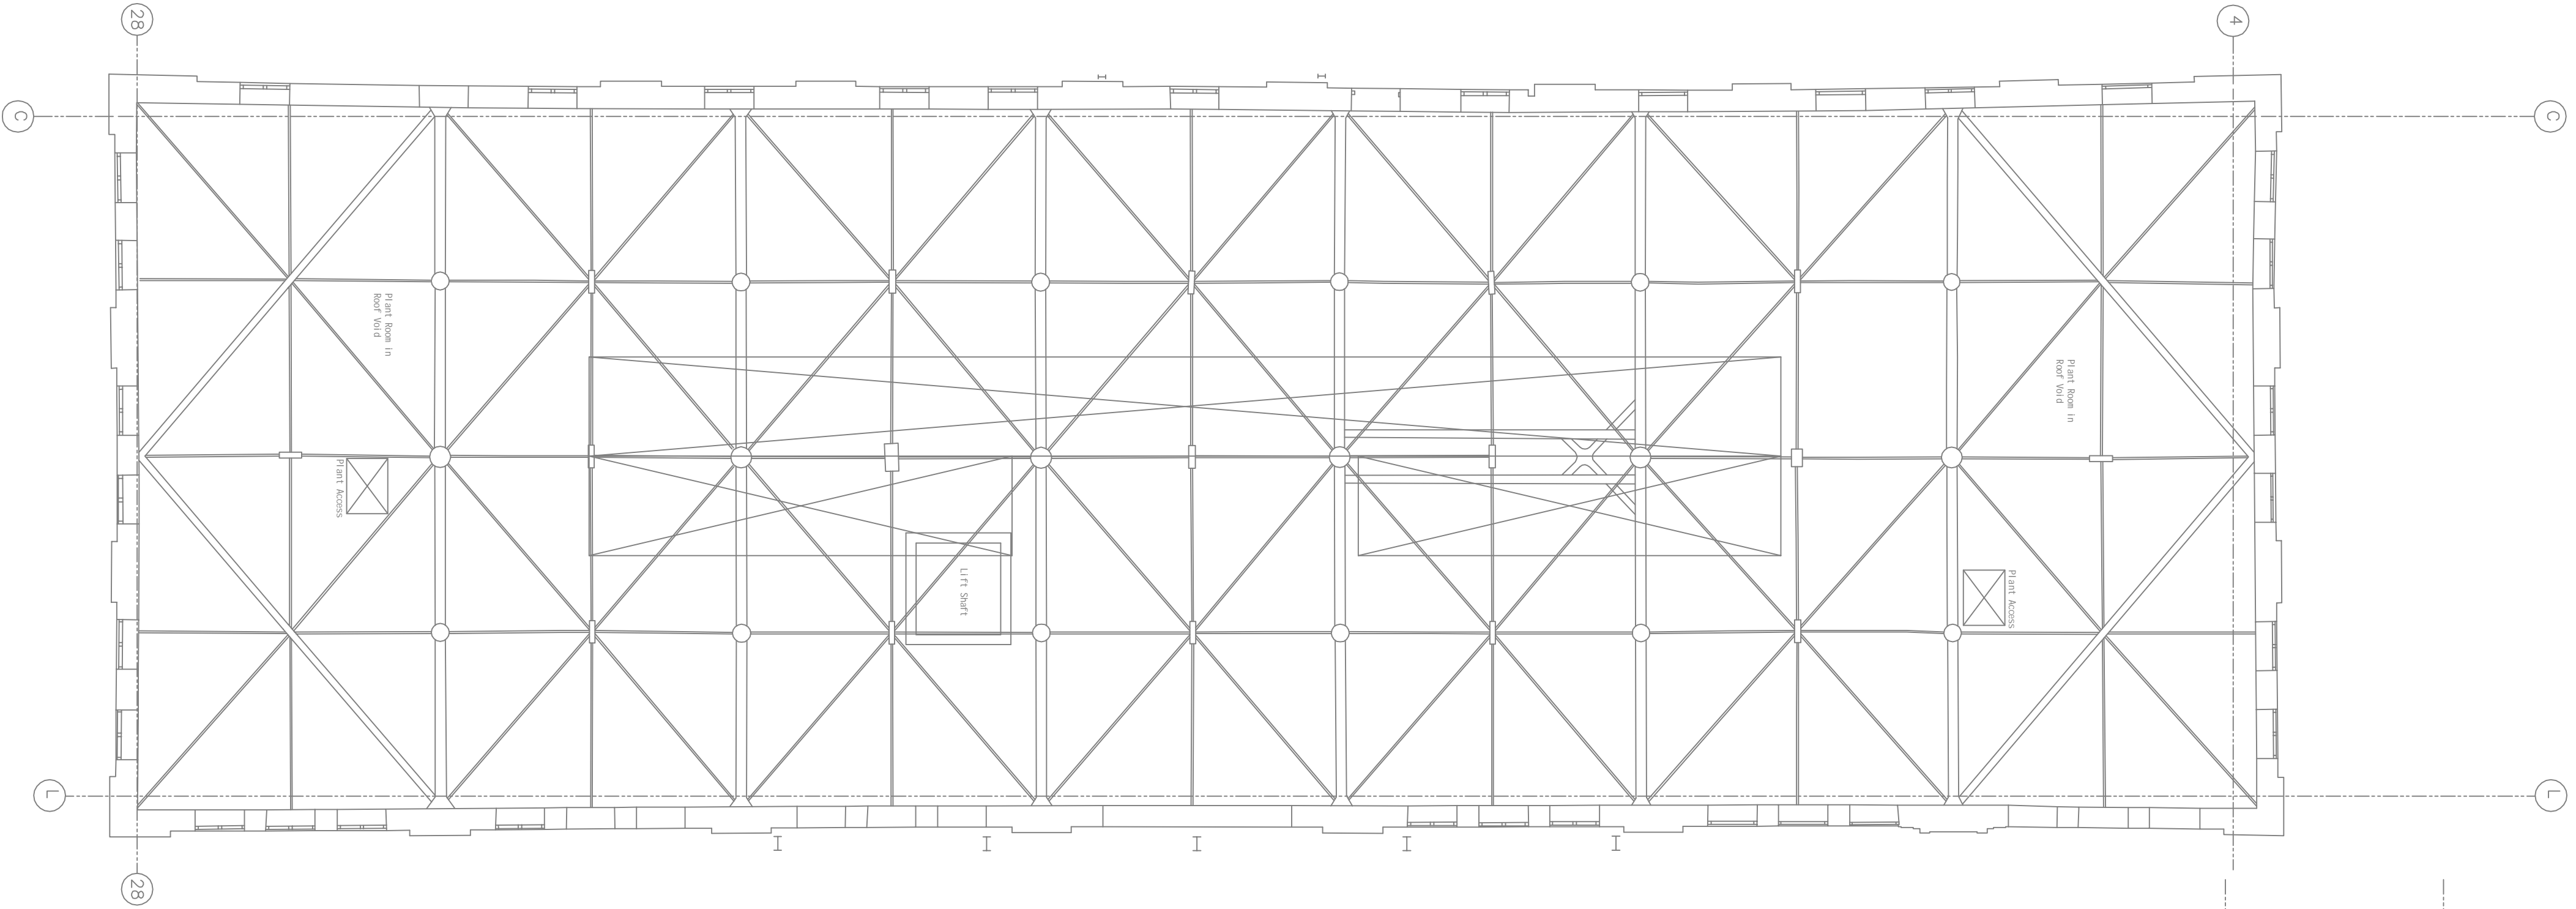


- NOTES:
- This drawing shall be read in conjunction with Accobiano Building Services Consulting Engineers Electrical Specification.
  - This drawing shall not be used as a working drawing. All scaled dimensions shall be verified on site.
  - For architectural and structural details pieces refer to appropriate specialist drawings
  - Furniture layouts to be confirmed by architect
  - The contractor shall ensure a 200mm gap is maintained between the LV and Data cabling confinement wherever possible

LEGEND:

- MOUF CABLE ADAPTER FOR SUB MAIN CABLEING, GENERALLY 150mm WIDE OR SIZED AS DETAILED ON LAYOUT
- CABLE BASKET FOR DATA CABLEING, SIZED AS DETAILED ON LAYOUT
- CABLE BASKET FOR EIV AND FIRE ALARM CABLEING, GENERALLY 150mm WIDE OR SIZED AS DETAILED ON LAYOUT
- CABLE BASKET FOR LV CABLEING, GENERALLY 150mm WIDE OR SIZED AS DETAILED ON LAYOUT
- CONTAMINANT RISER SECTION, WHERE POSSIBLE CABLES TO RISE WITHIN STUD WALL CONSTRUCTION WITHIN CONDUITS
- RFC RISE TO CEILING VOID
- MCS DISTRIBUTION BOARD

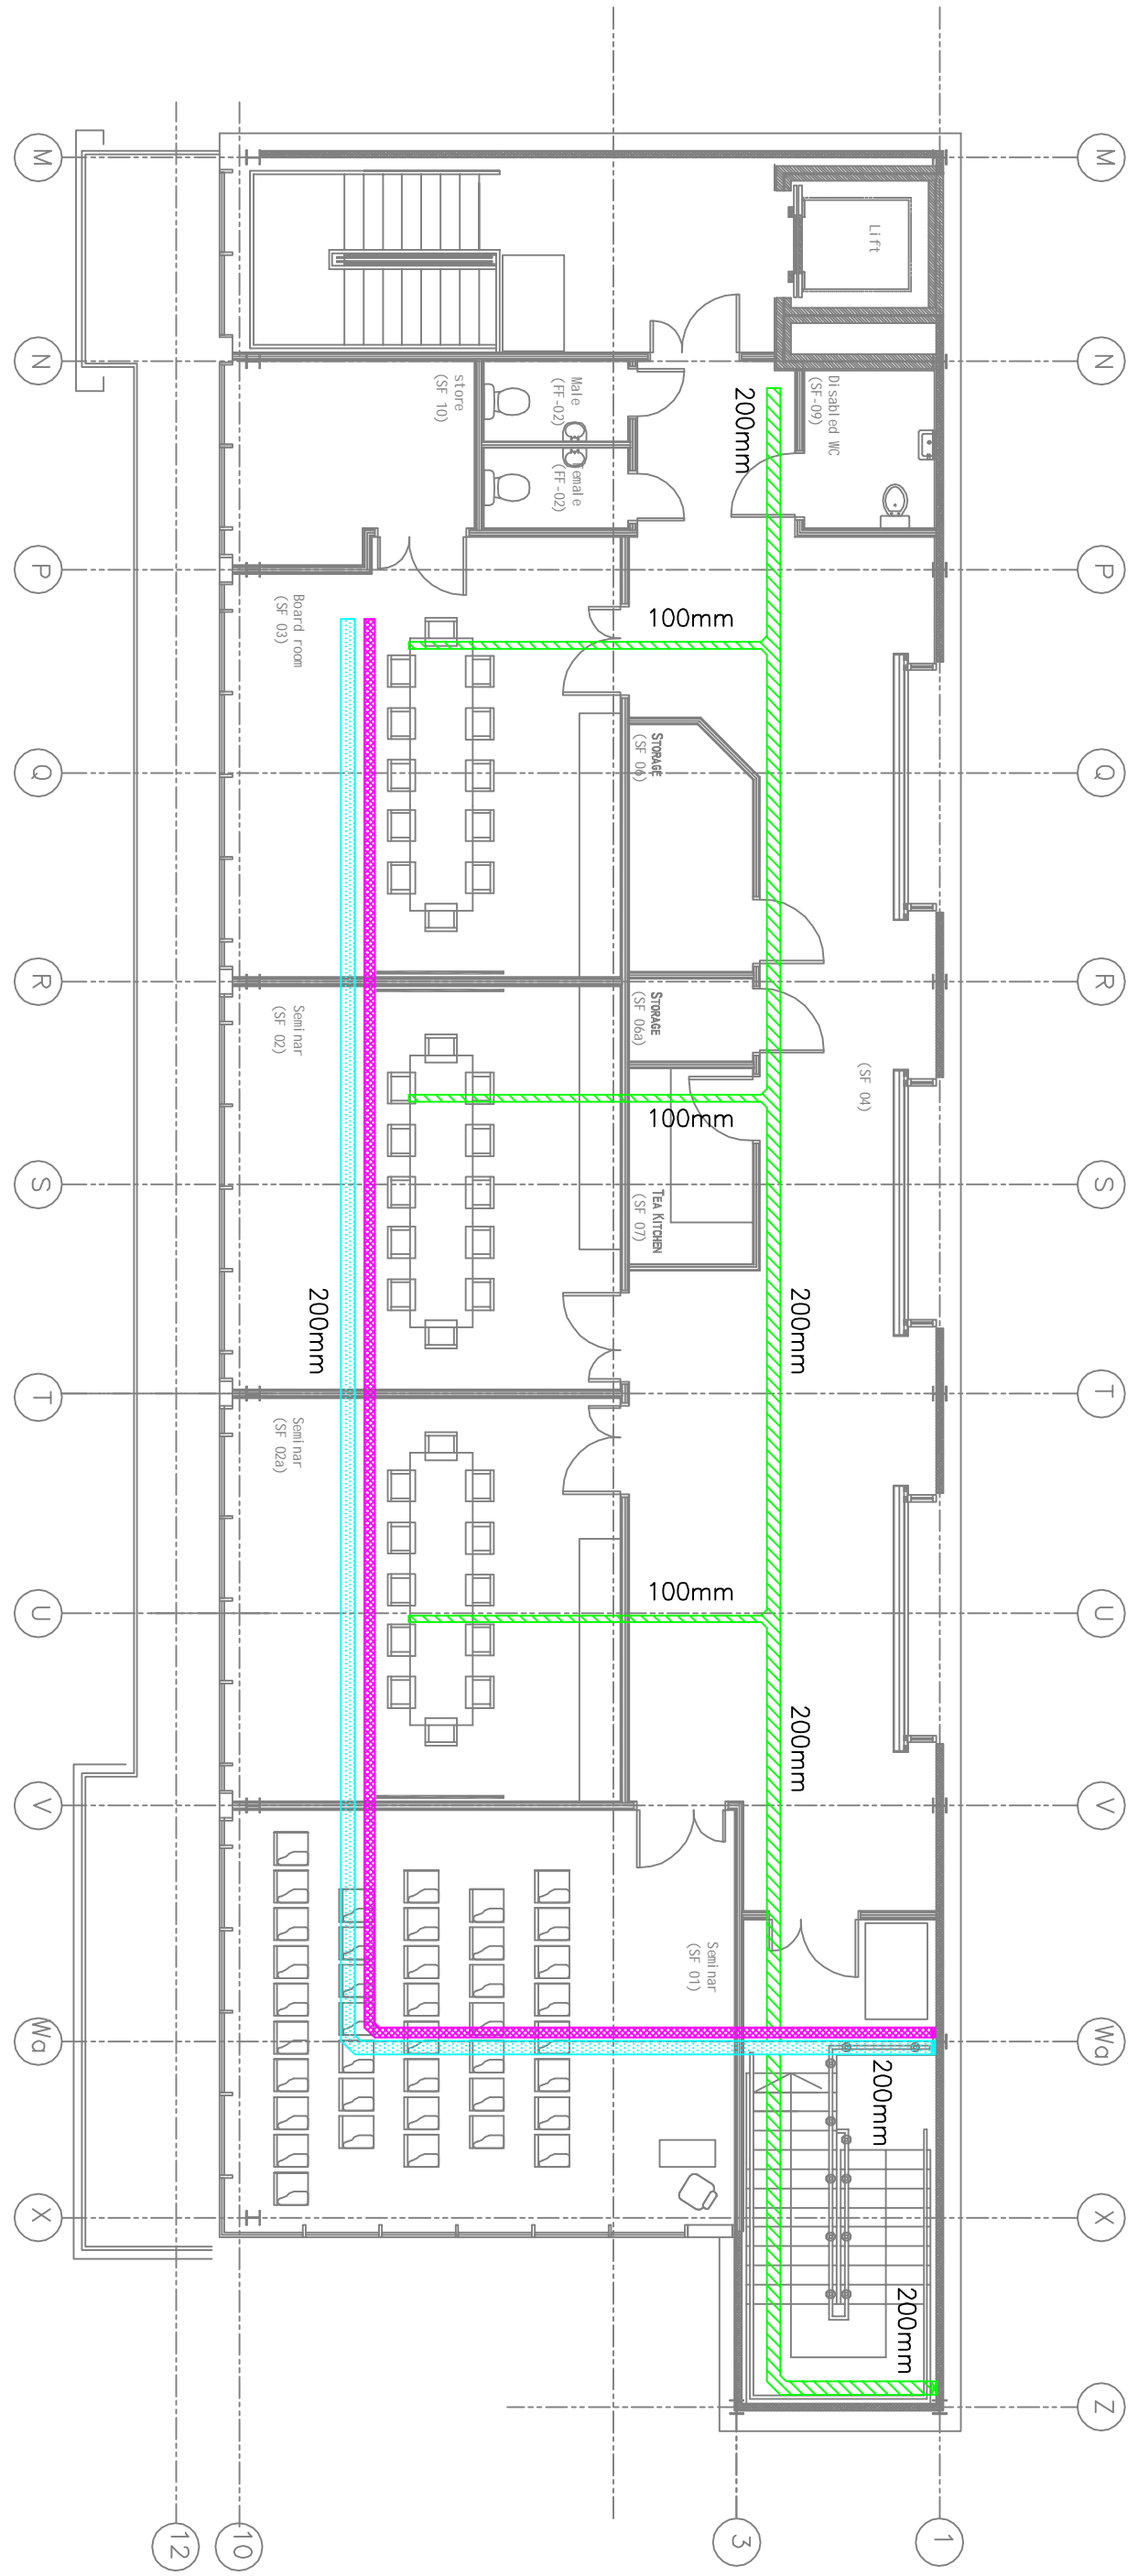

T1	Drawing Issue for Tender	CJ	K8	22.08.11
A1	Drawing Issue for Approval	CJ	K8	01.03.11
REV	REASON FOR REVISION	DR	APP	DATE

VERLANE

Project:  
STOURBRIDGE LION MEDICAL CENTRE

Title:  
PROPOSED SECOND FLOOR CONTAINMENT LAYOUT

Accobiano | Consulting Engineers  
Suite 3, Third Floor,  
104 - 106, Highley Road,  
Wolverhampton,  
West Midlands,  
B69 8LT  
TEL : 0121 455 0225  
E-MAIL : info@accobiano.org

Project No.	Drawing No.	Rev.
ABS12/003	02/01/003	T1
Date:	October 2012	Scale(s):
Drawn:	C. JONES	Approved:
Checked:	K. BAWA	Authorised:
Drawn:	C. JONES	Approved:
Checked:	K. BAWA	Authorised:
Drawn:	C. JONES	Approved:
Checked:	K. BAWA	Authorised:

ALL WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH B.S.7671 LANDLORDS TERMS AND CONDITIONS AND ALL VALID LEGISLATION.