



DESIGN SCHEDULE:				
REF	LENGTH	WIDTH	DEPTH	COVER TYPE
L/V1	500	1000	1000	FOOTPATH
L/V2	500	1000	1000	FOOTPATH
L/V3	500	1000	1000	FOOTPATH
L/V4	500	1000	1000	FOOTPATH
L/V5	500	600	600	FOOTPATH
L/V6	500	600	600	SOFT JG
L/V7	500	600	600	FOOTPATH
L/V8	500	600	600	FOOTPATH
L/V9	500	600	600	FOOTPATH
L/V10	500	600	600	HARD STANDING
L/V11	500	600	600	FOOTPATH
L/V12	500	600	600	SOFT JG
L/V13	500	600	600	FOOTPATH
L/V14	500	600	1000	FOOTPATH
L/V15	500	600	600	FOOTPATH

HORIZONTAL SPACING REQUIREMENTS (mm)				
SERVICE	HV	LV	ELV	P/EPD SERVICES
HV	300	1000	1000	1000
LV	1000	300	300	300
ELV	1000	300	50	300



MINIMUM DEPTH OF LAYING (mm)			
SERVICE	BURIED DIRECT IN GROUND	UNDER CONCRETE HARDENING IN DUCTS	UNDER FOOTPATHS IN DUCTS
HV	900	900	500
LV	750	750	400
ELY	750	750	400

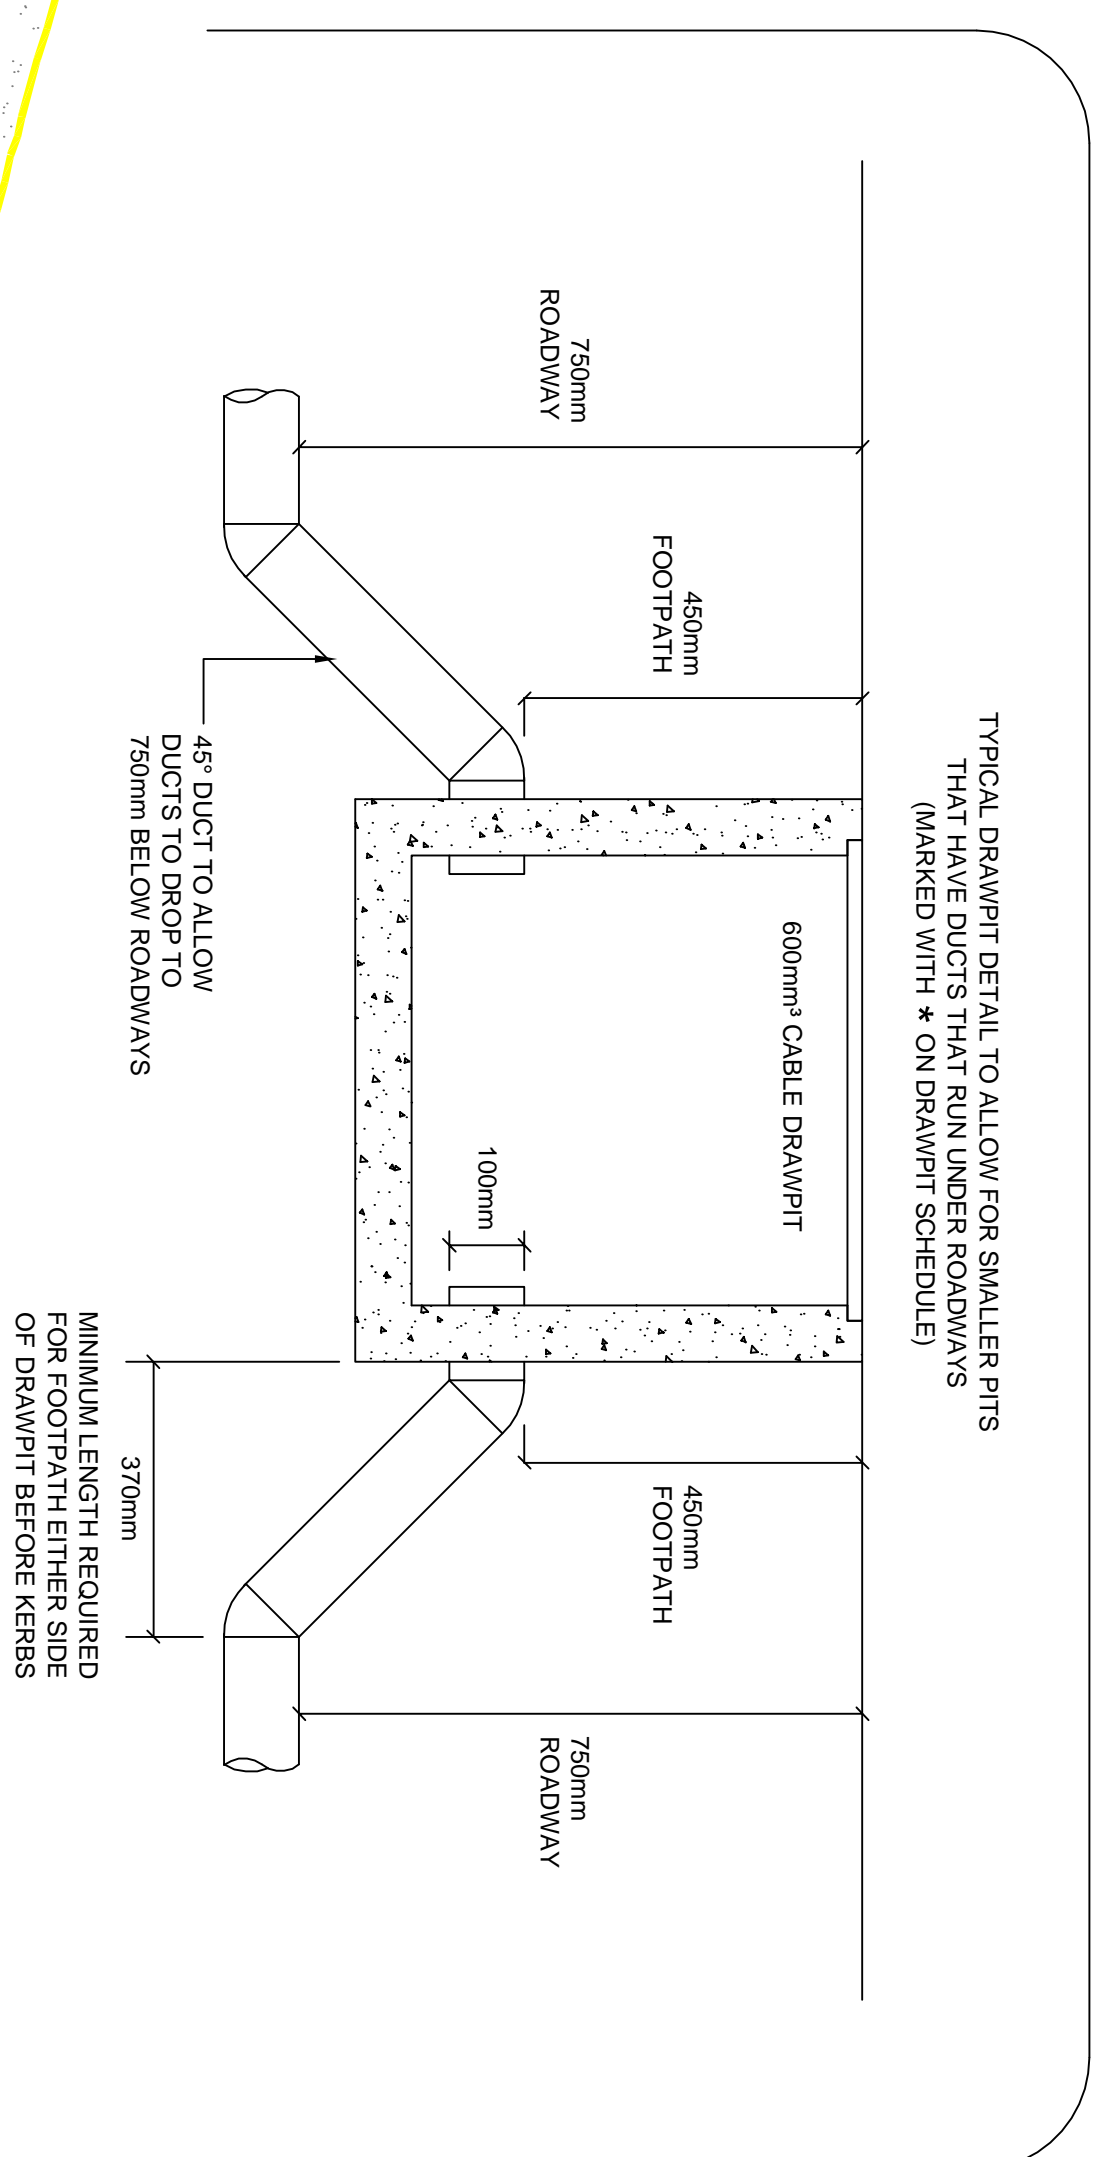

SECTION THROUGH CABLE/CABLE DUCT
INSTALLATION BELOW OPEN GROUND

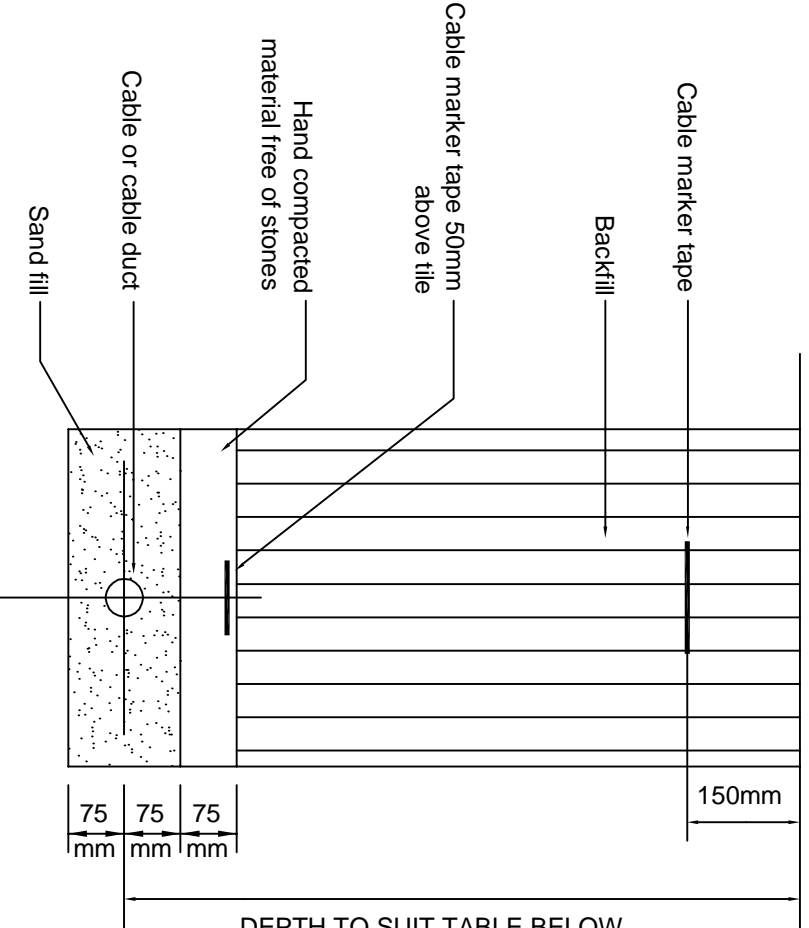

SECTION THROUGH CABLE/CABLE DUCT
INSTALLATION BELOW HARDSTANDING
AREAS (ROADS AND FOOTPATHS).

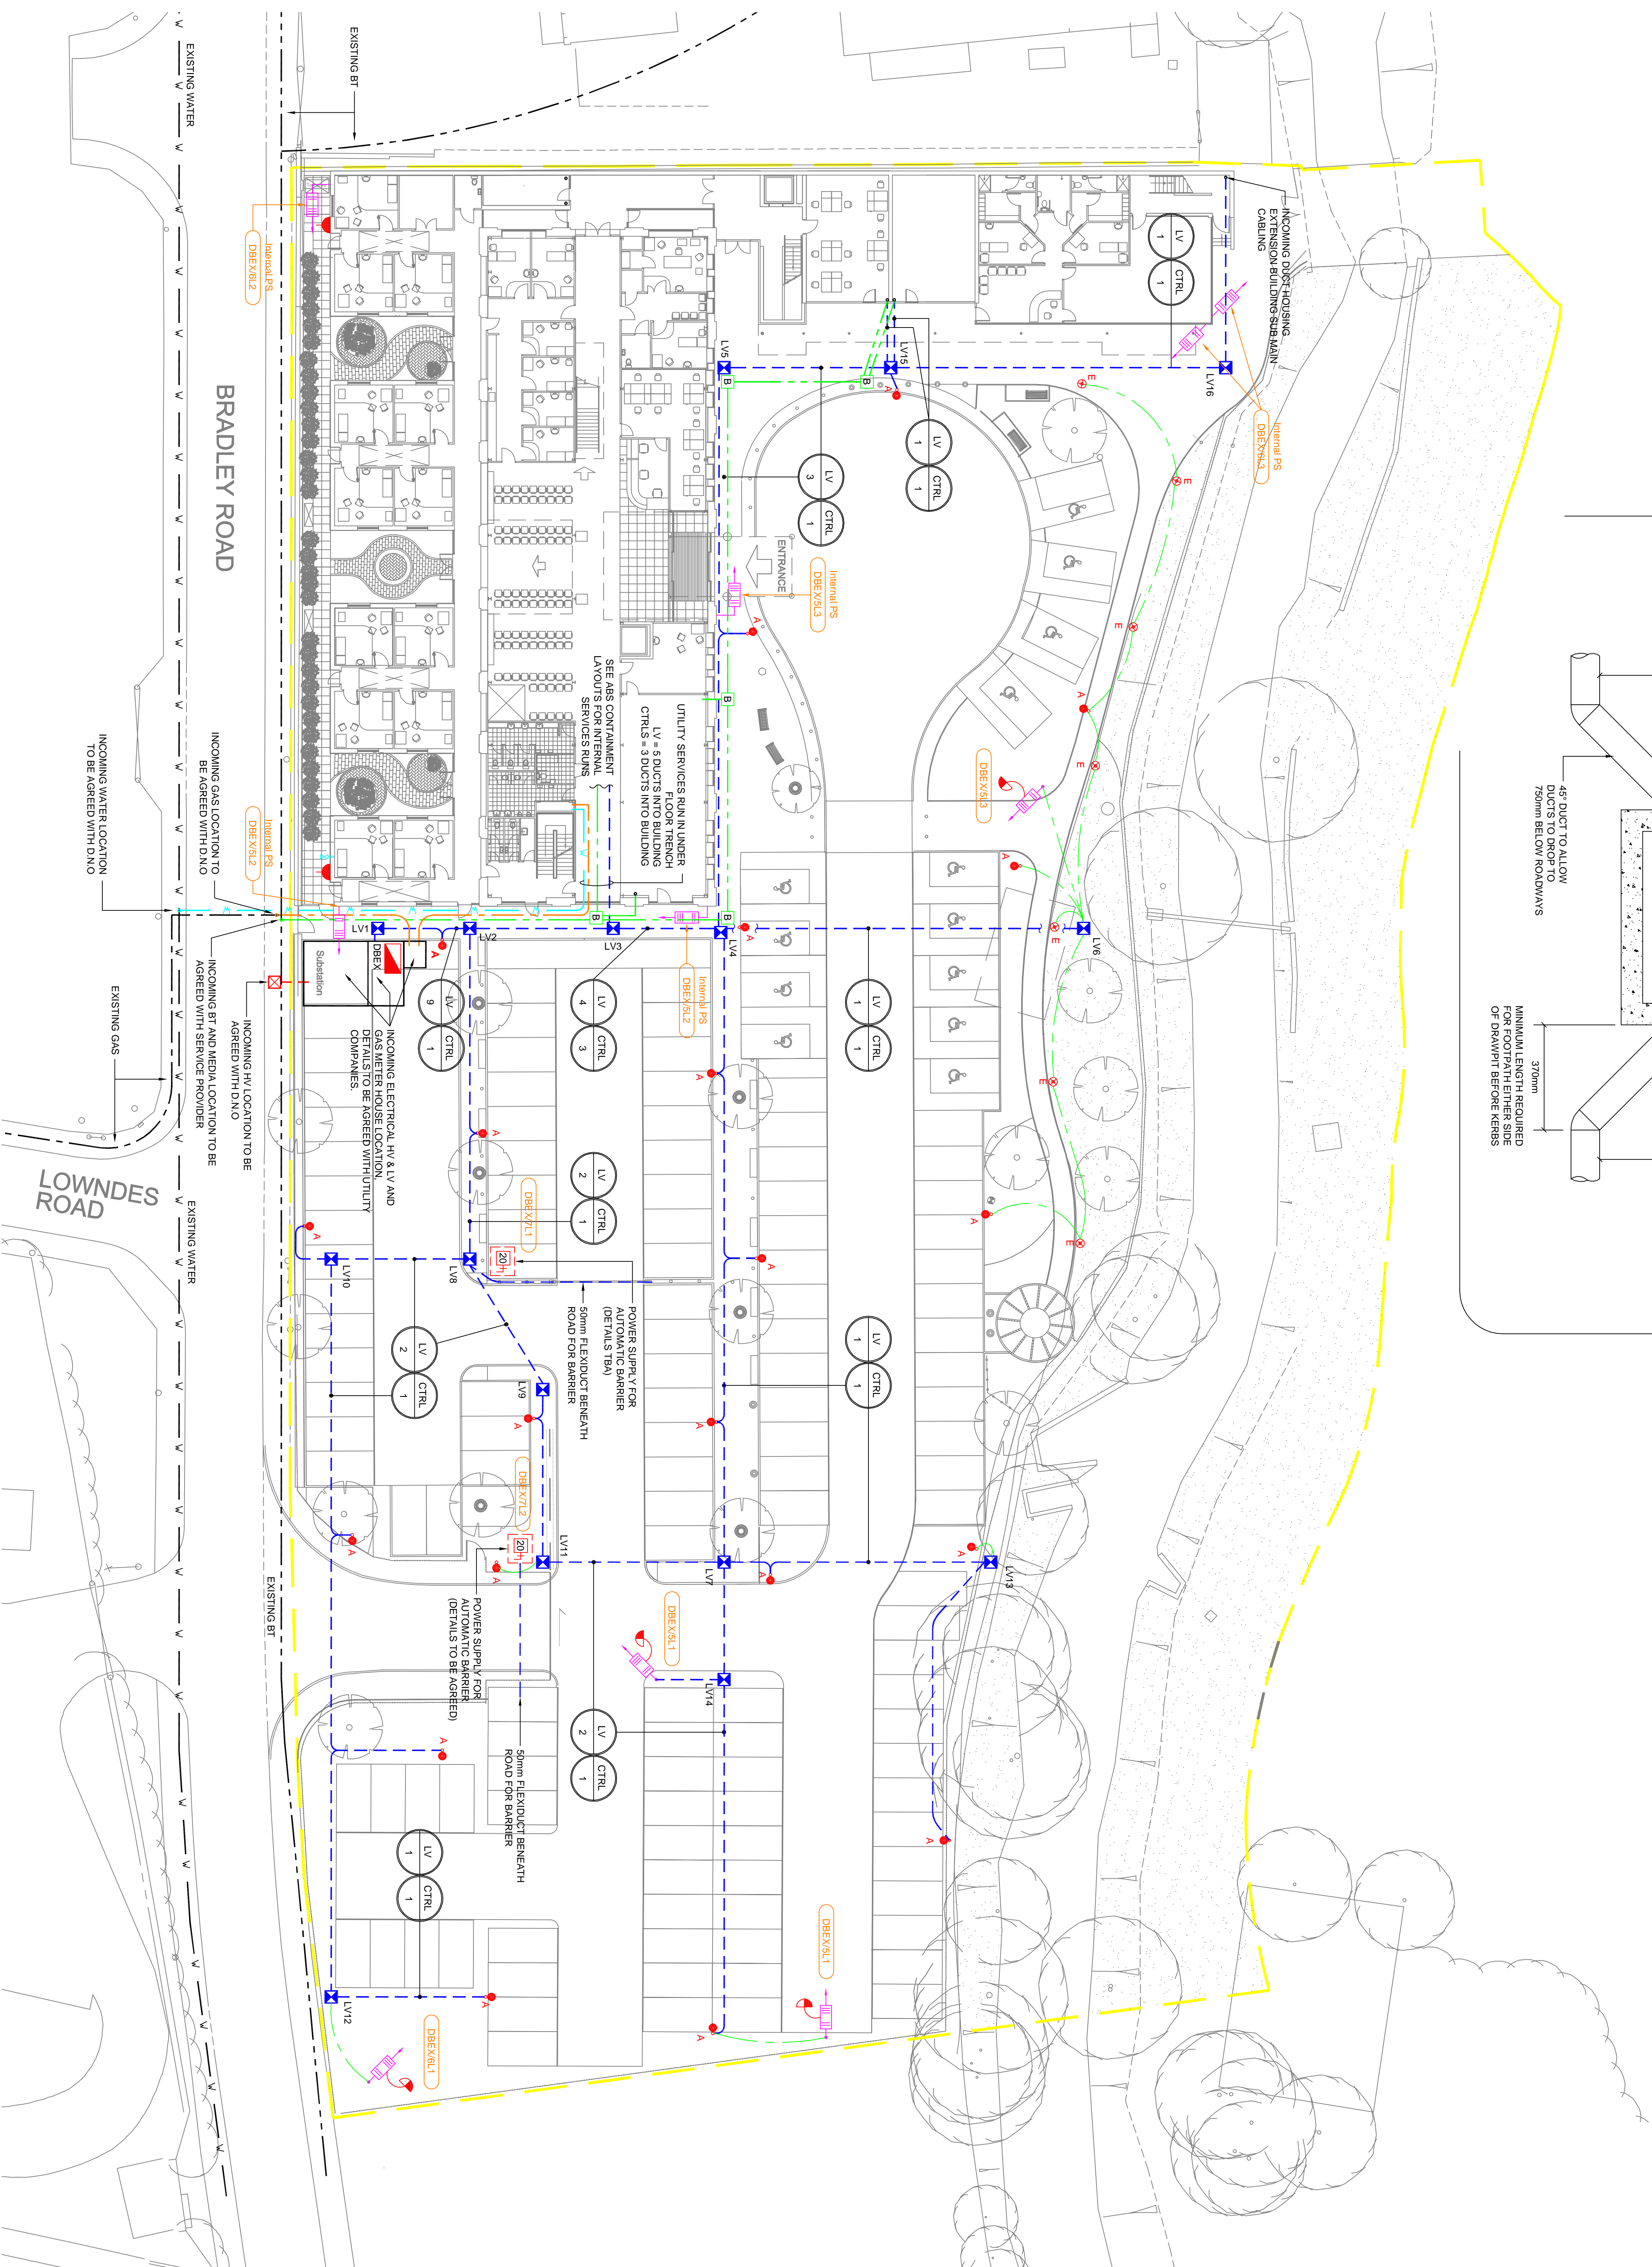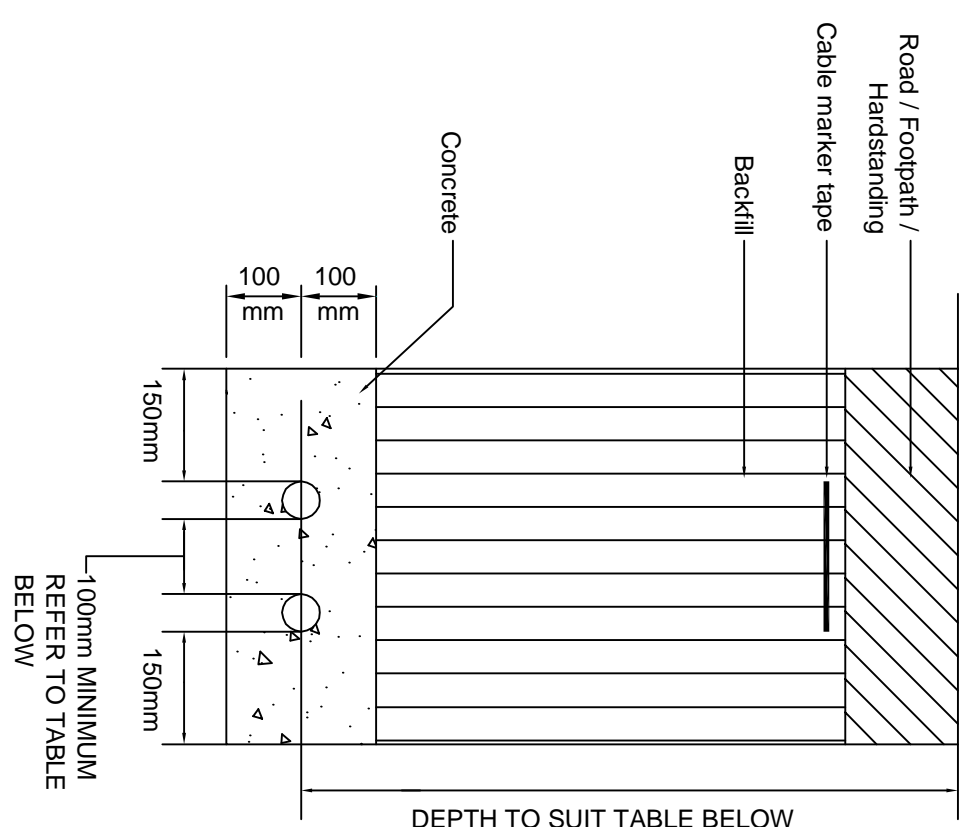


ALL WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH B.S.7671, LANDLORDS TERMS AND CONDITIONS AND ALL VALID LEGISLATION.

1. The drawing shall be read in conjunction with Accolero Building Services Consulting Engineers Electrical Specification.
2. This drawing shall not be used as a working drawing. All scaled dimensions shall be verified on site.
3. For architectural and structural details please refer to appropriate specialist drawings.
4. This report is indicative only at this point, information is still outstanding for the main utility companies.
5. For external lighting control and circuitry refer to ABS layout drawing 001/1002.

2012 Copyright

PROPOSED EXTERNAL MECHANICAL AND ELECTRICAL SERVICES LAYOUT

 Arcobaleno | Consulting Engineers
Suite 3, Third Floor,
104 - 106 Havel Road

TEL: 0121 455 0225
E-Mail: info@absorb.com

E-Mail - info@absuk.co

Project No:	Drawing No:
-------------	-------------

NOVEMBER 2012

מחיר	
------	--

C JONES

TEND)

A Gene associated with DE FENICO 0001 2000 D-2-N- 2005/144