2013 Copyright ©

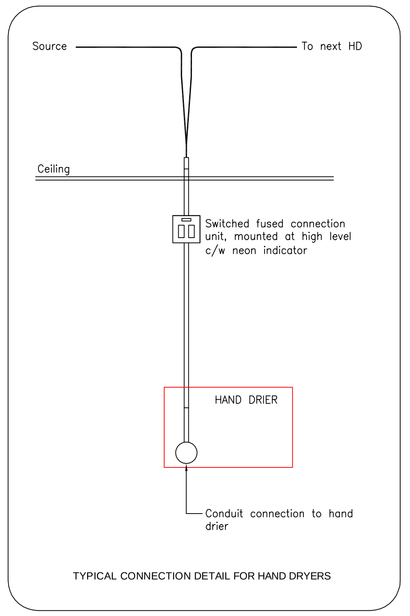

TYPICAL CONNECTION DETAIL FOR HAND DRYERS

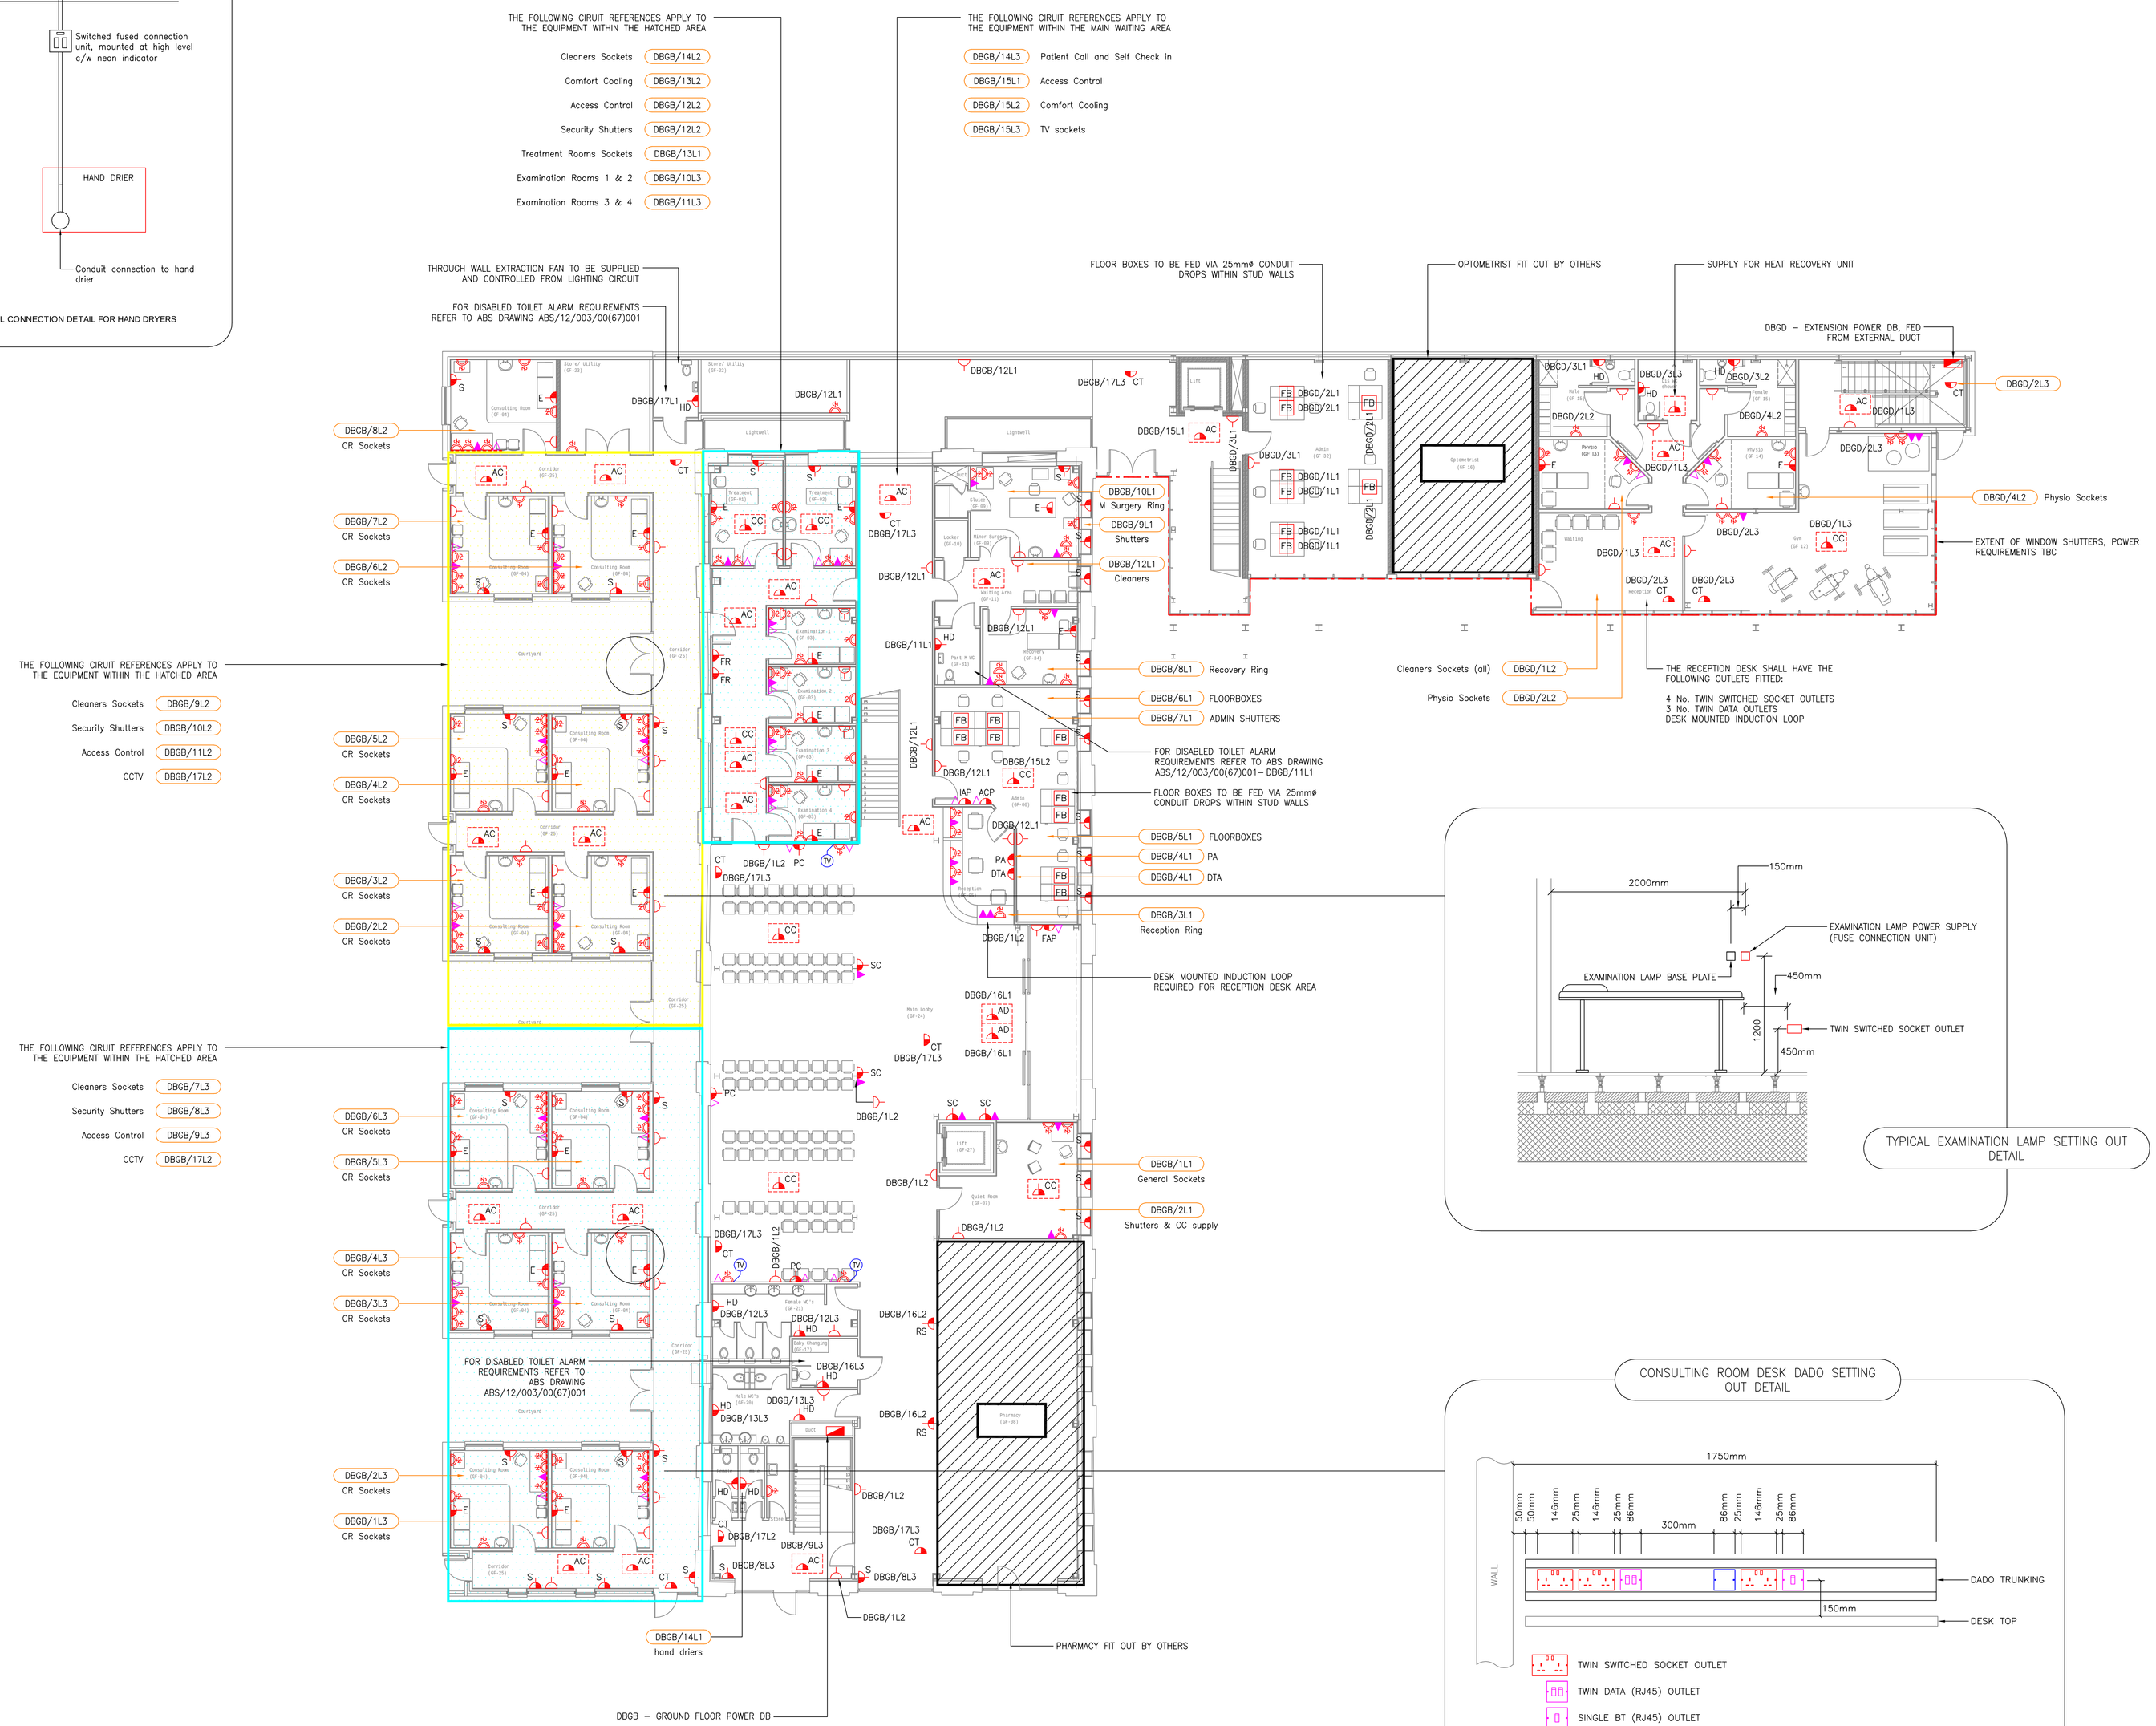

TYPICAL EXAMINATION LAMP SETTING OUT DETAIL

CONSULTING ROOM DESK DADO SETTING OUT DETAIL

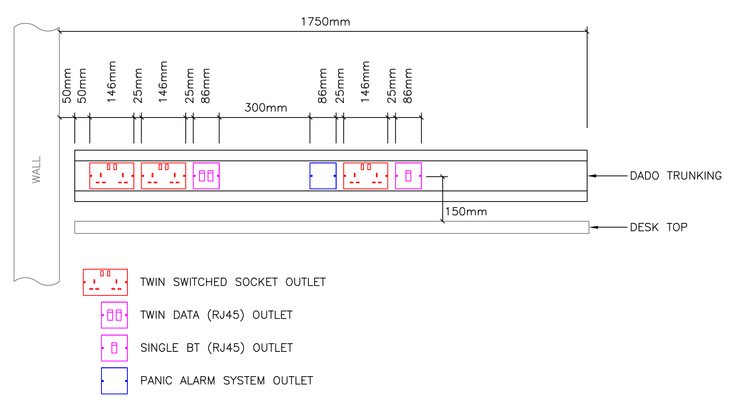

ALL WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH B.S.7671, LANDLORDS TERMS AND CONDITIONS AND ALL VALID LEGISLATION.

NOTES:

1. This drawing shall be read in conjunction with Arcobaleno Building Services Consulting Engineers Electrical Specification.
2. This drawing shall not be used as a working drawing. All scaled dimensions shall be verified on site.
3. For architectural and structural details please refer to appropriate specialist drawings
4. Furniture layouts to be confirmed by architect
5. Intercom system to be provided from reception desk to both the main public entrance, public external entrance by the LV substation and the incoming Car Parl Barrier.

LEGEND:

- White plastic single switched socket outlet, mounted 450mm affl unless otherwise stated
- White plastic twin switched socket outlet mounted 450mm affl unless otherwise stated

  MC Denotes Metal Clad version
- Switched fused connection unit, white plastic complete with neon indicator, mounted adjacent equipment it is feeding, as follows:

  WB Water Boiler power supply
  CC Comfort Cooling unit power supply
  E Examination lamp power supply
  HD Hand Drier power supply
  PC Patient call system
  SC Self check system
  S Window shutter supply in Ceiling Void
  RS Roller Shutter supply in Ceiling Void
  AD Automatic Doors supplies
- Switched fused connection unit (150mm above worktop) connected to low level single socket outlet (450mm AFFL), white plastic complete with neon indicator, as follows:

  FR Denotes Refrigerator power supply
  DW Denotes dishwasher power supply
  WM Denotes Washing Machine supply
- Un-switched fused connection unit, white plastic complete with neon indicator, mounted adjacent equipment it is feeding unless otherwise stated, as follows:

  AC Access Control power supply
  CT CCTV Camera power supply in ceiling void
  DTA Denotes disabled toilet alarm PS
  PA Panic alarm panel supply
  FAP Fire alarm panel supply
  IAP Intruder alarm panel supply
  ACP Access control panel supply
- SP&N Switched isolator R denotes rating of device
- TP&N Switched isolator R denotes rating of device
- Single data point
- Twin data point
- Indicates item is located within ceiling void
- TV system outlet, mounted 2000mm AFFL adjacent power supply socket outlet
- FB 3 Compartment recessed floorbox containing the following outlets:

  2 No. Twin switched socket outlets
  1 No. 3 gang data plate for on site punching
- 3 Compartment white plastic Dado Trunking

REV	REASON FOR REVISION	DR	APP	DATE
T1	Drawing issue for Tender	CJ	KB	22-03-12
A1	Drawing issue for approval	CJ	KB	04-03-12
P1	Preliminary drawing issue for approval & comment	CJ	KB	24-10-12

Client:
VERLANE

Project:
STOURBRIDGE LION MEDICAL CENTRE

Title:
PROPOSED GROUND FLOOR SMALL POWER AND DATA LAYOUT

Arcobaleno | Consulting Engineers
Suite 3, Third Floor,
104 - 106 Hagley Road,
Edgbaston, Birmingham,
West Midlands,
B16 8LT
TEL: 0121 455 0225
E-Mail - info@absuk.org

Project No:	Drawing No:	Rev:
ABS/12/003	00(62)001	T1

Date:	Scale@A0:
MARCH 2012	1:100

Drawn	Approved
C JONES	K BAJWA

TENDER

A firm accreditted to BS EN ISO 9001 - 2000, Reg No. 2006/449