

- NOTES:
1. This drawing shall be read in conjunction with Arcobaleno Building Services Consulting Engineers Electrical Specification.
  2. This drawing shall not be used as a working drawing. All scaled dimensions shall be verified on site.
  3. For architectural and structural details please refer to appropriate specialist drawings

FIRE ALARM LEGEND:


- SURFACE MOUNTED SMOKE DETECTOR
- SURFACE MOUNTED SMOKE DETECTOR CW BASE
- MOUNTED SOUNDER
- SURFACE MOUNTED SMOKE DETECTOR CW BASE
- MOUNTED SOUNDER AND BEACON
- SURFACE MOUNTED HEAT DETECTOR CW BASE
- MOUNTED SOUNDER
- SURFACE MOUNTED HEAT DETECTOR CW BASE
- SURFACE MOUNTED HEAT DETECTOR CW BASE
- MOUNTED SOUNDER AND BEACON
- SURFACE MOUNTED SOUNDER AND BEACON
- SURFACE MOUNTED SOUNDER AND BEACON
- SURFACE MOUNTED EMERGENCY BREAK GLASS UNIT, MOUNTED 1100mm AFL
- SEMI-RECESSED FIRE ALARM PANEL
- FIRE ALARM INPUT - OUTPUT MODULE

DISABLED TOILET ALARM LEGEND:

- DISABLED TOILET ALARM POWER SUPPLY UNIT
- MOUNTED WITHIN CEILING VOID
- DISABLED TOILET ALARM RESET BUTTON, MOUNTED WITHIN REACH OF PERSON SITTING ON TOILET - PART B BUILDING REGS
- DISABLED TOILET ALARM PULL CHORD, WITH 2 DETAILLED IN PART M BUILDING REGS
- DISABLED TOILET ALARM VISUAL/TONE UNIT MOUNTED CENTRALLY ABOVE TOILET DOOR
- DISABLED ALARM PANEL

INTRUDER/SECURITY ALARM LEGEND:


- INTRUDER ALARM SURFACE MOUNTED PASSIVE INFRARED MOTION SENSOR
- INTRUDER ALARM DOOR CONTACT
- WALL MOUNTED PANIC ATTACK BUTTON COMPLETE WITH INDICATOR AND RESET BUTTON
- WALL MOUNTED PANIC ATTACK ALARM VISUAL/TONE INDICATOR, MOUNTED ABOVE DOOR
- INTRUDER ALARM PANEL
- PANIC ATTACK ALARM PANEL
- INTRUDER ALARM ENTRY / EXIT KEY PAD, MOUNTED 1100mm AFL
- MAGNETIC DOOR LOCK
- PROXIMITY CARD OR RFID READER
- PUSH TO EXIT BUTTON
- EMERGENCY BREAK GLASS BUTTON
- CCTV MONITOR(S) LOCATION
- CCTV RECORDING EQUIPMENT
- CCTV CONTROL CONSOLE
- INTRUDER ALARM INTERNAL SOUNDER
- INTRUDER ALARM EXTERNAL SOUNDER
- COVERT FIXED POSITION CCTV CAMERA

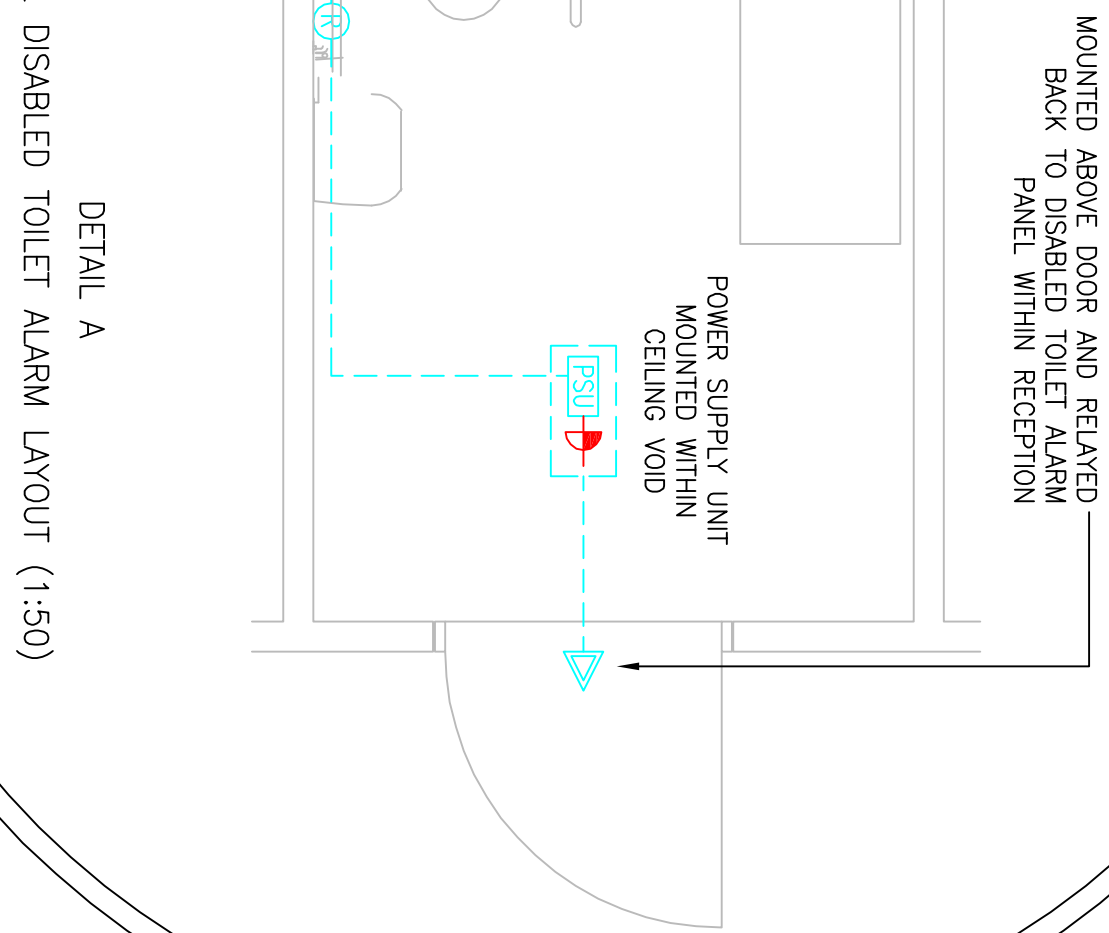

INPUT OUTPUT DEVICES PER ACCESS CONTROL EQUIPMENT - LOCATIONS TO BE ADVISED

FIRE ALARM LAYOUT

SECURITY LAYOUT

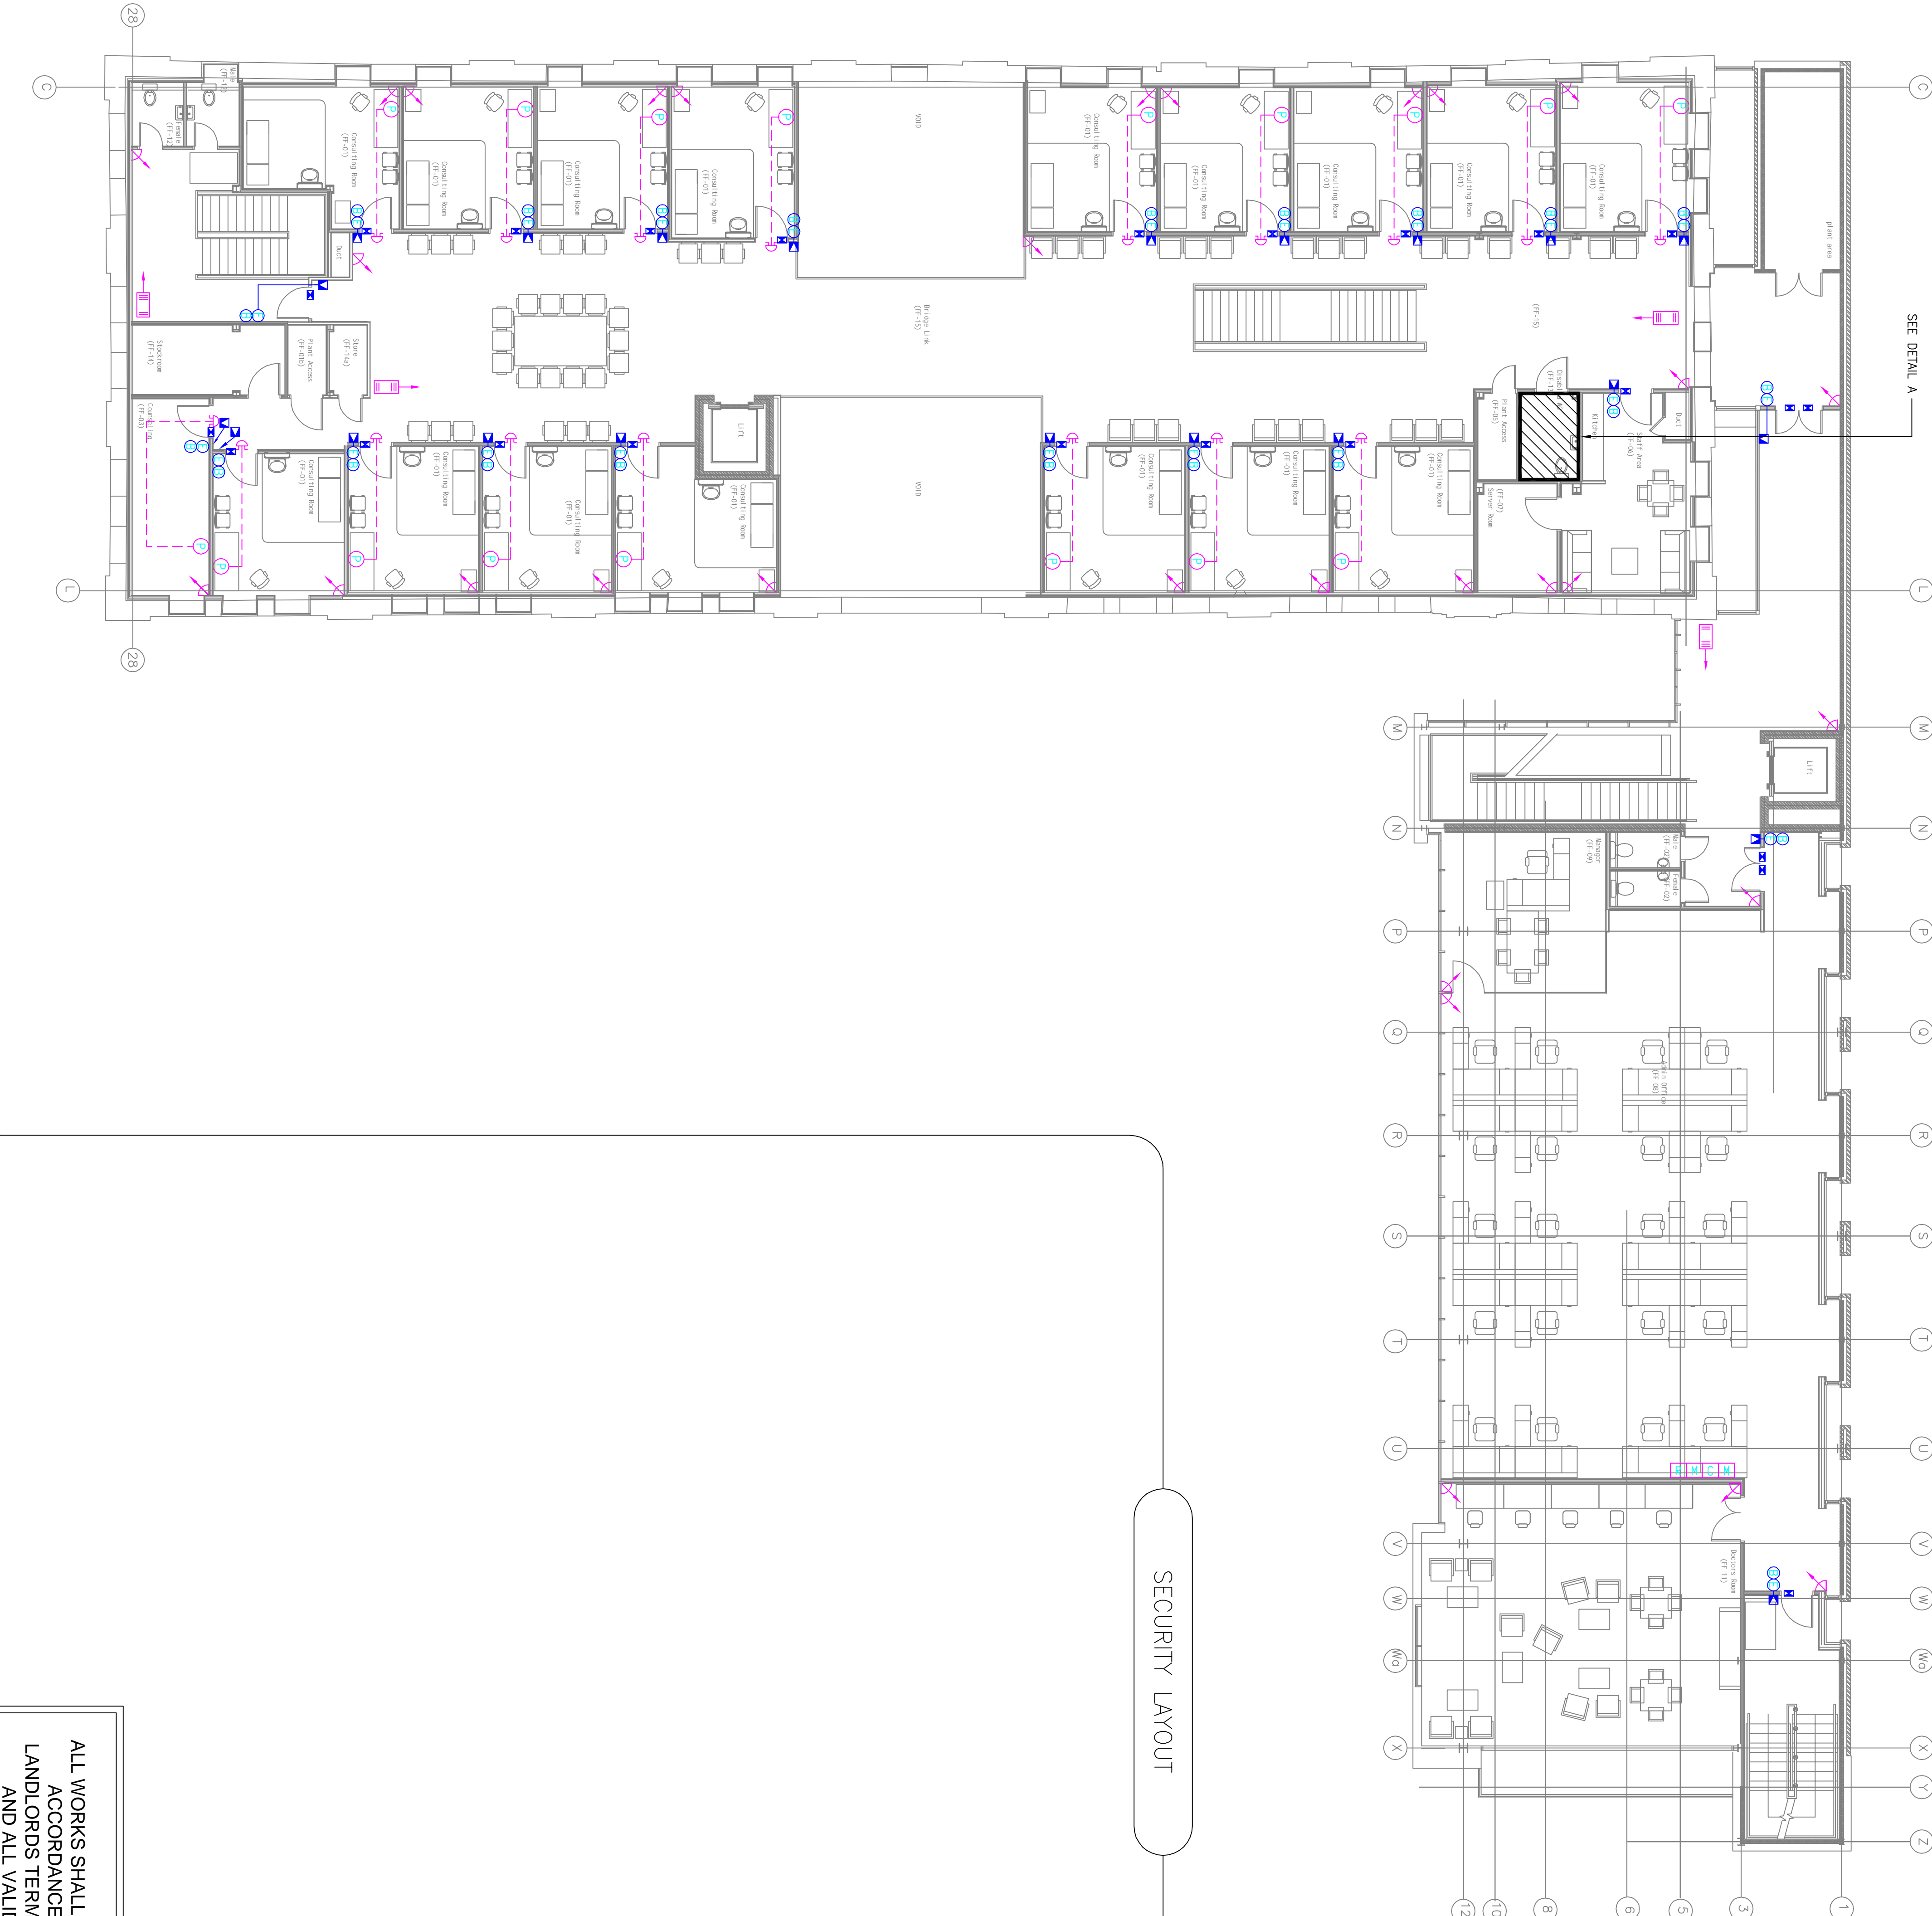

ALL WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH B.S.7671 LANDLORDS TERMS AND CONDITIONS AND ALL VALID LEGISLATION.

REV	REASON FOR REVISION	DR	APP	DATE
T1	Drawing Issue for Tender	CJ	KB	22-08-12
A1	Drawing Issue for approval	CJ	KB	01-08-12
P1	Preliminary drawing Issue for approval & comment	CJ	KB	10-12-11

VERLANE

PROJECT:  
STOURBRIDGE LION MEDICAL CENTRE

TITLE:  
PROPOSED FIRST FLOOR  
FIRE ALARM AND SECURITY  
SERVICES LAYOUT

**Arcobaleno | Consulting Engineers**  
Suite 3, Third Floor,  
104 - 106 Highley Road,  
Wolverhampton,  
West Midlands,  
B69 8LT  
TEL: 0121 455 0225  
E-Mail: [info@arcad.co.uk](mailto:info@arcad.co.uk)

Project No.	Drawing No.	Rev
ABS12/003	01/07/002	T1
Date:	DECEMBER 2012	Scale(s):
Drawn:	C. JONES	Approved:
Drawn:	C. JONES	K. BAWMA
TENDER		