


- NOTES
1. This drawing shall not be used as a working drawing. All scaled dimensions shall be verified on site.
 2. For architectural and structural details please refer to appropriate specialist drawings
 3. Lighting control systems to be agreed with client, based on the following design criteria:


LEGEND

- B3 2 x 5W SURFACE MOUNTED LINEAR FLUORESCENT LUMINAIRE COMPLETE WITH POLYCARBONATE DIFFUSER AND HF CONTROL (SEE 1)
- B4 1 x 5W SURFACE MOUNTED LINEAR FLUORESCENT LUMINAIRE COMPLETE WITH POLYCARBONATE DIFFUSER AND HF CONTROL (SEE 1)
- E1 1 x 8 WATT 3 HOUR MAINTAINED SURFACE MOUNTED EMERGENCY C/W PPS
- E2 1 x 8 WATT 1 HOUR NON MAINTAINED SURFACE MOUNTED EMERGENCY LUMINAIRE C/W PPS
- SHIM E DENOTES 5 AMP BREAKDOWN TRANSITION BREAKER UP OF MAIN LUMINAIRE
- 1/2 2 WATT LIGHTING SWITCH IN DENOTES NUMBER OF SPACES
- 1/2 2 WATT LIGHTING SWITCH IN DENOTES NUMBER OF SPACES


LOCATION PLAN

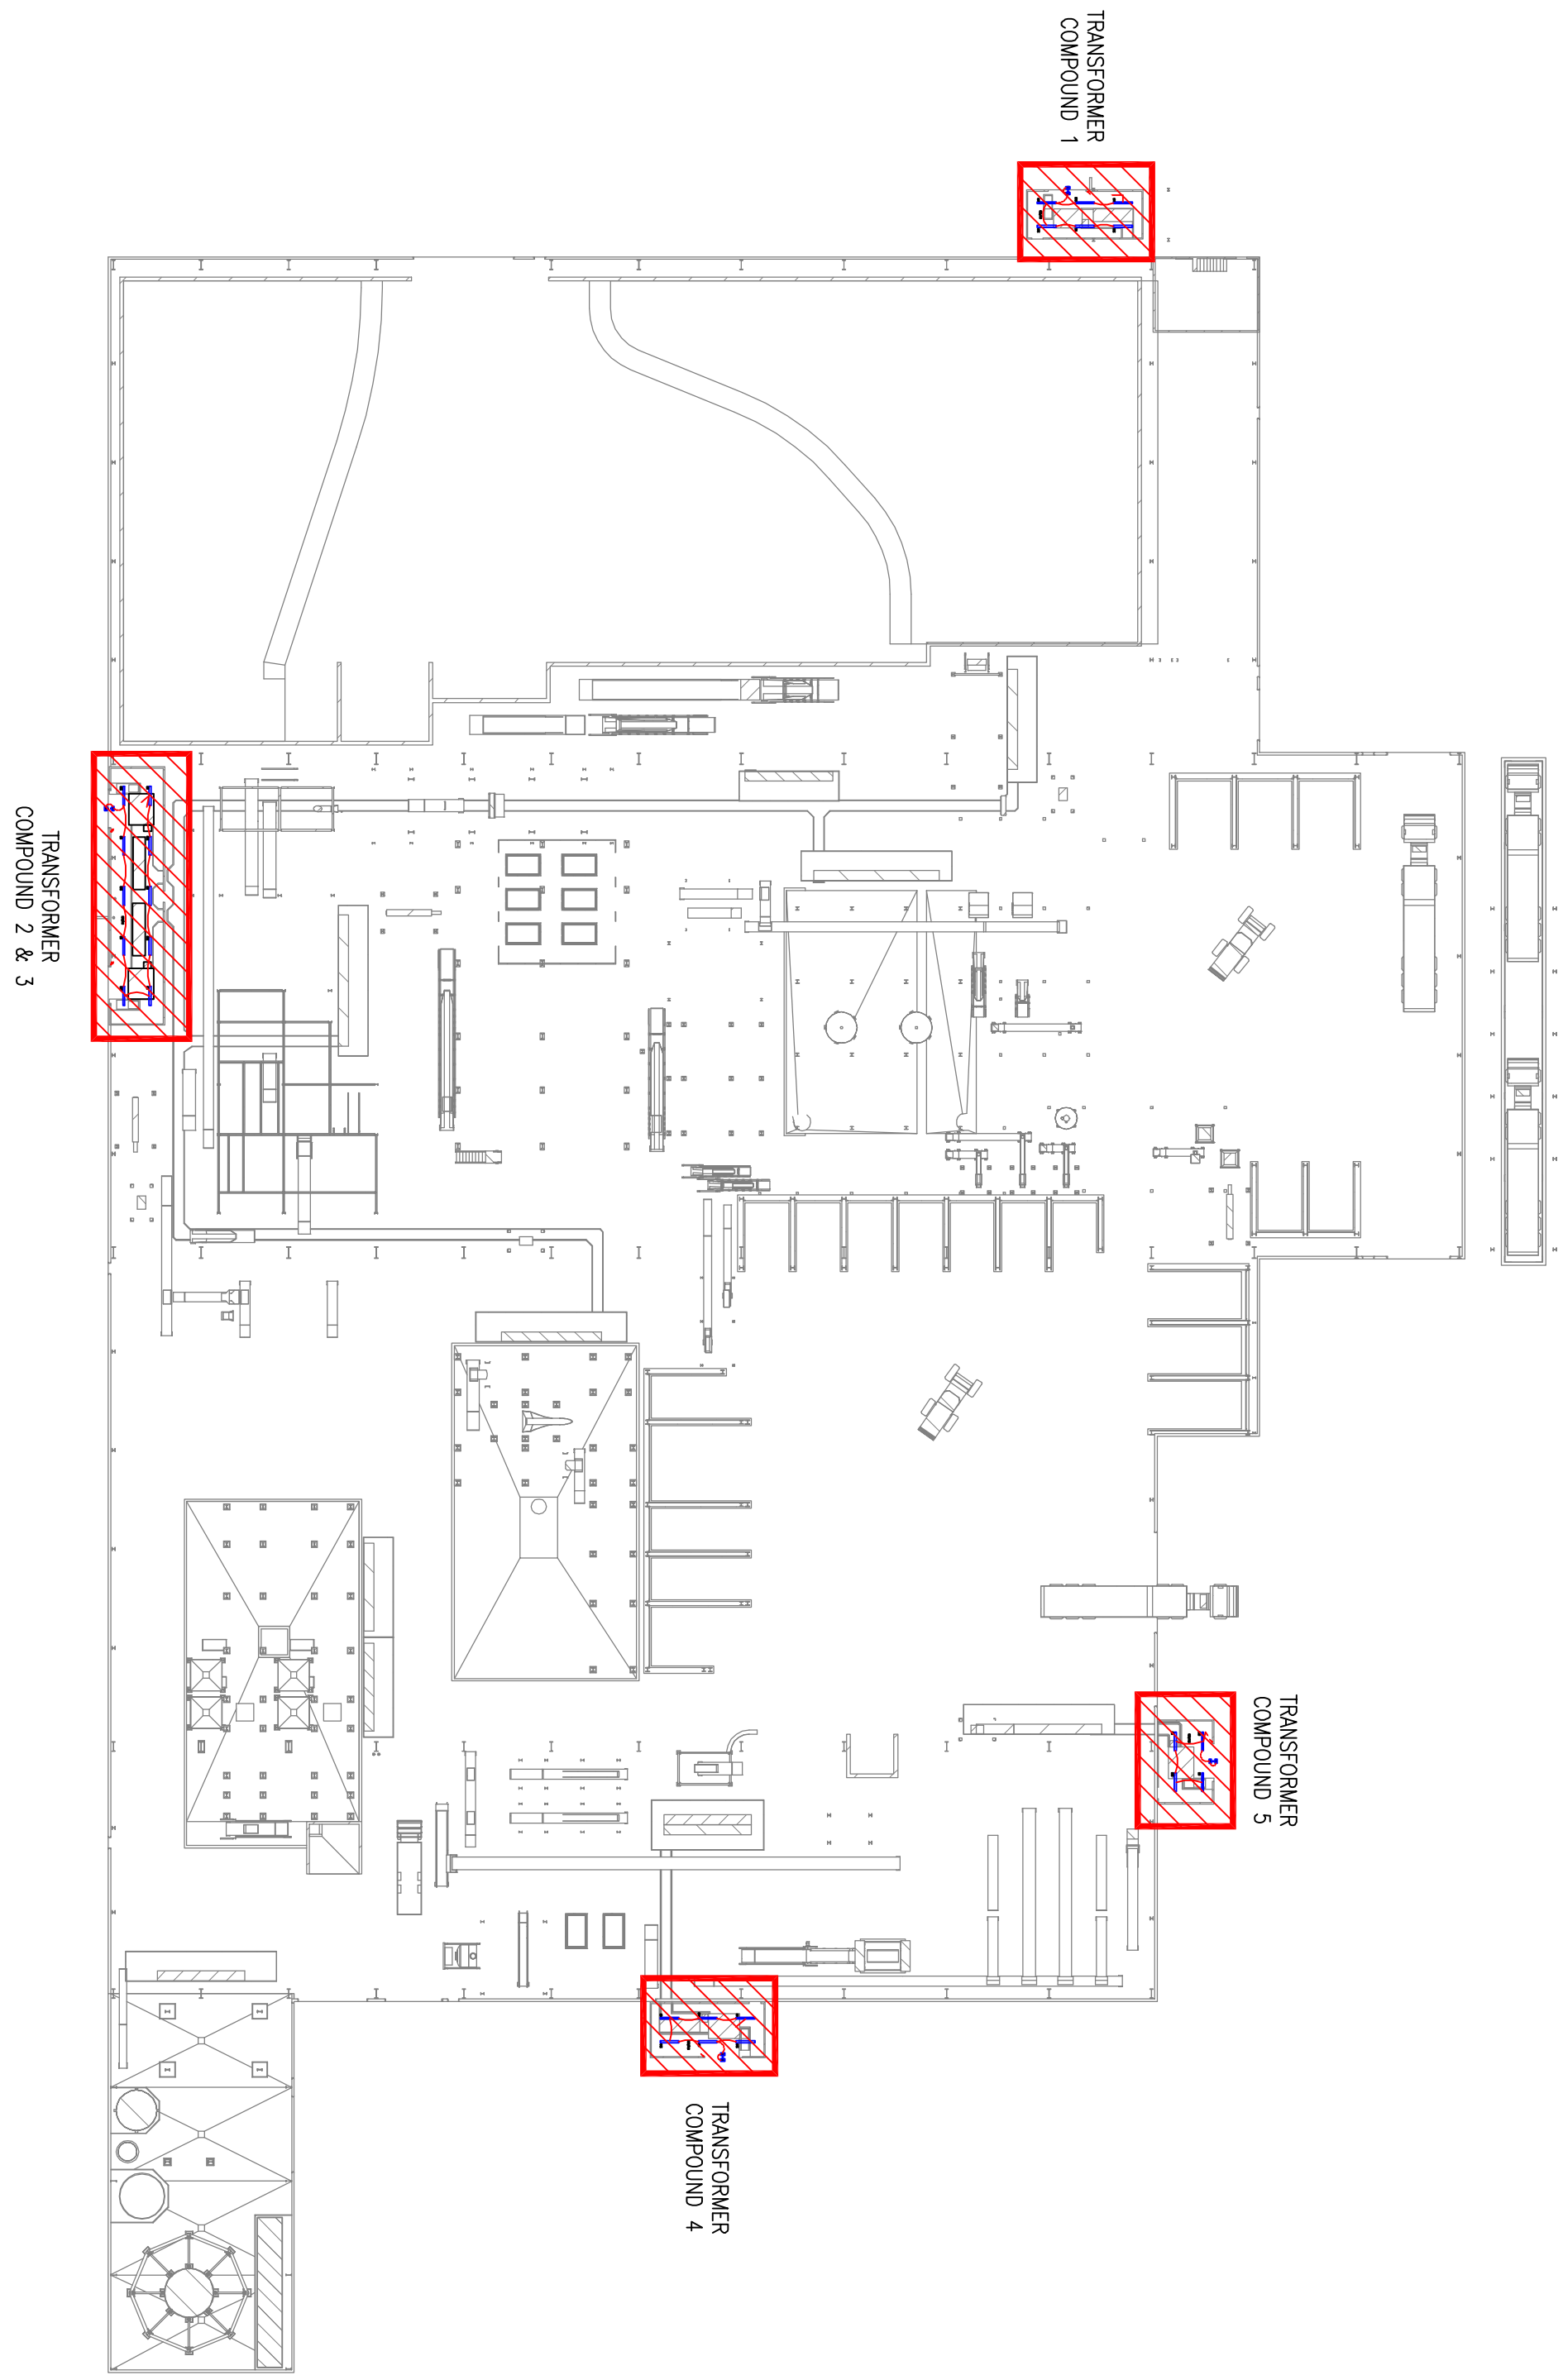


TRANSFORMER COMPOUND 2 & 3

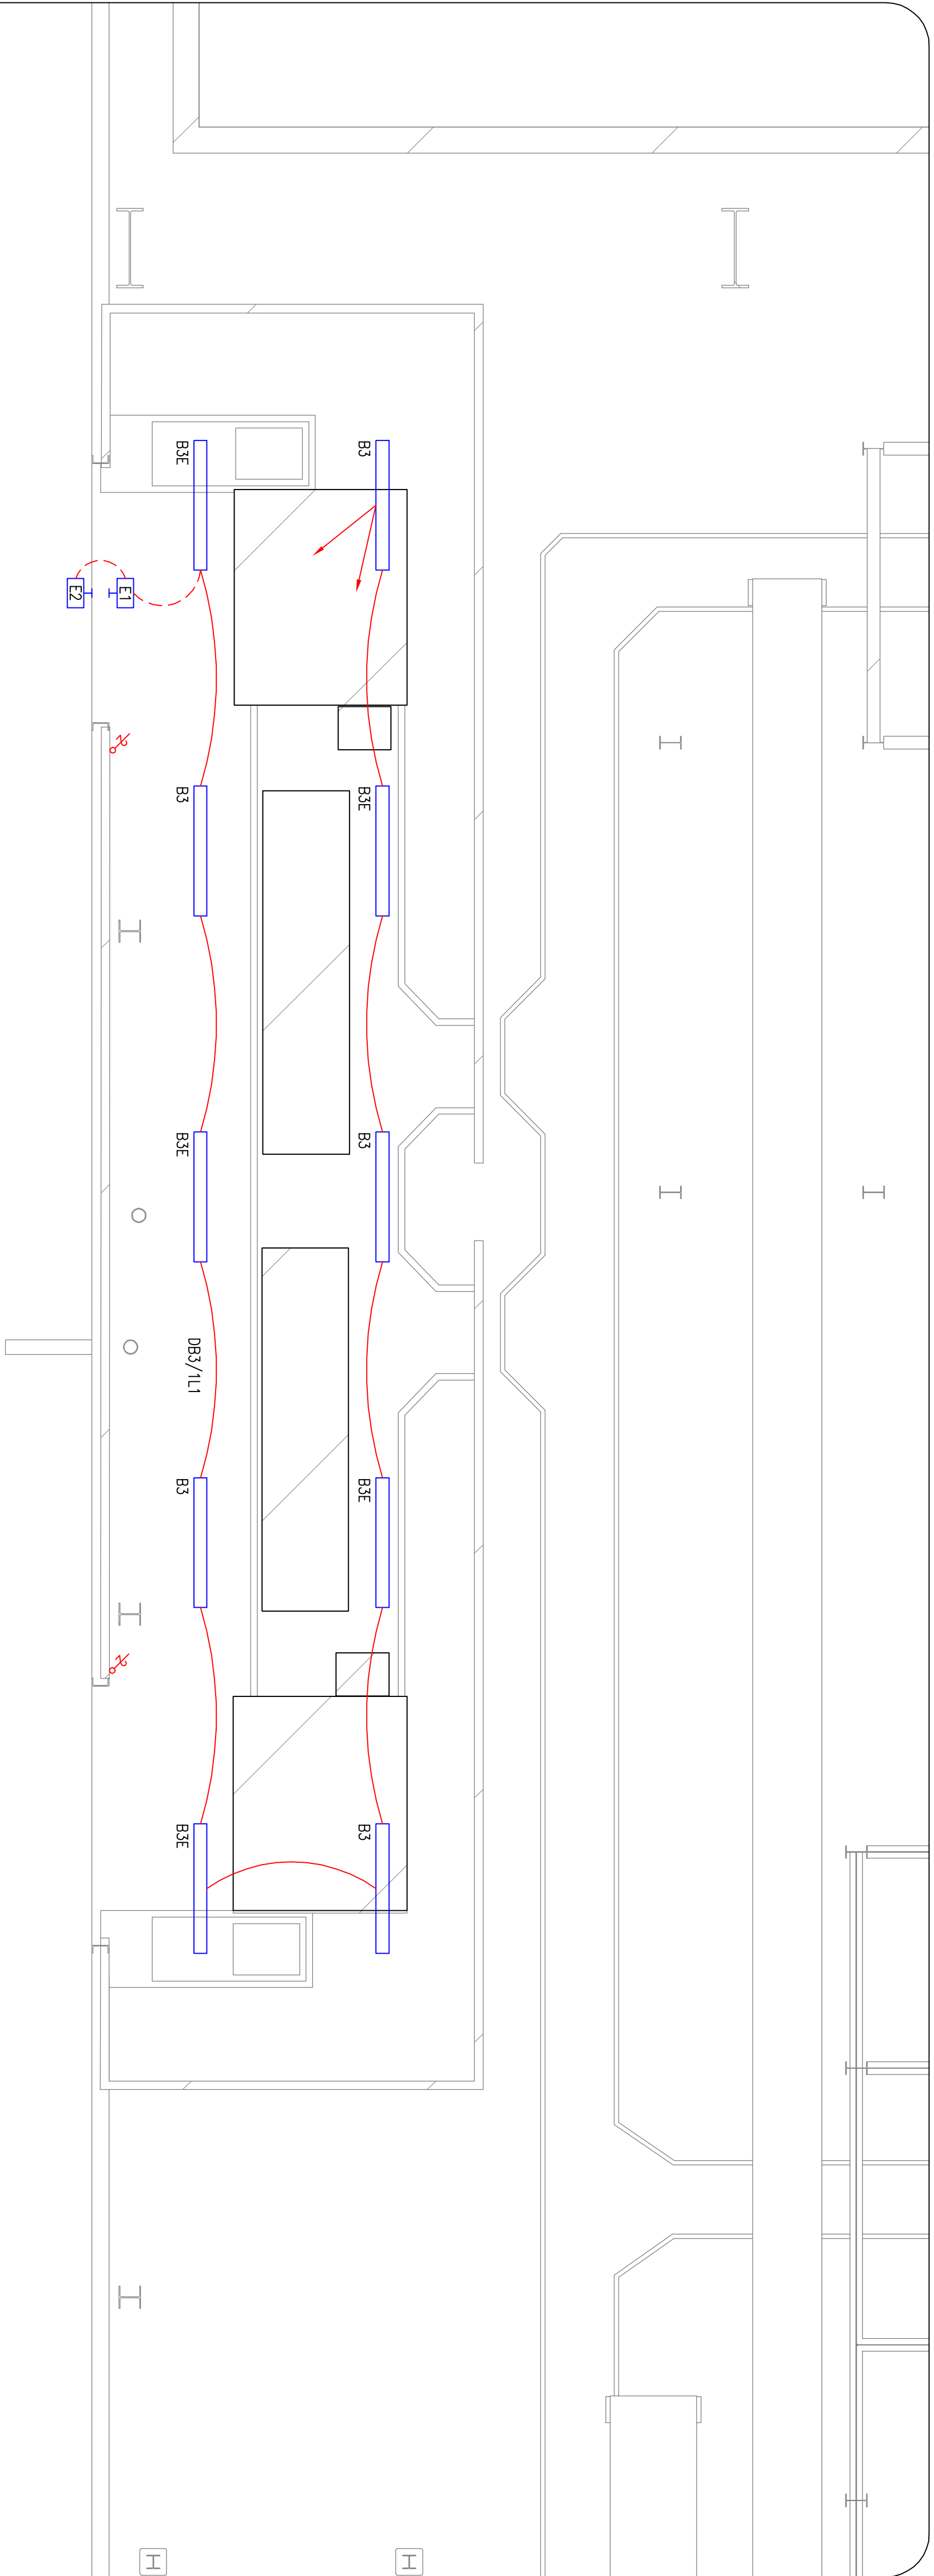

TRANSFORMER COMPOUND 1

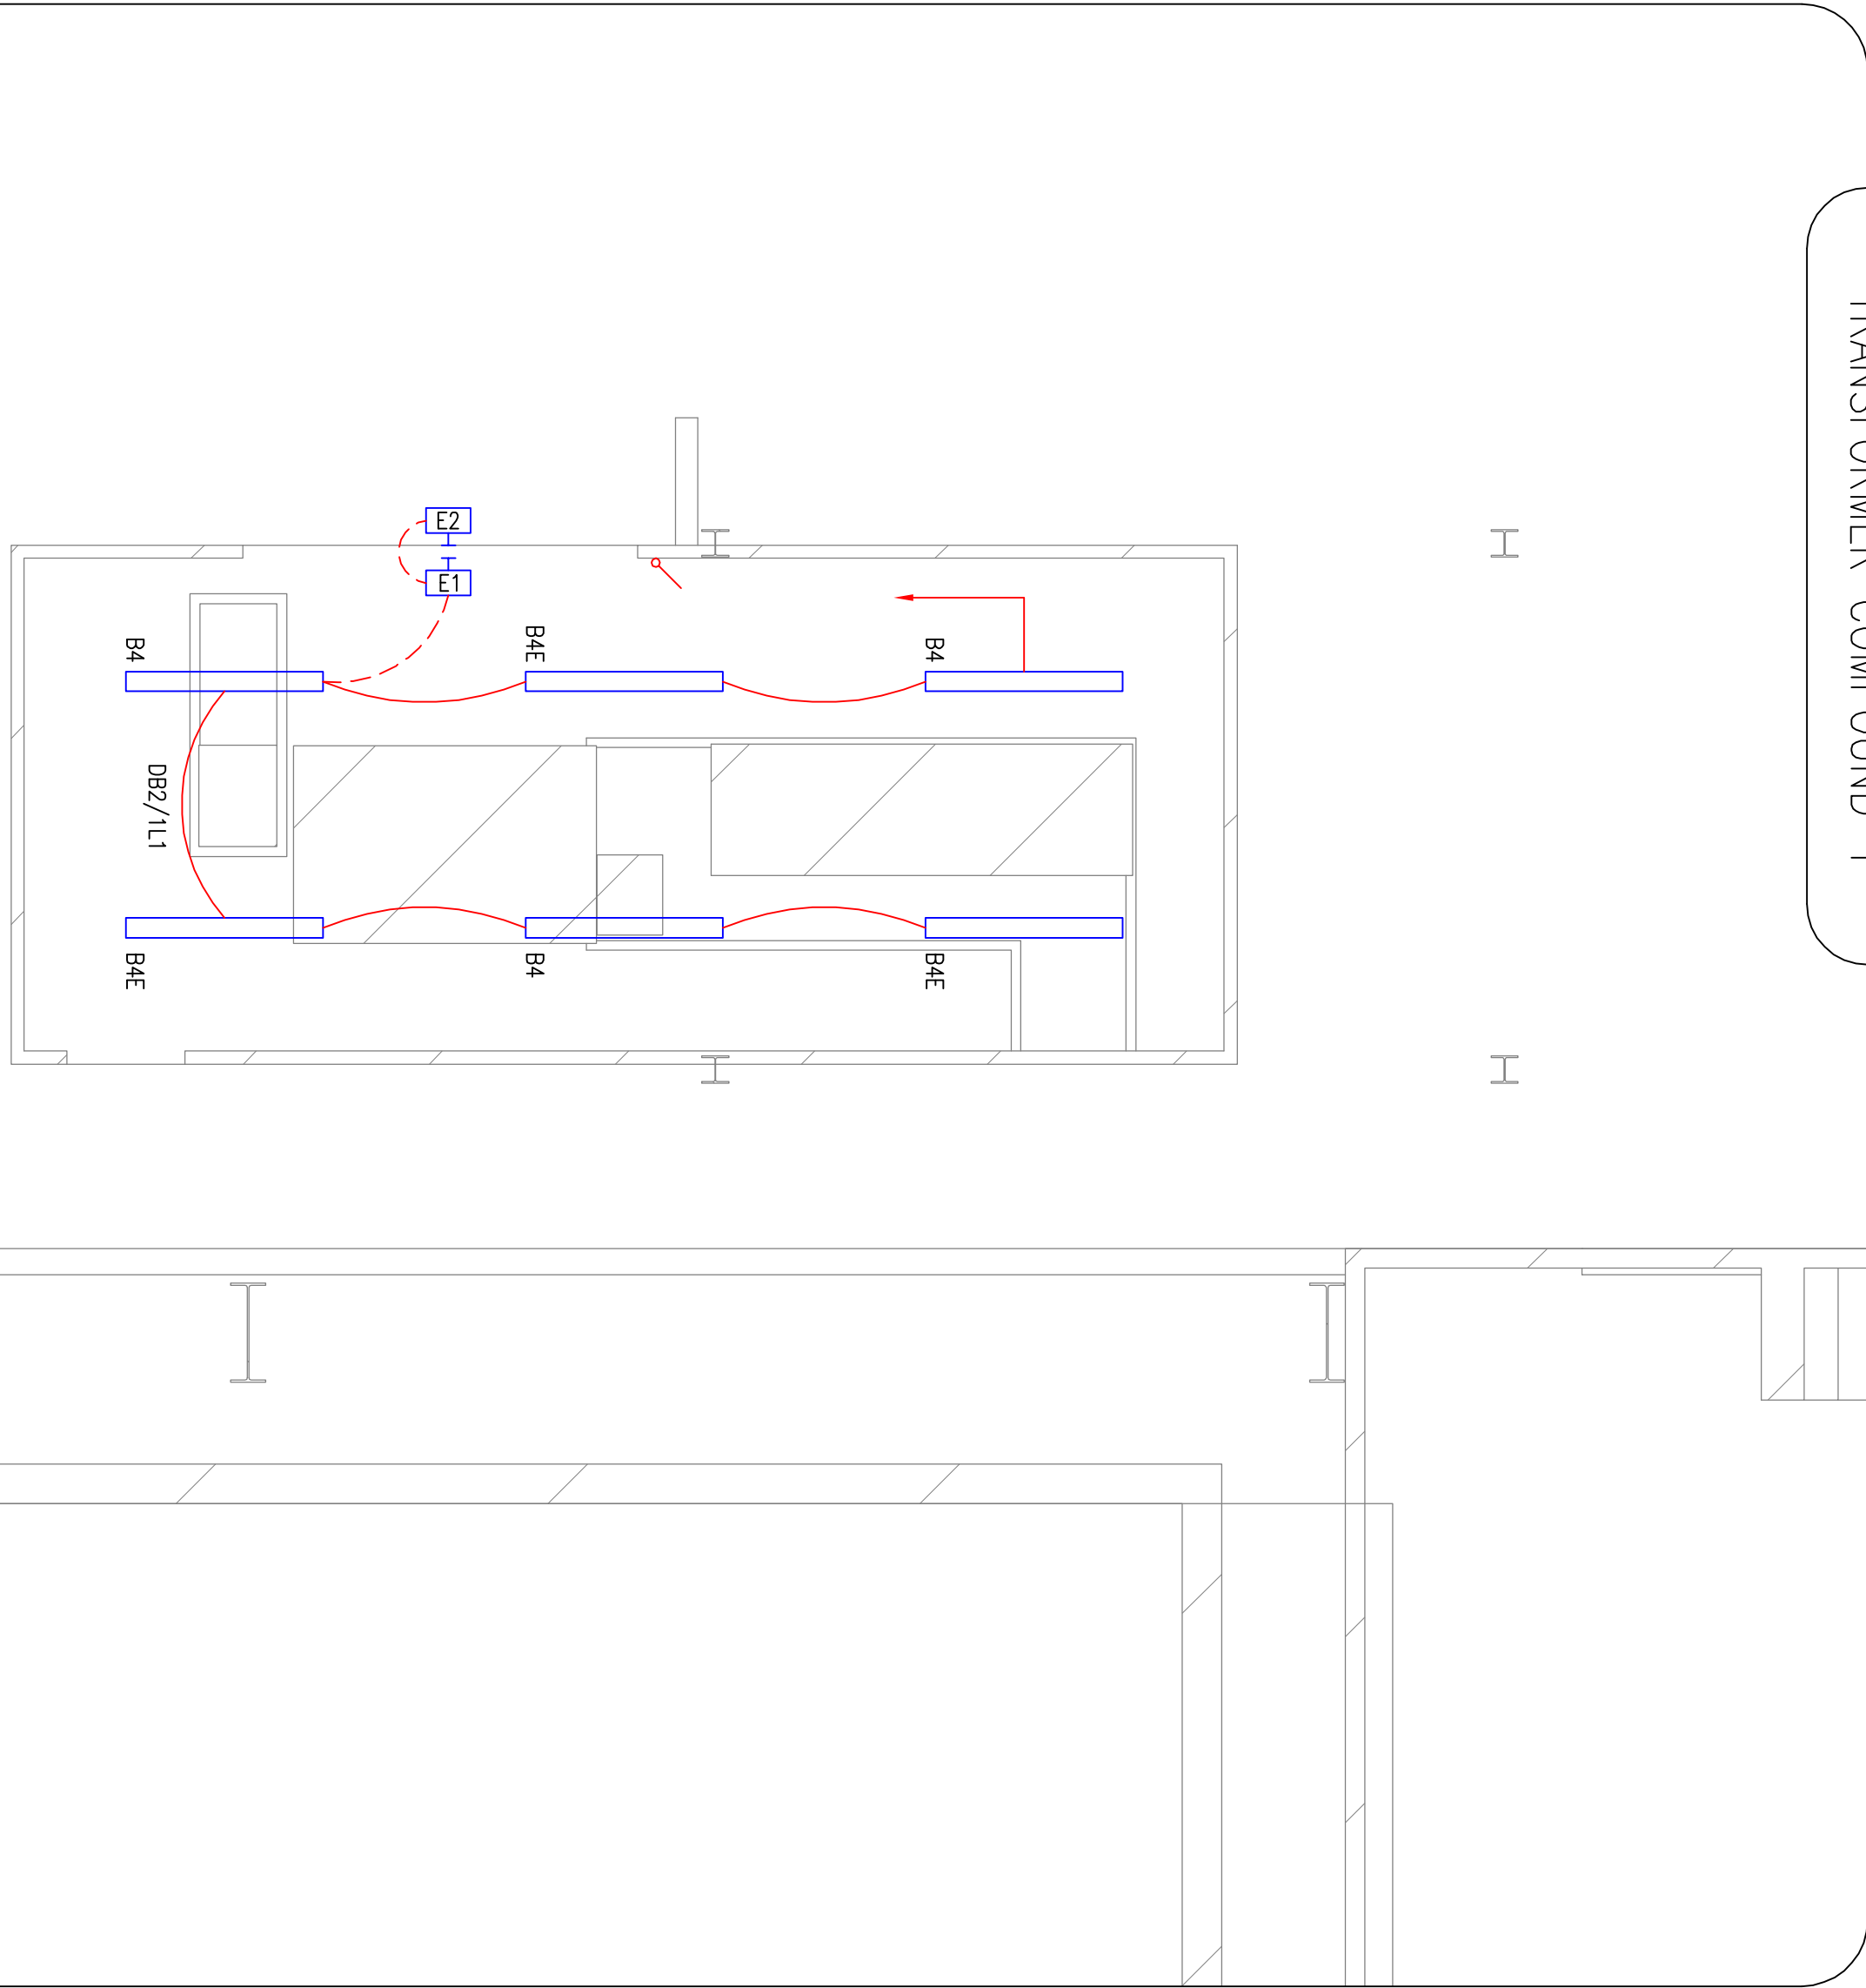

TRANSFORMER COMPOUND 4

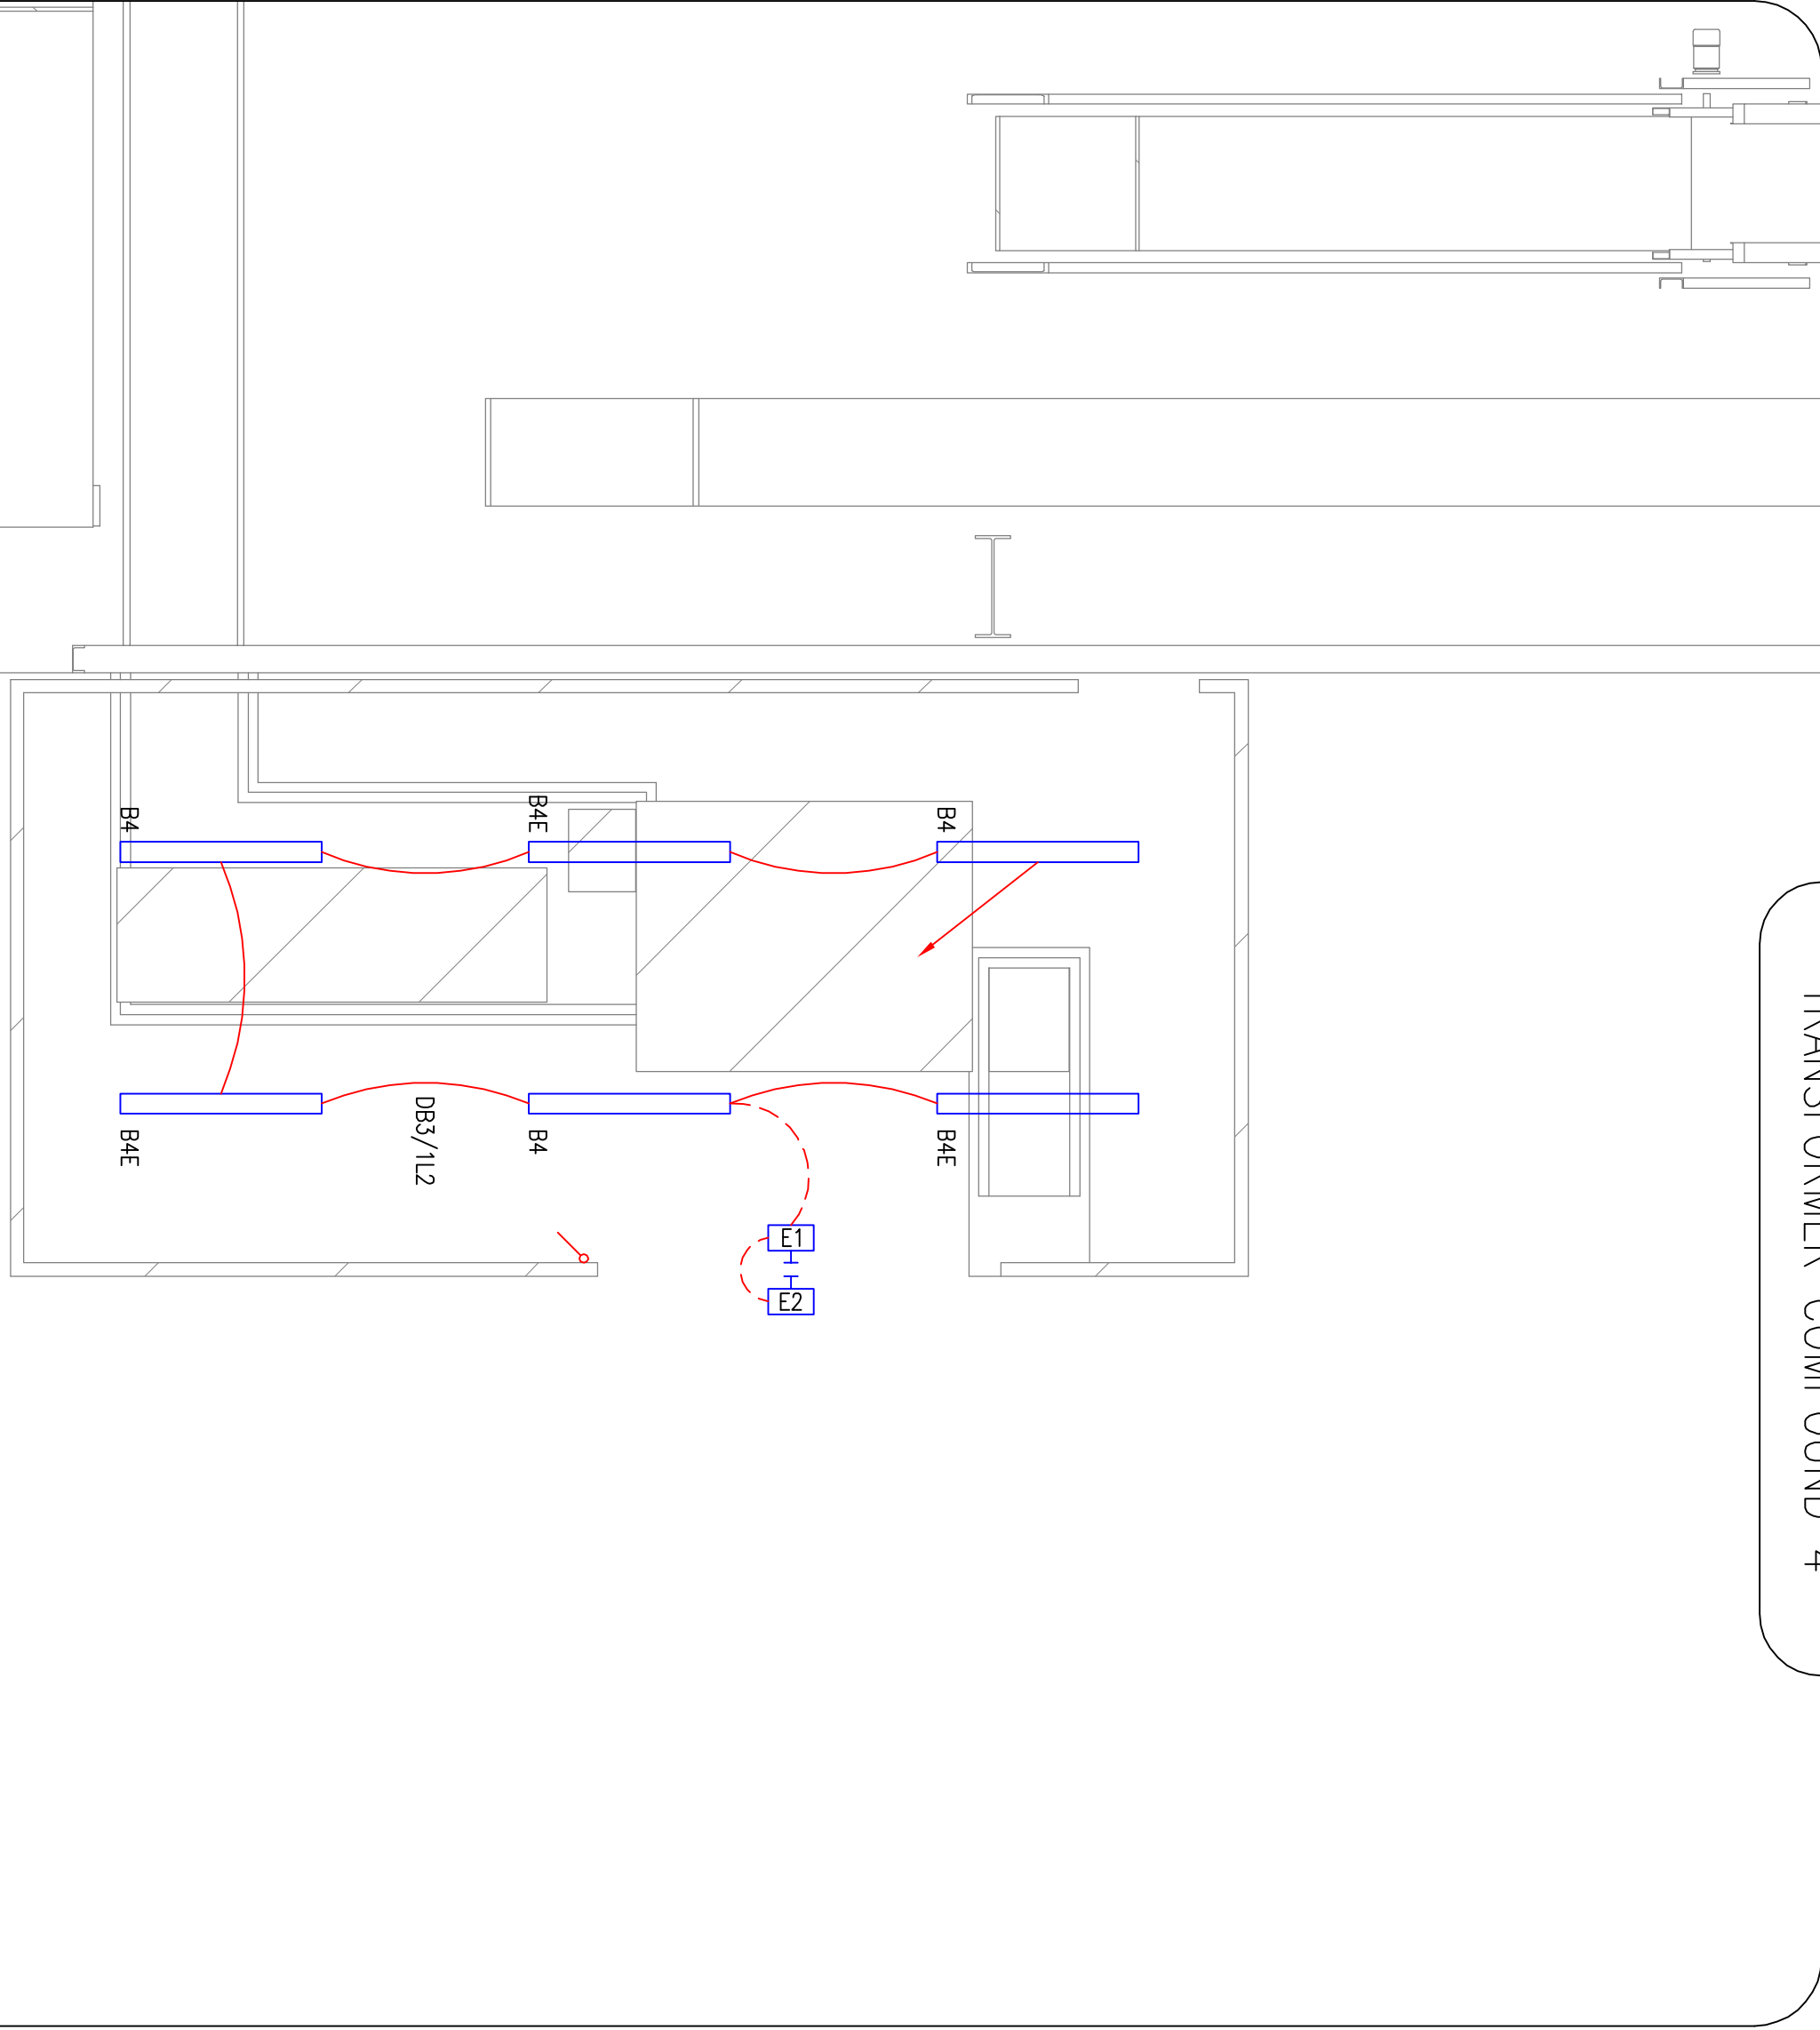

TRANSFORMER COMPOUND 5

