



- THIS DRAWING IS COPYRIGHT AND MAY NOT BE REPRODUCED OR MADE USE OF UNLESS EXPRESSLY AGREED BY EMOR Engineering Services Limited
- NOTES
- This drawing shall not be used as a working drawing. All scaled dimensions shall be verified on site.
 - For architectural and structural details please refer to appropriate specialist drawings.
 - This drawing details the design intent of the lighting and emergency lighting services, for setting out refer to the relevant drawings (02/05/2023).
 - Where 2 or more lighting control RFLs are located in the same room, the lighting control RFLs shall be connected to ensure all luminaires within that room come on at the same time.
- LEGEND
- C1 2 x 20W COMPACT FLUORESCENT RECESSED DOWNLIGHT COMPLETE WITH HF CONTROL GEAR
- C3 1 x 18W COMPACT FLUORESCENT RECESSED DOWNLIGHT COMPLETE WITH HF CONTROL GEAR AND P54 GLASS DIFFUSER
- C4 1 x 20W COMPACT FLUORESCENT RECESSED DOWNLIGHT COMPLETE WITH HF CONTROL GEAR AND P54 GLASS DIFFUSER
- D1 1 x 50W 15 LINEAR FLUORESCENT MODULE RECESSED LUMINAIRE COMPLETE WITH HF CONTROL GEAR AND L27 DIFFUSER
- D2 2 x 40W 15 LINEAR FLUORESCENT MODULE RECESSED LUMINAIRE COMPLETE WITH HF CONTROL GEAR AND L27 DIFFUSER
- D3 1 x 50W 15 LINEAR FLUORESCENT MODULE RECESSED LUMINAIRE COMPLETE WITH HF CONTROL GEAR AND L27 DIFFUSER
- D4 4 x 30W 18 1200 x 600mm LINEAR FLUORESCENT MODULE RECESSED LUMINAIRE COMPLETE WITH HF CONTROL GEAR AND L27 DIFFUSER
- F1 1 x 30W T-CO-DO COMPACT FLUORESCENT SURFACE MOUNTED CIRCULAR LUMINAIRE COMPLETE WITH HF CONTROL GEAR, P54 GLASS DIFFUSER AND P54 GLASS DIFFUSER
- R 1 x 20W T-CO-DO COMPACT FLUORESCENT SURFACE MOUNTED CIRCULAR LUMINAIRE COMPLETE WITH HF CONTROL GEAR, P54 GLASS DIFFUSER AND P54 GLASS DIFFUSER
- E1 1 x 8 WMT 3 HOUR MAINTAINED SURFACE MOUNTED EMERGENCY LUMINAIRE C/W EMERGENCY EXIT SOUNGE
- E2 1 x 8 WMT 3 HOUR NON MAINTAINED SURFACE MOUNTED EMERGENCY LUMINAIRE C/W P55 POLYCARBONATE DIFFUSER
- Safe E DENOTES 3 HOUR EMERGENCY CONNECTION BATTERY BACK UP OF MAIN LUMINAIRE
- N 1 WAY LIGHTING SWITCH, N DENOTES NUMBER OF PAVES
- * EMERGENCY LIGHTING TEST KEY SWITCH
- + RECESSED LIGHTING CONTROL, PIR MOTION SENSOR
- DISTRIBUTION BOARD

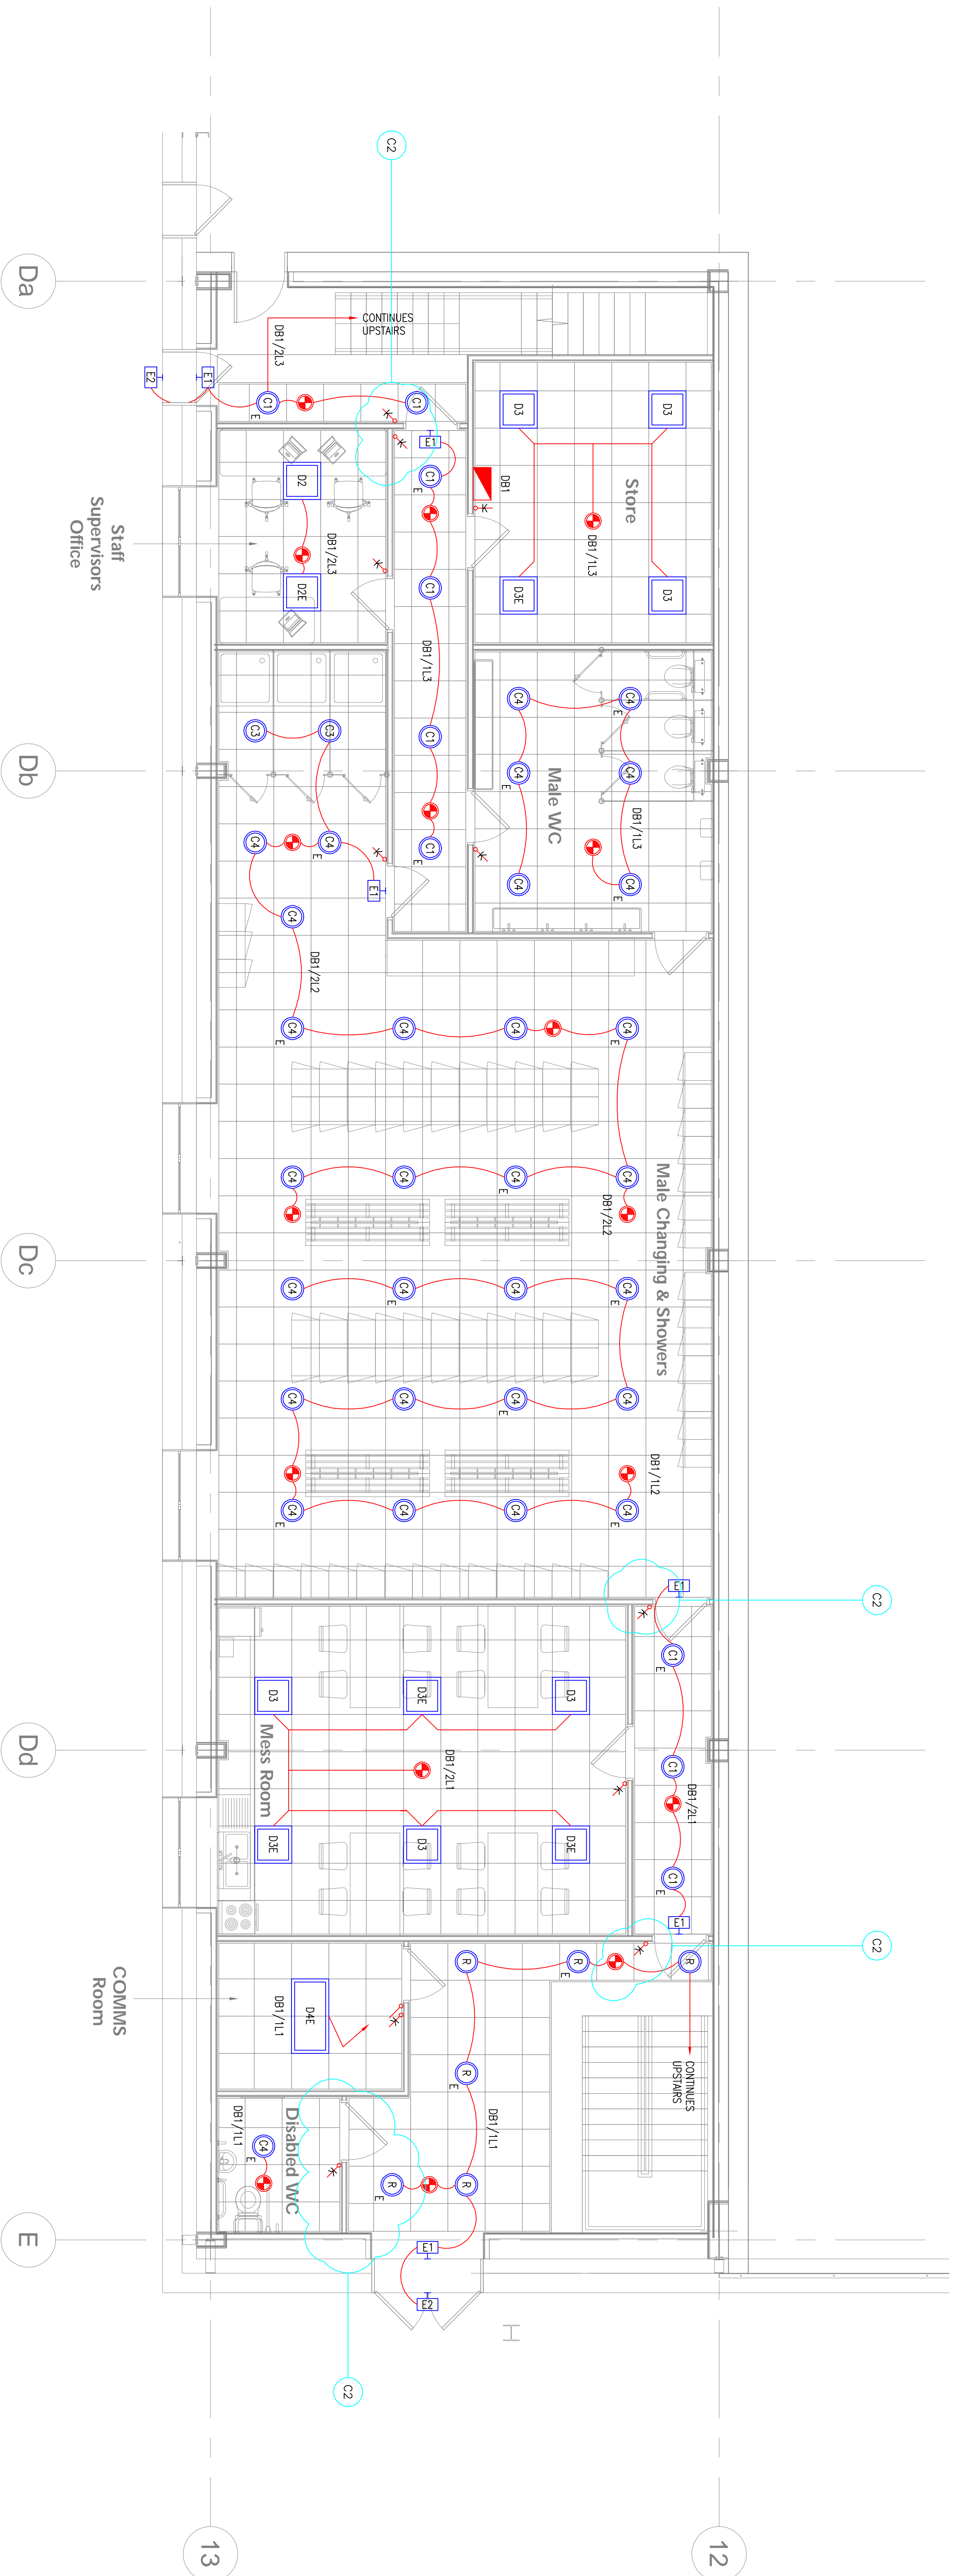

C2	EMERGENCY LIGHTING MOUNTED TEST SWITCH	24x13	CJ
C1	EMERGENCY LIGHTING MOUNTED & 20 W. 40W. 40W.	13x13	CJ
A1	ISSUED FOR APPROVAL STATUS	7.2.13	CJ

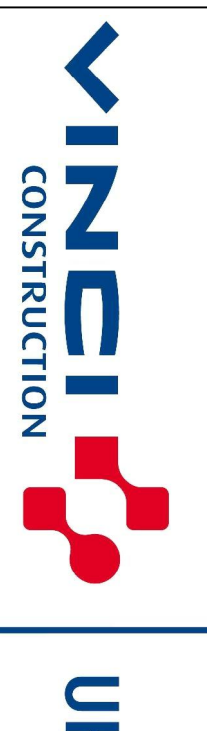

IES OLDBURY

Project

00/63/008

EMR OFFICES LIGHTING AND EMERGENCY LIGHTING LAYOUT

Electrical

CONSTRUCTION

Drawn

Job

00/63/008

00/63/008