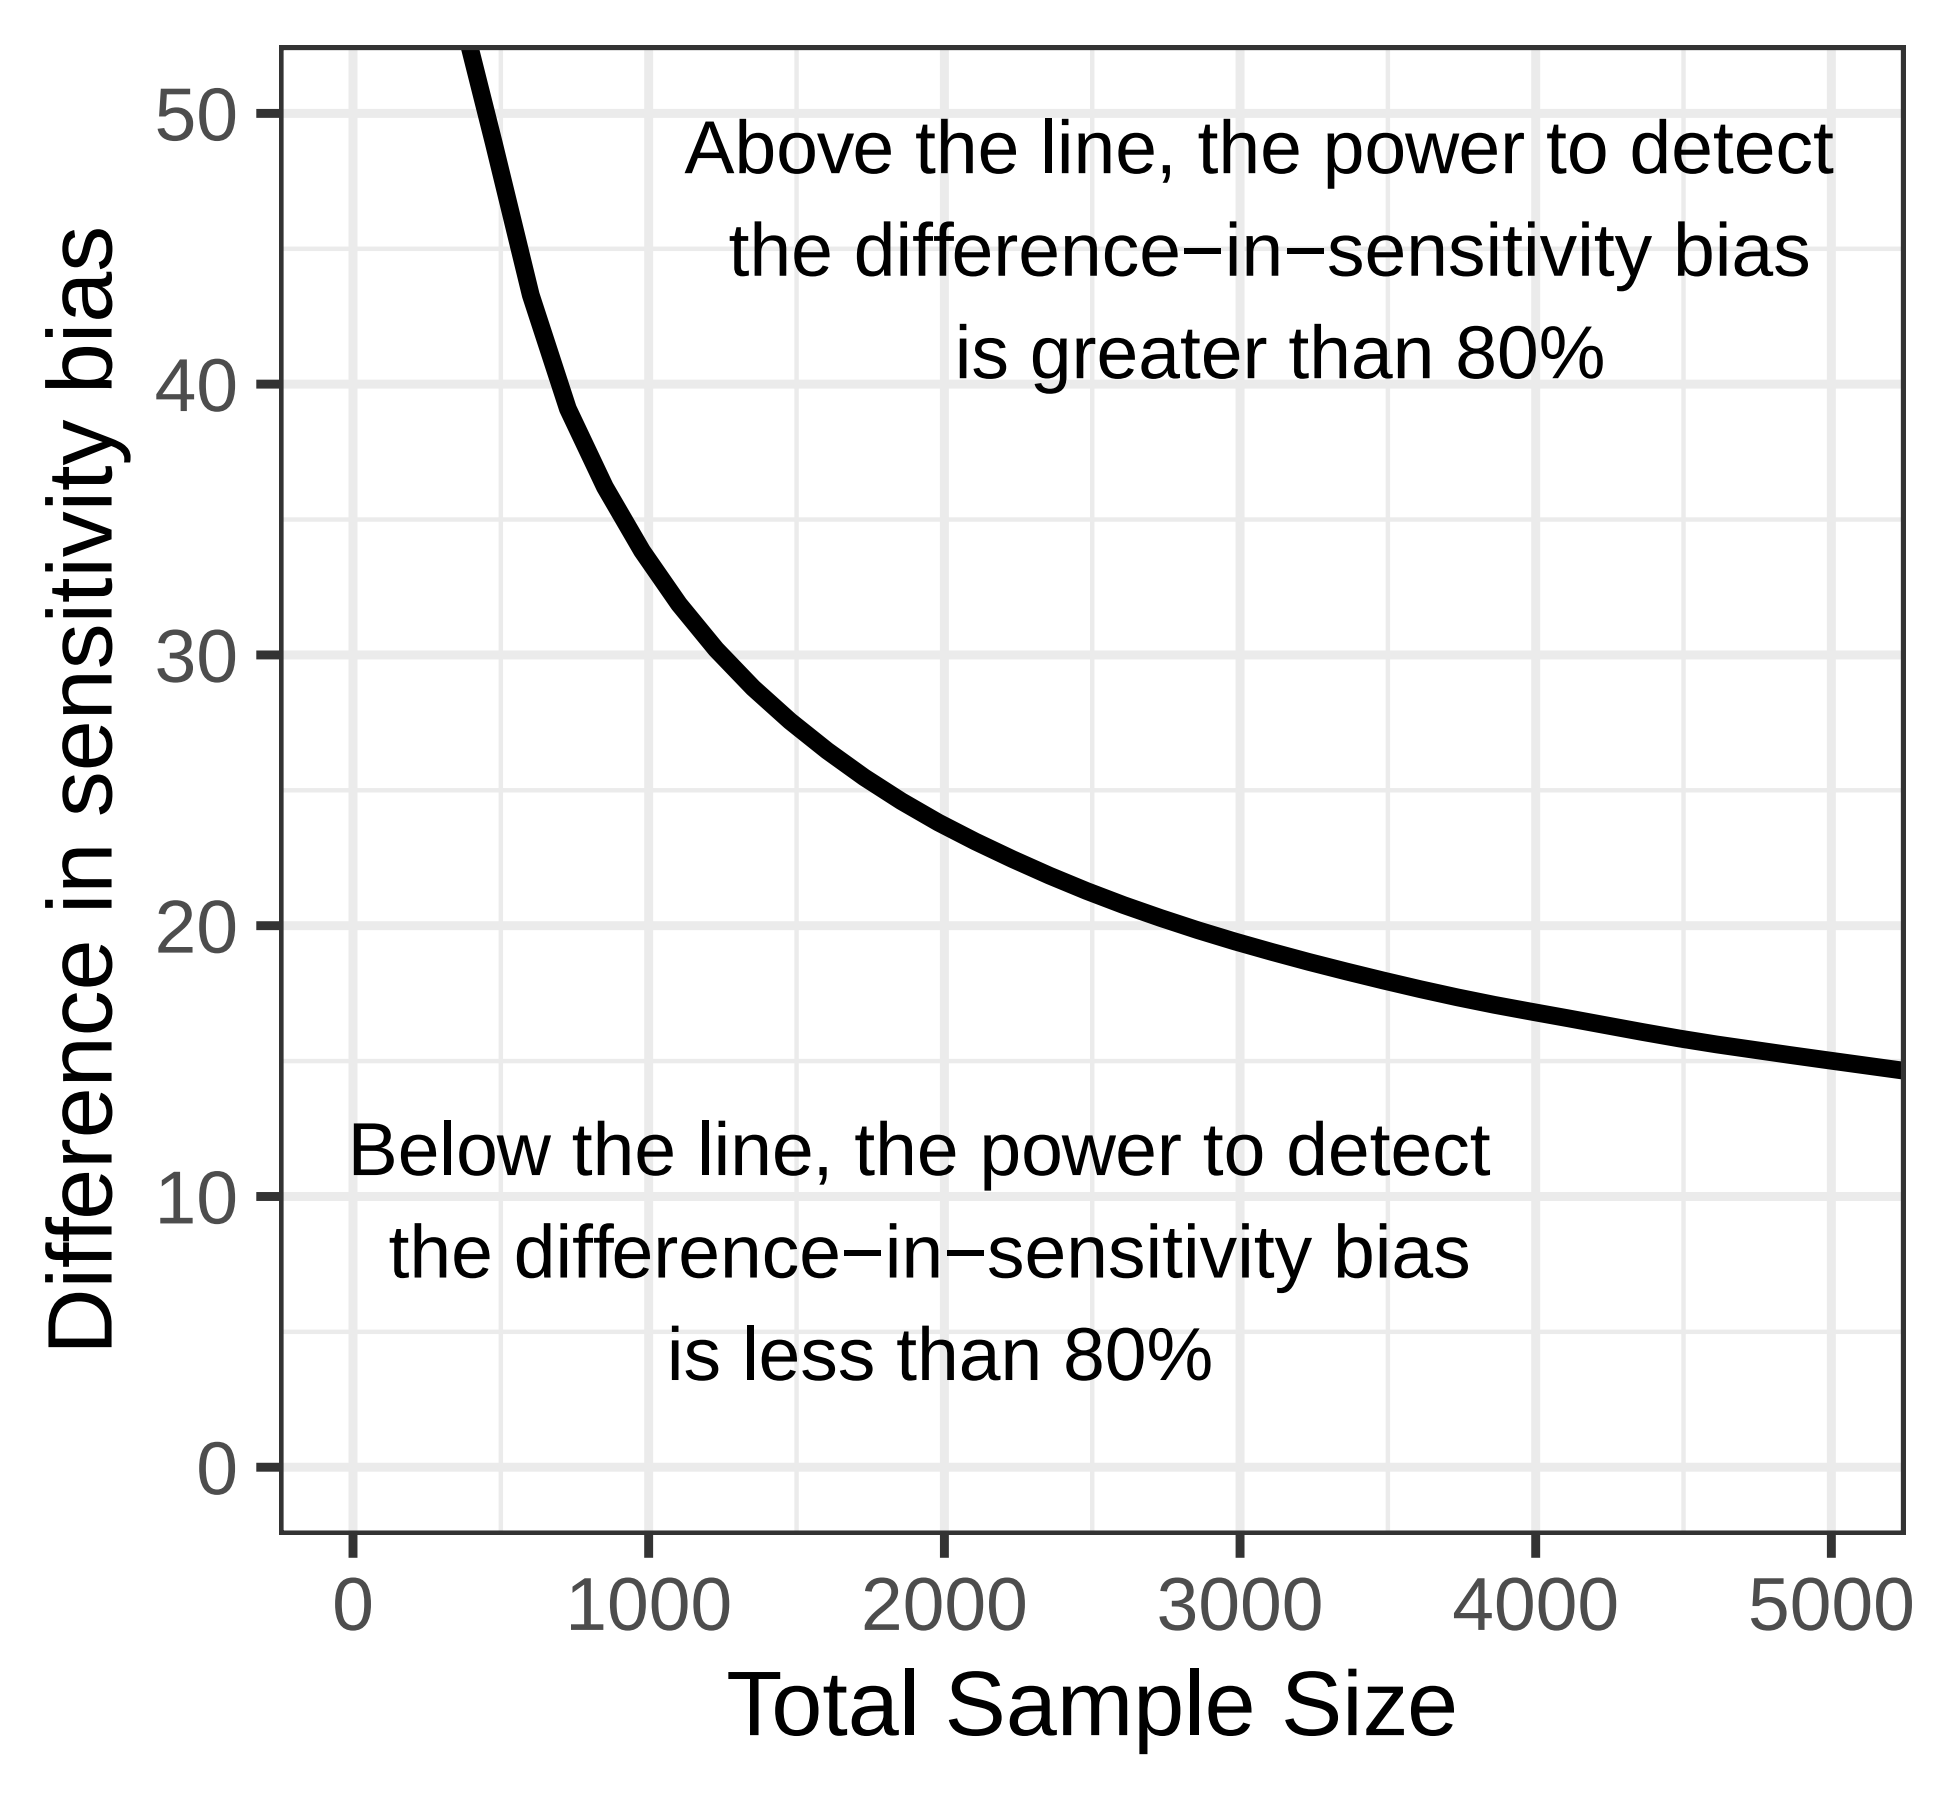
Above the line, the power to detect
the difference−in−sensitivity bias
is greater than 80%
Below the line, the power to detect
the difference−in−sensitivity bias
is less than 80%
Difference in sensitivity bias
50
40
30
20
10
0
0
1000
2000
3000
4000
5000
Total Sample Size