DEMONSTRATION ONLY — NOT A QUALIFIED PROCEDURE; THE FACILITY OWNER'S QUALIFIED PROCEDURES AND APPLICABLE CODES GOVERN.

WO-500-01 — Replace 3 supports on 8"-P150-FL-2009

Area	A500 Pipe rack	**Task**	SP Pipe support replacement
Priority	3 (reliability)	**Issued by**	Facility owner (demonstration)
Primary asset	rack-bent:720 — Pipe rack bent at E 60'-0" — E 60'-0" N 0.000" EL 122'-0"		
Equipment	—	**Lines**	8"-P150-FL-2009
Isometrics	ISO-8"-P150-FL-2009 (generated); owner's drawings ISO-FL-2009		
Permits	General work permit, Hot work permit		

Reason

Corroded shoes and guides on the flare header.

Scope of work

1. Support 8"-P150-FL-2009 temporarily either side of each support location.
2. Cut out guide 8"-P150-FL-2009/S1 at E 40'-0" N 4'-6" EL 122'-0"; prepare surfaces.
3. Cut out shoe 8"-P150-FL-2009/S2 at E 60'-0" N 4'-6" EL 122'-0"; prepare surfaces.
4. Cut out guide 8"-P150-FL-2009/S3 at E 80'-0" N 4'-6" EL 122'-0"; prepare surfaces.
5. Weld new supports to WS-03; VT and MT of every fillet weld (SW-NDE-3).
6. Remove temporary supports; check the line rests on every support.

Affected items: 8"-P150-FL-2009/S1, 8"-P150-FL-2009/S2, 8"-P150-FL-2009/S3

Rules: SW-ITP-1, SW-ITP-2, SW-ITP-3, SW-NDE-3, SW-PS-12, SW-WO-1, SW-WO-2, SW-WO-7, SW-WPS-1

Owner's isometric drawings (SW-IMP-6)

Drawing	Line drawn	Work line	Sheets	Match to the plant model
ISO-FL-2009	8"-P150-FL-2009	8"-P150-FL-2009	5	0 error(s), 1 warning(s) — see below

ISO-FL-2009 (PDF): ../isometrics-imported/ISO-FL-2009.pdf — the generated isometrics follow the ITP.

Drawing	Sheet	Level	Finding
ISO-FL-2009	1	warning	weld 8"-P150-FL-2009/W2 (E 21'-11 5/16" N 4'-6" EL 123'-0", sheet 1) has no label

Assets in the plant model (SW-WO-7)

Tag	Kind	Description	Line	Location
rack-bent:720	structure	Pipe rack bent at E 60'-0"		E 60'-0" N 0.000" EL 122'-0"
8"-P150-FL-2009/S1	support	GUIDE FOR 8" LINE (GUIDE-8)	8"-P150-FL-2009	E 40'-0" N 4'-6" EL 122'-0"
8"-P150-FL-2009/S2	support	SHOE FOR 8" LINE (SHOE-8)	8"-P150-FL-2009	E 60'-0" N 4'-6" EL 122'-0"
8"-P150-FL-2009/S3	support	GUIDE FOR 8" LINE (GUIDE-8)	8"-P150-FL-2009	E 80'-0" N 4'-6" EL 122'-0"

Parts

Description	Qty	Replaces
GUIDE FOR 8" LINE (GUIDE-8)	1	8"-P150-FL-2009/S1
SHOE FOR 8" LINE (SHOE-8)	1	8"-P150-FL-2009/S2
GUIDE FOR 8" LINE (GUIDE-8)	1	8"-P150-FL-2009/S3

New welds (SW-WO-4)

Weld	Replaces	On drawing	Line	Size	Wall	Shop/field	Spec	NDE	Location	Welder	Date
WO-500-01-W01	8"-P150-FL-2009/S1	—	8"-P150-FL-2009	8" P150	—	field	WS-03	VT + MT	E 40'-0" N 4'-6" EL 122'-0"		
WO-500-01-W02	8"-P150-FL-2009/S2	—	8"-P150-FL-2009	8" P150	—	field	WS-03	VT + MT	E 60'-0" N 4'-6" EL 122'-0"		
WO-500-01-W03	8"-P150-FL-2009/S3	—	8"-P150-FL-2009	8" P150	—	field	WS-03	VT + MT	E 80'-0" N 4'-6" EL 122'-0"		

Welding specification WS-03 — Fillet welds of support attachments

DEMONSTRATION ONLY — NOT A QUALIFIED PROCEDURE; THE FACILITY OWNER'S QUALIFIED PROCEDURES AND APPLICABLE CODES GOVERN.

Scope	Shoes, guides and anchors to pipe or steel
Joint	Fillet, leg per the support part (SW-PS-12)
Process	Shielded metal arc throughout
Filler	SW-F2 covered electrode
Preheat	≥ 30 °F above dew point and ≥ 60 °F
Interpass	≤ 450 °F
Post-weld heat treatment	None
Rules	SW-WPS-1, SW-WPS-2, SW-WPS-3, SW-PS-12

NDE

Method	Extent	Welds	Basis
VT + MT	100 % of attachment fillet welds	WO-500-01-W01, WO-500-01-W02, WO-500-01-W03	SW-NDE-3

Inspection and test plan (SW-ITP-1..3)

H hold · W witness · R review · S surveillance. Status: accepted / rejected / not applicable.

#	Activity	Reference	Acceptance	Record	Contr.	Owner	3rd party	Status	Signed (contr. / owner / 3rd)	Date	Remark
1	Temporary supports in place; line load taken	Owner rigging procedure	Line held at its elevation	Daily report	H	W	—				
2	Old supports removed; pipe surface inspected under the support	SW-NDE-4	No wall loss beyond the owner's criteria (else raise a spool work order)	Inspection record	W	H	—				
3	New supports welded to WS-03	WS-03, SW-WPS-3	Fit and leg as specified	Weld record	S	S	—				
4	VT and MT of every attachment weld	SW-NDE-3	No crack or lack of fusion	VT/MT reports	W	R	R				
5	Records complete; work order handed back to operations	SW-ITP-3	All ITP activities accepted or not applicable	Signed ITP and completion record	H	H	R				

ISOMETRIC — 8"-P150-FL-2009 — Replace 3 supports on 8"-P150-FL-2009

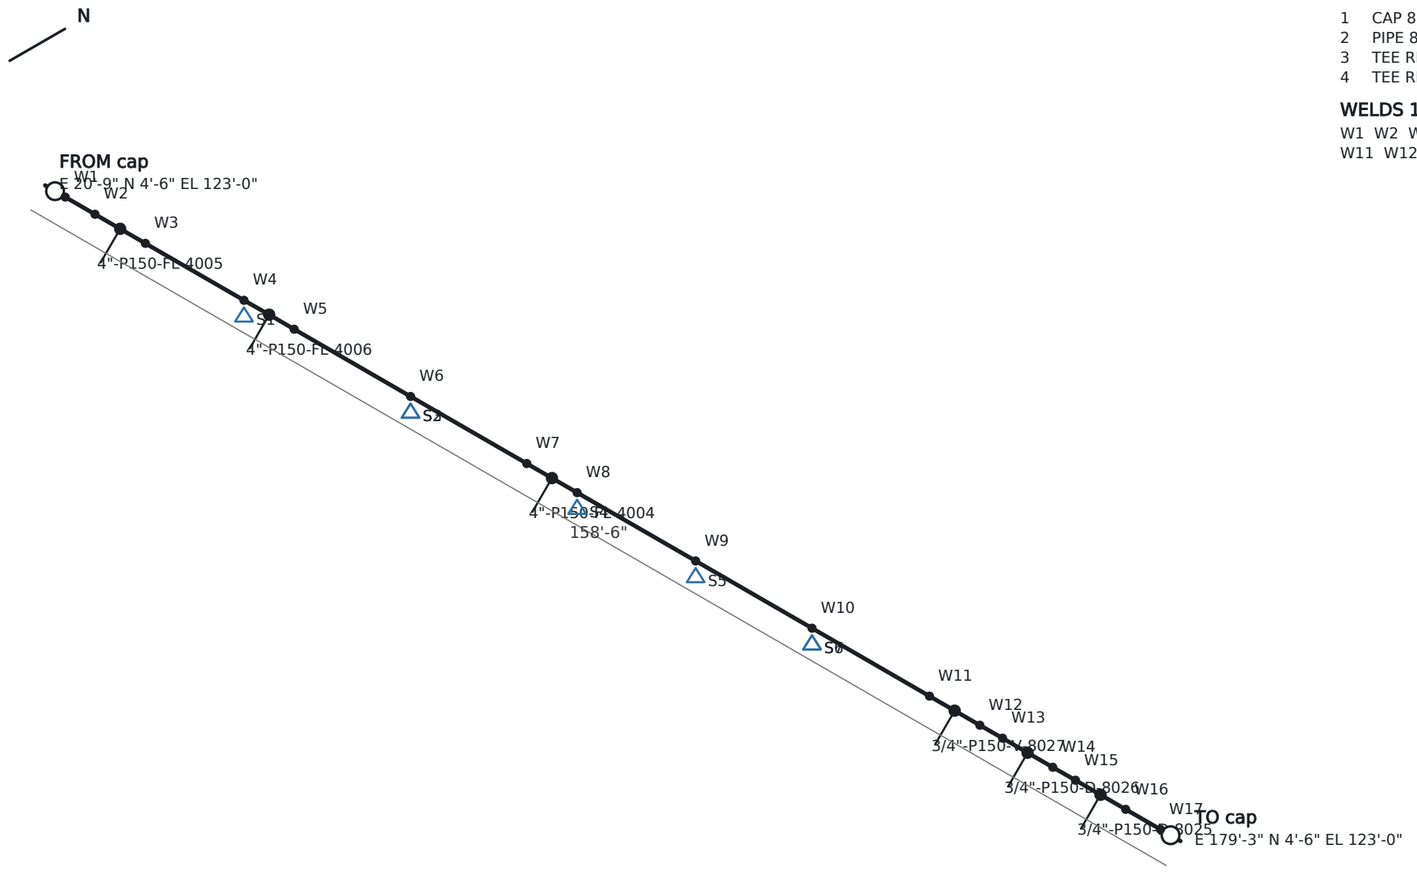

BILL OF MATERIALS

1	CAP 8" P150	2
2	PIPE 8" P150 BEVELLED ENDS	151'-4"
3	TEE REDUCING 8" × 4" P150	3
4	TEE REDUCING 8" × 3/4" P150	3

WELDS 17 (0 FIELD) · SUPPORTS 7 · SPOOLS 1

W1 W2 W3 W4 W5 W6 W7 W8 W9 W10
W11 W12 W13 W14 W15 W16 W17

8"-P150-FL-2009

CLASS F150 — Flare and relief outlets
SERVICE FL · 8" · P150 · DESIGN 150 psi
cap → cap
PIPE 151'-4" · WEIGHT 3684 lb

DWG ISO-8"-P150-FL-2009 REV 0 WO-500-01

SmartWeld AI · not to scale · E lower right, N upper right, EL up (SW-ISO-1)

DEMONSTRATION ONLY — NOT A QUALIFIED PROCEDURE

Notices

DEMONSTRATION ONLY — NOT A QUALIFIED PROCEDURE; THE FACILITY OWNER'S QUALIFIED PROCEDURES AND APPLICABLE CODES GOVERN.

This document embeds a subset of the DejaVu Sans font (SW-LIC-3), renamed under its licence. DejaVu Sans (assets/fonts/DejaVuSans.ttf), from the DejaVu fonts 2.37 as packaged in the build environment.

Copyright (c) 2003 by Bitstream, Inc. All Rights Reserved. Bitstream Vera is a trademark of Bitstream, Inc.
DejaVu changes are in public domain.

Permission is hereby granted, free of charge, to any person obtaining a copy
of the fonts accompanying this license ("Fonts") and associated
documentation files (the "Font Software"), to reproduce and distribute the
Font Software, including without limitation the rights to use, copy, merge,
publish, distribute, and/or sell copies of the Font Software, and to permit
persons to whom the Font Software is furnished to do so, subject to the
following conditions:

The above copyright and trademark notices and this permission notice shall
be included in all copies of one or more of the Font Software typefaces.

The Font Software may be modified, altered, or added to, and in particular
the designs of glyphs or characters in the Fonts may be modified and
additional glyphs or characters may be added to the Fonts, only if the fonts
are renamed to names not containing either the words "Bitstream" or the word
"Vera".

This License becomes null and void to the extent applicable to Fonts or Font
Software that has been modified and is distributed under the "Bitstream
Vera" names.

The Font Software may be sold as part of a larger software package but no
copy of one or more of the Font Software typefaces may be sold by itself.

THE FONT SOFTWARE IS PROVIDED "AS IS", WITHOUT WARRANTY OF ANY KIND, EXPRESS
OR IMPLIED, INCLUDING BUT NOT LIMITED TO ANY WARRANTIES OF MERCHANTABILITY,
FITNESS FOR A PARTICULAR PURPOSE AND NONINFRINGEMENT OF COPYRIGHT, PATENT,
TRADEMARK, OR OTHER RIGHT. IN NO EVENT SHALL BITSTREAM OR THE GNOME
FOUNDATION BE LIABLE FOR ANY CLAIM, DAMAGES OR OTHER LIABILITY, INCLUDING
ANY GENERAL, SPECIAL, INDIRECT, INCIDENTAL, OR CONSEQUENTIAL DAMAGES,
WHETHER IN AN ACTION OF CONTRACT, TORT OR OTHERWISE, ARISING FROM, OUT OF
THE USE OR INABILITY TO USE THE FONT SOFTWARE OR FROM OTHER DEALINGS IN THE
FONT SOFTWARE.

Except as contained in this notice, the names of Gnome, the Gnome
Foundation, and Bitstream Inc., shall not be used in advertising or
otherwise to promote the sale, use or other dealings in this Font Software
without prior written authorization from the Gnome Foundation or Bitstream
Inc., respectively. For further information, contact: fonts at gnome dot
org.