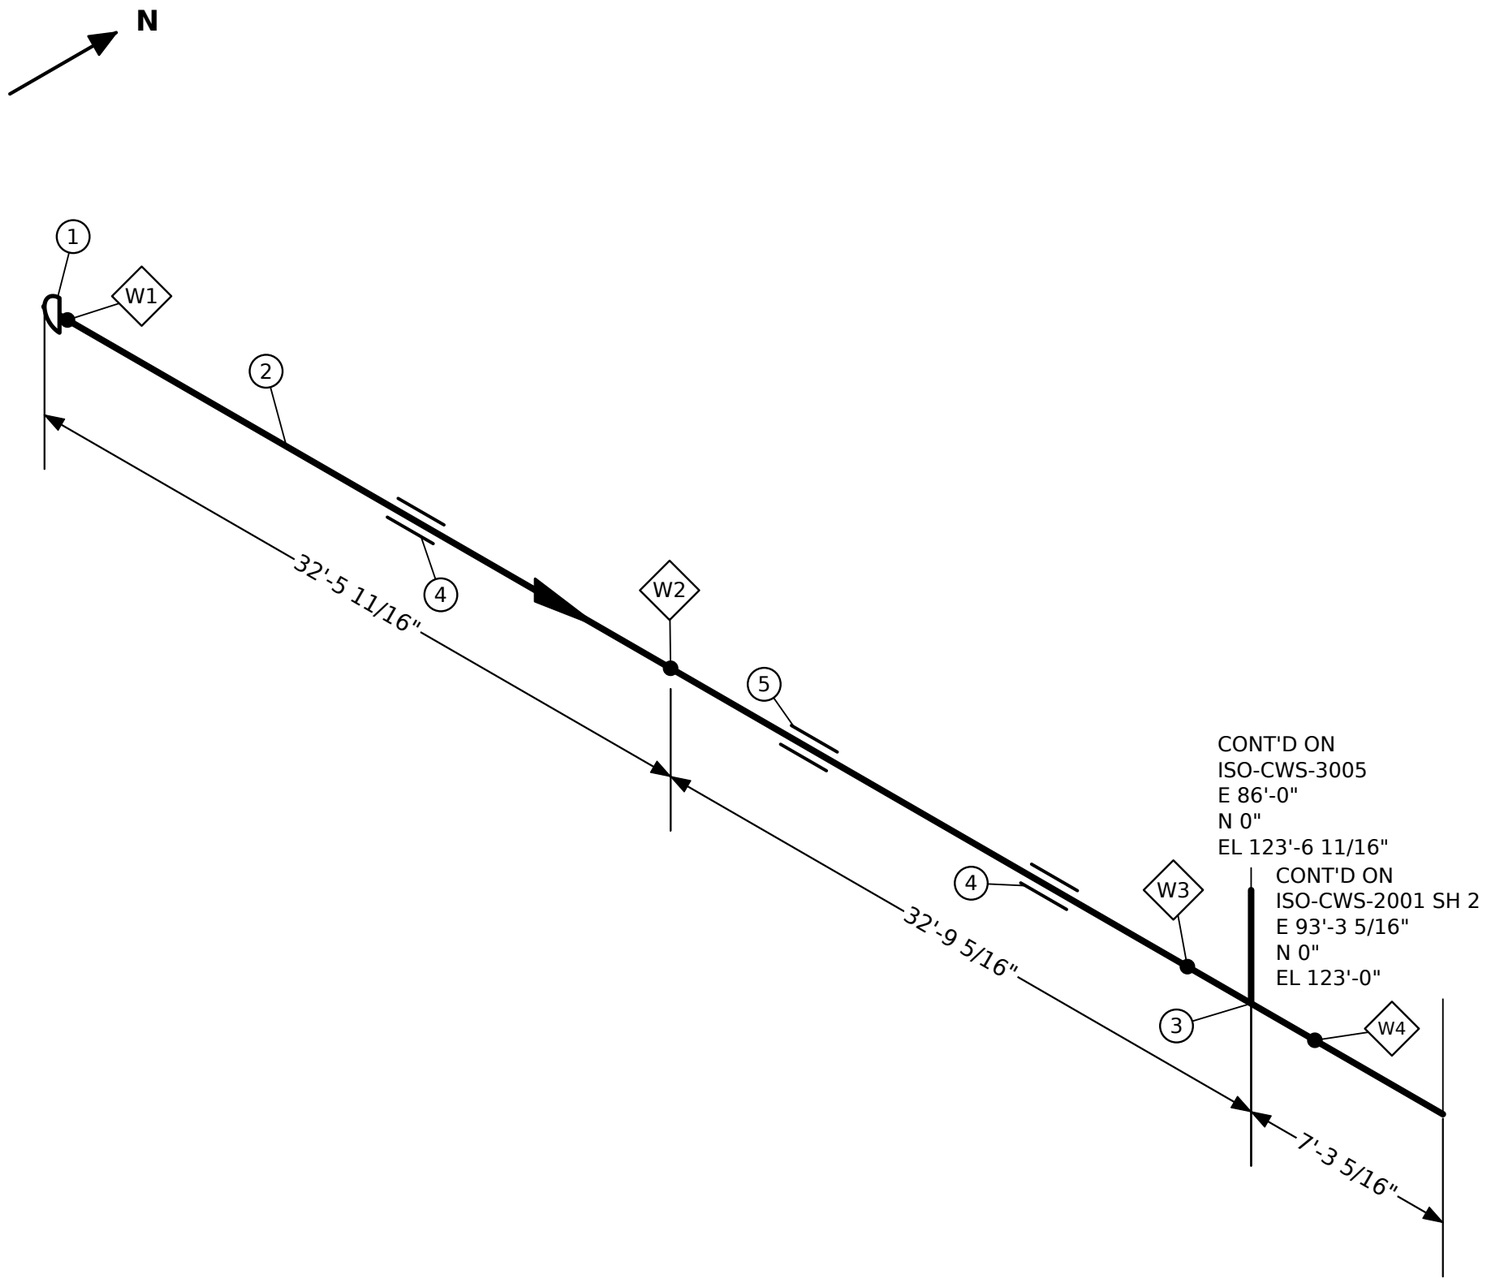



**BILL OF MATERIALS**

| PT | QTY | NPS | DESCRIPTION |
|---|---|---|---|
| 1 | 1 | 8" | CAP 8" P150 |
| 2 | 71'-2" | 8" | PIPE 8" P150 BEVELLED ENDS |
| 3 | 1 | 8"x4" | TEE REDUCING 8" × 4" P150 |
| 4 | 2 | 8" | GUIDE FOR 8" LINE (GUIDE-8) |
| 5 | 1 | 8" | SHOE FOR 8" LINE (SHOE-8) |

| REV | DATE | DESCRIPTION | BY |
|---|---|---|---|
| 0 | 2026-11-01 | ISSUED FOR CONSTRUCTION | - |

COMPANY

**SMARTWELD**

TITLE

**WATER (COOLING AND PROCESS)**

**NOTES:**


1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD

| TEST PRESS. | INSULATION | PAINT |
|---|---|---|
| - | NONE | - |
| PWHT | NDE | FLUID |
| - | - | CWS |

| LINE NO. | PIPING CLASS | DESIGN PRESS. | DESIGN TEMP. |
|---|---|---|---|
| 8"-P150-CWS-2001 | W150 | 150 PSIG | - |

| DRAWING NO. | SHEET | REV |
|---|---|---|
| ISO-CWS-2001 | 1 OF 4 | 0 |

| DATE | DRAWN | CHECKED | SCALE |
|---|---|---|---|
| 2026-11-01 | - | - | NTS |

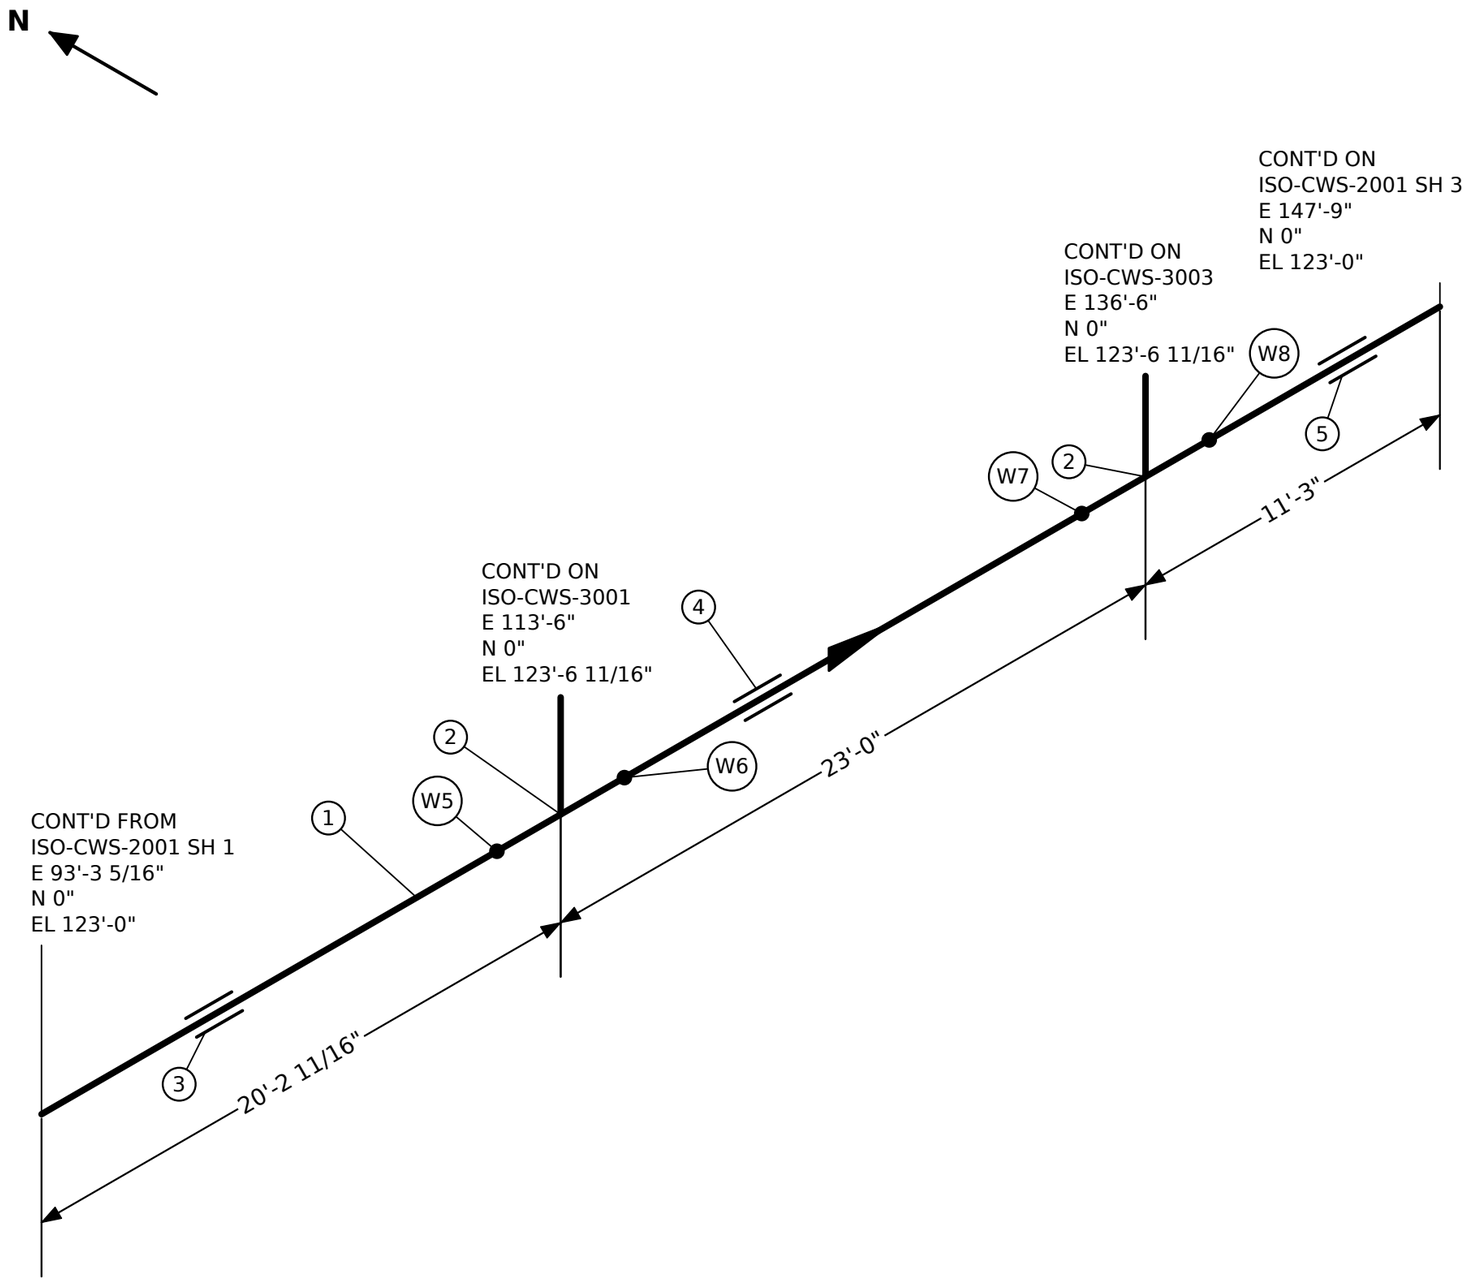


**BILL OF MATERIALS**

| PT | QTY | NPS | DESCRIPTION |
|---|---|---|---|
| 1 | 52'-3" | 8" | PIPE 8" P150 BEVELLED ENDS |
| 2 | 2 | 8"x4" | TEE REDUCING 8" × 4" P150 |
| 3 | 1 | 8" | ANCHOR FOR 8" LINE (ANCHOR-8) |
| 4 | 1 | 8" | GUIDE FOR 8" LINE (GUIDE-8) |
| 5 | 1 | 8" | SHOE FOR 8" LINE (SHOE-8) |

| REV | DATE | DESCRIPTION | BY |
|---|---|---|---|
| 0 | 2026-11-01 | ISSUED FOR CONSTRUCTION | - |

COMPANY

**SMARTWELD**

TITLE

**WATER (COOLING AND PROCESS)**

**NOTES:**


1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD

| TEST PRESS. | INSULATION | PAINT |
|---|---|---|
| - | NONE | - |
| PWHT | NDE | FLUID |
| - | - | CWS |

| LINE NO. | PIPING CLASS | DESIGN PRESS. | DESIGN TEMP. |
|---|---|---|---|
| 8"-P150-CWS-2001 | W150 | 150 PSIG | - |

| DRAWING NO. | SHEET | REV |
|---|---|---|
| ISO-CWS-2001 | 2 OF 4 | 0 |

| DATE | DRAWN | CHECKED | SCALE |
|---|---|---|---|
| 2026-11-01 | - | - | NTS |

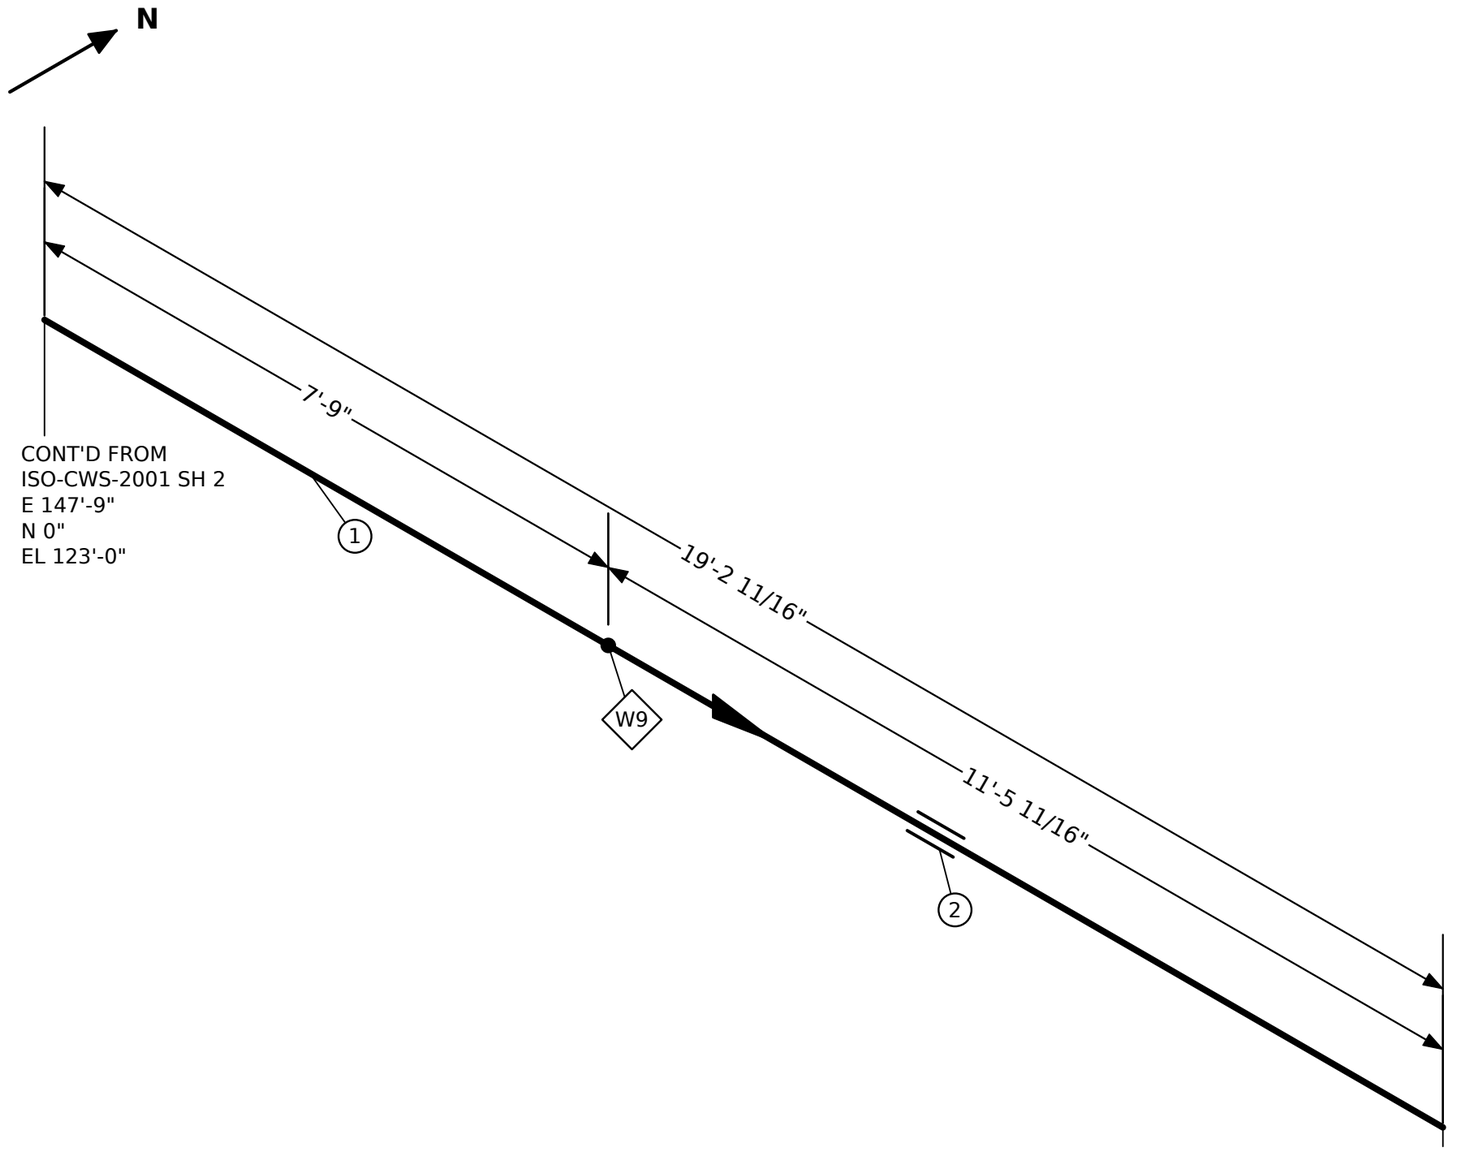


**BILL OF MATERIALS**

| PT | QTY | NPS | DESCRIPTION |
|---|---|---|---|
| 1 | 19'-2 11/16" | 8" | PIPE 8" P150 BEVELLED ENDS |
| 2 | 1 | 8" | GUIDE FOR 8" LINE (GUIDE-8) |

**NOTES:**

1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD
3. REMOVE BURRS FROM ALL CUT ENDS

| REV | DATE | DESCRIPTION | BY |
|---|---|---|---|
| 0 | 2026-11-01 | ISSUED FOR CONSTRUCTION | - |

COMPANY

**SMARTWELD**

TITLE


**WATER (COOLING AND PROCESS)**

| TEST PRESS. | INSULATION | PAINT |
|---|---|---|
| - | NONE | - |
| PWHT | NDE | FLUID |
| - | - | CWS |

| LINE NO. | PIPING CLASS | DESIGN PRESS. | DESIGN TEMP. |
|---|---|---|---|
| 8"-P150-CWS-2001 | W150 | 150 PSIG | - |

| DRAWING NO. | SHEET | REV |
|---|---|---|
| ISO-CWS-2001 | 3 OF 4 | 0 |

| DATE | DRAWN | CHECKED | SCALE |
|---|---|---|---|
| 2026-11-01 | - | - | NTS |

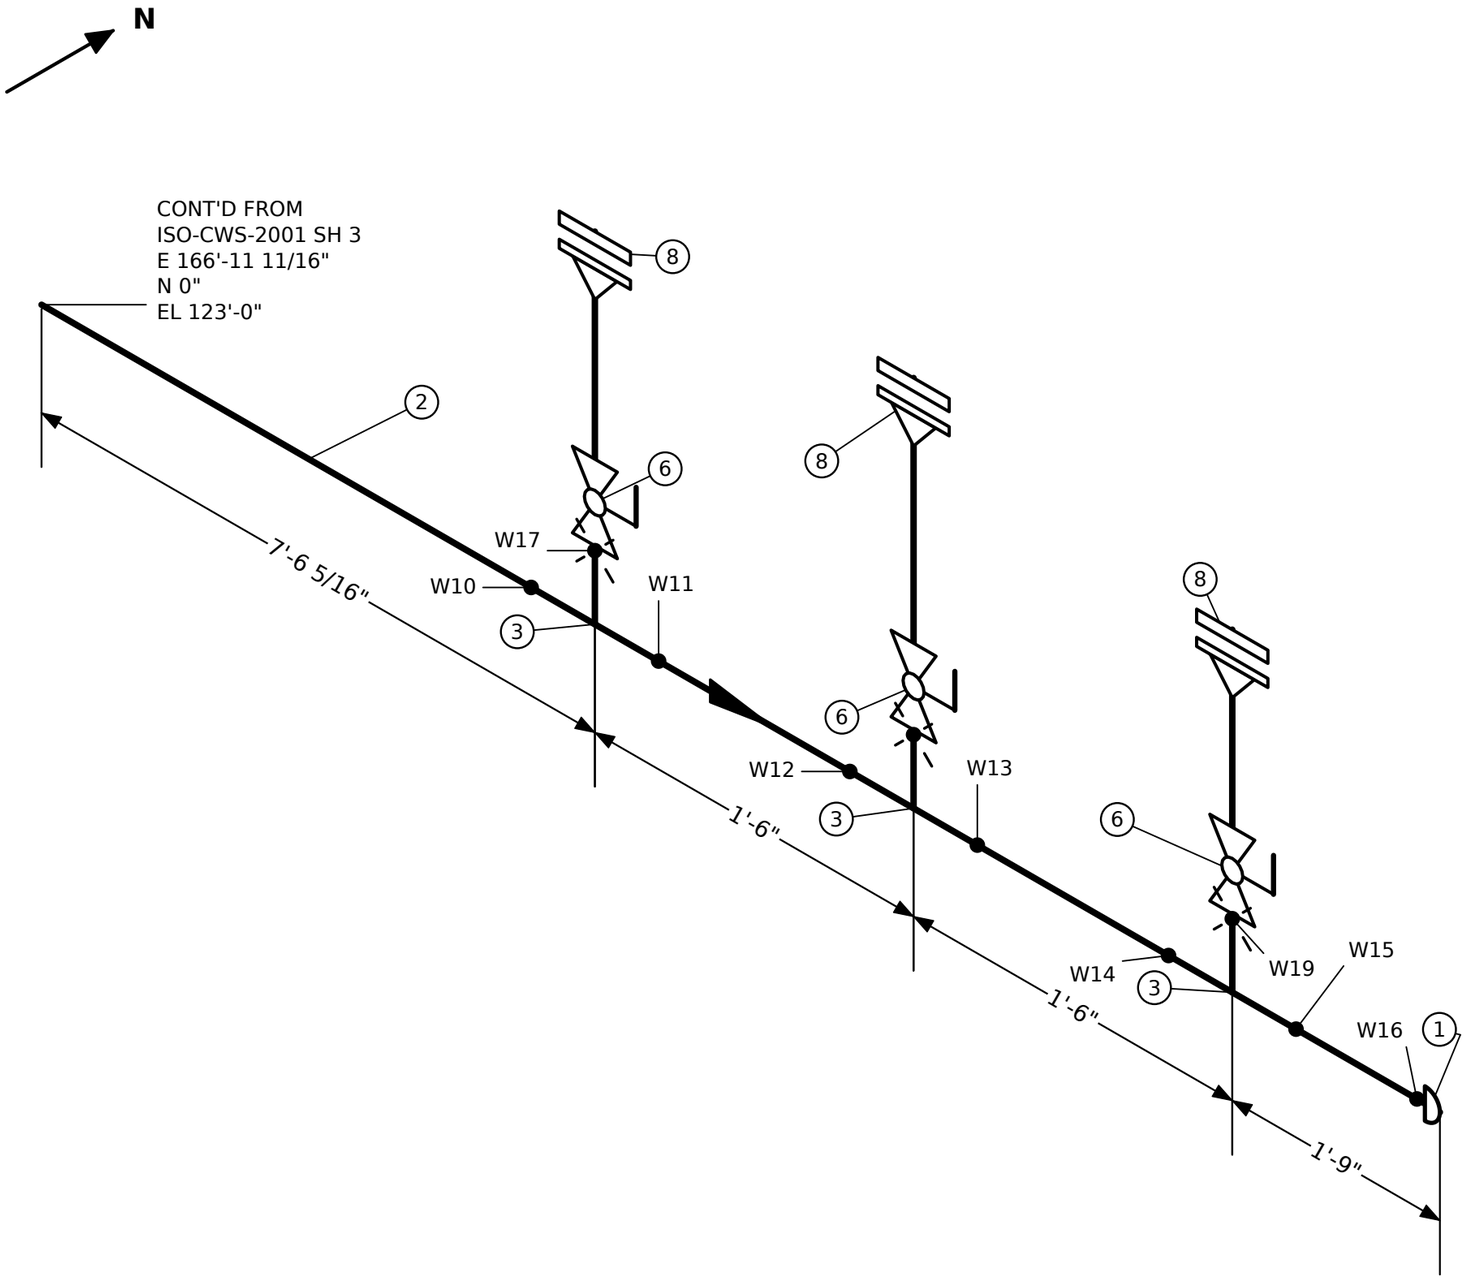


## BILL OF MATERIALS

| PT | QTY | NPS | DESCRIPTION |
|---|---|---|---|
| 1 | 1 | 8" | CAP 8" P150 |
| 2 | 8'-8 5/16" | 8" | PIPE 8" P150 BEVELLED ENDS |
| 3 | 3 | 8"x3/4" | TEE REDUCING 8" × 3/4" P150 |
| 4 | 3 | 3/4" | FLANGE WELD-NECK 3/4" P150 RAISED FACE |
| 5 | 6 | 3/4" | GASKET 3/4" P150 COMPRESSED SHEET |
| 6 | 3 | 3/4" | VALVE, BALL, FLOATING 3/4" P150 |
| 7 | 6 | 3/4" | STUD SET 4 × 0.5" × 4-1/4" WITH 2 NUTS, FOR 3/4" P150 |
| 8 | 3 | 3/4" | FLANGE BLIND 3/4" P150 RAISED FACE |

| REV | DATE | DESCRIPTION | BY |
|---|---|---|---|
| 0 | 2026-11-01 | ISSUED FOR CONSTRUCTION | - |

COMPANY

**SMARTWELD**

TITLE

**WATER (COOLING AND PROCESS)**

**NOTES:**
1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD
3. PAINT PER PROJECT SPECIFICATION

| TEST PRESS. | INSULATION | PAINT |
|---|---|---|
| - | NONE | - |
| PWHT | NDE | FLUID |
| - | - | CWS |

| LINE NO. | PIPING CLASS | DESIGN PRESS. | DESIGN TEMP. |
|---|---|---|---|
| 8"-P150-CWS-2001 | W150 | 150 PSIG | - |

| DRAWING NO. | SHEET | REV |
|---|---|---|
| ISO-CWS-2001 | 4 OF 4 | 0 |

| DATE | DRAWN | CHECKED | SCALE |
|---|---|---|---|
| 2026-11-01 | - | - | NTS |