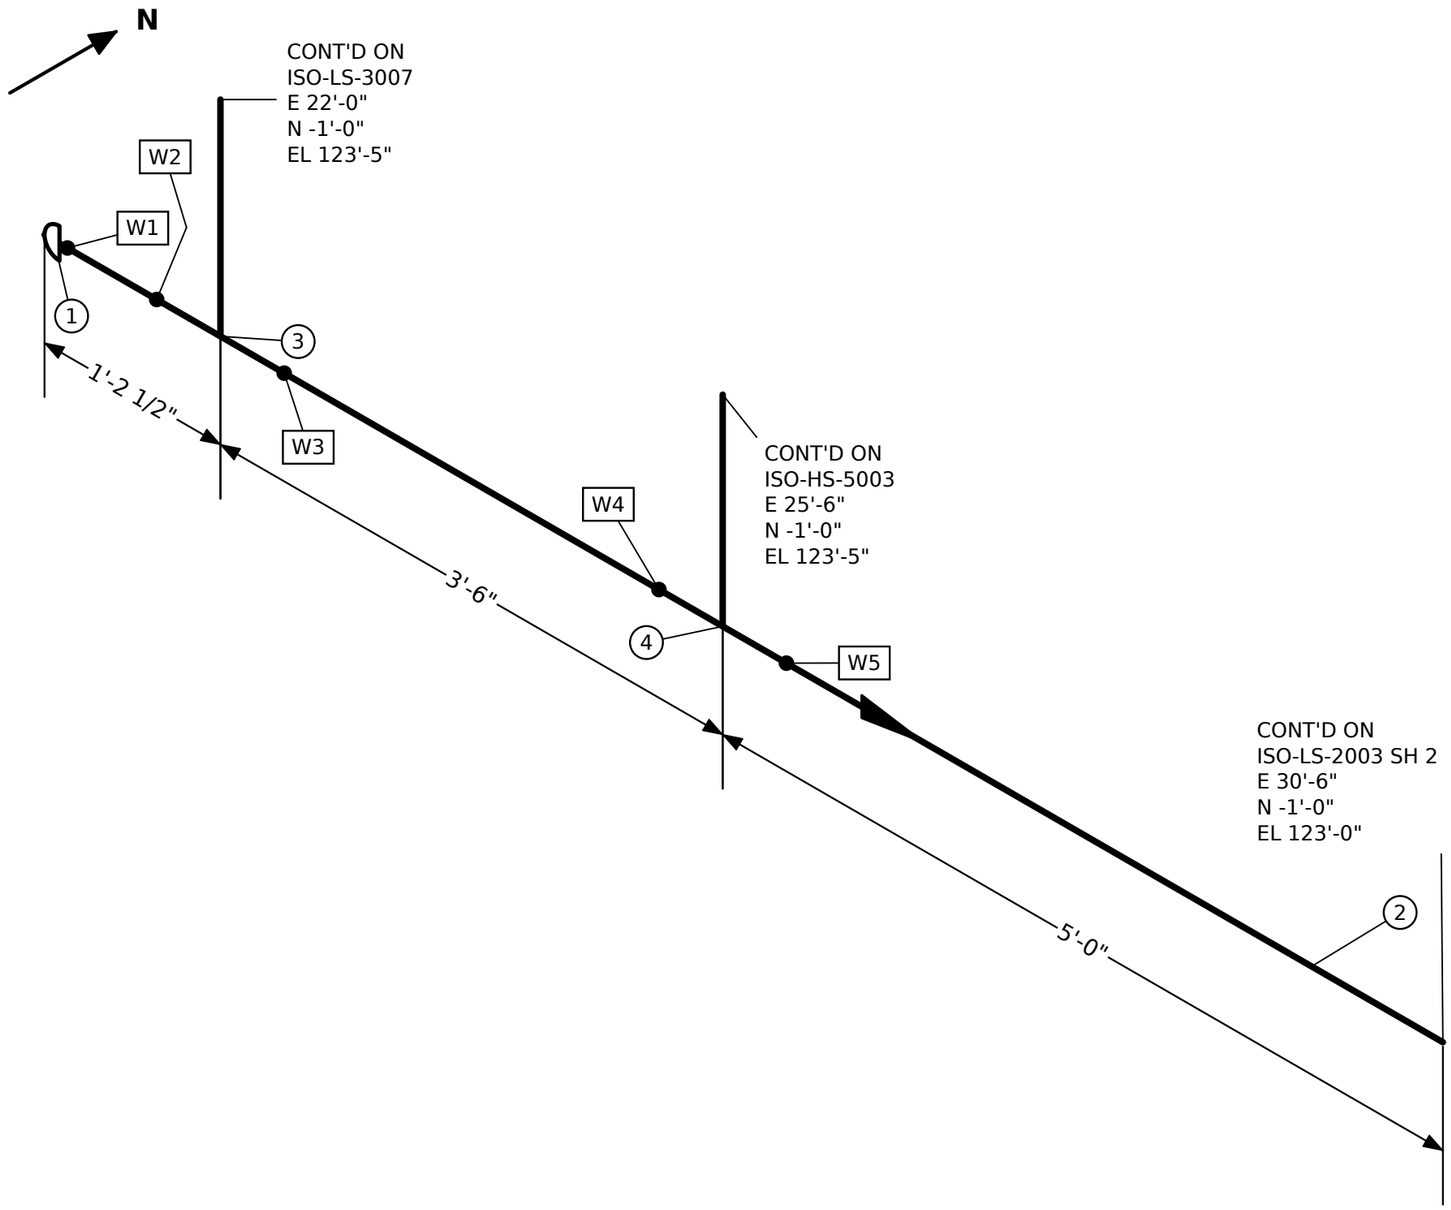


BILL OF MATERIALS

PT	QTY	NPS	DESCRIPTION
1	1	6"	CAP 6" P300
2	7'-10"	6"	PIPE 6" P300 BEVELLED ENDS
3	1	6"x2"	TEE REDUCING 6" × 2" P300
4	1	6"x1"	TEE REDUCING 6" × 1" P300

REV	DATE	DESCRIPTION	BY
0	2026-11-01	ISSUED FOR CONSTRUCTION	-

COMPANY

SMARTWELD

TITLE

LOW-PRESSURE STEAM

NOTES:


1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD

TEST PRESS.	INSULATION	PAINT
-	YES	-
PWHT	NDE	FLUID
-	-	LS

LINE NO.	PIPING CLASS	DESIGN PRESS.	DESIGN TEMP.
6"-P300-LS-2003	S300	300 PSIG	-

DRAWING NO.	SHEET	REV
ISO-LS-2003	1 OF 7	0

DATE	DRAWN	CHECKED	SCALE
2026-11-01	-	-	NTS

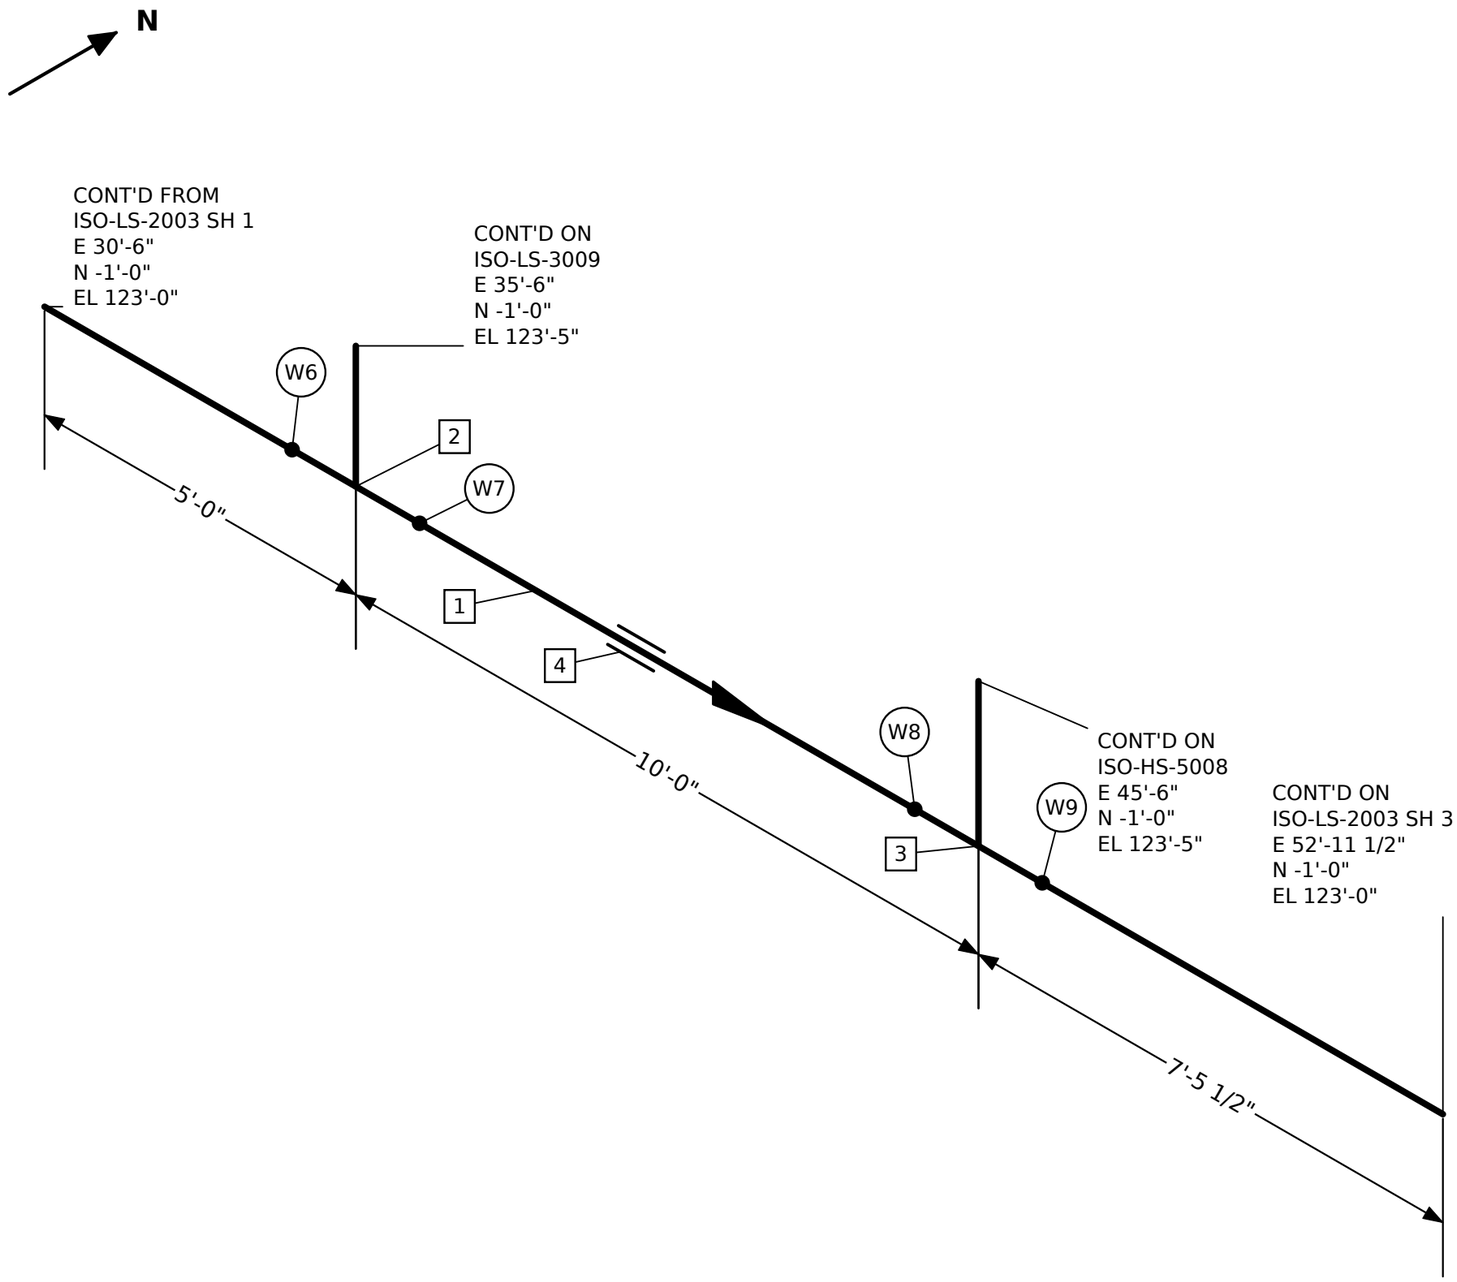

BILL OF MATERIALS

PT	QTY	NPS	DESCRIPTION
1	20'-9 1/2"	6"	PIPE 6" P300 BEVELLED ENDS
2	1	6"x2"	TEE REDUCING 6" × 2" P300
3	1	6"x1"	TEE REDUCING 6" × 1" P300
4	1	6"	GUIDE FOR 6" LINE (GUIDE-6)

REV	DATE	DESCRIPTION	BY
0	2026-11-01	ISSUED FOR CONSTRUCTION	-

COMPANY

SMARTWELD

TITLE

LOW-PRESSURE STEAM

NOTES:


1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD

TEST PRESS.	INSULATION	PAINT
-	YES	-
PWHT	NDE	FLUID
-	-	LS

LINE NO.	PIPING CLASS	DESIGN PRESS.	DESIGN TEMP.
6"-P300-LS-2003	S300	300 PSIG	-

DRAWING NO.	SHEET	REV
ISO-LS-2003	2 OF 7	0

DATE	DRAWN	CHECKED	SCALE
2026-11-01	-	-	NTS

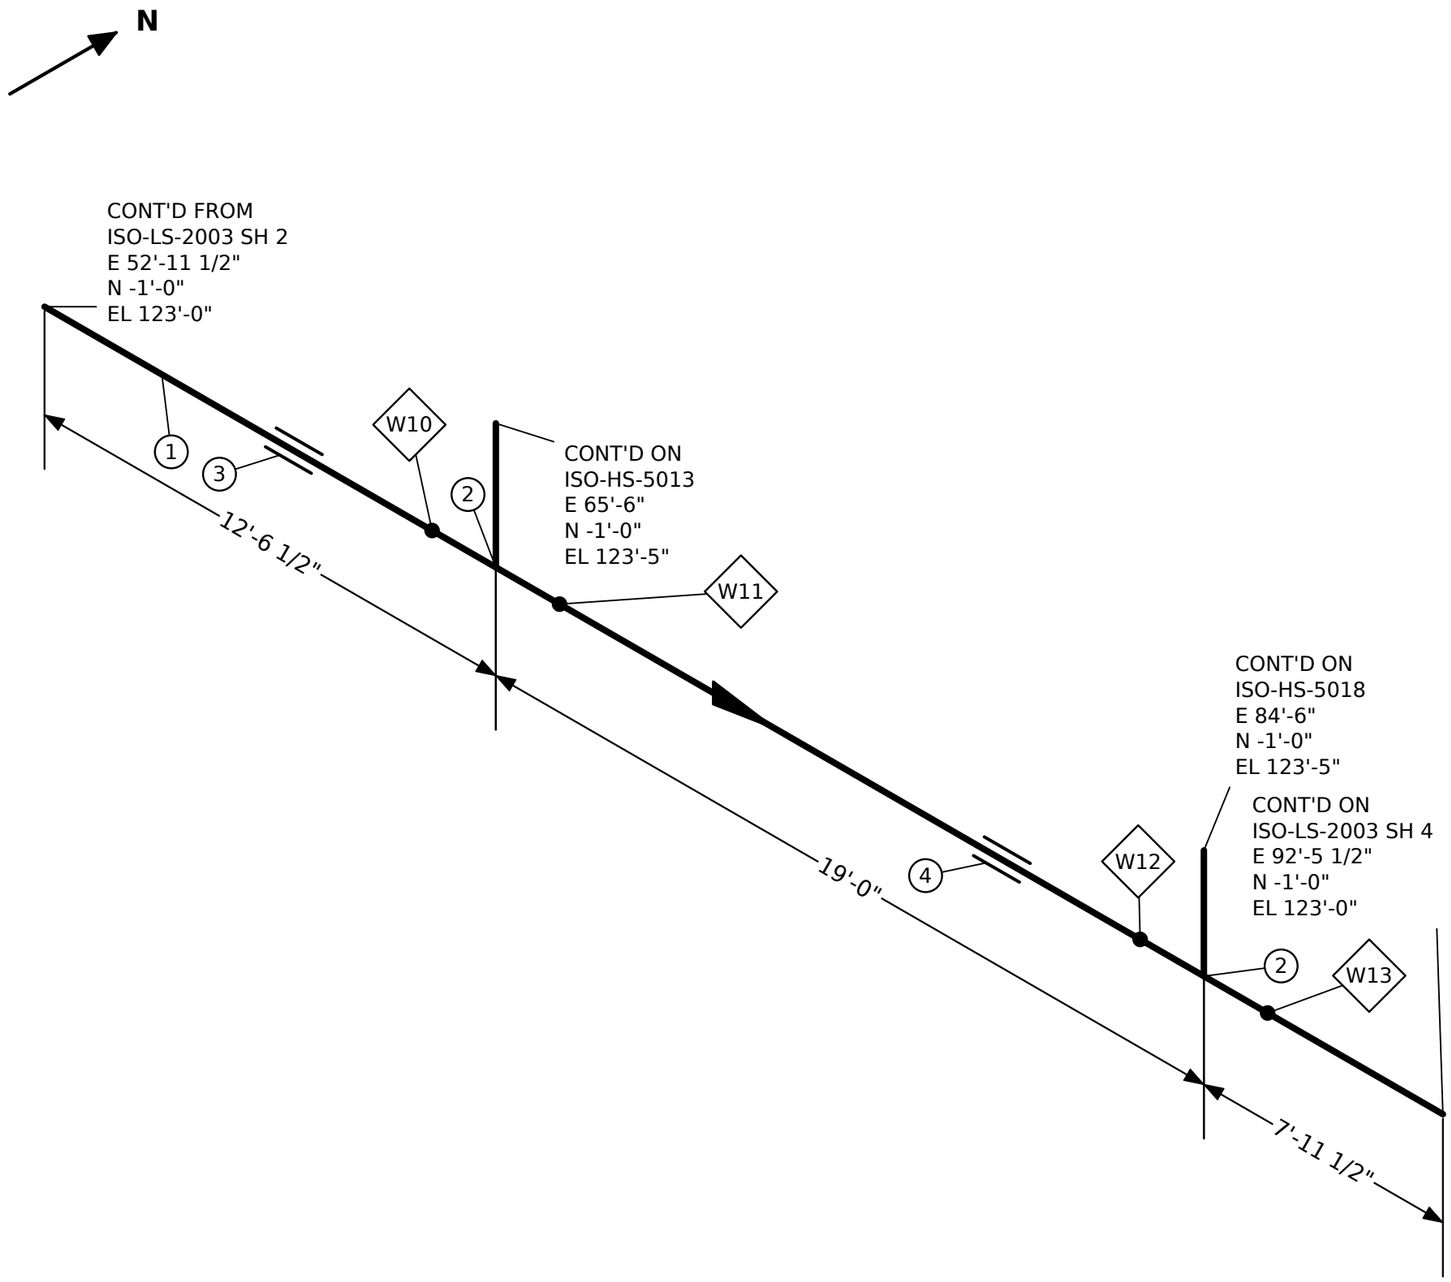

BILL OF MATERIALS

PT	QTY	NPS	DESCRIPTION
1	37'-10"	6"	PIPE 6" P300 BEVELLED ENDS
2	2	6"x1"	TEE REDUCING 6" × 1" P300
3	1	6"	SHOE FOR 6" LINE (SHOE-6)
4	1	6"	GUIDE FOR 6" LINE (GUIDE-6)

REV	DATE	DESCRIPTION	BY
0	2026-11-01	ISSUED FOR CONSTRUCTION	-

NOTES:

1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD
3. HYDROTEST BEFORE PAINTING
4. CHECK ORIENTATION BEFORE WELDING

TEST PRESS.	INSULATION	PAINT
-	YES	-
PWHT	NDE	FLUID
-	-	LS

COMPANY

SMARTWELD


TITLE

LOW-PRESSURE STEAM

LINE NO.	PIPING CLASS	DESIGN PRESS.	DESIGN TEMP.
6"-P300-LS-2003	S300	300 PSIG	-

DRAWING NO.	SHEET	REV
ISO-LS-2003	3 OF 7	0

DATE	DRAWN	CHECKED	SCALE
2026-11-01	-	-	NTS

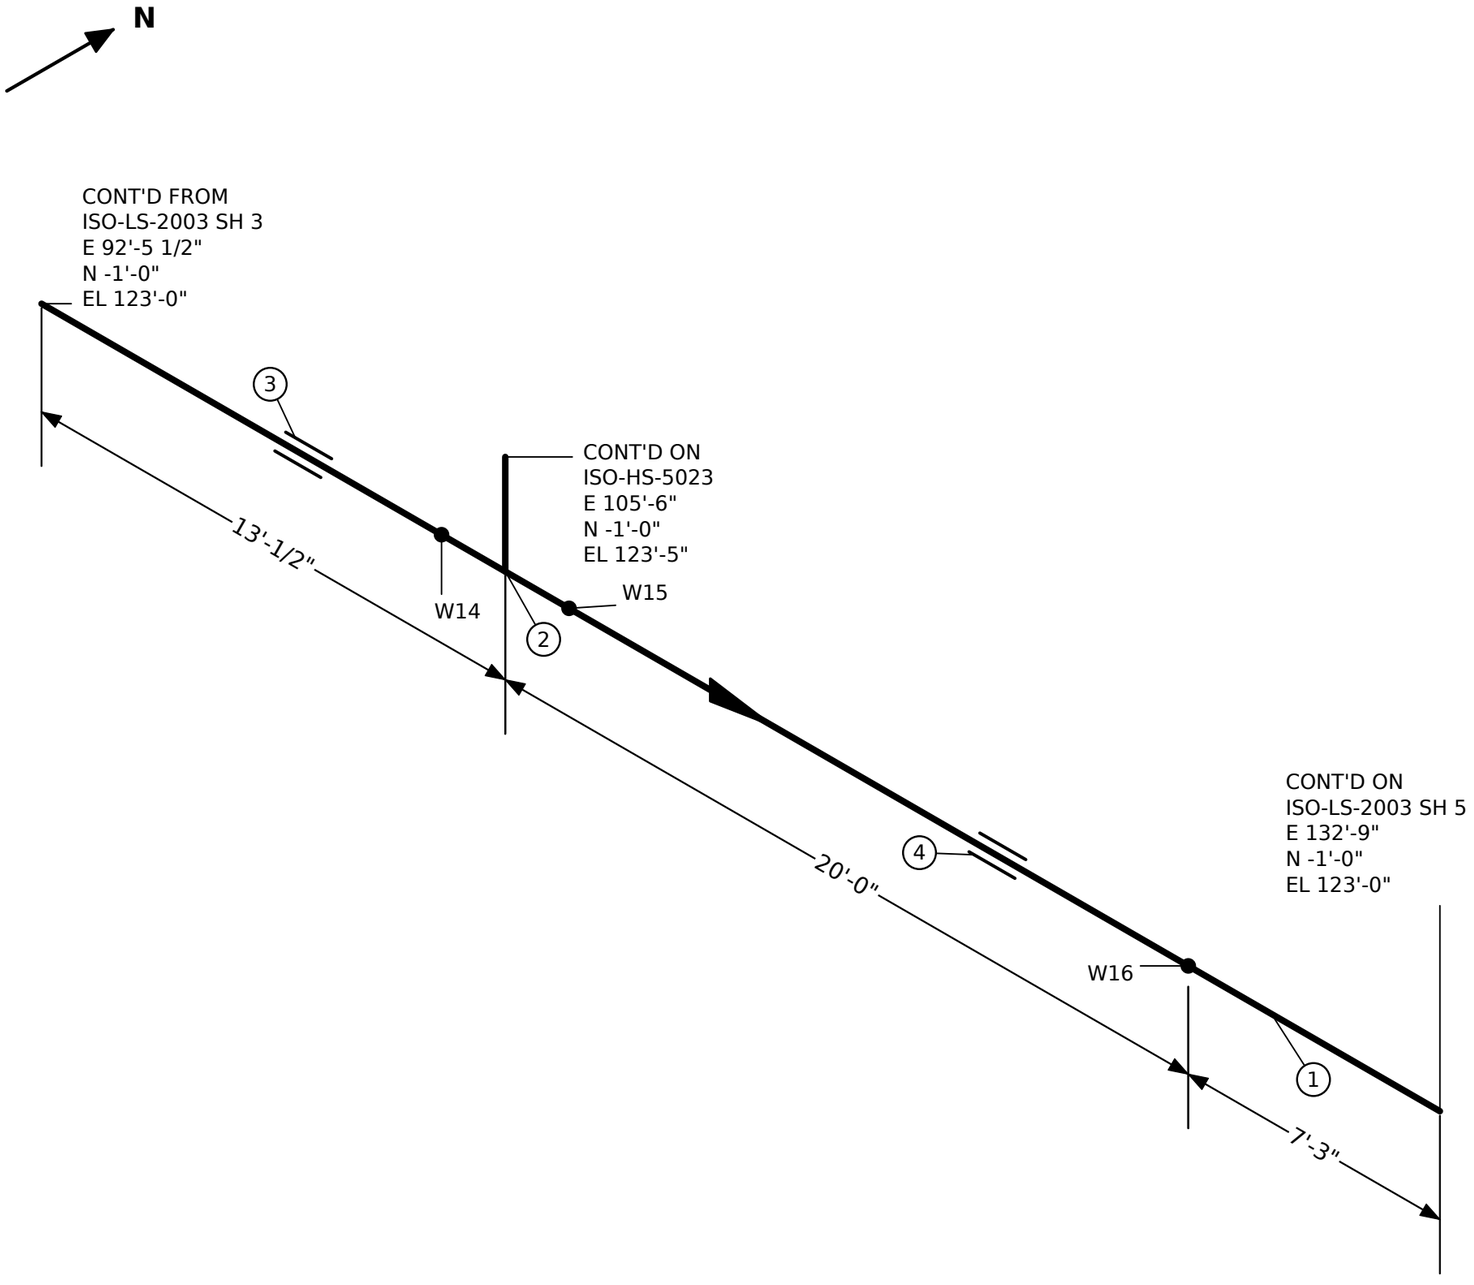

BILL OF MATERIALS

PT	QTY	NPS	DESCRIPTION
1	39'-5 1/2"	6"	PIPE 6" P300 BEVELLED ENDS
2	1	6"x1"	TEE REDUCING 6" × 1" P300
3	1	6"	ANCHOR FOR 6" LINE (ANCHOR-6)
4	1	6"	GUIDE FOR 6" LINE (GUIDE-6)

NOTES:

1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD

REV	DATE	DESCRIPTION	BY
0	2026-11-01	ISSUED FOR CONSTRUCTION	-

COMPANY

SMARTWELD

TITLE


LOW-PRESSURE STEAM

TEST PRESS.	INSULATION	PAINT
-	YES	-
PWHT	NDE	FLUID
-	-	LS

LINE NO.	PIPING CLASS	DESIGN PRESS.	DESIGN TEMP.
6"-P300-LS-2003	S300	300 PSIG	-

DRAWING NO.	SHEET	REV
ISO-LS-2003	4 OF 7	0

DATE	DRAWN	CHECKED	SCALE
2026-11-01	-	-	NTS

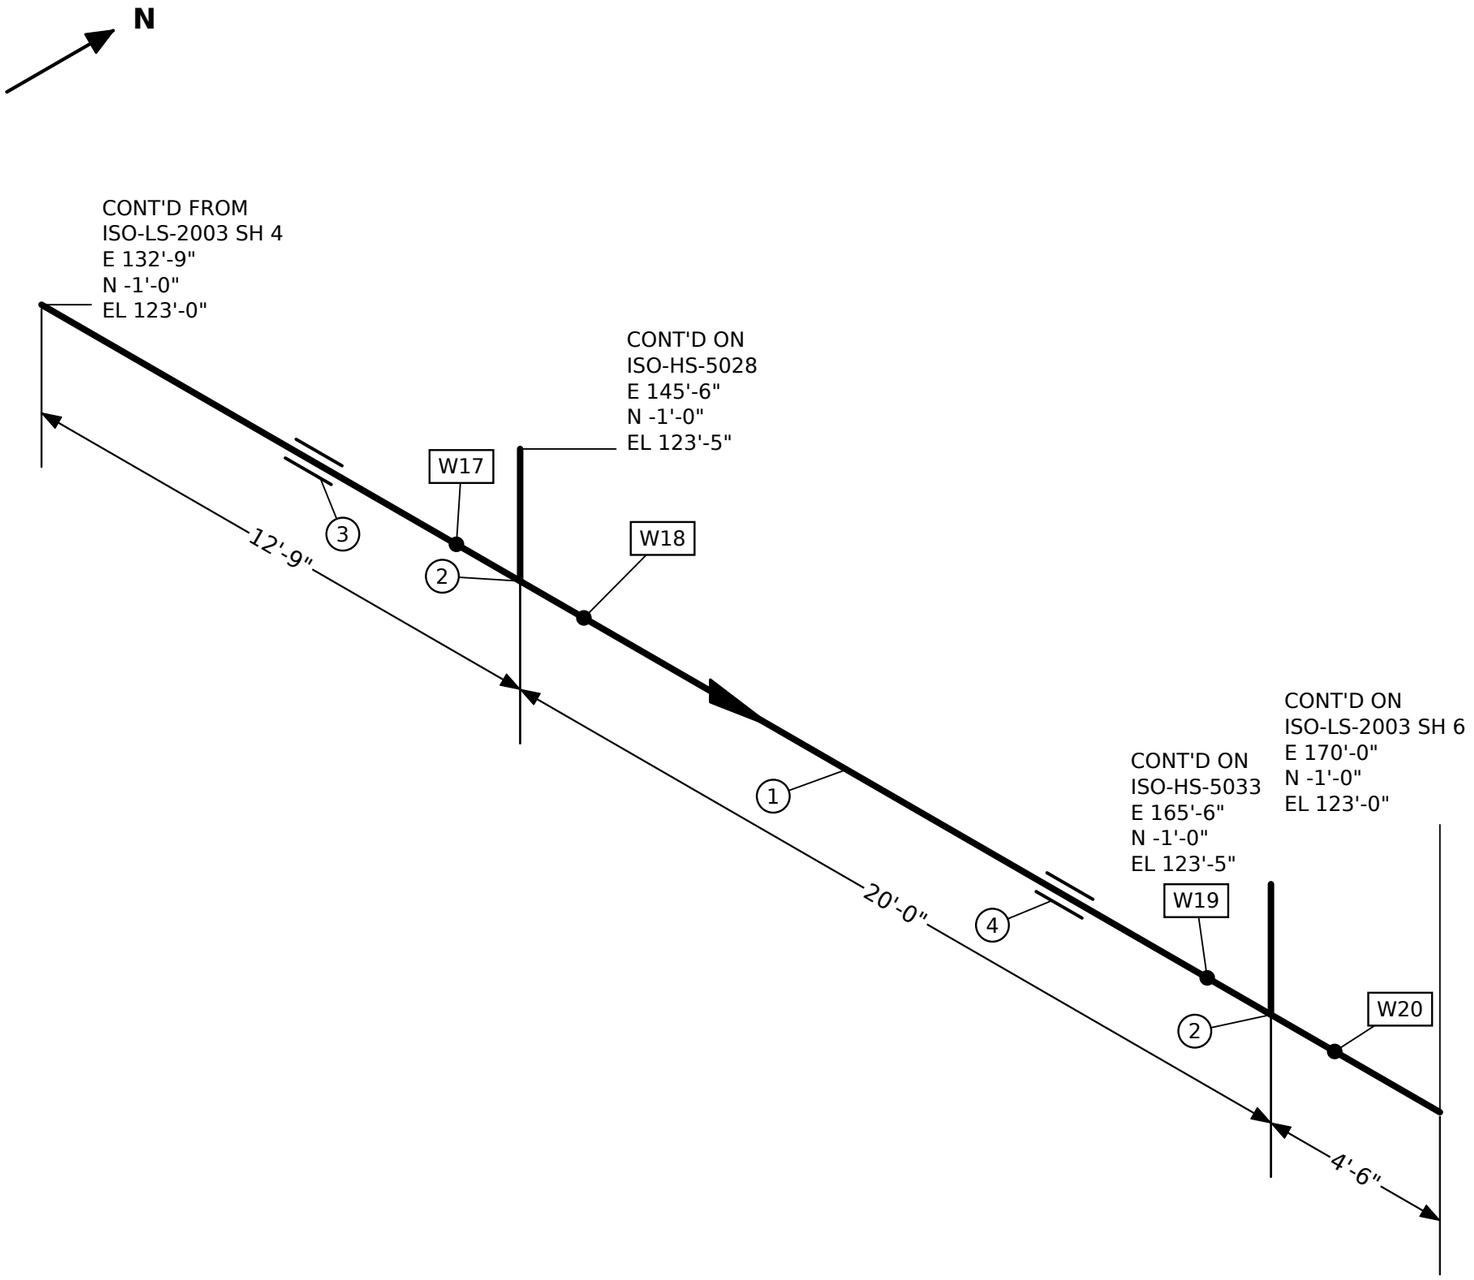

BILL OF MATERIALS

PT	QTY	NPS	DESCRIPTION
1	35'-7"	6"	PIPE 6" P300 BEVELLED ENDS
2	2	6"x1"	TEE REDUCING 6" × 1" P300
3	1	6"	SHOE FOR 6" LINE (SHOE-6)
4	1	6"	GUIDE FOR 6" LINE (GUIDE-6)

REV	DATE	DESCRIPTION	BY
0	2026-11-01	ISSUED FOR CONSTRUCTION	-

COMPANY

SMARTWELD

TITLE

LOW-PRESSURE STEAM

NOTES:


1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD
3. FLANGE BOLT HOLES STRADDLE CENTRELINES
4. PAINT PER PROJECT SPECIFICATION

TEST PRESS.	INSULATION	PAINT
-	YES	-
PWHT	NDE	FLUID
-	-	LS

LINE NO.	PIPING CLASS	DESIGN PRESS.	DESIGN TEMP.
6"-P300-LS-2003	S300	300 PSIG	-

DRAWING NO.	SHEET	REV
ISO-LS-2003	5 OF 7	0

DATE	DRAWN	CHECKED	SCALE
2026-11-01	-	-	NTS

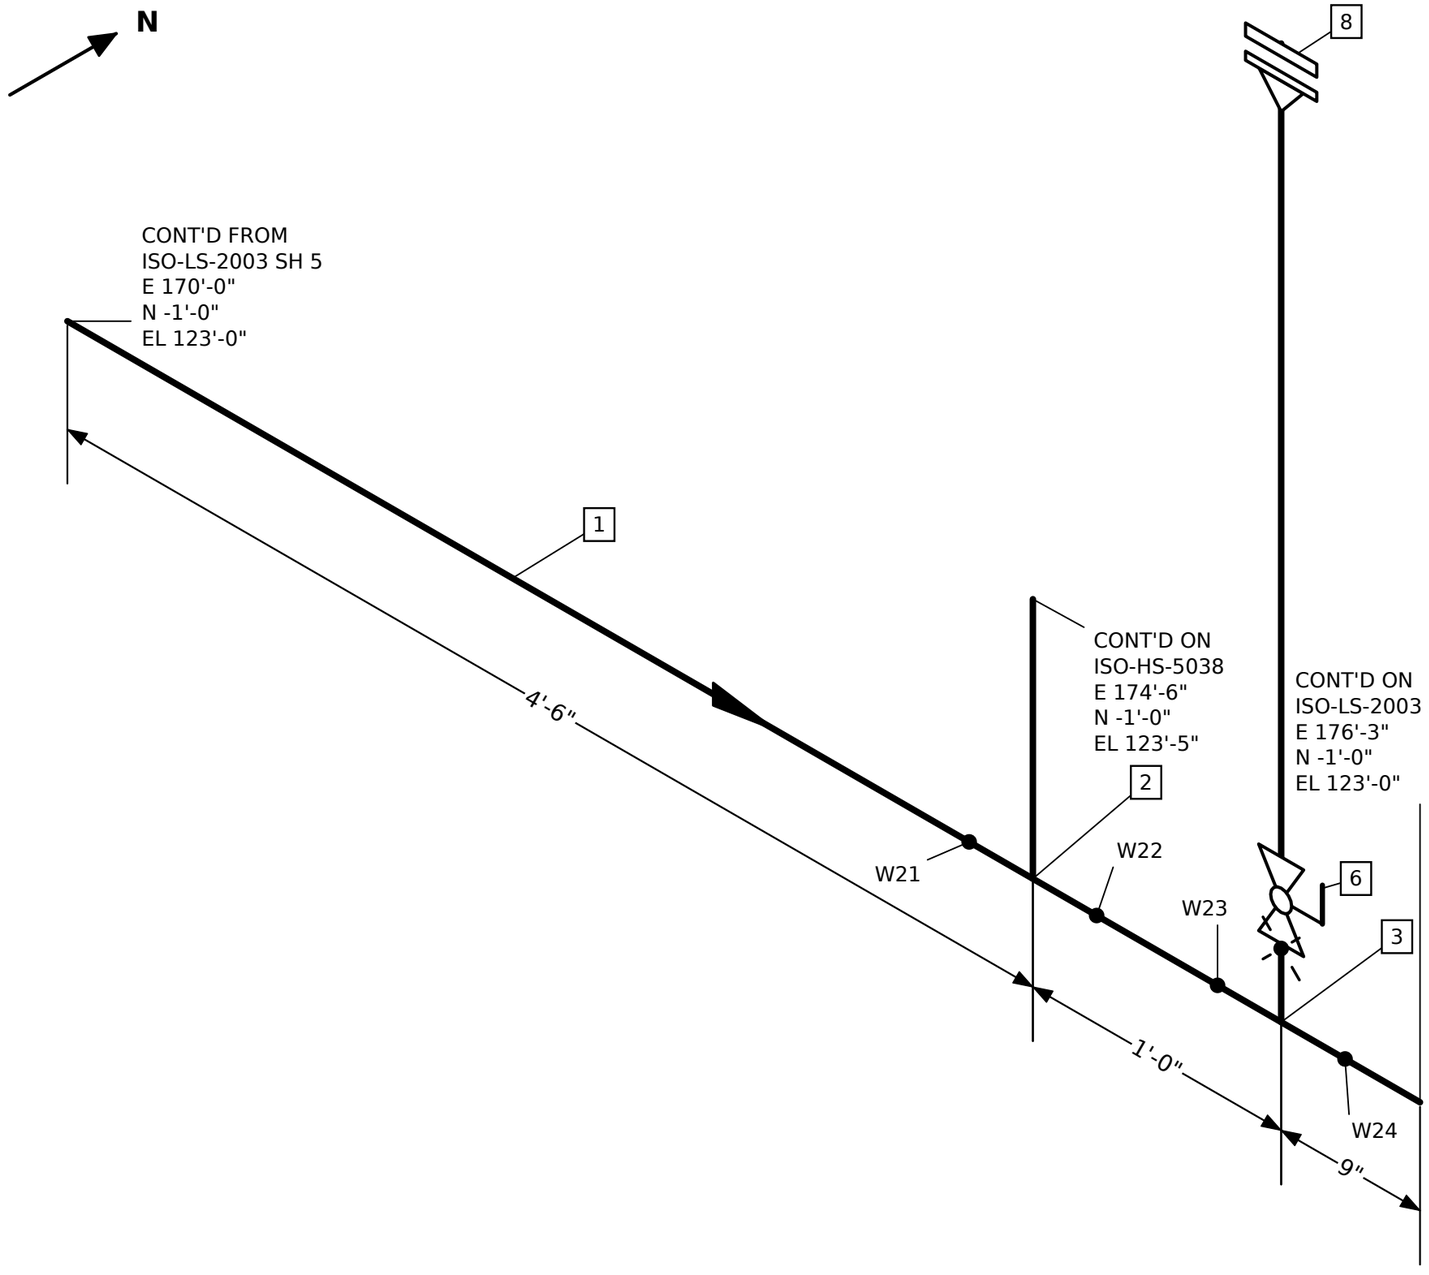

BILL OF MATERIALS

PT	QTY	NPS	DESCRIPTION
1	4'-7"	6"	PIPE 6" P300 BEVELLED ENDS
2	1	6"x1"	TEE REDUCING 6" × 1" P300
3	1	6"x3/4"	TEE REDUCING 6" × 3/4" P300
4	1	3/4"	FLANGE WELD-NECK 3/4" P150 RAISED FACE
5	2	3/4"	GASKET 3/4" P150 COMPRESSED SHEET
6	1	3/4"	VALVE, BALL, FLOATING 3/4" P150
7	2	3/4"	STUD SET 4 × 0.5" × 4-1/4" WITH 2 NUTS, FOR 3/4" P150
8	1	3/4"	FLANGE BLIND 3/4" P150 RAISED FACE

REV	DATE	DESCRIPTION	BY
0	2026-11-01	ISSUED FOR CONSTRUCTION	-

NOTES:
1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD

TEST PRESS.	INSULATION	PAINT
-	YES	-
PWHT	NDE	FLUID
-	-	LS

COMPANY

SMARTWELD


TITLE

LOW-PRESSURE STEAM

LINE NO.	PIPING CLASS	DESIGN PRESS.	DESIGN TEMP.
6"-P300-LS-2003	S300	300 PSIG	-

DRAWING NO.	SHEET	REV
ISO-LS-2003	6 OF 7	0

DATE	DRAWN	CHECKED	SCALE
2026-11-01	-	-	NTS

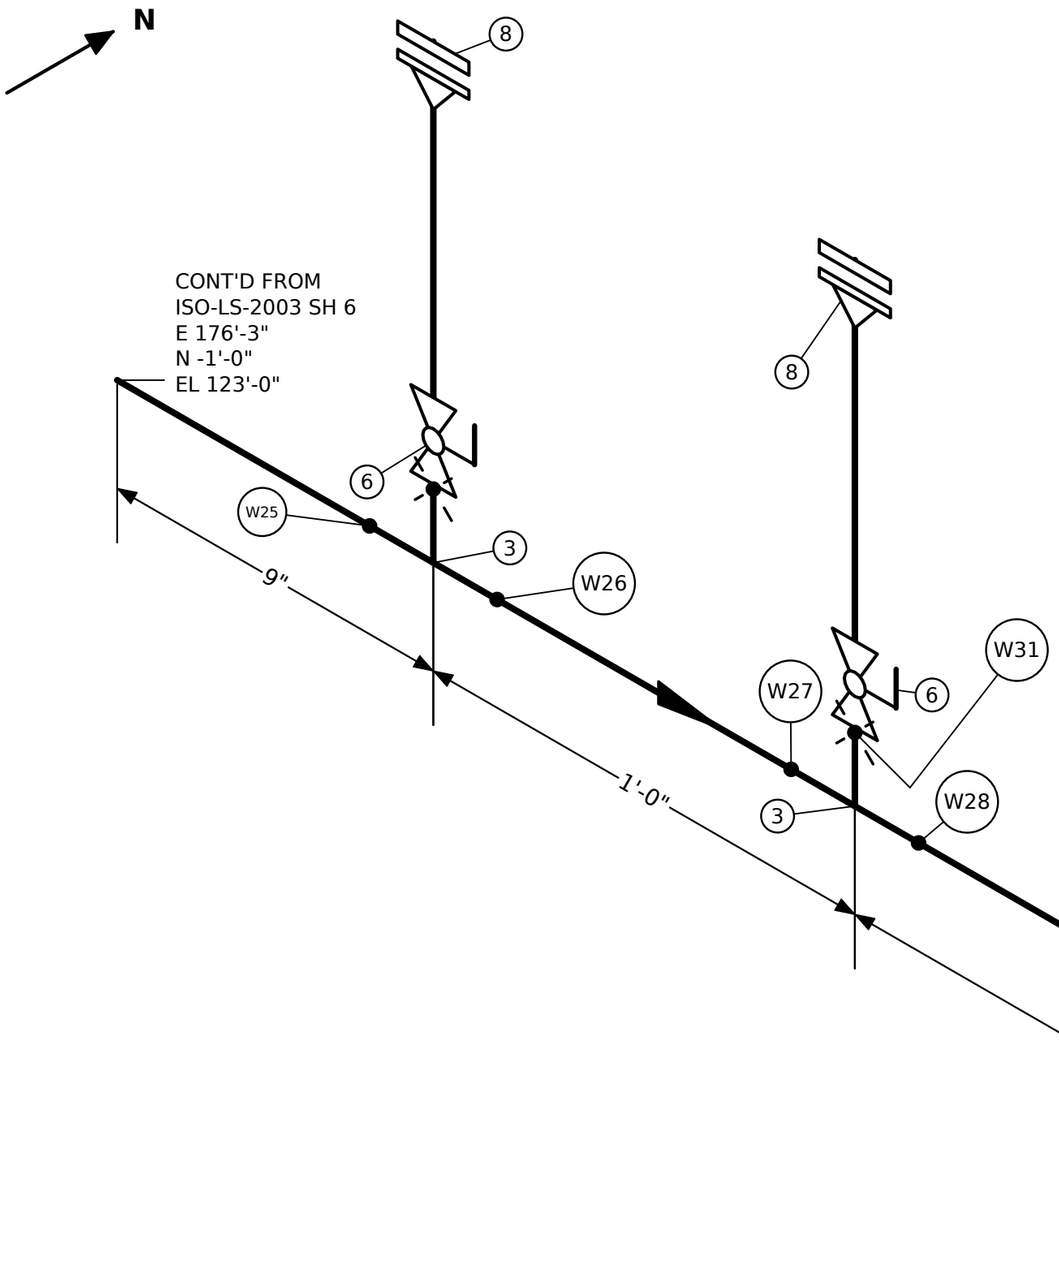

BILL OF MATERIALS

PT	QTY	NPS	DESCRIPTION
1	1	6"	CAP 6" P300
2	1'-1"	6"	PIPE 6" P300 BEVELLED ENDS
3	2	6"x3/4"	TEE REDUCING 6" × 3/4" P300
4	2	3/4"	FLANGE WELD-NECK 3/4" P150 RAISED FACE
5	4	3/4"	GASKET 3/4" P150 COMPRESSED SHEET
6	2	3/4"	VALVE, BALL, FLOATING 3/4" P150
7	4	3/4"	STUD SET 4 × 0.5" × 4-1/4" WITH 2 NUTS, FOR 3/4" P150
8	2	3/4"	FLANGE BLIND 3/4" P150 RAISED FACE

NOTES:
1. ALL DIMENSIONS IN FEET AND INCHES UNLESS NOTED
2. BEVEL ENDS FOR BUTT WELD
3. FLANGE BOLT HOLES STRADDLE CENTRELINES

REV	DATE	DESCRIPTION	BY
0	2026-11-01	ISSUED FOR CONSTRUCTION	-

COMPANY

SMARTWELD

TITLE

LOW-PRESSURE STEAM

TEST PRESS.	INSULATION	PAINT
-	YES	-

PWHT	NDE	FLUID
-	-	LS

LINE NO.	PIPING CLASS	DESIGN PRESS.	DESIGN TEMP.
6"-P300-LS-2003	S300	300 PSIG	-

DRAWING NO.	SHEET	REV
ISO-LS-2003	7 OF 7	0

DATE	DRAWN	CHECKED	SCALE
2026-11-01	-	-	NTS