
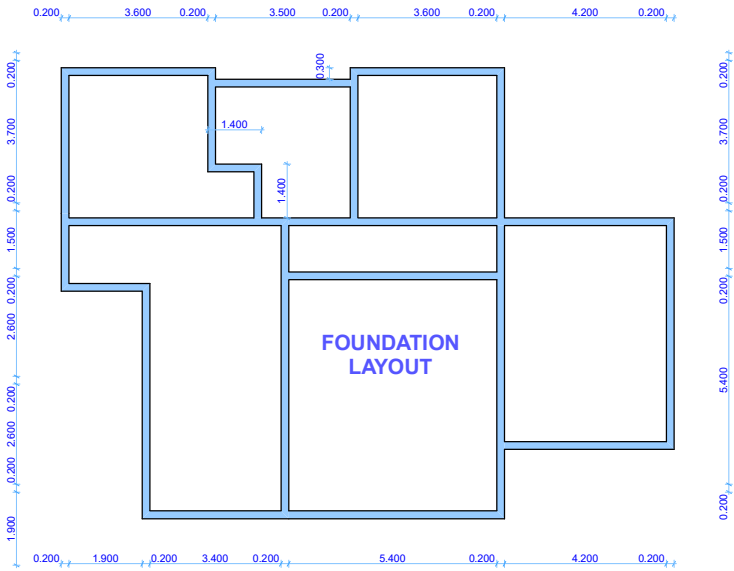


North Elevation

North Elevation

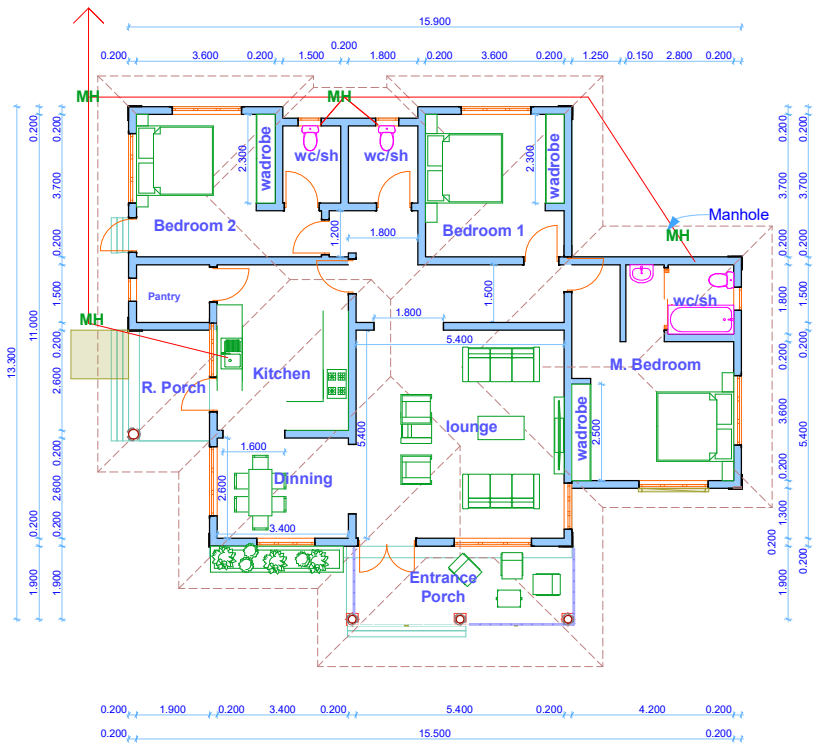


#### DOOR SCHEDULE

| Location          | Width   |
|-------------------|---------|
| Main Entrance     | 1500 mm |
| Bedrooms          | 900 mm  |
| Kitchen Rear Exit | 900 mm  |
| Bathrooms         | 800 mm  |

#### WINDOW SCHEDULE


| Location    | Size           |
|-------------|----------------|
| Living Room | 1800 x 1500 mm |
| Kitchen     | 1800 x 1200 mm |
| Bedrooms    | 1800 x 1500 mm |
| Bathrooms   | 600 x 600 mm   |

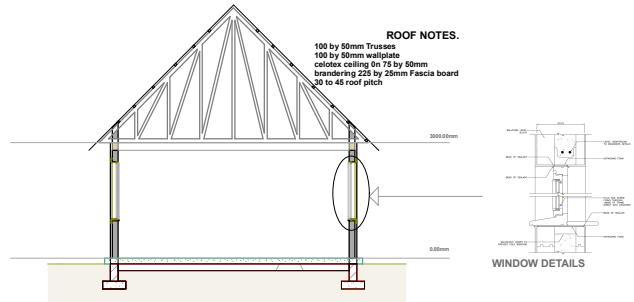

**ROOF NOTES.**  
100 by 50mm Trusses  
100 by 50mm wallplate  
colorex ceiling on 75 by 50mm  
timbering 225 by 25mm Fascia board  
30 to 45 roof pitch


**FOUNDATION NOTES.**  
Foundation on 150mm conc. slab on 1000G polythene  
sheet DPM on 50mm murrum blinding on 300mm HVC fill.  
600 by 300mm conc. in slabs.

#### ROOF PLAN

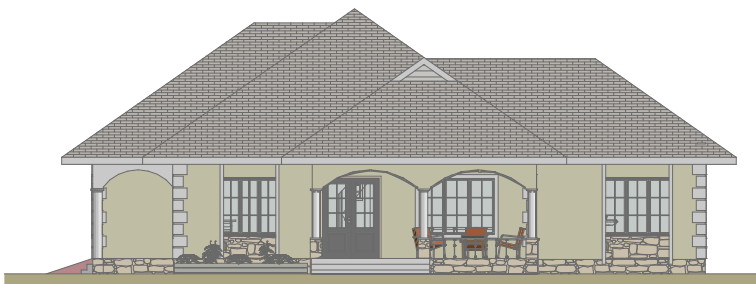


South Elevation (2)

1:100

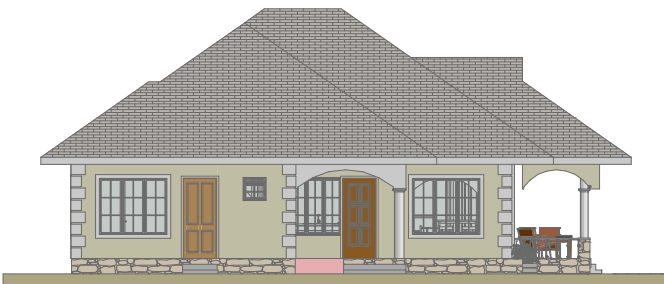


West Elevation

1:100

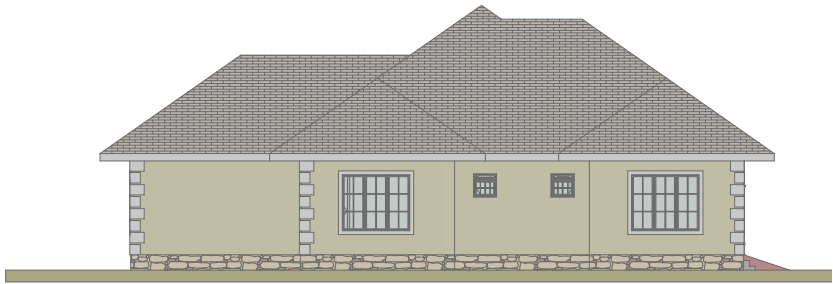


North Elevation

1:100

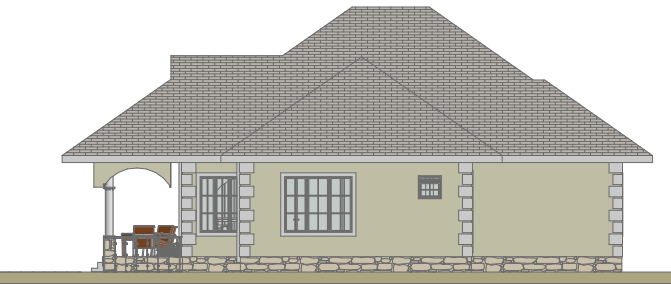


East Elevation (2)

1:100

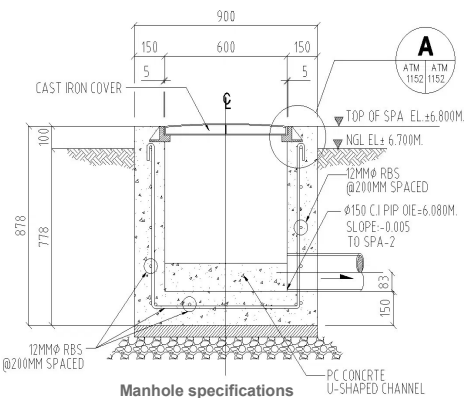

Manhole specifications

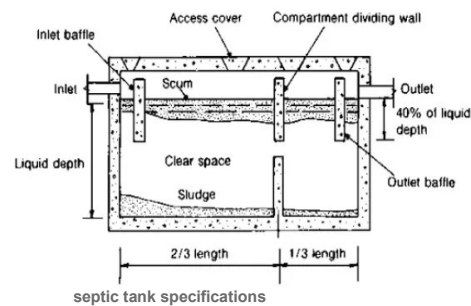

septic tank specifications

**THE DRAWINGS**  
**COPYRIGHT OF THE AUTHOR**  
IT IS ILLEGAL TO USE THE DRAWING FOR PURPOSES  
OF CONSTRUCTION OR TO REPRODUCE IT IN PART OR  
IN WHOLE WITHOUT THE AUTHOR'S PRIOR CONSENT

**NOTES**  
1. All measurements are shown in millimeters. Drawings  
not to be scaled. Only figured dimensions to be used.  
2. The contractor must check and verify all dimensions on  
site before commencement of work. Any discrepancies  
must be notified immediately to the architect and clarified.

**CONSTRUCTION**  
1. Damp proof course must be provided under all external  
walls at grade. DPC to be min. 150mm above G.L.  
2. All slab at grade to be poured on 1000 Gauge  
polythene on 50mm store dust blinding on hardcore.  
3. All soil under slab and around external foundations to  
be positioned for anti-termite control.  
4. Window sills must be finished before internal  
blastering.

**STRUCTURAL**  
1. All RC work to structural engineer's details.  
2. Depth of foundation to be determined on site to S.E.  
approval.  
3. All walls shall be 150mm thick unless otherwise shown  
4. All walls shall be reinforced with approved hoop iron  
at every alternate course.

**MECHANICAL**  
1.1 Drain pipes passed beneath buildings and driveways  
to be encased in 150mm concrete surround.  
1.2 All mechanical work must be coordinated with  
electrical work. Any conflicts must be clarified before  
work begins.  
1.3 Minimum slopes in drain pipes shall be 1%.  
1.4 All testing of pipes must be completed before  
blastering.

**NOTE**  
This drawing is an architectural conceptual design prepared for consultation  
and planning purposes. It is not to be used for construction. The design should be reviewed  
and approved by a professional engineer and a professional architect together  
with a structural engineer to ensure compliance with applicable regulations  
and local requirements.

| RevID | ChID | Change Name | Date |
|-------|------|-------------|------|
|       |      |             |      |
|       |      |             |      |
|       |      |             |      |
|       |      |             |      |
|       |      |             |      |
|       |      |             |      |
|       |      |             |      |
|       |      |             |      |
|       |      |             |      |

Company Title  
PROPOSED 3 BEDROOM HOUSE  
PROJECT

CLIENT:  
DESIGNED BY: SIGN  
CHECKED BY: SIGN

SHEET TITTLE  
FLOOR PLAN,  
ELEVATION, SECTION  
3D

**SCALE**  
1:100

SHEET NO  
A.01  
DESIGNED BY  
A.B  
CHECKED BY  
A.B