

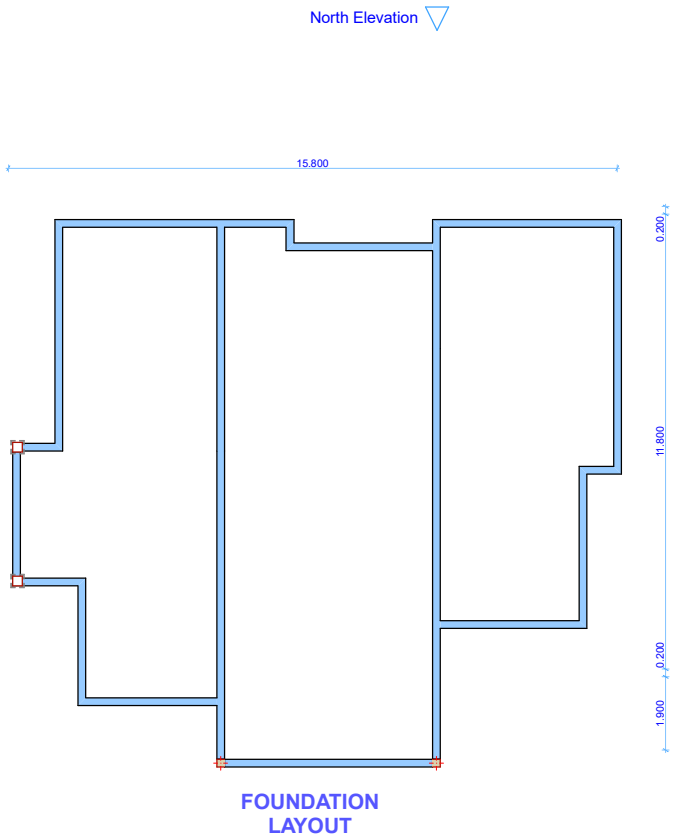



South Elevation 1:100

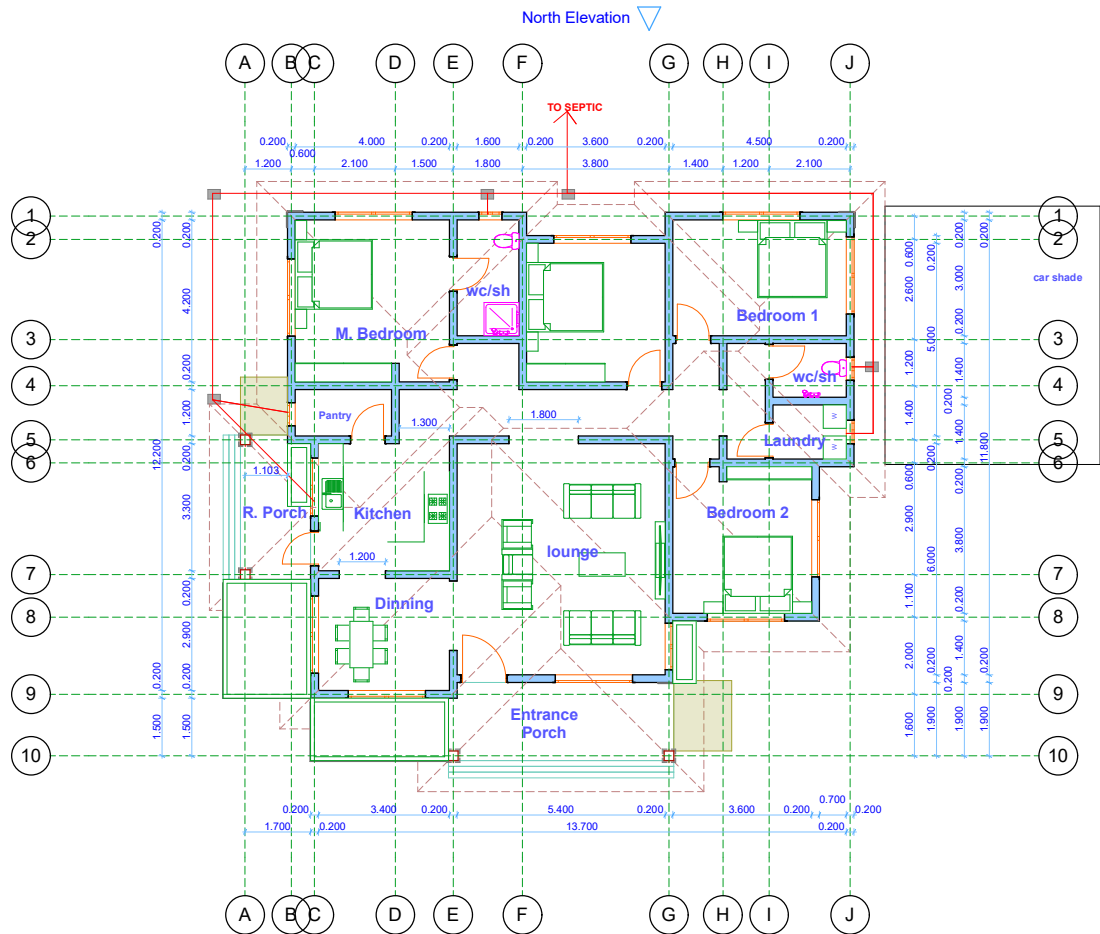

North Elevation (1) 1:100

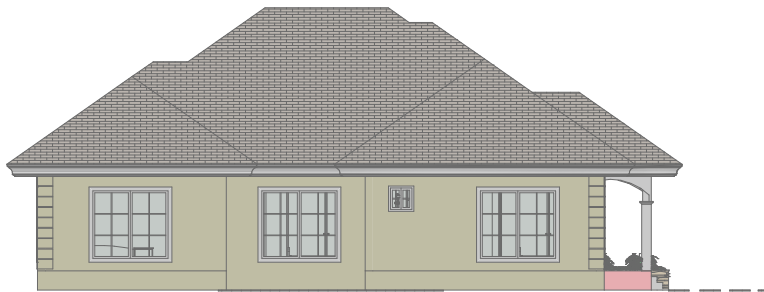

East Elevation 1:100

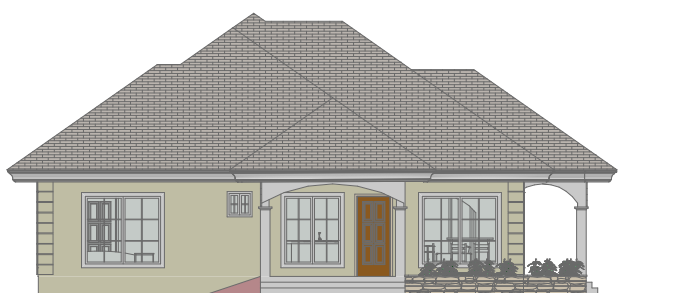


West Elevation 1:100

DOOR SCHEDULE




Location	Width
Main Entrance	1500 mm
Bedrooms	900 mm
Kitchen Rear Exit	900 mm
Bathrooms	800 mm

WINDOW SCHEDULE

Location	Size
Living Room	1800 x 1500 mm
Kitchen	1800 x 1200 mm
Bedrooms	1800 x 1500 mm
Bathrooms	600 x 600 mm

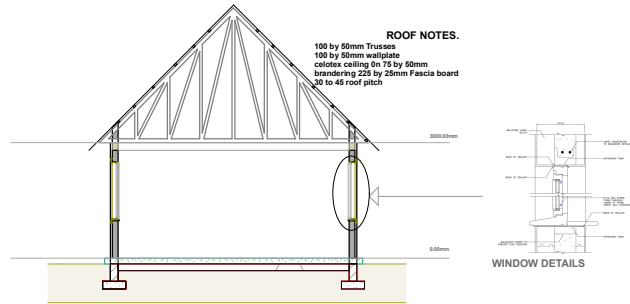

FOUNDATION NOTES.
Foundation on 150mm conc. slab on 1000G polythene sheet DPM on 50mm murrum blinding on 300mm HVC fill. 600 by 300mm conc. in slabs.

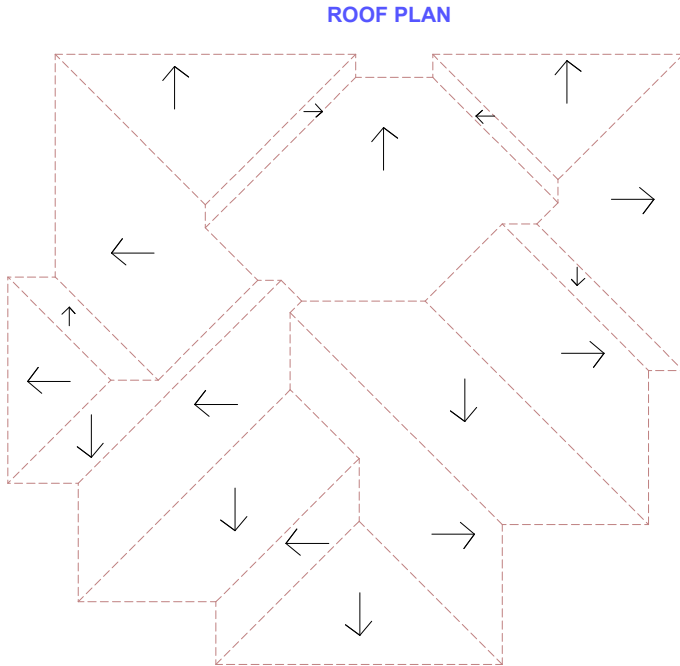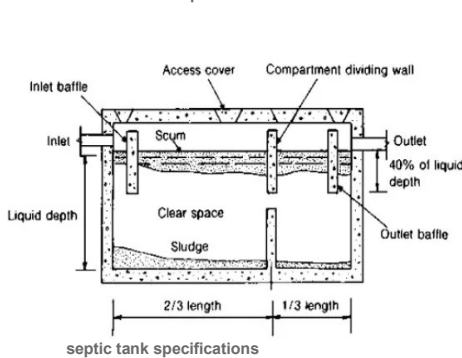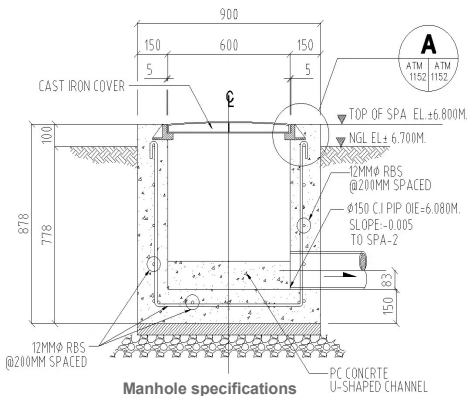

THE DRAWINGS
COPYRIGHT OF THE AUTHOR
IT IS ILLEGAL TO USE THE DRAWING FOR PURPOSES OF CONSTRUCTION OR TO REPRODUCE IT IN PART OR IN WHOLE WITHOUT THE AUTHOR'S PRIOR CONSENT

NOTES

1. All measurements are shown in millimeters. Drawings not to be scaled. Only figured dimensions to be used.
2. The contractor must check and verify all dimensions on site before commencement of work. Any discrepancies must be notified immediately to the architect and clarified.
3. All measurements are shown in millimeters. Drawings not to be scaled. Only figured dimensions to be used.
4. The contractor must check and verify all dimensions on site before commencement of work. Any discrepancies must be notified immediately to the architect and clarified.

CONSTRUCTION

1. Damp proof course must be provided under all external walls at grade. DPC to be min. 150mm above G.L.
2. All slabs at grade to be poured on 1000 Gauge polythene on 50mm store dust blinding on hardcore.
3. All soil under slab and around external foundations to be positioned for anti-termite control.
4. Window sills must be finished before internal plastering.

STRUCTURAL

1. All RC work to structural engineer's details.
2. Depth of foundation to be determined on site to S.E. approval.
3. All walls shall be 150mm thick unless otherwise shown.
4. All walls shall be reinforced with approved hoop iron at every alternate course.

MECHANICAL

1. All drain pipes passed beneath buildings and driveways to be encased in 150mm concrete surround.
2. All mechanical work must be coordinated with electrical work. Any conflicts must be clarified before work begins.
3. Minimum slopes in drain pipes shall be 1%.
4. All testing of pipes must be completed before plastering.

NOTE

This drawing is an architectural conceptual design prepared for visualization purposes only. It is not to be used for construction. The design should be subject to structural, mechanical, and electrical engineering approval and a professional engineer's seal and stamp.

Revision History

RevID	Chd	Change Name	Date

Company Title
PROPOSED 4 BEDROOM HOUSE
PROJECT

CLIENT:
DESIGNED BY: A.B.
CHECKED BY: A.B.
SIGN
SIGN

SHEET TITLE
FLOOR PLAN,
ELEVATION, SECTION
3D

SCALE
1:100

SHEET NO
A.01
DESIGNED BY
A.B.
DESIGNED BY
A.B.