

KINGDOM HALL MAINTENANCE PROGRAM

DOCUMENTATION

OVERVIEW

A suite of documents has been provided to assist in caring for Kingdom Hall maintenance

Each document serves as a template that can be customized based on the specific needs of each individual Kingdom Hall

JOB CARD

JOB CARD

BUILDING INTERIOR

B-2

INSPECTION: 12 MONTHS

NOTE:

Assigned:

Date Assigned:

Date Completed:

INSTRUCTIONS

WALLS

- Check painted and vinyl wall coverings for lifting, water or other damage.

CEILING

- Check plasterboard and solid ceilings for damage and stains that may indicate a water problem
- Check suspended ceiling for damaged, wet or dirty tiles
- Check the condition of the edge trim and support rails
- Check that light fittings are securely and neatly attached to the ceiling.

CABINETS AND FITTINGS

- Ensure doors and drawers operate freely
- Check hinges and hardware for tightness, loose screws etc.
- Check door and drawer alignment with cabinet. Ensure are level and parallel
- Check straightness and firmness of mounted items/hardware such as shelves
- Check laminate for chips, cracks or wear
- Check for swelling along edges.

PARTITIONS


- Check condition of panels
- Note wear in Melamine finishes, attachments to floor, walls and ceiling
- Check operation of all latches and hinges.

Needed Repairs or Additional Comments

Jun-24

BUILDING MAINTENANCE

MAINTENANCE CALENDAR

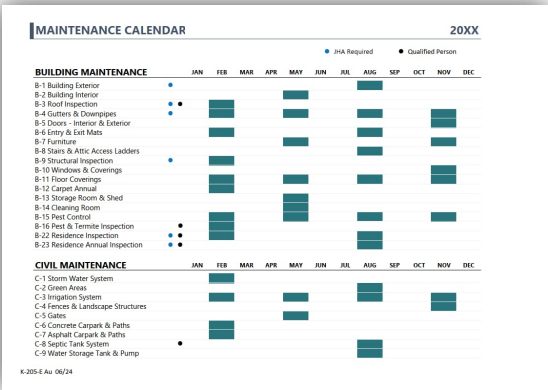

REPAIR CARD

REPAIR CARD

DESCRIPTION

Job Card Ref:

Assigned:

Date Assigned:

Date Completed:

NOTE:

DESCRIPTION

(Include comments on safety)

(Enter brief and clear description of required work to be completed)

Incomplete Items / Additional Comments

K-207-E Au 7/24

CLEANING SCHEDULE

[INSERT KINGDOM HALL NAME]

CLEANING SCHEDULE

PLEASE NOTE: Use disposable gloves while sanitizing and cleaning. Make sure equipment is sanitized after use.

AFTER EACH MEETING	WEEKLY CARE
Sanitize touch points - Light switches - Door handles - Audio/Video system - Handheld microphones - Contribution Boxes Clean bathrooms as required and replenish supplies - Wipe down toilet bowl and cistern - Toilet buttons & cubicle locks - Clean soap dispensers - Wipe down wash basins Clean kitchen as required - Clean and put away dishes - Wipe down sink Touch up glass & mirrors in high traffic areas Vacuum/clean high traffic areas Straighten chairs and rows Empty rubbish	Clean glass and mirrors Wipe counter/tabletops & lectern Dust furniture Replenish cleaning supplies Clean bathrooms and kitchen - Clean toilets - Clean floor and walls including partitions and cabinets - Clean hand basins and sinks - Clean outside of appliances - Check items in fridge Thorough vacuum Map steel floors Collect rubbish or debris on property Empty rubbish Check for/remove cobwebs Cut grass and trim lawn (seasonal) Pull weeds in landscaped areas (seasonal)

K-210-E Au 7/24

KINGDOM HALL MAINTENANCE PROGRAM

DOCUMENTATION

MANUAL

The *Maintenance Manual* template has been designed to provide information for most elements found in a standard Kingdom Hall. the *Maintenance Manual* should be tailored to suit the elements found at an individual Kingdom Hall.

It should only include basic element specific information that a person would require to know when carrying out a particular *Job Card*.

The manual slides can be updated, deleted (if not applicable to the hall) or added to.

Should you need to add a slide to the manual, each *Workgroup* has a template design that is easy to follow (Master slide).


MECHANICAL MAINTENANCE

1 AC / SPLIT DUCTED

Locations and specifications of key components of the air conditioning system are listed for reference. Instructions on how to perform maintenance are described in following pages.

For additional information, consult the manufacturer's documentation.

General overview of element

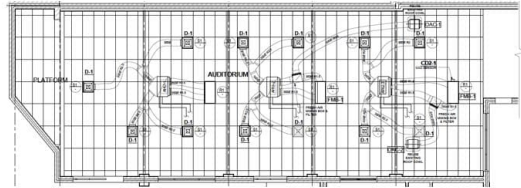

DESCRIPTION	LOCATION	MODEL
Air Handling Unit	Auditorium 1, Ceiling Space (3)	Toshiba; RAV-SM1603DT-A
Outdoor Unit	Auditorium 2, Roof Access (3)	Toshiba; RAV-SP1604AT8-A
CO-2 Sensor	Auditorium 1, Ceiling Space (1)	Regulator Australia, TG9106
Modulating DC	Auditorium 1, Ceiling Space (1)	Regulator Australia, TC5044
Return Air Grille Filter	Auditorium 1 (2) Foyer (1)	G4-101

Provides specific maintenance information. If you don't have access to building plans showing the location of specific elements, you may include equipment tables, fault tables, photos and diagrams or other helpful information.

Reference number for *Job Card* in 'NOTE' Box Example – M refers to 'Mechanical' and '1' refers to the sequence number of an element.

M-1

KINGDOM HALL MAINTENANCE PROGRAM

DOCUMENTATION

JOB CARDS

The *Job Card* suite has been designed to cater for most elements found in a standard Kingdom Hall. However, as each Kingdom Hall has different elements due to location, age or surrounding environment, not all *Job Cards* will need to be used.

When updating or creating a new *Job Card*, effort should be made to provide clear and concise instructions that focus on the main aspects requiring attention.

The templates provided serve as a guide based on standard maintenance practices. Manufacturing documentation and manuals provide valuable information that may be incorporated into a *Job Card* where applicable.

The image shows a sample 'JOB CARD' for 'REVERSE CYCLE SYSTEMS'. The card is titled 'JOB CARD' at the top left. The main heading is 'REVERSE CYCLE SYSTEMS' with a frequency of 'M - 2'. Below this, it states 'INSPECTION & SERVICE: 12 MONTHS'. There are three callouts with lightbulb icons: one pointing to the 'Job Card heading and frequency' (the top section), one pointing to the 'Job Card reference number' (the 'M - 2' code), and one pointing to a 'Note Box' which contains the text: 'NOTE: JHA Required, Qualified Person, Manual (M-1)'. Below the note box, there is an 'INSTRUCTIONS' section. The instructions state: 'The following tasks apply to systems such as ducted split, ceiling cassette, wall splits and package units.' followed by a bulleted list of tasks: 'Thoroughly clean the condenser and evaporator coils with water. Take care to not get electrical circuit wet', 'Straighten any bent or damaged coil fins using fin comb', 'Ensure the system has the correct refrigerant charge', 'Check and tighten electrical connections', 'Flush the drains', 'Check, clean and repair the rigid or flexible ductwork', 'Check bolts and fixings are secure, including rubber supports. Replace as required', and 'Barrel and outlet to be washed with a detergent and warm water.' Below the instructions, it says 'Reinstate supply and test system for correct overall operation.' At the bottom of the card, there is a section for 'Needed Repairs or Additional Comments' with a large empty box. The date 'Jun-24' and 'MECHANICAL MAINTENANCE' are at the bottom.

JOB CARD

REVERSE CYCLE SYSTEMS M - 2

INSPECTION & SERVICE: 12 MONTHS

Assigned:

Date Assigned:

Date Completed:

NOTE:
JHA Required
Qualified Person
Manual (M-1)

INSTRUCTIONS

The following tasks apply to systems such as ducted split, ceiling cassette, wall splits and package units.

- Thoroughly clean the condenser and evaporator coils with water. Take care to not get electrical circuit wet
- Straighten any bent or damaged coil fins using fin comb
- Ensure the system has the correct refrigerant charge
- Check and tighten electrical connections
- Flush the drains
- Check, clean and repair the rigid or flexible ductwork
- Check bolts and fixings are secure, including rubber supports. Replace as required
- Barrel and outlet to be washed with a detergent and warm water.

Reinstate supply and test system for correct overall operation.

Needed Repairs or Additional Comments

Jun-24 MECHANICAL MAINTENANCE

Job Card heading and frequency

Job Card reference number

Note Box: Indicates requirements for work to be carried out. Includes reference to the Maintenance Manual where applicable.