



TEST REPORT

Datacom Technologies Ltd.
Leutschenbachstrasse 95.
CH 8050 Zurich.

Report No: WLPR16-9388/1
Sample No: WSP16-9388/1
Report Date: 03/05/2016

Introduction: Further to the request received from M/s. Datacom Technologies Ltd. dated 28th April 2016, a sample of Cabinet was tested for Physical parameters.

Sample description : Cabinet 12U 150deep- Wall mount Series
Part Number : DC-RK-12WS-2R/2RB1/2RB2
Sample received date : 28/04/2016
Test date : 28/04/2016-02/05/2016
Tested by : SK



Corrosion Resistance (Salt Spray Method)

Test Method: ASTM B117

Salt Solution: (5% NaCl+95%Water) by mass


pH of Solution: 6.7

Temperature of Exposure Zone: 35°C


Duration of Test: 96 hours

Coating Thickness: 77microns

Test	Observation
Salt Spray Test	No cracking, blistering, flaking or loss of adhesion was observed.

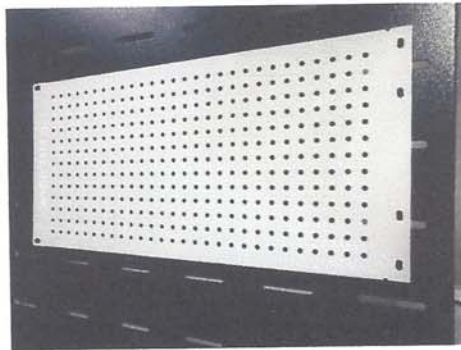

Before

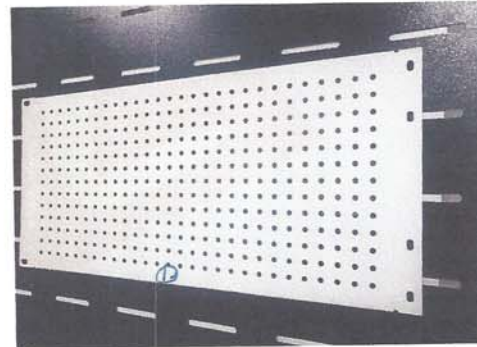

After

Chemical Composition

Test Method: XRF

Test	Unit	Result
Molybdenum	%	0.260
Niobium	%	0.116
Zirconium	%	0.074
Zinc	%	0.144
Cobalt	%	1.87
Iron	%	80.28
Vanadium	%	0.704
Titanium	%	10.19

**Surface Finish**

Test Method: IHP & Observation

Colour: Grey

Test	Observation
Surface Finish	Surface of the sample is smooth and no physical damage observed

Dimension

Test Method: IHP

Test	Unit	Result
Over All Length	mm	600
Over All Width	mm	600
Door Opening Length	mm	590
Door Opening Width	mm	590
Glass Length	mm	428
Glass Width	mm	428
Distance Between Mounting Holes	mm	494
Over All Depth	mm	150

PHYSICAL REQUIREMENTS**Stability: IEC-60950-1 Clause No.4.1**

Description	Result
Stability test	Not applicable for wall mount enclosure

Mechanical Strength: IEC-60950-1 Clause No.4.2**Steady Force Test**

Applied Force	Duration	Result
30 N	5 Seconds	No damage observed during the test

Drop Test: IEC-60950-1 Clause No.4.2.6

Description	Drop Height	Result
Drop Test	1 Meter	No damage observed and no possible of accessing hazardous parts

Stress Relief Test: IEC-60950-1 Clause No.4.2.7

Description	Sample	Temperature Condition	Duration	Result
Stress Relief Test	Portion of enclosure	70°C	7 Hours	No shrinkage or Distortion observed

**Wall or ceiling mounted equipment: IEC-60950-1 Clause No.4.2.10**

Description	Result
Wall mounted enclosure	Comply with the construction and available data of manufacture

Openings in enclosures: IEC-60950-1 Clause No.4.6

Description	Result
Side opening enclosure	Construction is considered to comply with the requirements

Thermal requirements: IEC-60950-1 Clause No.4.6


Description	Temperature Limits (°C)		Result
	Handles, knobs	External surfaces of equipment	
Temperature limits, materials and components	35	38	Comply with the standard limit

Design and construction IEC-60950-1 Clause No.4.3

Design and construction	Result
Edges and Corners	Well rounded and not to constitute a hazards
Handle or Manual Controls	None that would cause hazard
Adjustable controls and direct plug in equipments	No such device with the equipment

Remarks: None**Signed for and on behalf of Wimpey Laboratories****Binu K. Babu****Technical Manager**

Test results relate only to the samples tested.
 This report shall not be reproduced except in full, without the written approval of the laboratory.
 - End of text-





TEST REPORT

Datacom Technologies Ltd.
Leutschenbachstrasse 95.
CH 8050 Zurich.

Report No: WLPR16-9388/2
Sample No: WSP16-9388/2
Report Date: 03/05/2016

Introduction: Further to the request received from M/s. Datacom Technologies Ltd. dated 28th April 2016, a sample of Cabinet was tested for Physical parameters.


Sample description : Cabinet-12U 300deep Wall Mount Series
Part Number : DC-RK-12WS-3S
Sample received date : 28/04/2016
Test date : 28/04/2016-02/05/2016
Tested by : SK



Corrosion Resistance (Salt Spray Method)

Test Method: ASTM B117
Salt Solution: (5% NaCl+95%Water) by mass
pH of Solution: 6.7
Temperature of Exposure Zone: 35°C
Duration of Test: 96 hours
Coating Thickness: 82microns

Test	Observation
Salt Spray Test	No cracking, blistering, flaking or loss of adhesion was observed.

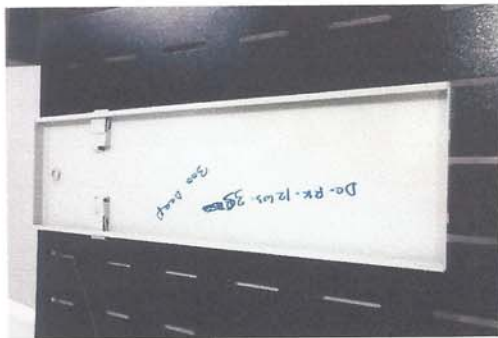

Before



After

Chemical Composition

Test Method: XRF

Test	Unit	Result
Molybdenum	%	0.712
Niobium	%	0.539
Zirconium	%	0.268
Cobalt	%	3.90
Iron	%	38.95
Vanadium	%	3.34
Titanium	%	50.89

**Surface Finish**

Test Method: IHP & Observation

Colour: Grey

Test	Observation
Surface Finish	Surface of the sample is smooth and no physical damage observed

Dimension

Test Method: IHP

Test	Unit	Result
Over All Length	mm	600
Over All Width	mm	600
Door Opening Length	Mm	600
Door Opening Width	mm	600
Over All Depth	mm	300
Glass Thickness	mm	3

PHYSICAL REQUIREMENTS**Stability: IEC-60950-1 Clause No.4.1**

Description	Result
Stability test	Not applicable for wall mount enclosure

Mechanical Strength: IEC-60950-1 Clause No.4.2**Steady Force Test**

Applied Newton	Duration	Result
30	5 Seconds	No damage observed during the test

Drop Test: IEC-60950-1 Clause No.4.2.6

Description	Drop Height	Result
Drop Test	1 Meter	No damage observed and no possible of accessing hazardous parts

Stress Relief Test: IEC-60950-1 Clause No.4.2.7

Description	Sample	Temperature Condition	Duration	Result
Stress Relief Test	Portion of enclosure	70°C	7 Hours	No shrinkage or Distortion observed

Wall or ceiling mounted equipment: IEC-60950-1 Clause No.4.2.10

Description	Result
Wall mounted enclosure	Comply with the construction and available data of manufacture

**Openings in enclosures: IEC-60950-1 Clause No.4.6**

Description	Result
Side opening enclosure	Construction is considered to comply with the requirements

Thermal requirements: IEC-60950-1 Clause No.4.6

Description	Temperature Limits (°C)		Result
	Handles, knobs	External surfaces of equipment	
Temperature limits, materials and components	35	38	Comply with the standard limit

Design and construction IEC-60950-1 Clause No.4.3

Design and construction	Result
Edges and Corners	Well rounded and not to constitute a hazards
Handle or Manual Controls	None that would cause hazard
Adjustable controls and direct plug in equipments	No such device with the equipment

Remarks: None

Signed for and on behalf of Wimpey Laboratories

Binu K. Babu
Technical Manager

Test results relate only to the samples tested.

This report shall not be reproduced except in full, without the written approval of the laboratory.

- End of text-





TEST REPORT

Datacom Technologies Ltd.
Leutschenbachstrasse 95.
CH 8050 Zurich.

Report No: WLPR16-9388/3
Sample No: WSP16-9388/3
Report Date: 03/05/2016

Introduction: Further to the request received from **M/s. Datacom Technologies Ltd.** dated 28th April 2016, a sample of Cabinet was tested for Physical parameters.

Sample description : Cabinet-42U 800x800 Floor Standing Series
Part Number : DC-RK-4288-1/4281-1
Sample received date : 28/04/2016
Test date : 28/04/2016-02/05/2016
Tested by : SK



Corrosion Resistance (Salt Spray Method)

Test Method: ASTM B117

Salt Solution: (5% NaCl+95%Water) by mass

pH of Solution: 6.7

Temperature of Exposure Zone: 35°C

Duration of Test: 96 hours

Coating Thickness: 82microns

Test	Observation
Salt Spray Test	No cracking, blistering, flaking or loss of adhesion was observed.



Before



After

Chemical Composition

Test Method: XRF

Test	Unit	Result
Tin	%	0.070
Molybdenum	%	0.405
Niobium	%	0.092
Zirconium	%	0.096
Zinc	%	1.77
Cobalt	%	2.69
Iron	%	68.08
Manganese	%	0.887
Chromium	%	0.667
Vanadium	%	8.01
Titanium	%	17.13

**Surface Finish**

Test Method: IHP & Observation
Colour: Grey & Black

Test	Observation
Surface Finish	Surface of the sample is smooth and no physical damage observed

Dimension

Test Method: IHP

Test	Unit	Result
Over All Length	mm	1960
Over All Width	mm	800
Over All Depth	mm	300
Glass Thickness	mm	3

Stability: IEC-60950-1 Clause No.4.1

Description	Applied Newton	Result
Stability test	250	Stable, Comply with the standard requirements.

Mechanical Strength: IEC-60950-1 Clause No.4.2**Steady Force Test**

Applied Newton	Duration	Result
30	5 Seconds	Comply with standard requirements.

Drop Test: IEC-60950-1 Clause No.4.2.6

Description	Result
Drop Test	Not applicable (Floor-standing equipment.).

Stress Relief Test: IEC-60950-1 Clause No.4.2.7

Description	Sample	Temperature Condition	Duration	Result
Stress Relief Test	Portion of enclosure	70°C	7 Hours	No risk of shrinkage or Distortion.

Wall or ceiling mounted equipment: IEC-60950-1 Clause No.4.2.10

Description	Result
Floor-standing equipment	Comply with the construction and available data of manufacture.

**Openings in enclosures: IEC-60950-1 Clause No.4.6**

Description	Result
Side opening enclosure	Construction is considered to comply with the requirements

Thermal requirements: IEC-60950-1 Clause No.4.6

Description	Temperature Limits (°C)		Result
	Handles, knobs	External surfaces of equipment	
Temperature limits, materials and components	34	39	Comply with the standard limit

Design and construction IEC-60950-1 Clause No.4.3

Design and construction	Result
Edges and Corners	Well rounded and not to constitute a hazards
Handle or Manual Controls	None that would cause hazard
Adjustable controls and direct plug in equipments	No such device with the equipment

Remarks: None**Signed for and on behalf of Wimpey Laboratories****Binu K. Babu**
Technical Manager

Test results relate only to the samples tested.

This report shall not be reproduced except in full, without the written approval of the laboratory.

- End of text-

